



GENERAL NOTES

1. THERMOSTATS SHALL BE LOCATED IN REPRESENTATIVE SPACES, MOUNTED APPROXIMATELY 48 INCHES ABOVE FINISHED FLOOR, AWAY FROM DIRECT SUNLIGHT, EXTERIOR WALLS, SUPPLY AIR DIFFUSERS, AND HEAT-PRODUCING EQUIPMENT.
2. EACH ZONE SHALL BE INDEPENDENTLY CONTROLLED BY A DEDICATED THERMOSTAT OR APPROVED CONTROL DEVICE AS INDICATED ON THE PLANS.

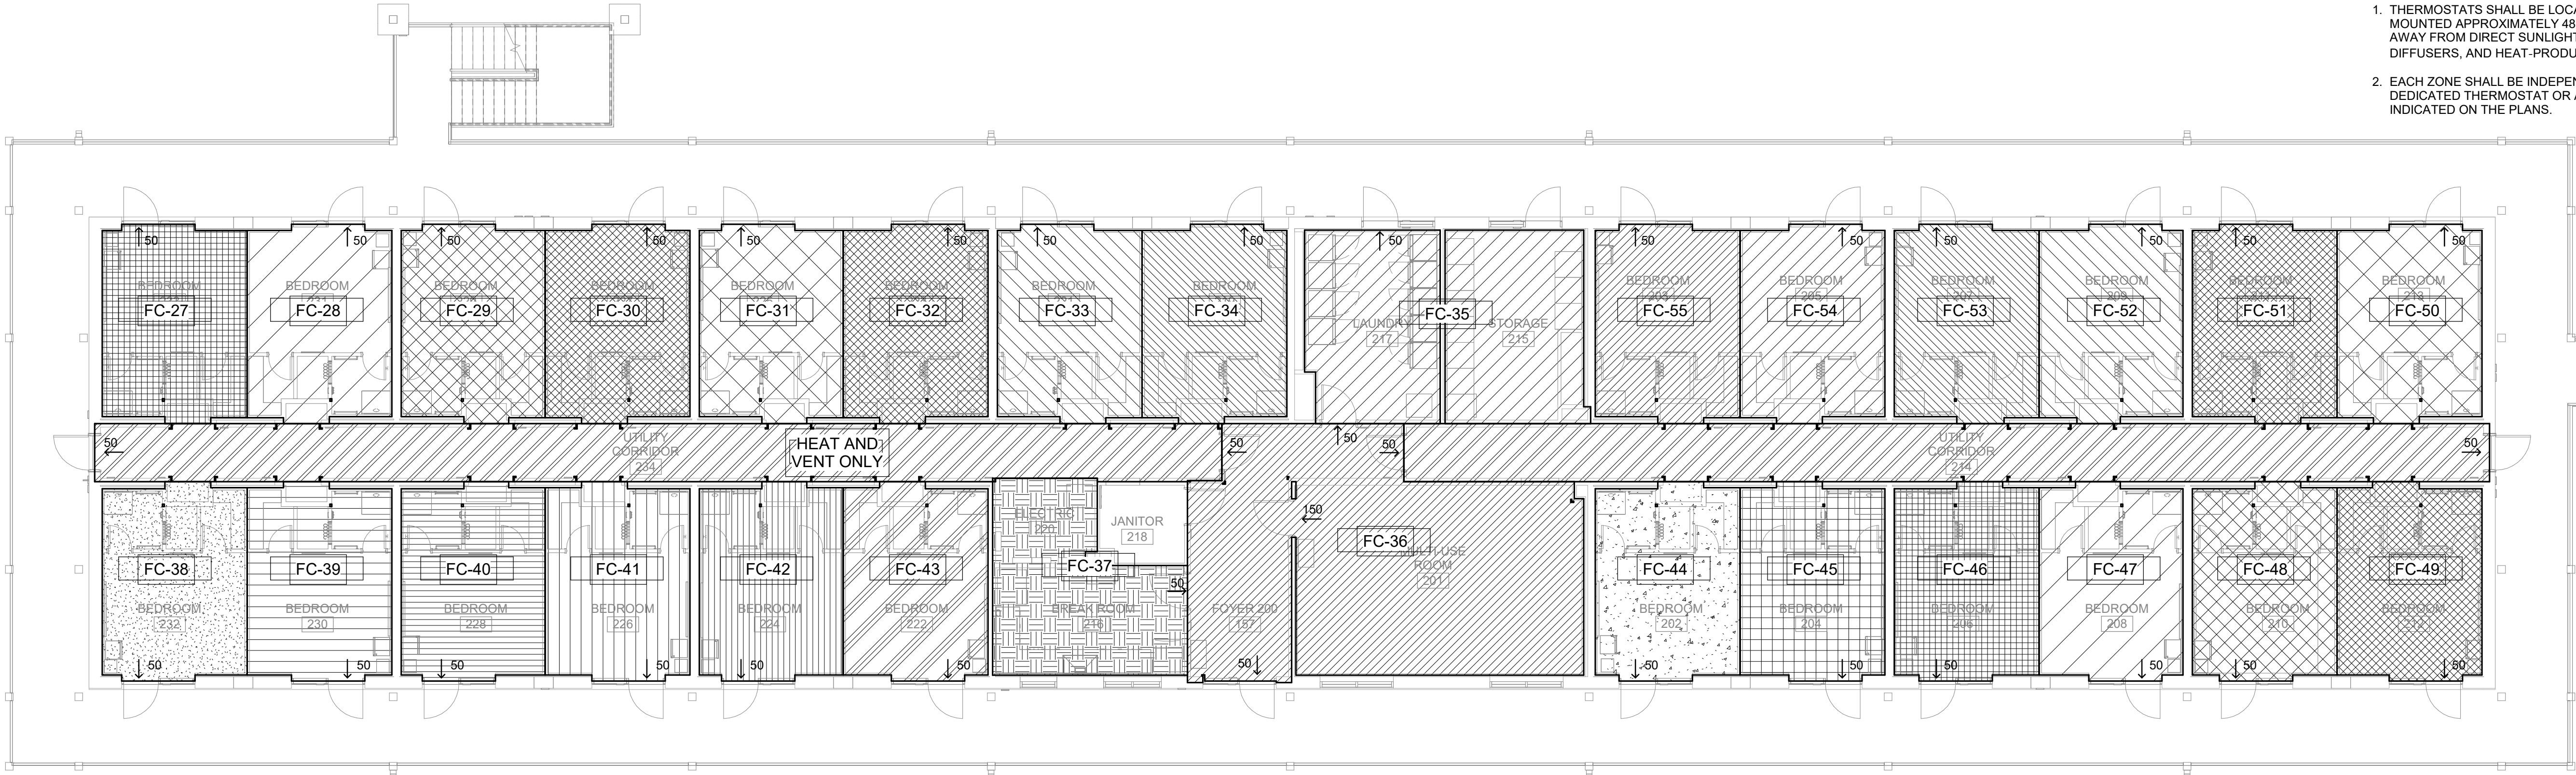


1 LEVEL 2 MECHANICAL ZONING AND PRESSURIZATION PLAN
SCALE: 1/8" = 1'-0"

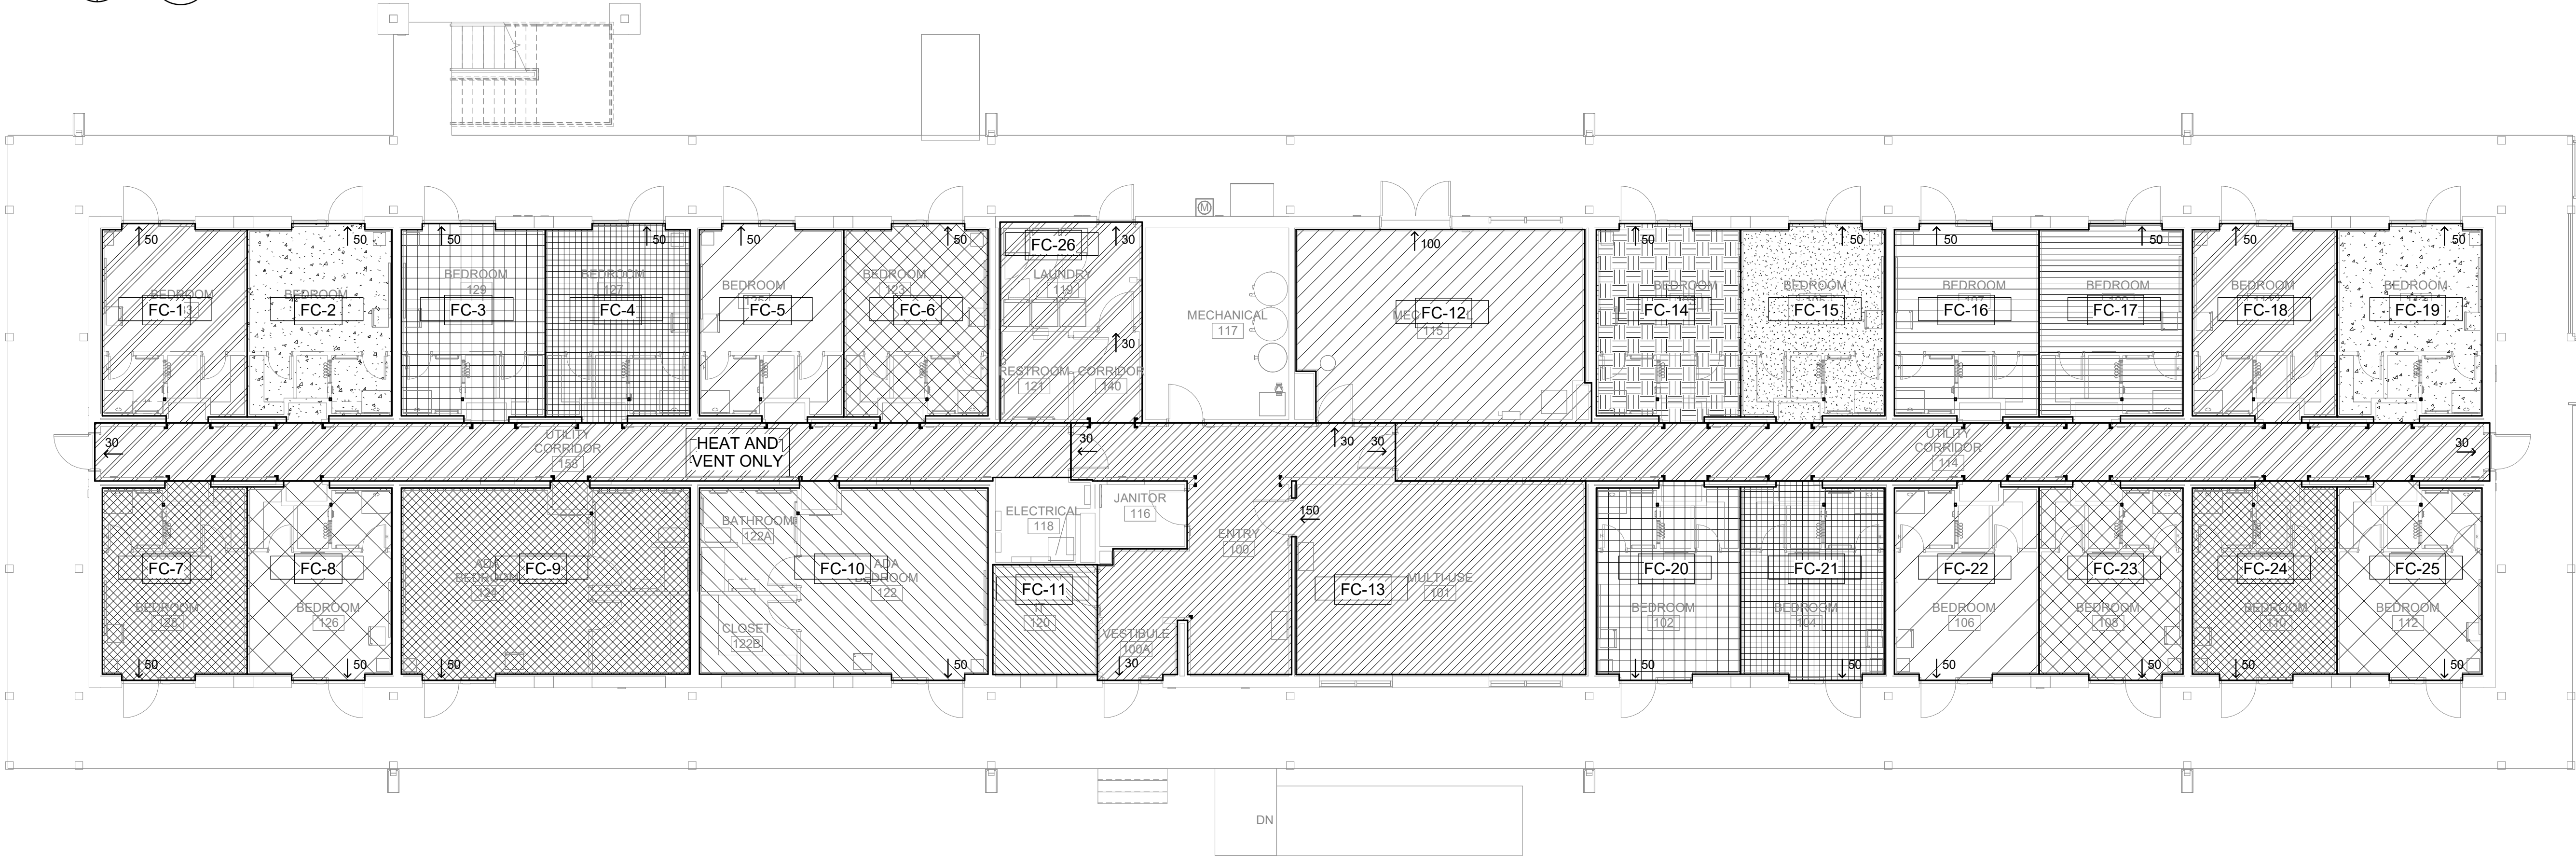

A1 LEVEL 1 MECHANICAL ZONING AND PRESSURIZATION PLAN
SCALE: 1/8" = 1'-0"

SCALE



APP'D					
DESCRIPTION					
DATE					
REV #					
APPROVED					
CHIEF ENGINEER					
APPROVED					
CIVIL ENGINEER					
NKAK 22-1076					
B718 DORM					
LITTLE ROCK AFB					
DETAILS (1)					
LEVEL 1 AND LEVEL 2					
ZONE AND					
PRESSURIZATION PLAN					
AIR MOBILITY COMMAND					
19TH CIVIL ENGINEER SQUADRON					
LITTLE ROCK, ARKANSAS					
DATE: JULY 2026					
DESIGNED BY: SAH					
DRAWN BY: B.WHR					
BUILDING NO.:					
PROJECT NO.:					
SHEET REF.:					
M-100					
SHEET NO.:					
1 OF XX					