GENERAL NOTES

1. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS PRIOR TO COMMENCEMENT OF WORK. REPORT ANY DISCREPANCIES TO THE ENGINEER PRIOR TO INSTALLATION.
2. CONTRACTOR SHALL COORDINATE ALL MECHANICAL WORK WITH STRUCTURAL, ARCHITECTURAL, ELECTRICAL, FIRE PROTECTION, AND OTHER TRADES PRIOR TO FABRICATION AND INSTALLATION.
3. PROVIDE SUFFICIENT ACCESS CLEARANCES FOR OPERATION, SERVICE, MAINTENANCE, TUBE PULL, COIL REMOVAL, FILTER REPLACEMENT, AND EQUIPMENT COMPONENT REPLACEMENT IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
4. ALL MECHANICAL EQUIPMENT SHALL BE INSTALLED LEVEL, PLUMB, AND IN ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS.

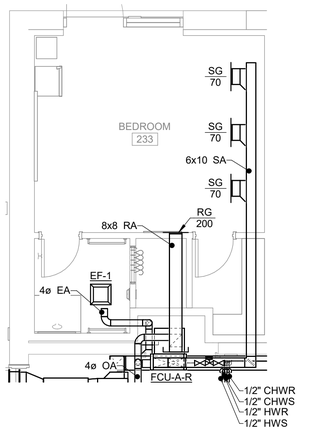

H1 ENLARED BEDROOM PLAN

SCALE: 1/4" = 1'-0"

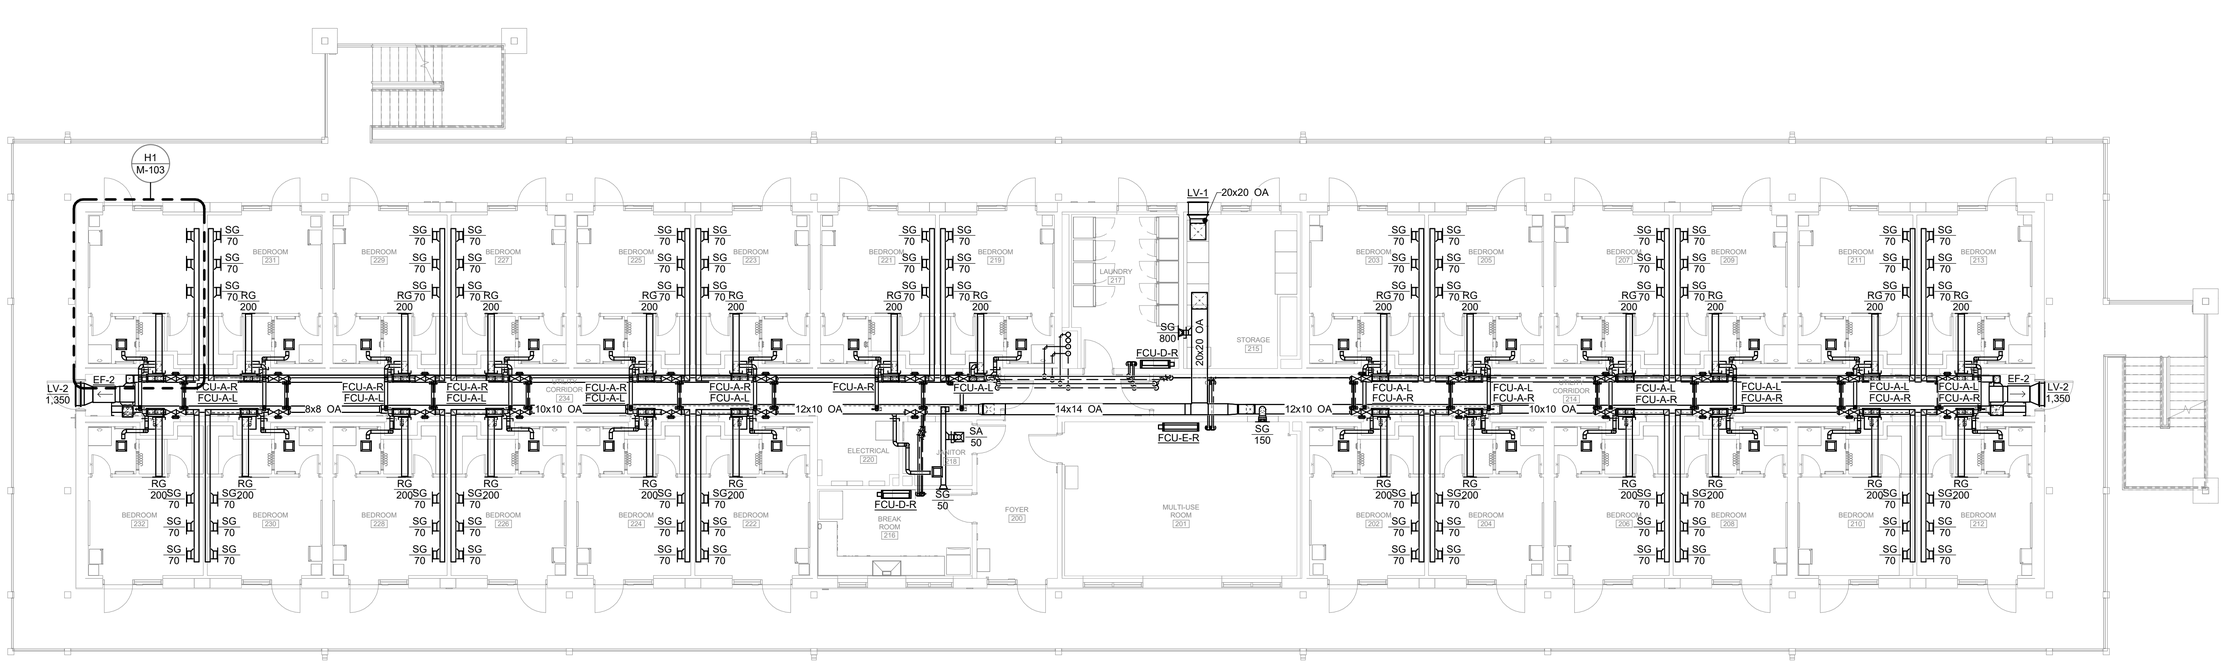

A1 LEVEL 2 MECHANICAL DUCTWORK PLAN

SCALE: 1/8" = 1'-0"

SCALE

0 4' 8' 16'

SCALE: 1/8"=1'-0

REV #	DATE	DESCRIPTION	APP'D

APPROVED
CHIEF ENGINEER
APPROVED
CIVIL ENGINEER

NKAK 22-1076
B718 DORM
LITTLE ROCK AFB

DETAILS (1)

LEVEL 2 DUCTWORK PLAN

AIR MOBILITY COMMAND
19TH CIVIL ENGINEER SQUADRON
LITTLE ROCK, ARKANSAS

DATE: JULY 2026
DESIGNED BY: SAH
DRAWN BY: BWHR
BUILDING NO.:
PROJECT NO.:
SHEET REF.: M-103
SHEET NO.: 1 OF XX

STATUS:65% PRELIMINARY DESIGN