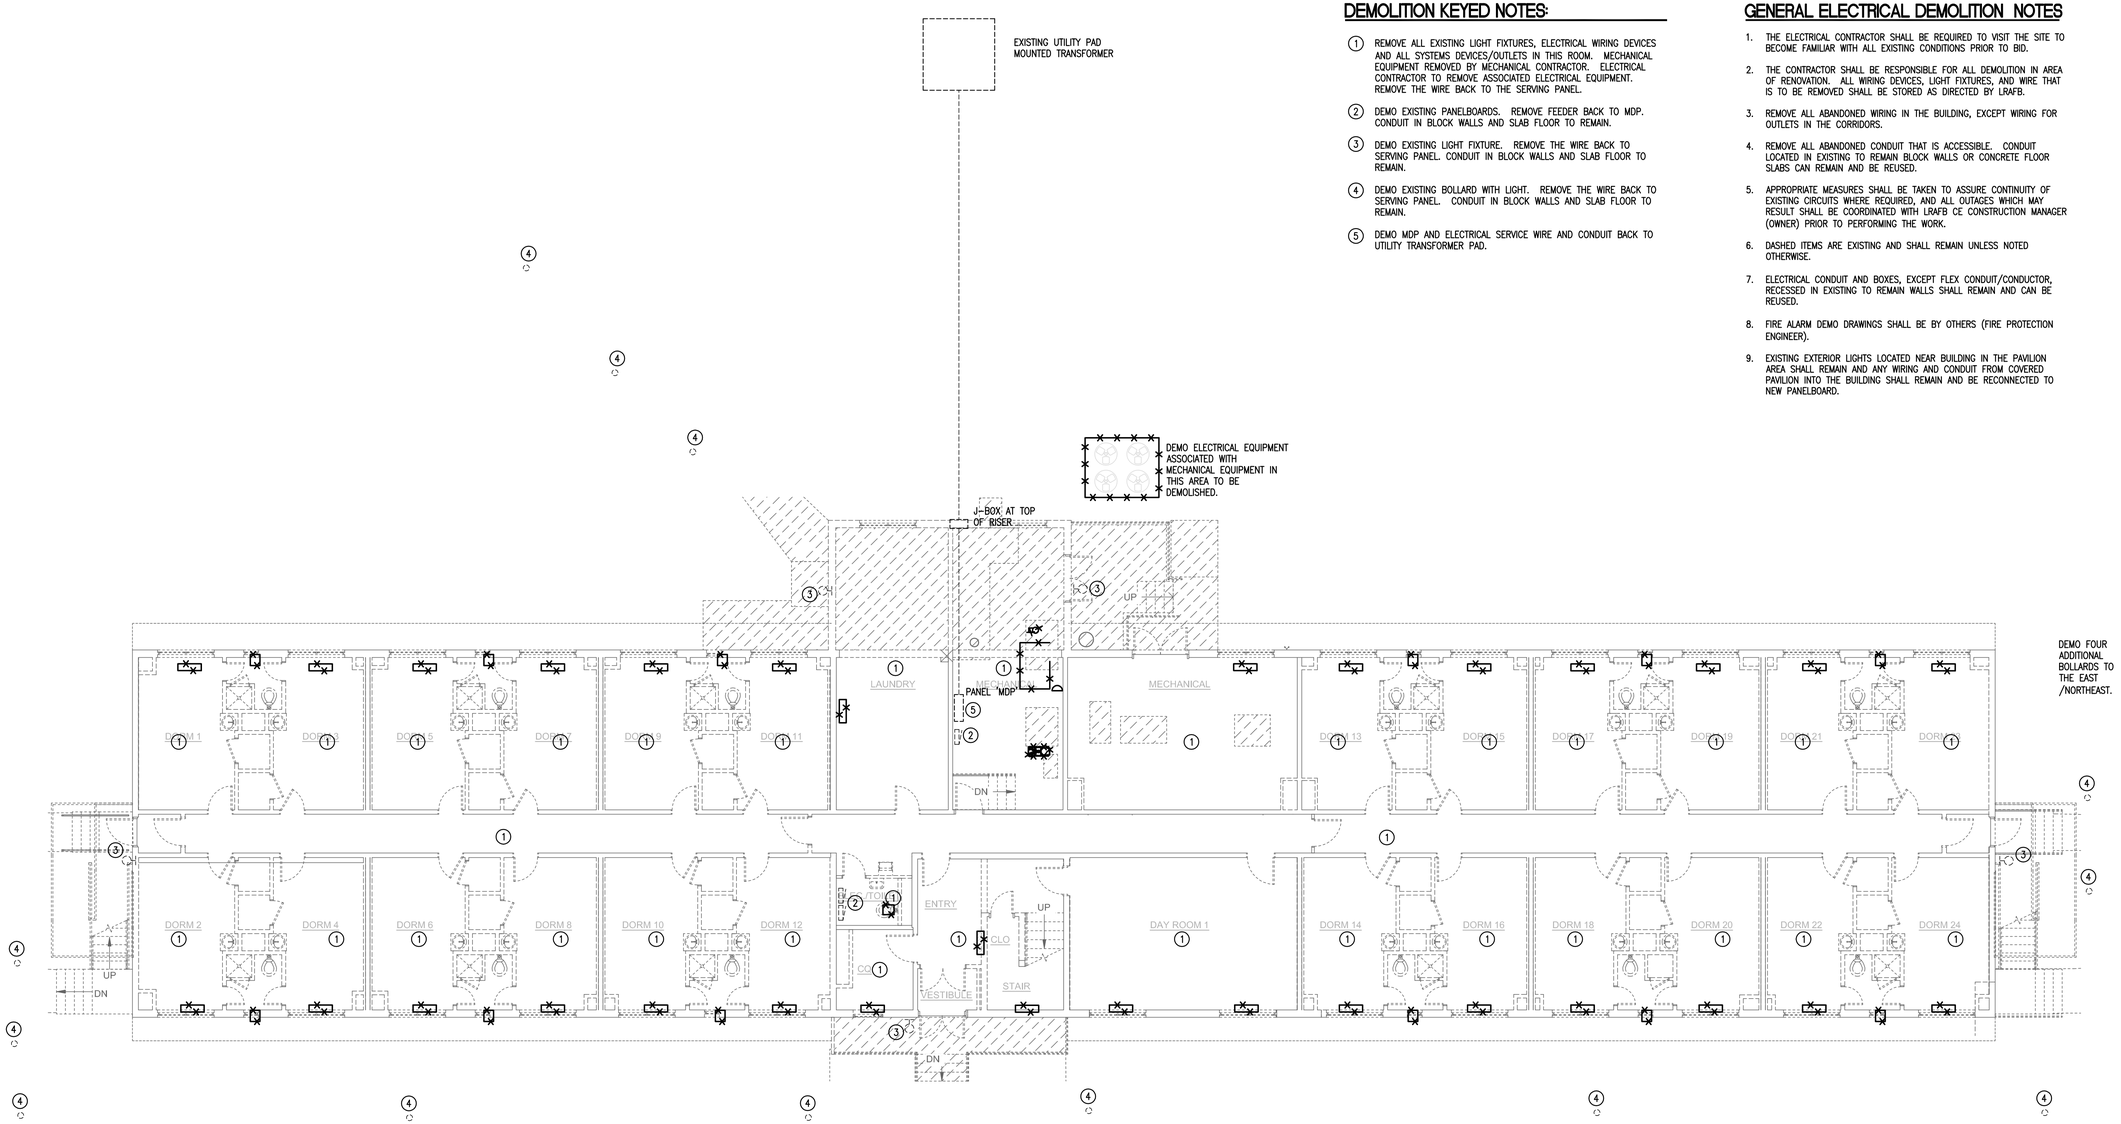

1 FIRST FLOOR ELECTRICAL DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

DEMOLITION KEYED NOTES:

1. REMOVE ALL EXISTING LIGHT FIXTURES, ELECTRICAL WIRING DEVICES AND ALL SYSTEMS DEVICES/OUTLETS IN THIS ROOM. MECHANICAL EQUIPMENT REMOVED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR TO REMOVE ASSOCIATED ELECTRICAL EQUIPMENT. REMOVE THE WIRE BACK TO THE SERVING PANEL.
2. DEMO EXISTING PANELBOARDS. REMOVE FEEDER BACK TO MDP. CONDUIT IN BLOCK WALLS AND SLAB FLOOR TO REMAIN.
3. DEMO EXISTING LIGHT FIXTURE. REMOVE THE WIRE BACK TO SERVING PANEL. CONDUIT IN BLOCK WALLS AND SLAB FLOOR TO REMAIN.
4. DEMO EXISTING BOLLARD WITH LIGHT. REMOVE THE WIRE BACK TO SERVING PANEL. CONDUIT IN BLOCK WALLS AND SLAB FLOOR TO REMAIN.
5. DEMO MDP AND ELECTRICAL SERVICE WIRE AND CONDUIT BACK TO UTILITY TRANSFORMER PAD.

GENERAL ELECTRICAL DEMOLITION NOTES

1. THE ELECTRICAL CONTRACTOR SHALL BE REQUIRED TO VISIT THE SITE TO BECOME FAMILIAR WITH ALL EXISTING CONDITIONS PRIOR TO BID.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEMOLITION IN AREA OF RENOVATION. ALL WIRING DEVICES, LIGHT FIXTURES, AND WIRE THAT IS TO BE REMOVED SHALL BE STORED AS DIRECTED BY LRAFB.
3. REMOVE ALL ABANDONED WIRING IN THE BUILDING, EXCEPT WIRING FOR OUTLETS IN THE CORRIDORS.
4. REMOVE ALL ABANDONED CONDUIT THAT IS ACCESSIBLE. CONDUIT LOCATED IN EXISTING TO REMAIN BLOCK WALLS OR CONCRETE FLOOR SLABS CAN REMAIN AND BE REUSED.
5. APPROPRIATE MEASURES SHALL BE TAKEN TO ASSURE CONTINUITY OF EXISTING CIRCUITS WHERE REQUIRED, AND ALL OUTAGES WHICH MAY RESULT SHALL BE COORDINATED WITH LRAFB CE CONSTRUCTION MANAGER (OWNER) PRIOR TO PERFORMING THE WORK.
6. DASHED ITEMS ARE EXISTING AND SHALL REMAIN UNLESS NOTED OTHERWISE.
7. ELECTRICAL CONDUIT AND BOXES, EXCEPT FLEX CONDUIT/CONDUCTOR, RECESSED IN EXISTING TO REMAIN WALLS SHALL REMAIN AND CAN BE REUSED.
8. FIRE ALARM DEMO DRAWINGS SHALL BE BY OTHERS (FIRE PROTECTION ENGINEER).
9. EXISTING EXTERIOR LIGHTS LOCATED NEAR BUILDING IN THE PAVILION AREA SHALL REMAIN AND ANY WIRING AND CONDUIT FROM COVERED PAVILION INTO THE BUILDING SHALL REMAIN AND BE RECONNECTED TO NEW PANELBOARD.

0' 4' 8' 16'
SCALE: 1/8" = 1'-0"

CERTIFICATE OF AUTHORIZATION
ENERGY ENGINEERING CONSULTANTS, INC.
No. 1586
ARKANSAS ENGINEER

EECI
ENERGY ENGINEERING CONSULTANTS, INC.
10 CORPORATE HILL DR., STE. 100 PH: (501) 244-0511
LITTLE ROCK, AR 72205 FX: (501) 244-0241

LITTLE ROCK A.F.B.
ARKANSAS

HGL Construction

CLEMENTS & ASSOCIATES
ARCHITECTURE, INC.
507 MAIN STREET
NORTH LITTLE ROCK, ARKANSAS 72114
PHONE: 501-375-3380
WWW.CLEMENTSARCHITECTS.COM

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
NO. 18633
ERIC C. TARVER
2-29-24

No.	Revision/Issue	Date	By	APP'D

PROJECT TITLE: REPAIR (SUS) AIRMEN DORMITORY BLDG 854

SHEET TITLE: ELECTRICAL DEMOLITION PLAN

DRAWN BY: HS, BD	LEAD DESIGNER: GC
TECH. REVIEWER: HS	PROJECT NUMBER: NKAK 21-1034
ENGINEER OF RECORD: GC	SHEET: E1.01
DATE: 29 FEB. 2024	
SCALE: AS NOTED	87 OF 100