


- SHEET NOTES:**
1. DEMO ALL EXISTING MECHANICAL EQUIPMENT, DUCTWORK, PIPING AND SUPPORTS UNLESS NOTED OTHERWISE.
 2. ALL DARK AND DASHED EQUIPMENT, DUCTWORK, PIPING AND ASSOCIATED SUPPORTS ARE TO BE REMOVED IN ITS ENTIRETY AND EXISTING PENETRATIONS PATCHED. PIPING SHOWN LIGHTLY IS TO REMAIN.
 3. HAZARDOUS MATERIALS ARE PRESENT IN/ON SELECT EXISTING MATERIALS - REFER TO HAZARDOUS MATERIAL REPORT FOR LOCATIONS. REFER TO SPECIFICATIONS FOR ABATEMENT, REMOVAL AND DISPOSAL.

- KEYNOTES: (#)**
1. DISCONNECT AND REMOVE EXISTING STEAM BOILERS AND ASSOCIATED BOILER FLUE, PIPING AND CONTROLS.
 2. DISCONNECT AND REMOVE EXISTING CONDENSATE PUMP AND ASSOCIATED LPC AND PC PIPING.
 3. DISCONNECT AND REMOVE EXISTING FIELD BUILT AIR HANDLING UNIT AND ASSOCIATED HEATING COILS, FILTERS, DAMPERS, DUCTWORK, PIPING AND CONTROLS.
 4. DISCONNECT AND REMOVE EXISTING AIR HANDLING UNIT FAN AND ASSOCIATED DUCTWORK AND CONTROLS.
 5. DISCONNECT AND REMOVE EXISTING TEMPERATURE CONTROL PANEL AND ASSOCIATED CONDUIT AND WIRING.
 6. DISCONNECT AND REMOVE EXISTING STEAM PRV STATION.
 7. DISCONNECT AND REMOVE EXISTING BLOWDOWN SEPARATOR AND ASSOCIATED STEAM VENT AND BLOWDOWN PIPING.
 8. DISCONNECT AND REMOVE EXISTING STEAM COIL AND ASSOCIATED LPS AND LPC PIPING.
 9. DISCONNECT AND REMOVE EXISTING EXHAUST FAN AND ASSOCIATED DUCTWORK AND CONTROLS. BLANK OFF BACKSIDE OF EXISTING LOUVER WITH INSULATED SHEET METAL SANDWICH PANEL.
 10. DISCONNECT AND REMOVE EXISTING CONDENSING UNIT AND ASSOCIATED REFRIGERANT PIPING UP TO FAN COIL UNIT IN ATTIC.
 11. DISCONNECT AND REMOVE EXISTING 10"x10" GRILLE AND DUCT IN WALL. BLANK OFF BEHIND LOUVER WITH INSULATED SHEET METAL. BLANK OFF PANEL.
 12. DISCONNECT AND REMOVE EXISTING DUCTWORK AND ASSOCIATED SUPPORTS.
 13. DISCONNECT AND REMOVE EXISTING PIPING AND ASSOCIATED VALVES AND SUPPORTS.
 14. DISCONNECT & REMOVE EXISTING BOILER FLUE TO BOILER. PATCH ABANDONED WALL PENETRATION TO MATCH EXISTING.

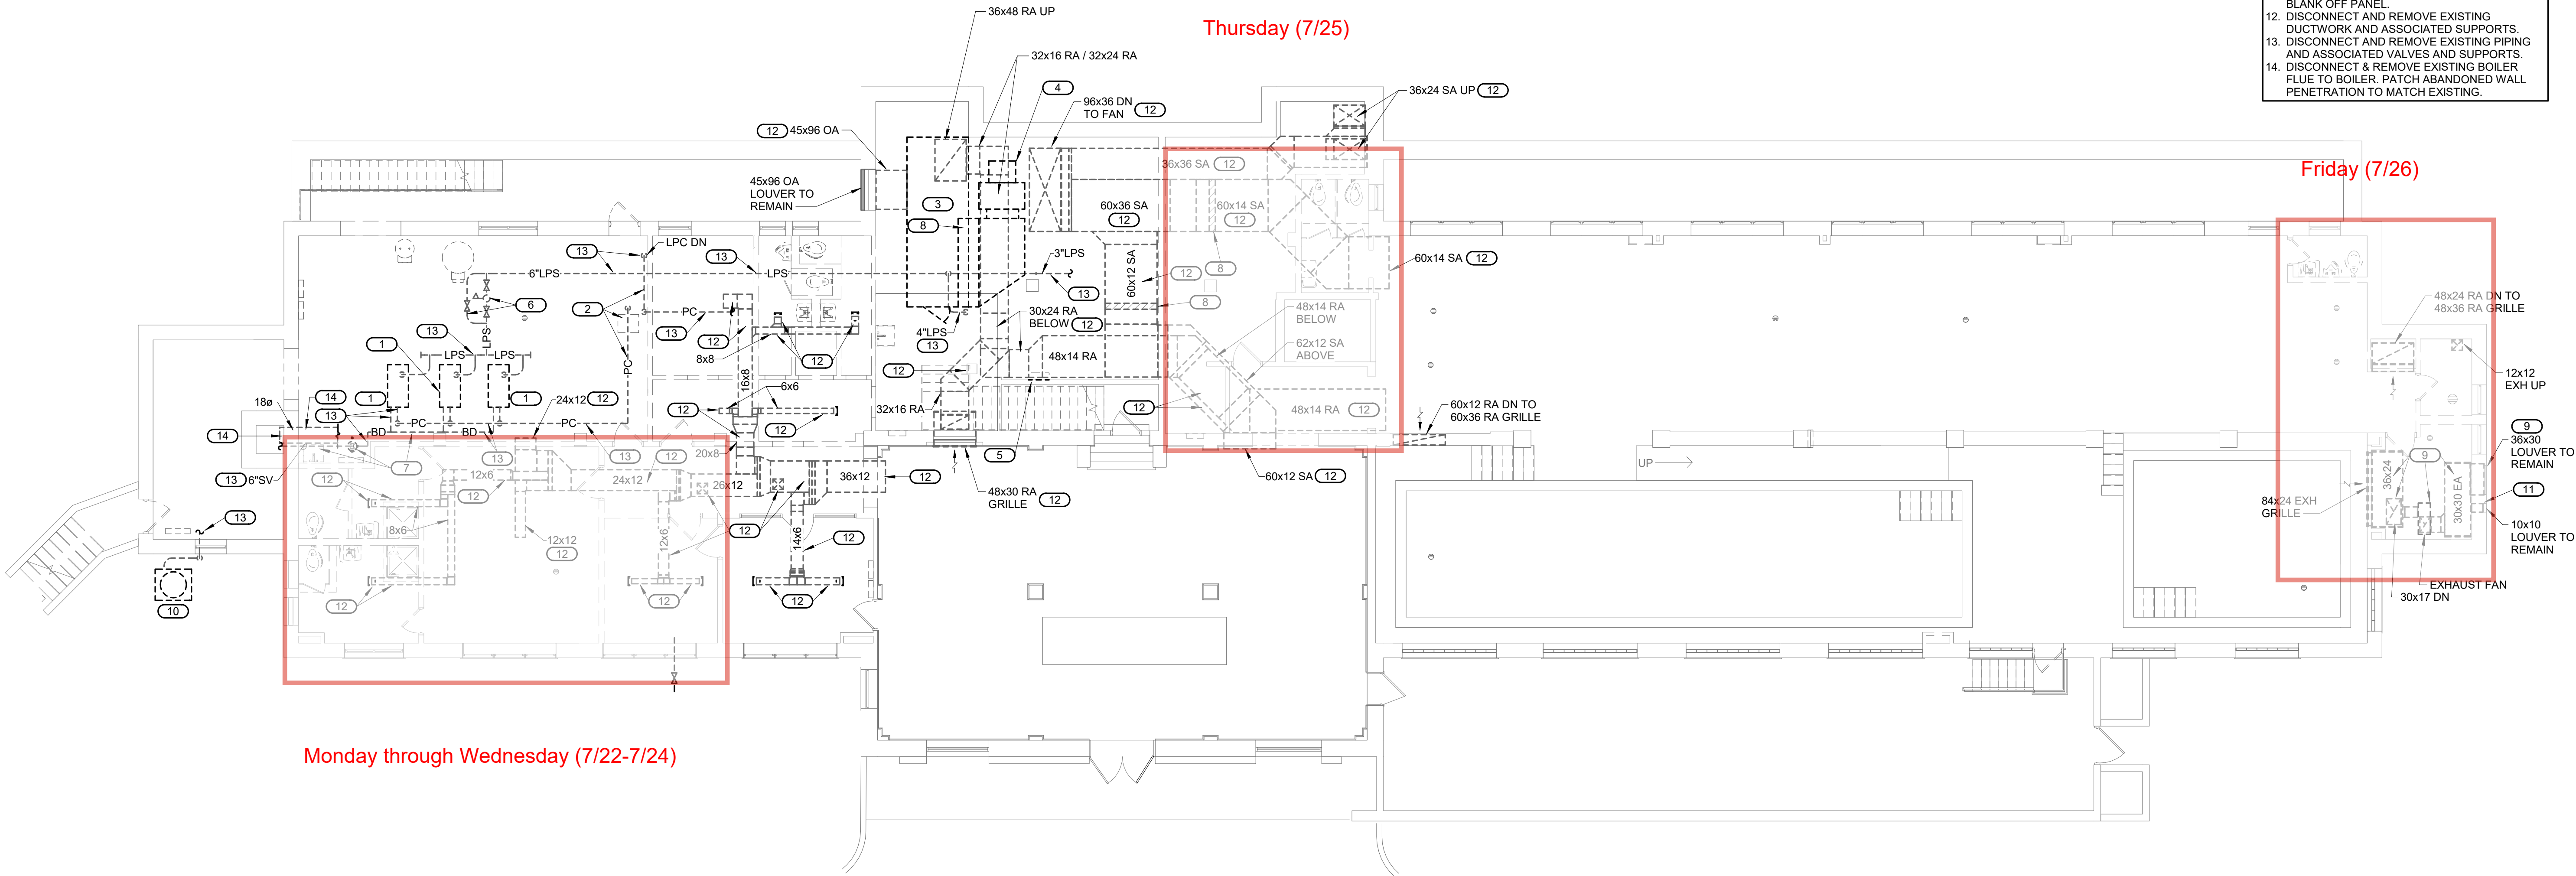

1
MX1.1 LOWER LEVEL DEMOLITION PLAN - MECHANICAL
1/8" = 1'-0"

8' 0' 8' 16'
1/8" = 1' - 0" SCALE OF FEET

CERTIFICATE OF AUTHORIZATION
IMEG Consultants Corp. No. 4308
ARIZONA

LICENSED PROFESSIONAL ENGINEER
No. 20909
DAVID W. BODENHORN
10.27.2023

A/E FIRMS ARCH: QUINN EVANS 219 1/2 N. MAIN STREET ANN ARBOR, MI T: 734.663.5888 MEP/ENG: IMEG CORP. 1400 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED: SGB	SUB SHEET NO. 02 MX1.1	TITLE OF SHEET LIBBEY BATHHOUSE LOWER LEVEL DEMOLITION PLAN - MECHANICAL REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	DRAWING NO. 128 182951 PMIS/PKG NO. 318915 SHEET 233 OF 286
	CADD: WMM			
	TECH. REVIEW: SGB			
	DATE: 10.27.2023			