




PARTITION TYPE LEGEND

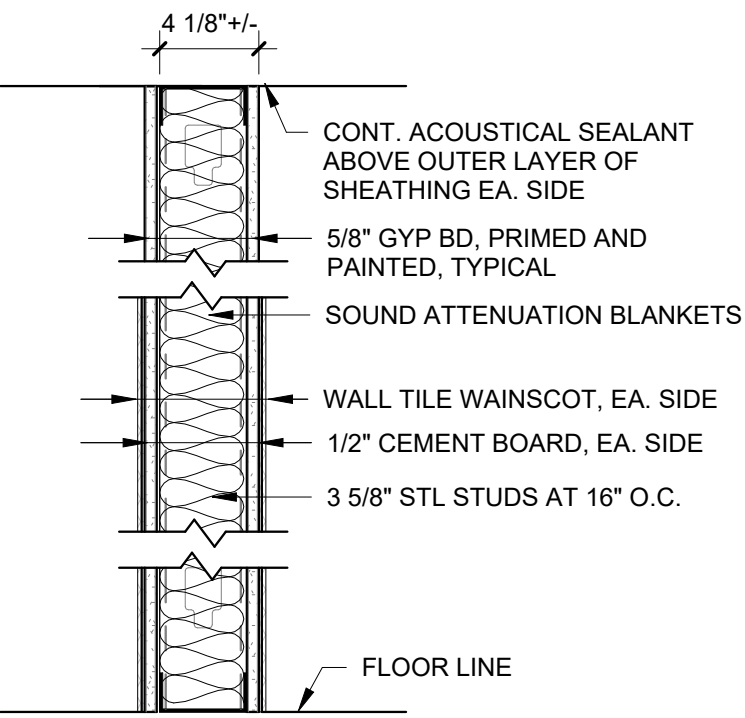


A1 ACOUSTIC GYPSUM BOARD ASSEMBLY

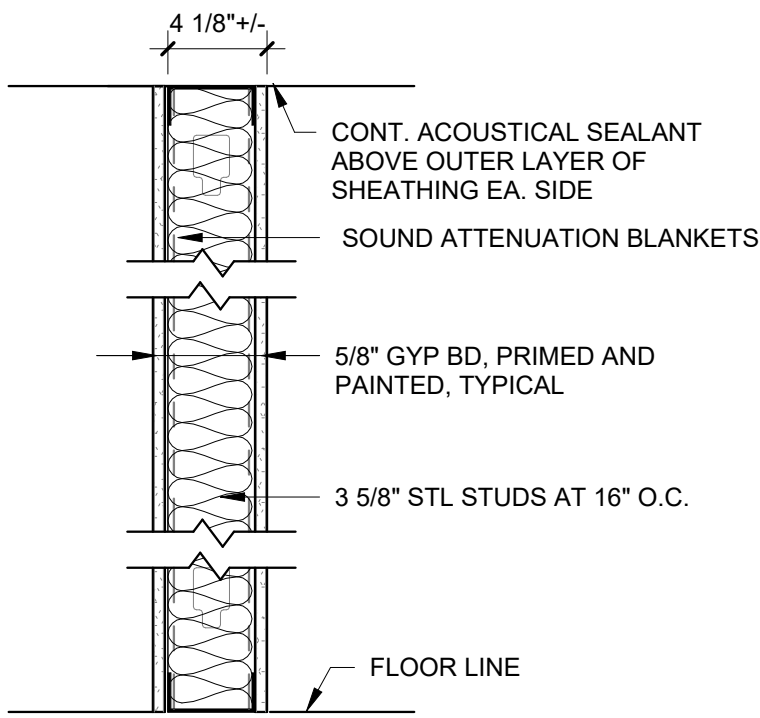


A2 ACOUSTIC GYPSUM BOARD ASSEMBLY

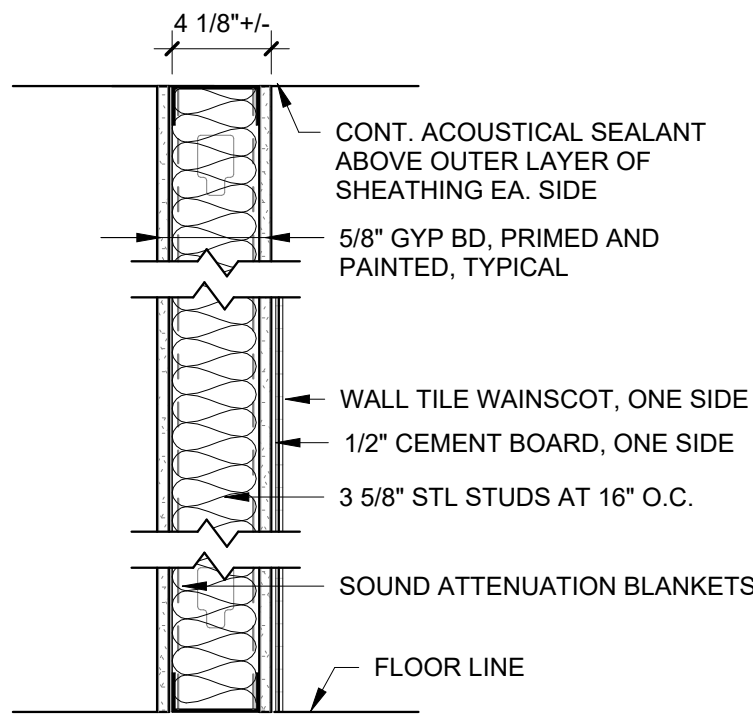


A3 ACOUSTIC GYPSUM BOARD ASSEMBLY

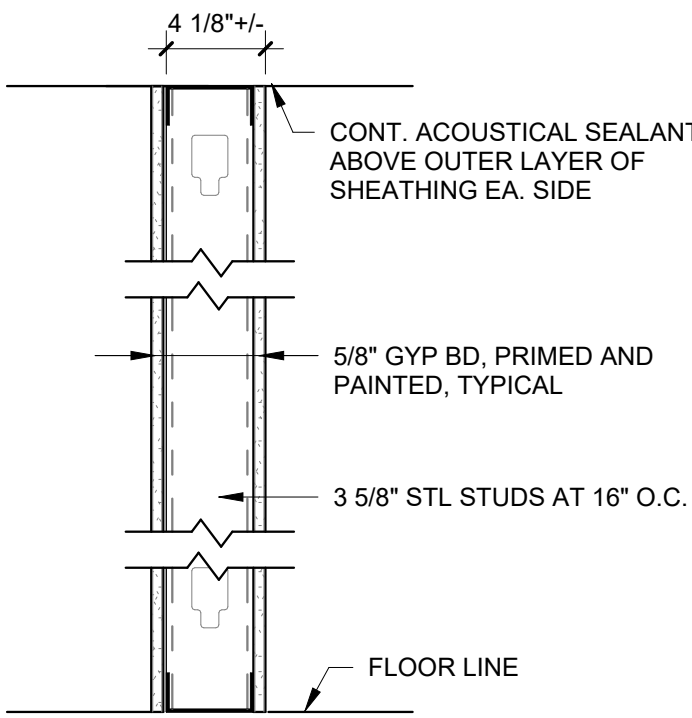


B1 GYPSUM BOARD ASSEMBLY

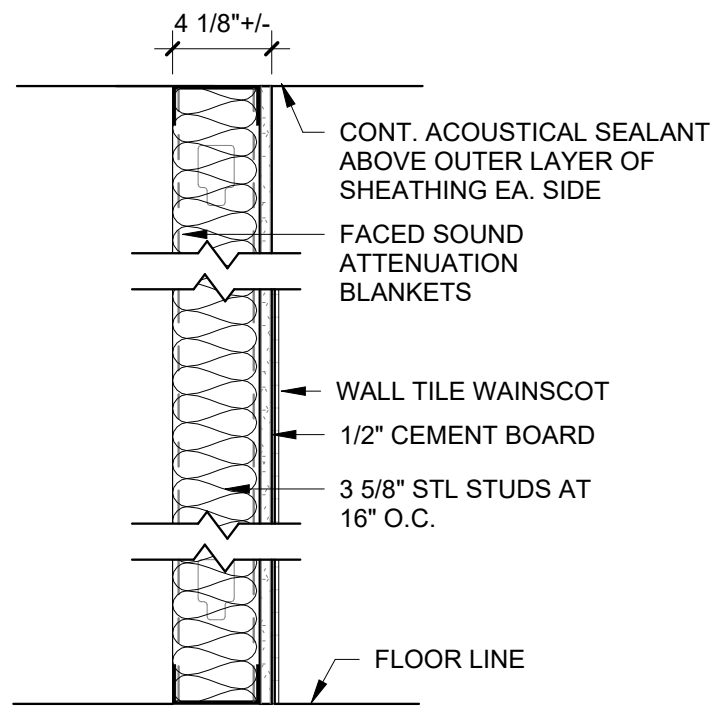


O1 ACOUSTIC GYPSUM BOARD ASSEMBLY

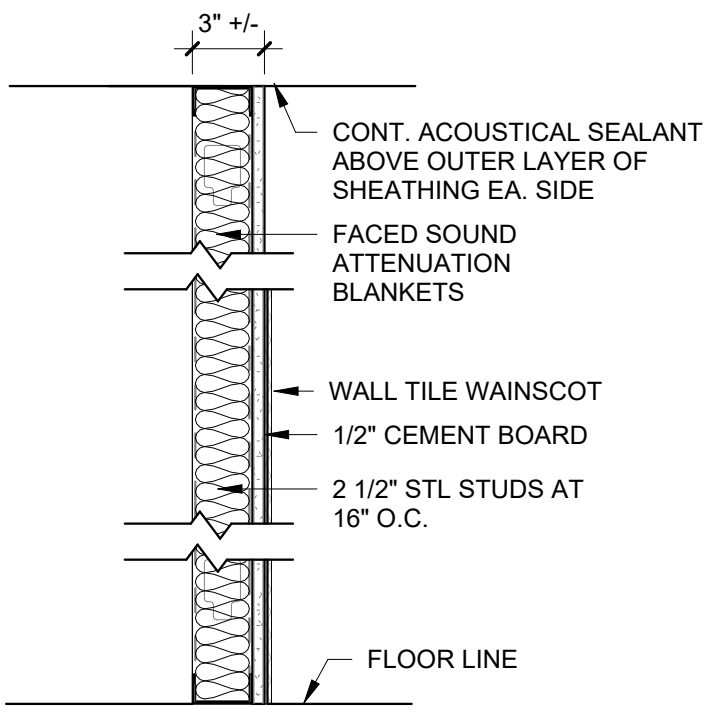

O2 ACOUSTIC GYPSUM BOARD ASSEMBLY

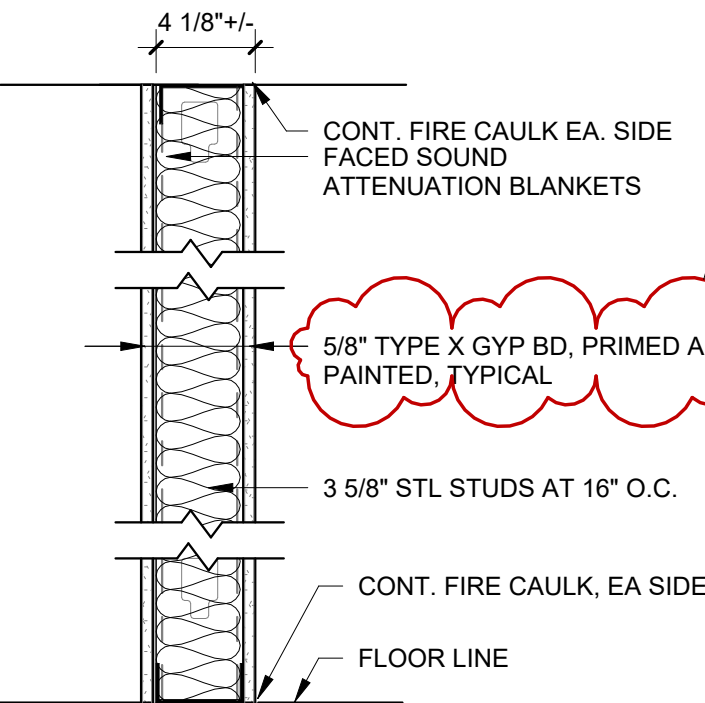

F1 (1 HOUR) FIRE RATED PARTITION

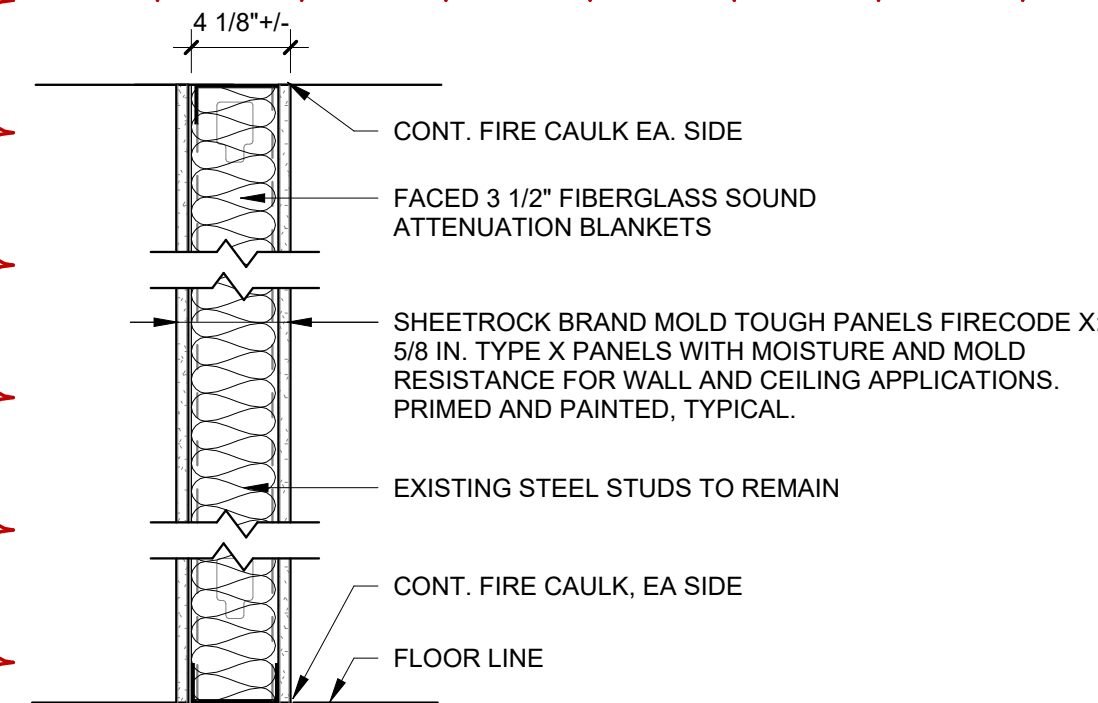

F2 (1 HOUR) FIRE RATED PARTITION

DESIGN NO. UL U419

FIRE RATING: 1 HOUR

STC RATING: 45

SOUND TEST: UST 19042

SYSTEM THICKNESS: 4 1/8" (104 mm)

LOCATION: INTERIOR

FRAMING TYPE: STEEL STUD (NAIL-DAD-BEARING)

ASSEMBLY REQUIREMENTS:

GYPSUM PANELS: ONE LAYER 5/8" (15.9 mm) SHEETROCK® GYPSUM PANEL (U.A. TYPE SCX)

STEEL STUDS: 3-1/2" (89 mm) STEEL STUDS, 6000 LB (2700 kg) C.F. (150 mm) O.C.

INSULATION: 5-1/2" (140 mm) FIBERGLASS INSULATION

GYPSUM PANELS: ONE LAYER 5/8" (15.9 mm) SHEETROCK® GYPSUM PANEL (U.A. TYPE SCX)

GENERAL NOTES:

1. REFER TO THE CABLE CODES REQUIREMENTS TO ENSURE COMPLIANCE PRIOR TO CONSTRUCTION.

2. FOR THE MOST UP TO DATE DETAILS, INCLUDING CONSTRUCTION LIMITATIONS, REFER TO THE PUBLISHED DESIGN.

3. WHERE DESIGN NO. INDICATES "PREP", THE FIRE RATING IS BASED ON LABORATORY TEST DATA OF THE REFERENCED ASSEMBLY. CONSTRUCTION ASSEMBLY.

4. STUD SIZES AND INSULATION THICKNESS ARE MINIMUM UNLESS OTHERWISE STATED IN THE PUBLISHED ASSEMBLY.

5. STUD AND FASTENER SPACING ARE MINIMUM UNLESS OTHERWISE STATED IN THE PUBLISHED ASSEMBLY.

6. PANEL ORIENTATION SHALL BE AS SPECIFIED IN THE PUBLISHED DESIGN.

7. FIRE RATING ARE MAINTAINED WITH ONE OR MORE OF THE FOLLOWING MODIFICATIONS: INCREASE STUD DEPTH, INCREASE STUD MATERIAL THICKNESS, INCREASE STUD SPACING, INCREASE FASTENER SPACING, INCREASE INSULATION THICKNESS UP TO CAVITY DEPTH.

8. WHERE ACOUSTICAL PERFORMANCE IS PROVIDED IN AN ESTIMATED RANGE, THE VALUES ARE BASED ON LABORATORY TEST DATA OF SIMILARLY CONSTRUCTED ASSEMBLIES.

9. WHERE ACOUSTICAL PERFORMANCE IS PROVIDED IN AN ESTIMATED RANGE, THE VALUES ARE BASED ON LABORATORY TEST DATA OF SIMILARLY CONSTRUCTED ASSEMBLIES.

10. SOUND RATING ARE MAINTAINED WITH ONE OR MORE OF THE FOLLOWING MODIFICATIONS: INCREASE STUD DEPTH, INCREASE STUD MATERIAL THICKNESS, INCREASE STUD SPACING, INCREASE FASTENER SPACING, INCREASE INSULATION THICKNESS UP TO CAVITY DEPTH. MODIFICATIONS MUST NOT EXCEED LIMITATIONS OF FIRE RATING.

UL U419

RECORD:

Revision Date: 10/03/2019

SHEET INFORMATION:


SN-P-1-02

SYMBOLS LEGEND

- (X) STRUCTURAL/COLUMN GRID
- DESCRIPTION 000'-0" ELEVATION HEIGHT TAG
- 0'-0" SPOT ELEVATION
- X00 A000 EXTERIOR ELEVATION
- Room name 101 ROOM TAG
- 000-0 DOOR TAG
- XX WALL TYPE
- (X) WINDOW TYPE
- SF - A STOREFRONT WINDOW
- 10' - 6 1/2" CEILING HEIGHT
- 00.00 KEYED NOTE
- X00 A000 INTERIOR ELEVATION
- X00 A000 SECTION CALLOUT
- X00 A000 DETAIL CALLOUT


PARTITION TYPES GENERAL NOTES

A. INSTALL NEW RESILIENT WALL BASE ON ALL NEW WALLS, TYPICAL.

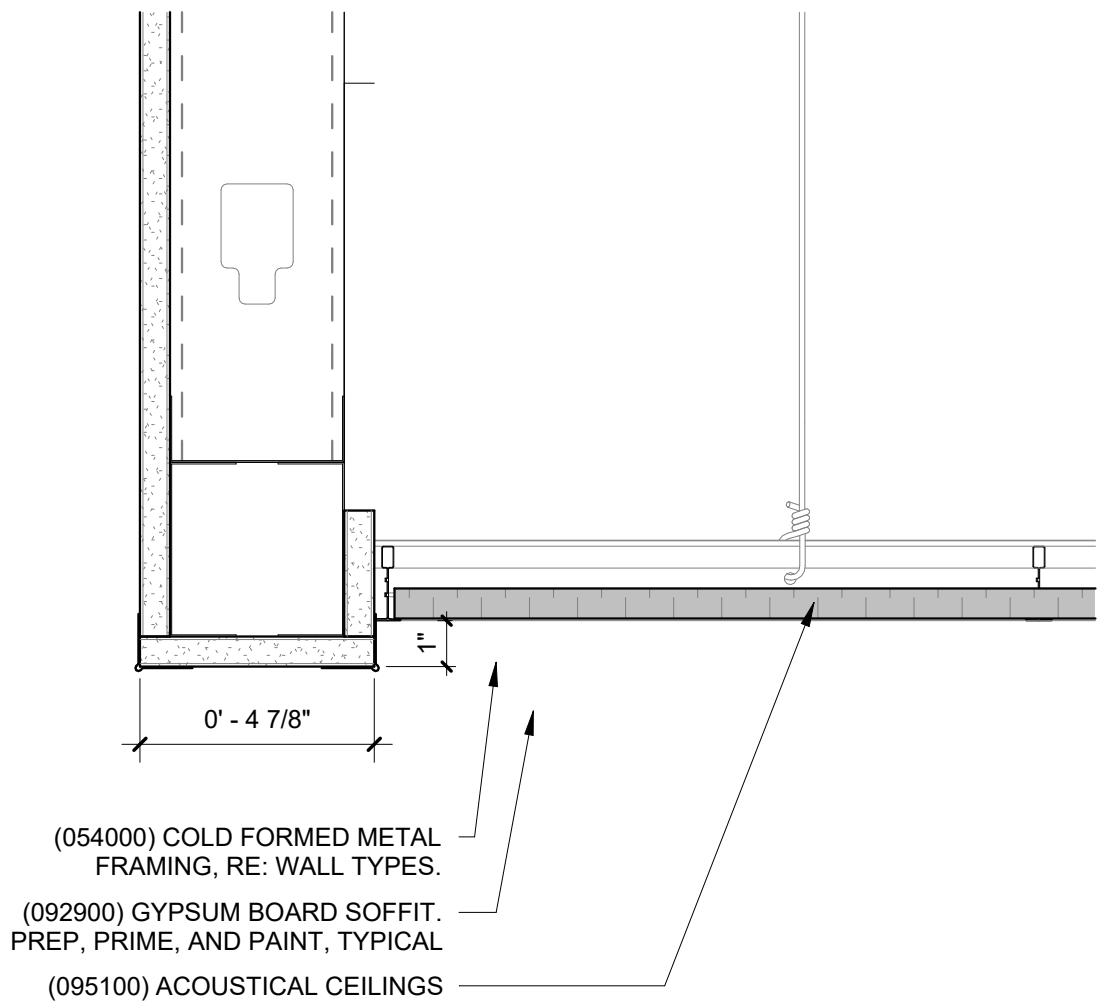

1 Soffit Detail

A0.02 3" = 1'-0" SCALE (A)

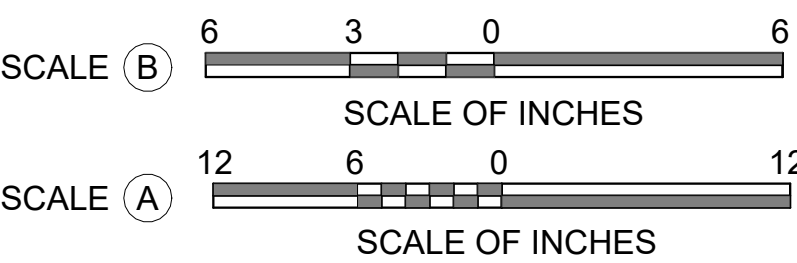

A/E FIRMS

PRIME/ARCH: STRATA ARCHITECTURE

1701 OAK STREET, SUITE 100, KANSAS CITY, MO 64105

DESIGNED: CA/AG

CADD: CA/ZA/EM

TECH. REVIEW: AG

DATE: 10.27.2023

SUB SHEET NO.

A0.02

TITLE OF SHEET

MAURICE BATHHOUSE

GENERAL NOTES

REHABILITATE BATHHOUSES

HOT SPRINGS NATIONAL PARK

DRAWING NO. 128

182951

PMIS/PKG NO. 318915

SHEET 15 OF 286