



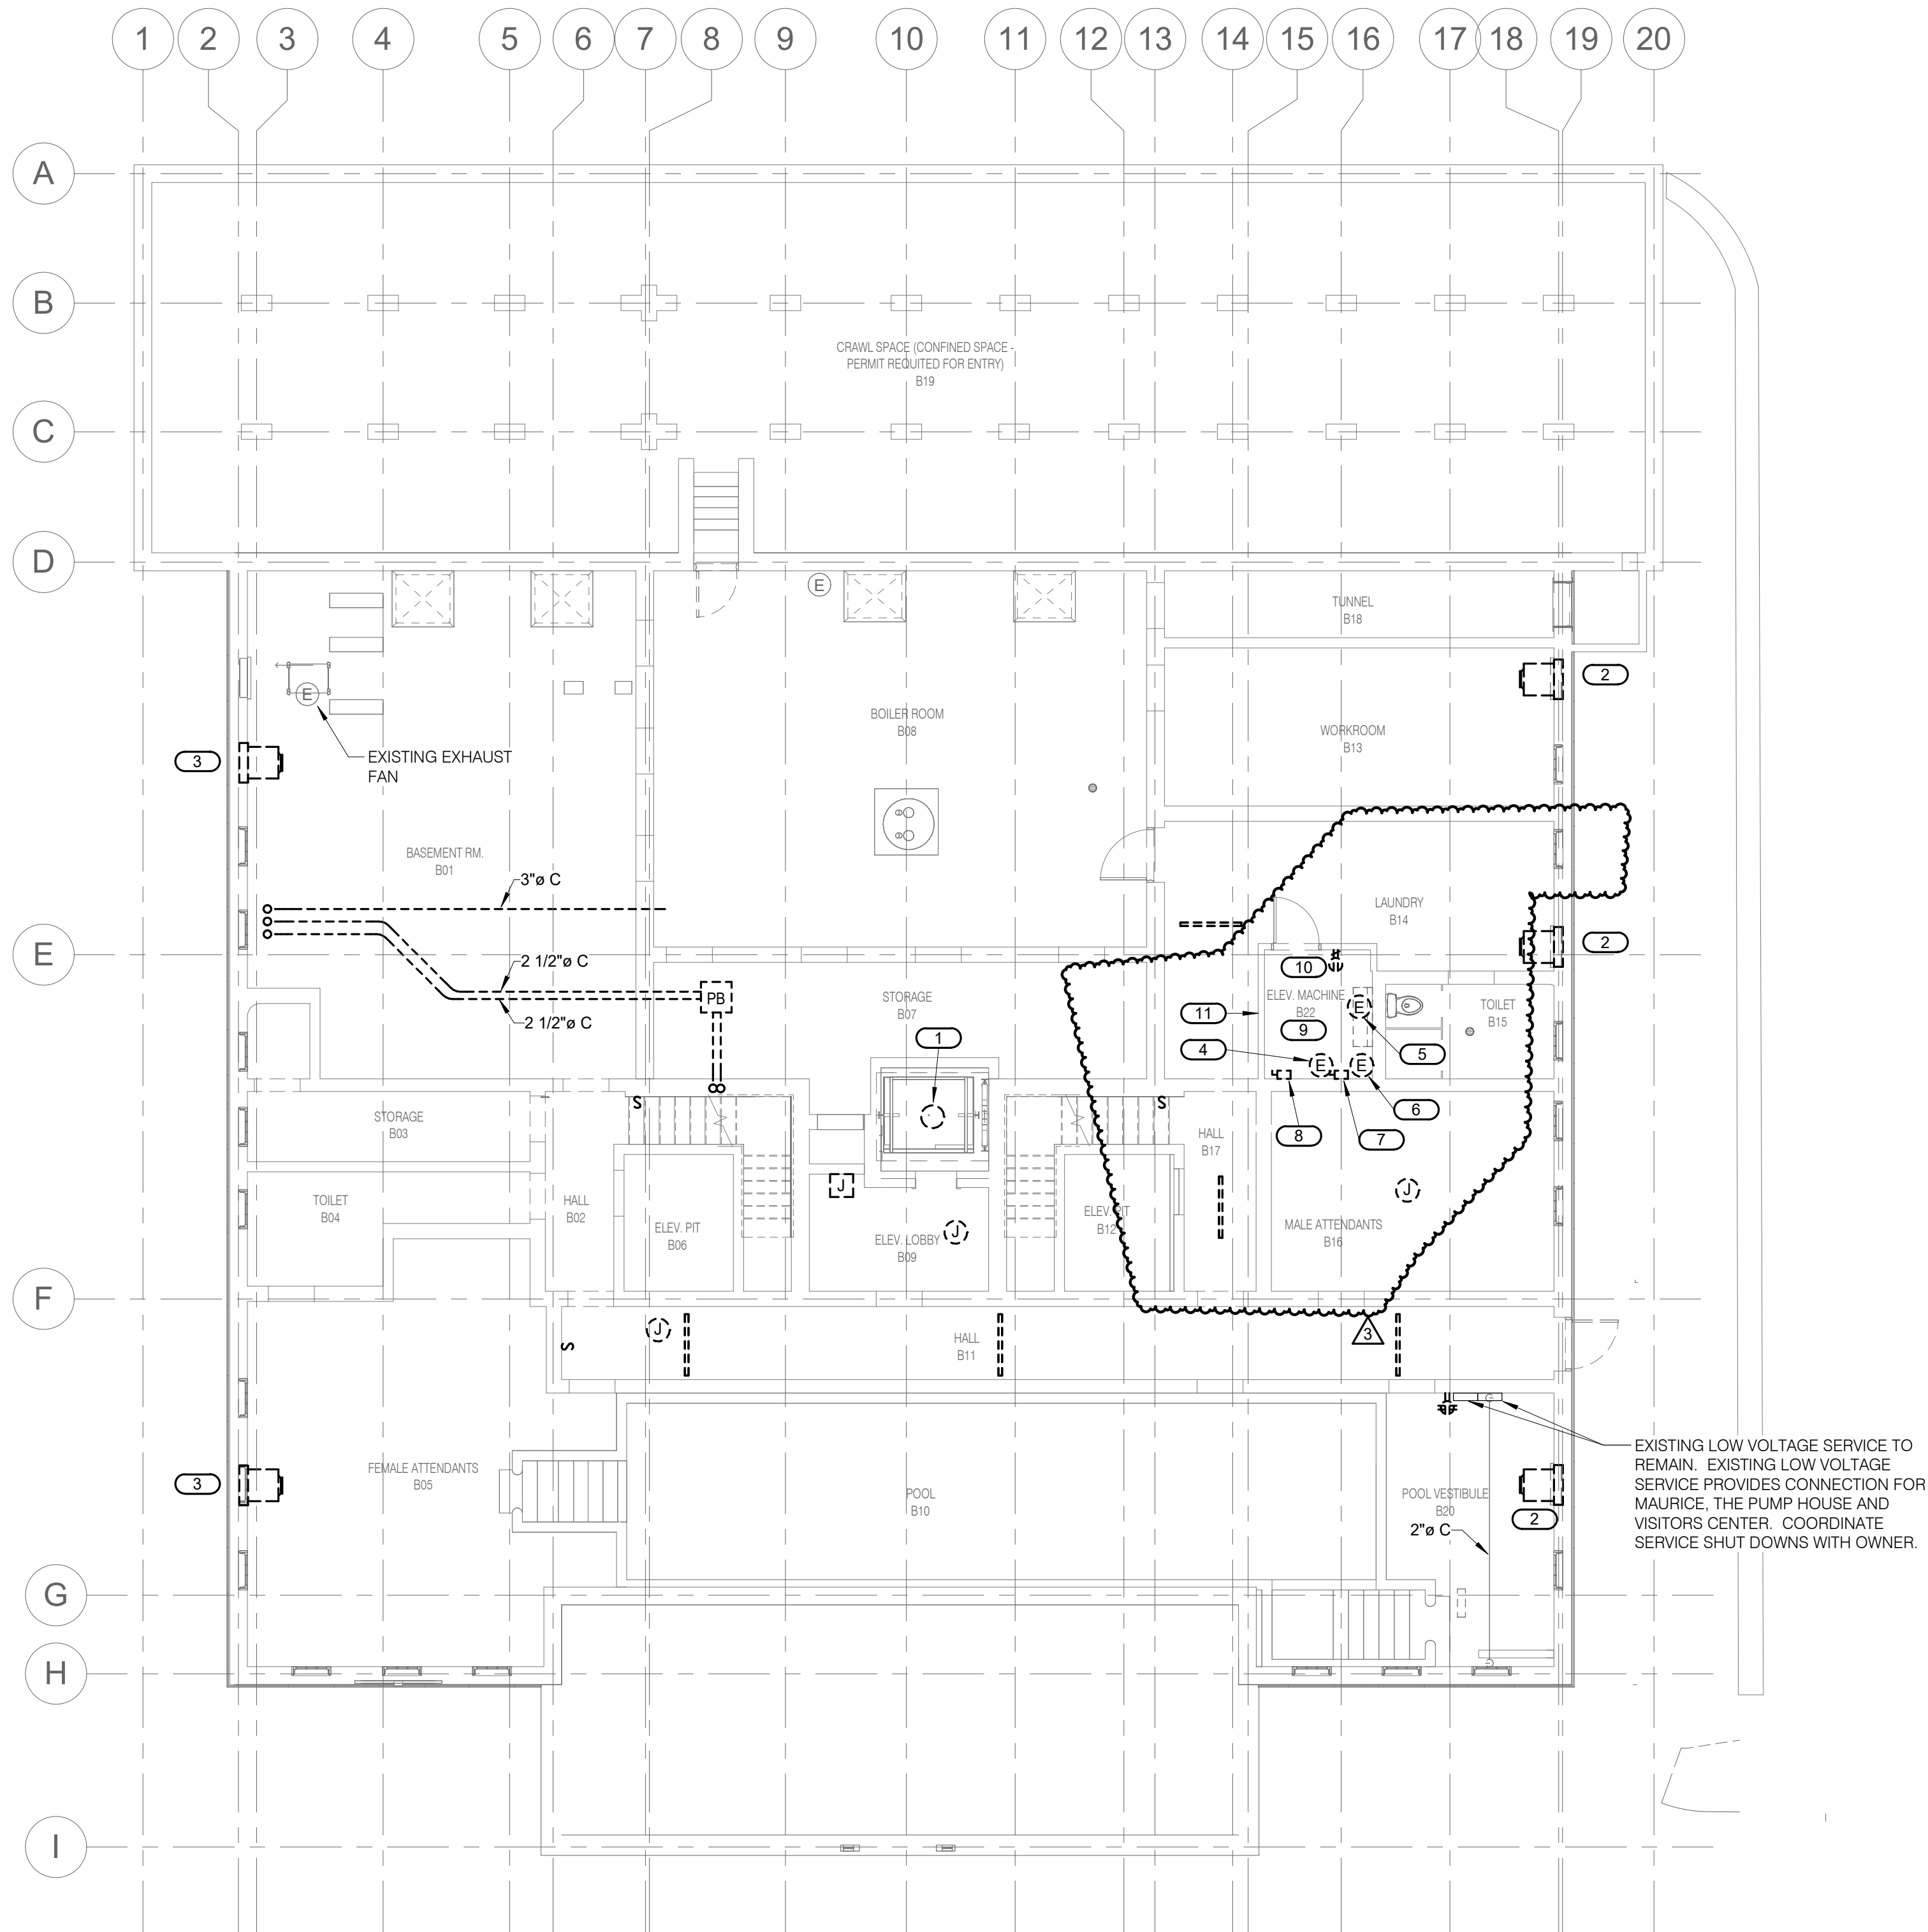


- SHEET NOTES:**
1. REFER TO SHEET E0.0 AND E0.1 FOR GENERAL NOTES AND SYMBOLS.
 2. FURNISH AND INSTALL STAINLESS STEEL COVER PLATES ON ALL JUNCTION BOXES THAT ARE EXISTING TO REMAIN. ALL JUNCTION BOXES ARE NOT SHOWN ON THIS PLAN.
 3. DISCONNECT AND REMOVE POWER, LIGHTING AND FIRE ALARM DEVICES AND LIGHTING FIXTURES SHOWN AS DEMOLISHED AND ALL ASSOCIATED WIRE AND CONDUIT. JUNCTION BOXES AND CABLES, ALL EXISTING CONDUIT TO BE REMOVED IS NOT BE SHOWN ON PLANS.

- KEYNOTES: #**
1. DISCONNECT EXISTING PUMP AND ALL ASSOCIATED CONDUIT AND WIRE NOT REQUIRED TO REMAIN. REMOVE ALL EQUIPMENT, CONDUIT AND WIRING BACK TO SOURCE.
 2. DISCONNECT EXISTING LOUVER AND ALL ASSOCIATED CONDUIT AND WIRE NOT REQUIRED TO REMAIN. REMOVE ALL EQUIPMENT, CONDUIT AND WIRING BACK TO SOURCE.
 3. DISCONNECT EXISTING FAN AND ALL ASSOCIATED CONDUIT AND WIRE NOT REQUIRED TO REMAIN. REMOVE ALL EQUIPMENT, CONDUIT AND WIRING BACK TO SOURCE.
 4. DISCONNECT AND REMOVE EXISTING ELEVATOR POWER CONNECTION.
 5. DISCONNECT AND REMOVE EXISTING FCU.
 6. DISCONNECT AND REMOVE EXISTING ELEVATOR CAB LIGHTS POWER CONNECTION.
 7. DISCONNECT AND REMOVE EXISTING ELEVATOR CAB LIGHTS DISCONNECT.
 8. DISCONNECT AND REMOVE EXISTING ELEVATOR DISCONNECT.
 9. DISCONNECT AND REMOVE ALL ELECTRICAL EQUIPMENT IN ROOM AND KEEP CIRCUIT AVAILABLE FOR RECONNECTION OF NEW ELECTRICAL EQUIPMENT/DEVICES.
 10. DISCONNECT AND REMOVE EXISTING ELEVATOR RECEPTACLE.
 11. DISCONNECT AND REMOVE ALL DEVICES ON WALL. REINSTALL DEVICES AS REQUIRED.

1
EX1.0 BASEMENT ELECTRICAL DEMOLITION PLAN

1/8" = 1'-0"

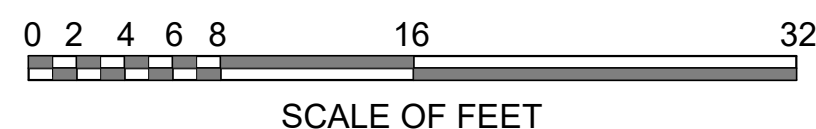

SI-08 05.27.2026



A/E FIRMS PRIME/ARCH: STRATA ARCHITECTURE 1701 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900 MEP/ENG: IMEG CORP. 1600 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED: PIP	SUB SHEET NO. 01 EX1.0	TITLE OF SHEET MAURICE BATHHOUSE BASEMENT ELECTRICAL DEMOLITION PLAN REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	DRAWING NO. 626 180065 PMIS/PKG NO. 318674 SHEET 167 OF 286
	CADD: WMM			
	TECH. REVIEW: PIP			
	DATE: 10.27.2023			