


SHEET NOTES:


1. BRANCH PIPING TO TERMINAL UNITS SHALL BE 3/4" MIN. UNLESS NOTED OTHERWISE.

KEYNOTES: (#)

1. VALVE AND CAP DRAIN WITH THREADED HOSE CONNECTION.
2. MINIMUM FLOW AUTO BYPASS VALVE.
3. VALVE AND CAP FOR FUTURE EXTENSION.

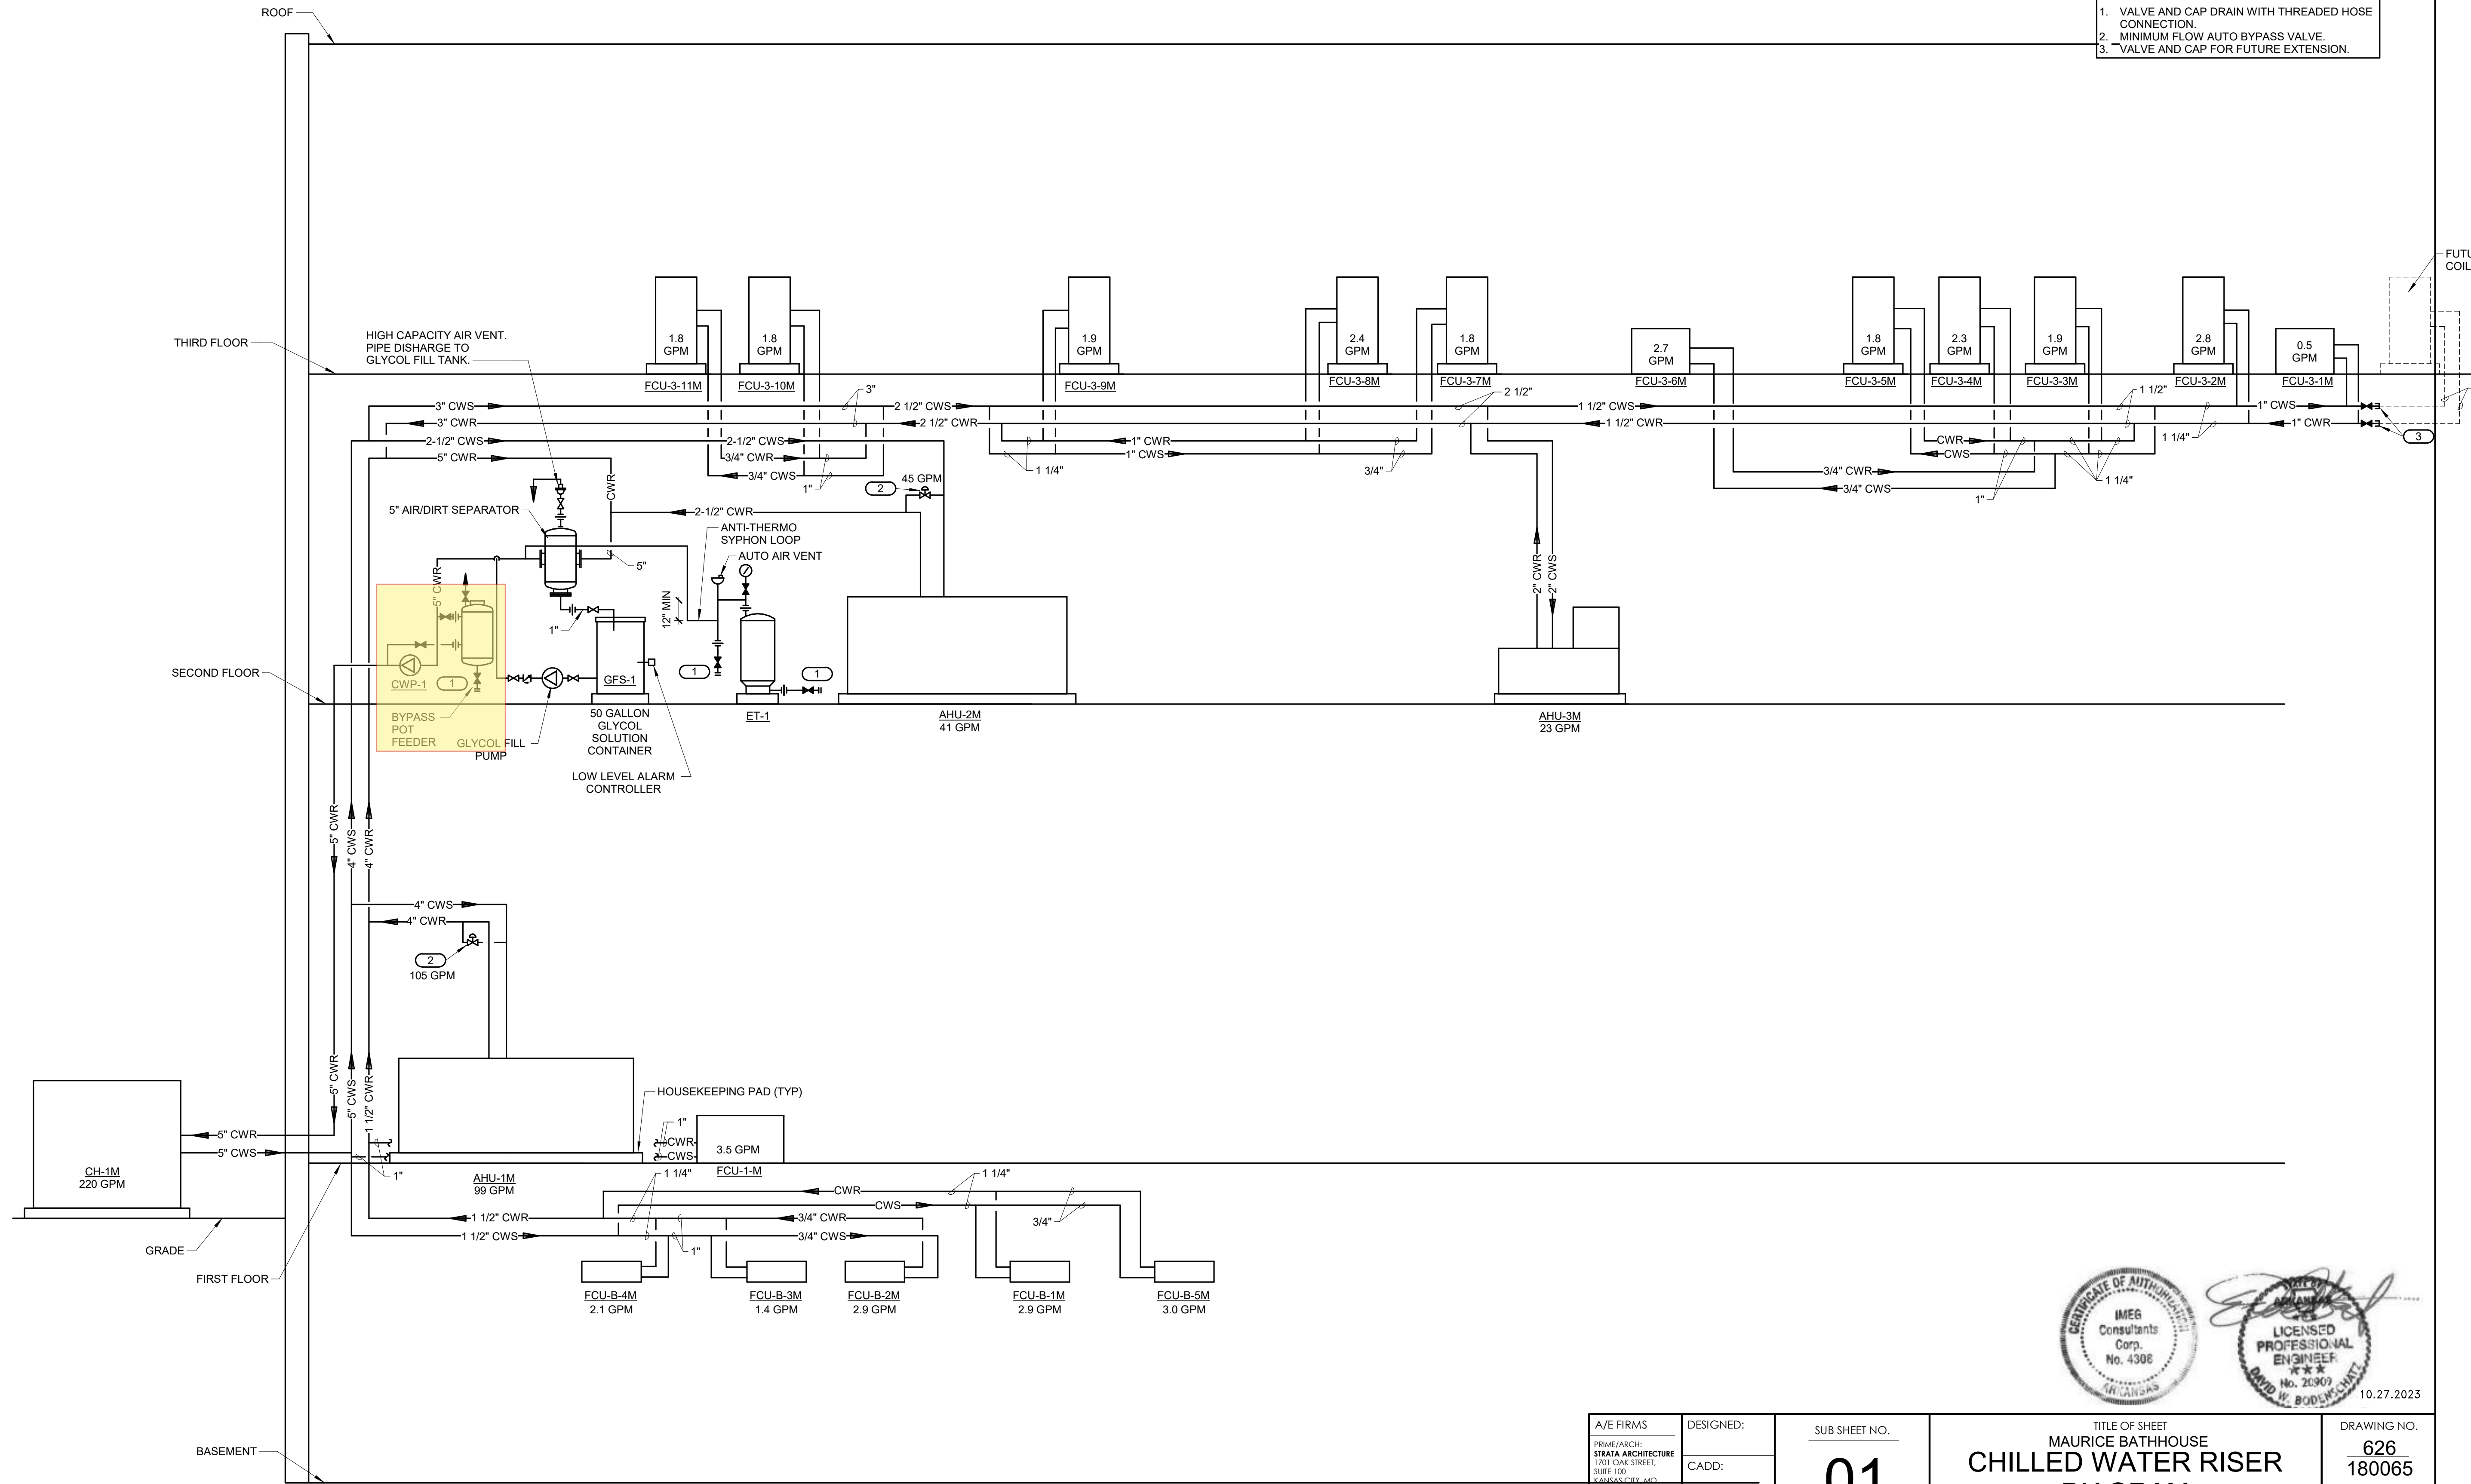

1 CHILLED WATER RISER DIAGRAM
M6.0 12" = 1'-0"

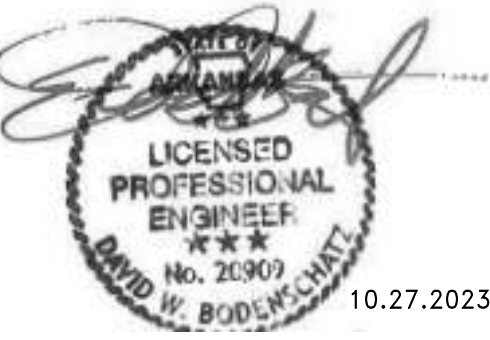

10.27.2023

A/E FIRMS PRIME/ARCH: STRATA ARCHITECTURE 1701 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900 MEP/ENG: IMEG CORP. 1600 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED:	SUB SHEET NO. 01 M6.0	TITLE OF SHEET MAURICE BATHHOUSE CHILLED WATER RISER DIAGRAM REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	DRAWING NO. 626 180065 PMIS/PKG NO. 318674 SHEET 154 OF 286
	CADD:			
	TECH. REVIEW:			
	DATE: 10.27.2023			