


2 WALL SECTION

1/2" = 1'-0"

BUILDING ENVELOPE NOTES	
<b>E.I.F.S. NOTES</b>	<b>SYNTHETIC STONE VENEER NOTES:</b>
1. ALL PENETRATIONS THROUGH EXTERIOR SURFACE OF E.I.F.S. PANELS TO HAVE 1/2" SEALANT AND BACKER ROD AT ALL FOUR SIDES. TOTAL SEPARATION MUST BE MAINTAINED BETWEEN E.I.F.S. AND ALL SEPARATE OR DIFFERENT MATERIALS.	1. SYNTHETIC STONE TO BE INSTALLED ACCORDING TO LATRICRETE SPECIFICATIONS W/ LATRICRETE REPRESENTATIVE ON SITE WHEN WORK BEGINS.
2. E.I.F.S. EXTERIOR FINISH COAT TO COVER ALL TOP, BOTTOM, AND EDGE CONDITIONS. THERE MUST BE NO EXPOSED MESH OR FOAM AT ANY PENETRATION.	2. SYNTHETIC STONE (ON METAL STUDS) TO BE 1-1/2" (+/-) THICK ON LATRICRETE MVS H-BOND VENEER MORTAR, ON LATRICRETE MVS AIR AND WATER BARRIER ON 5/8" CEMENT BACKER BD. (W/ ALL JOINTS REINF. W/ FIBER MESH PRIOR TO WATERPROOFING) ON 3/8" EXT. GR. FR1 PLYWD SHEATH ON METAL STUD FRAMING. (REFER TO STRUCTURAL DRAWINGS).
3. ALL PASTERING OR BOLT PENETRATIONS THROUGH E.I.F.S. TO BE MOUNTED TO SOLID WOOD BLOCKING AT STUD WALL BEYOND. TOGGLE OR LAG BOLTS WITHOUT TREATED WOOD BLOCKING BACKUP ARE NOT TO BE USED. PROVIDE SLEEVE @ PENETRATIONS TO AVOID CRUSHING FOAM.	3. SYNTHETIC STONE (ON CONCRETE TILT-WALL PANELS AND CMU WALLS) TO BE 1-1/2" (+/-) THICK ON LATRICRETE MVS H-BOND VENEER MORTAR, ON LATRICRETE MVS AIR AND WATER.
4. ALL EIFS CLADDING (ON METAL STUD CONSTRUCTION INCLUDING FACADES, CORNICES, TRIM BAND ASSEMBLIES ETC.) STEEL FRAMING @ 16" MAX. O.C.	<b>METAL STUD NOTES:</b>
<b>MISC. WOOD NOTE:</b>	1. ALL EXTERIOR METAL STUD FRAMING AND AT ROOF METAL STUD FRAMING, REFER TO STRUCTURAL DRAWINGS FOR METAL GAUGE.
1. ALL WOOD BLOCKING, PLYWOOD, AND/OR ANY MISC. WOOD, MUST BE FIRE RETARDANT TREATED. (TYP.)	2. ALL METAL STUD FRAMING AT ENTRANCE VESTIBULE, REFER TO STRUCTURAL DRAWINGS FOR METAL GAUGE.
<b>INSULATION NOTES:</b>	3. ALL INTERIOR METAL STUD WALLS FROM FINISH FLOOR TO ROOF DECK WILL BE 18 GAUGE.
1. SIZE THICKNESS OF RIGID ROOF INSULATION TO MEET OR EXCEED AN R-VALUE OF R-34.8.	4. ALL METAL STUD BRACING, REFER TO BOTH ARCHITECTURAL SECTIONS AND STRUCTURAL DRAWINGS.
2. EXTERIOR METAL STUD CONSTRUCTION AT THE BUILDING ENVELOPE ONE TYPICAL CONSTRUCTION SHALL HAVE 1" CONTINUOUS INSULATION BOARD WITH A MINIMUM REQUIRED R-VALUE OF R-4.1. PROVIDE 8" EXT. GRD. TYPE 'X' GYP. BD. ON BOTH SIDES.	
3. EXTERIOR METAL STUD CONSTRUCTION AT THE BUILDING ENVELOPE SHALL HAVE 6" BATT INSULATION W/ A MINIMUM REQUIRED R-VALUE OF R-19.	
4. 1-1/2" E.I.F.S. OVER EXTERIOR METAL STUD CONSTRUCTION @ THE BUILDING ENVELOPE SHALL HAVE INSULATION R-VALUE OF R-6.	

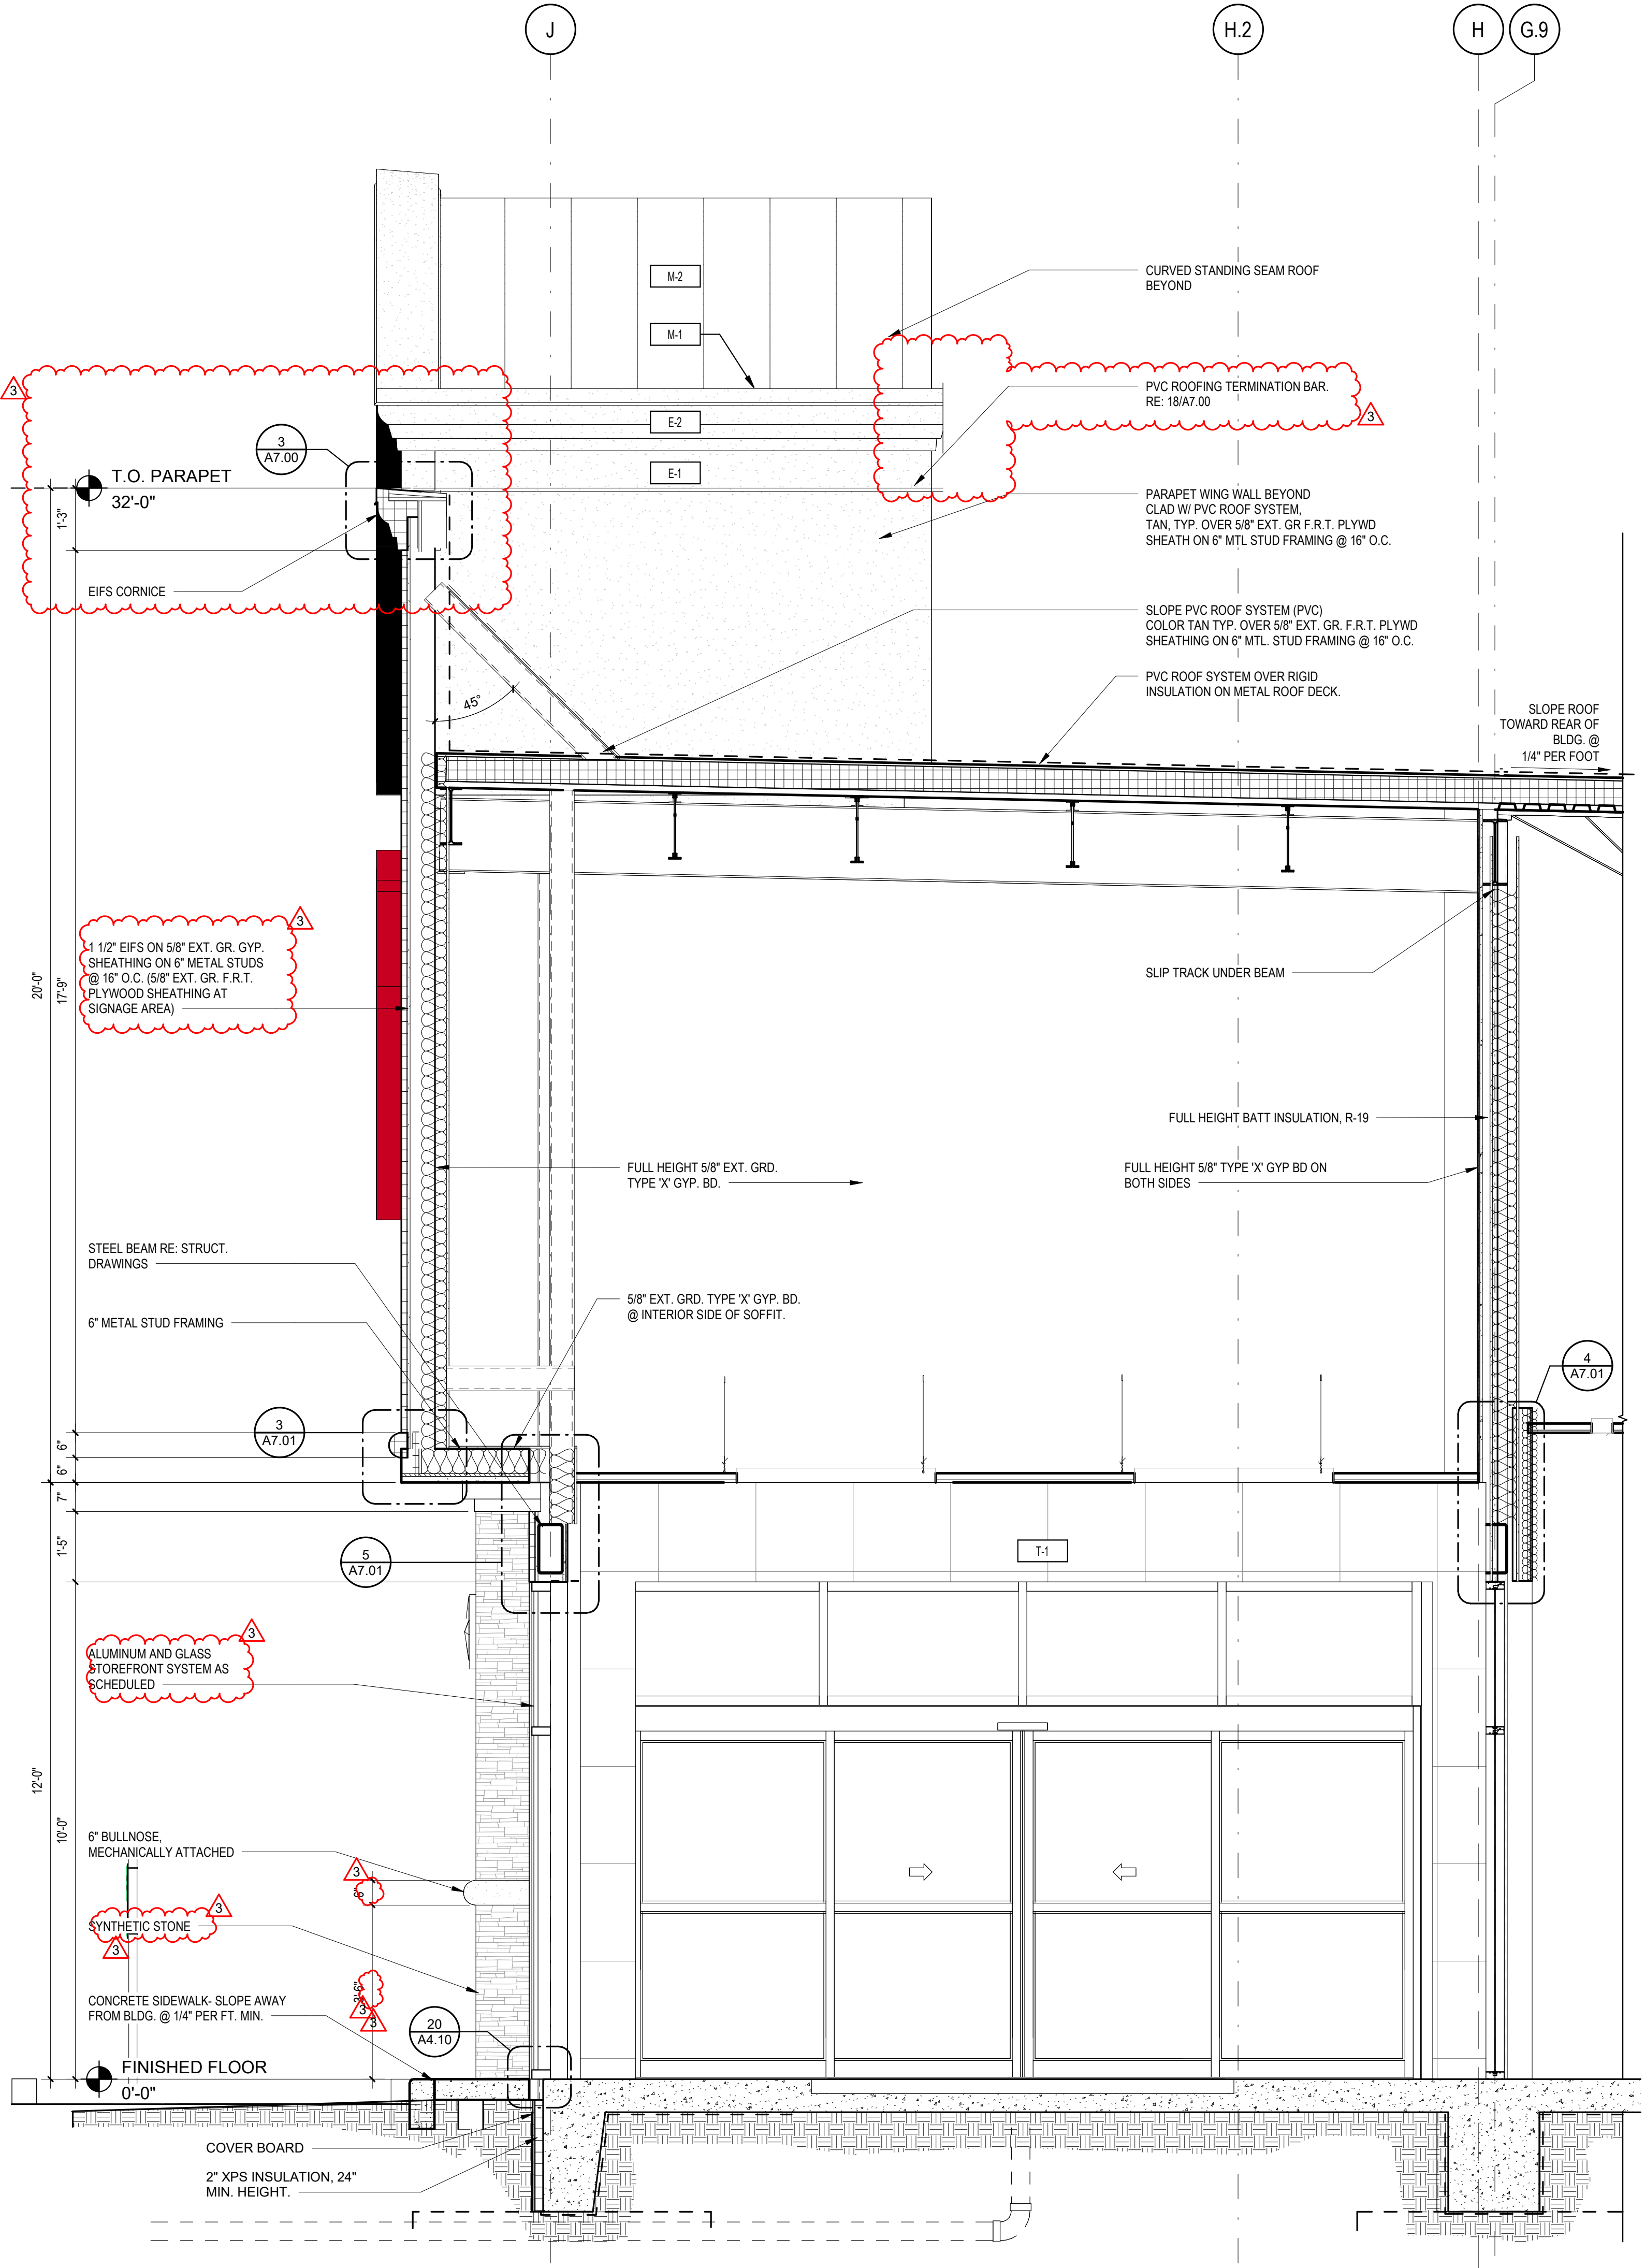

1 WALL SECTION

1/2" = 1'-0"



**BUC-EE'S**

A DEVELOPMENT OF

Buc-ee's Benton, LLC  
Saline County, Arkansas

TEL: (979) 230-2920

**BUC-EE'S TRAVEL CENTER**  
**BENTON, ARKANSAS**  
**74K - L - 2025 -Q1**  
**INTERSTATE 30 & STATE HIGHWAY 229**  
**BENTON, ARKANSAS 72019**

**LAWRENCE S. LEVINSON, A.I.A.**

7800 Washington Ave., Suite 600 Houston, TX 77007  
main: 713.600.3600 www.laarc.com

ISSUE/REVISION LOG:

No.	DESCRIPTION	DATE
3	OWNER CHANGES	04/23/2025



04/23/2025

ISSUED FOR REVIEW: 04/26/2024

ISSUED FOR BID: 05/14/2024

ISSUED FOR PERMIT: 05/14/2024

Copyright 2024 Lawrence S. Levinson, AIA. Warning: This document is protected by U.S. Copyright Law Under Section 102 of the U.S. Copyright and the Architectural Works Copyright Protection Act of 1990. Unauthorized reproduction and distribution of this document or any portion of it, other than for use of the particular project, is prohibited and may result in severe civil and criminal penalties, and will be prosecuted to maximum extent possible under the law.

**A6.01**

WALL SECTIONS

LAARC PROJECT NUMBER: 2024-107.000

**BENTON, ARKANSAS**