



BUC-EE'S

A DEVELOPMENT OF

Buc-ee's Benton, LLC
Saline County, AR

TEL: (979) 230-2920


BUC-EE'S TRAVEL CENTER
BENTON, ARKANSAS
74K - L - 2024 - Q2
INTERSTATE 30 & STATE HIGHWAY 229
BENTON, ARKANSAS 72019

**LAWRENCE S.
LEVINSON, A.I.A.**

7800 Washington Ave., Suite 600
main: 713.600.3600
Houston, TX 77007
www.laarc.com

**HENDERSON
ENGINEERS**
8345 LENEKA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
2450001433
AR CORPORATE NO. 484
EXPIRES 12/31/2025

ISSUE/REVISION LOG:
No. DESCRIPTION DATE
3 Revision 3 - Owner Changes 04/23/2025

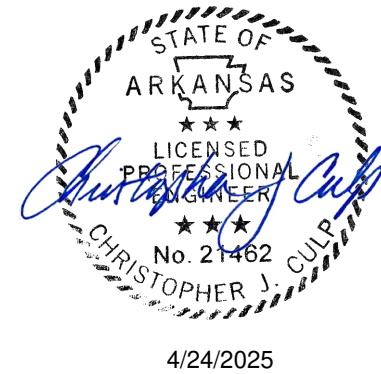

ISSUED FOR REVIEW: 05/14/2024
ISSUED FOR BID: 05/14/2024
ISSUED FOR PERMIT: 05/14/2024

Copyright 2024 Lawrence S. Levinson, AIA. Warning: This document is protected by U.S. Copyright Law Under Section 102 of the U.S. Copyright and the Architectural Works Copyright Protection Act of 1990. Unauthorized reproduction and distribution of this document or any portion of it, other than for use of this particular project, is prohibited and may result in severe civil and criminal penalties, and will be prosecuted to maximum extent possible under the law.

FA1.01

**FIRE ALARM FLOOR PLAN -
AREA A**

LSL PROJECT NUMBER: 2024-107.000

BENTON, ARKANSAS

Key Value	Keynote Text
1	CONNECT EXTERIOR WATERFLOW NOTIFICATION APPLIANCE TO FIRE ALARM SYSTEM.
2	CONNECT FIRE SPRINKLER MONITORING DEVICES TO FIRE ALARM SYSTEM. COORDINATE QUANTITY AND LOCATION OF DEVICES WITH FIRE PROTECTION SYSTEMS.
3	PROVIDE EQUIPMENT AND CONNECTION(S) REQUIRED TO SHUTDOWN TENANT AUDIO SYSTEM IN THE EVENT OF AN ALARM.
4	PROVIDE NEW FIRE ALARM CONTROL PANEL. PROVIDE A SMOKE DETECTOR ABOVE THE PANEL IN ACCORDANCE WITH NFPA 72.
5	PROVIDE LOW VOLTAGE WIRING FROM DUCT DETECTOR TO REMOTE TEST STATION. MOUNT REMOTE TEST STATION IN CEILING.
6	PROVIDE FIRE ALARM EQUIPMENT SUITABLE FOR ENVIRONMENTAL CONDITIONS.
7	PROVIDE REMOTE POWER SUPPLY TO POWER VISIBLE NOTIFICATION APPLIANCES.
8	PROVIDE DUCT MOUNTED SMOKE DETECTOR FOR FAN POWERED MECHANICAL AIR HANDLING EQUIPMENT SHUTDOWN. INSTALL DETECTOR PER MANUFACTURERS RECOMMENDATIONS. REFER TO MECHANICAL SHEETS FOR EQUIPMENT AND DUCTWORK LAYOUT AND DETAILS.
9	PROVIDE EQUIPMENT AND CONNECTIONS TO THE BACKFLOW IN YARD SUITABLE FOR THE ENVIRONMENT. REFER TO CIVIL DRAWINGS AND COORDINATE FINAL LOCATION IN THE FIELD. PROVIDE SURGE SUPPRESSION DEVICES FOR ALL CIRCUITS ENTERING/LEAVING THE BUILDING.

