WARNING SIGNS

- A. PAINT EMERGENCY SHEAR VALVES INSIDE OF THE DISPENSER SUMPS AS FOLLOWS: REGULAR - WHITE PREMIUM - RED NON-ETHANOL - BLUE DIESEL - YELLOW
- B. ALL TEST PORT FITTINGS TO BE ROTATED 45° FROM THE BOTTOM OF THE SUMP.
- . REMOVE PIPING INTERSTITIAL JUMPERS AND SCHRADER VALVES FROM UDCs, OR CUT JUMPER TUBES, FOLLOWING SECONDARY PIPING AIR TESTING (EXCEPT FOR DEF ONLY UDCs).

SIDE B

(OP4)

PRIMARY

FIBERGLASS ELBOW

PER SECTION 9.2.5.4 OF NFPA 30A-2015, WARNING SIGNS SHALL BE CONSPICUOUSLY POSTED IN THE DISPENSING AREA AND SHALL INCORPORATE THE FOLLOWING OR EQUIVALENT WORDING:

WARNING: IT IS UNLAWFUL AND DANGEROUS TO DISPENSE GASOLINE INTO UNAPPROVED CONTAINERS. NO SMOKING.


STOP MOTOR. NO FILLING OF PORTABLE CONTAINERS IN OR ON A MOTOR VEHICLE. PLACE CONTAINER ON GROUND BEFORE FILLING DISCHARGE YOUR STATIC ELECTRICITY BEFORE FUELING BY TOUCHING A METAL SURFACE AWAY FROM THE NOZZLE. DO NOT RE-ENTER YOUR VEHICLE WHILE GASOLIN IS PUMPING. IF A FIRE STARTS, DO NOT REMOVE NOZZLE BACK AWAY IMMEDIATELY.

DO NOT ALLOW INDIVIDUALS UNDER LICENSED AGE


TO USE THE PUMP.

PER SECTION 9.5.3 OF NFPA 30A-2015, IN ADDITIONAL TO THE WARNING SIGNS SPECIFIED IN 9.2.5.4 EMERGENCY INSTRUCTIONS SHALL BE CONSPICUOUSLY POSTED IN THE DISPENSER AREA. THE INSTRUCTION SHALL INCORPORATE THE FOLLWOING OR EQUIVALENT WORDING:

EMERGENCY INSTRUCTIONS IN CASE OF FIRE OR SPILL: (1) USE EMERGENCY STOP BUTTON. (2) (2) REPORT ACCIDENT BY CALLING (SPECIFY LOCAL FIRE NUMBER). REPORT LOCATION.

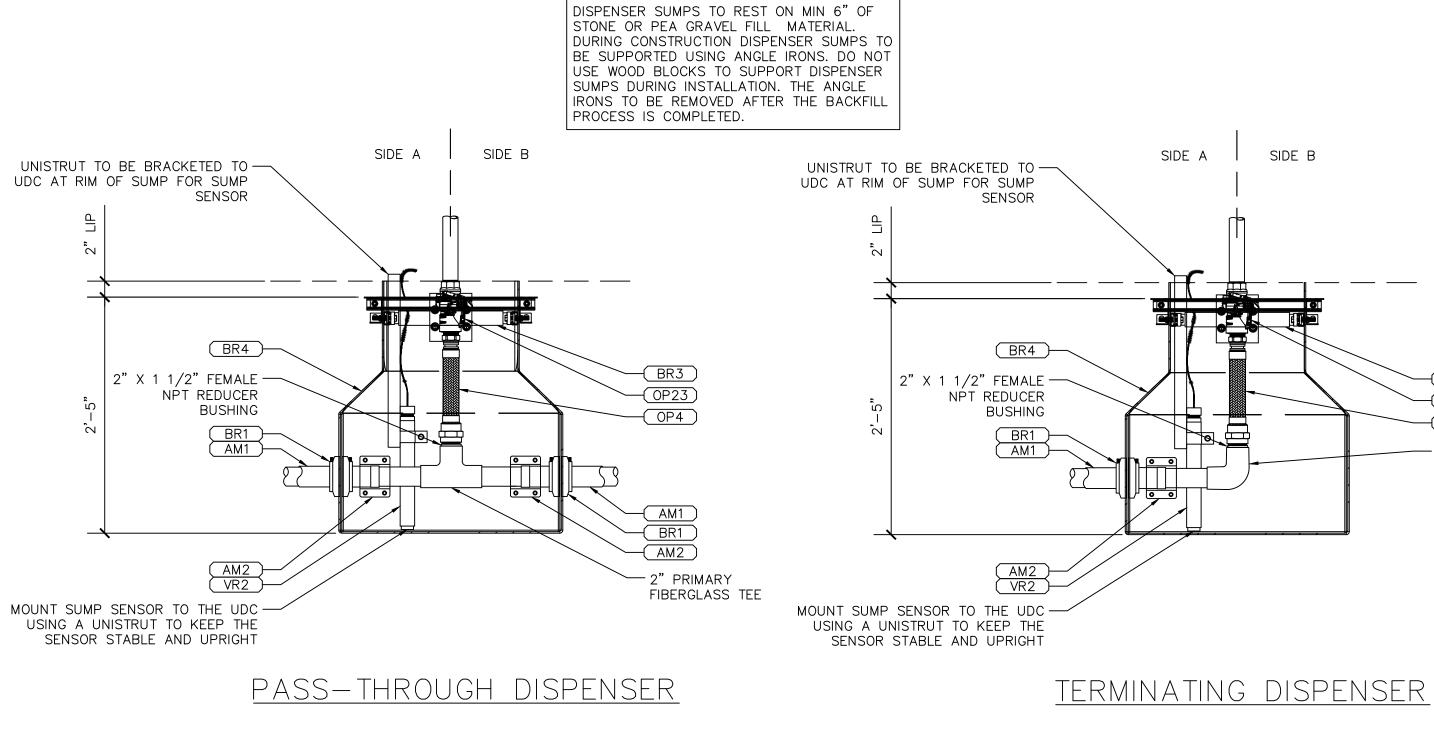

3 DISPENSER SUMP DETAILS
scale: 1" = 1'-0"

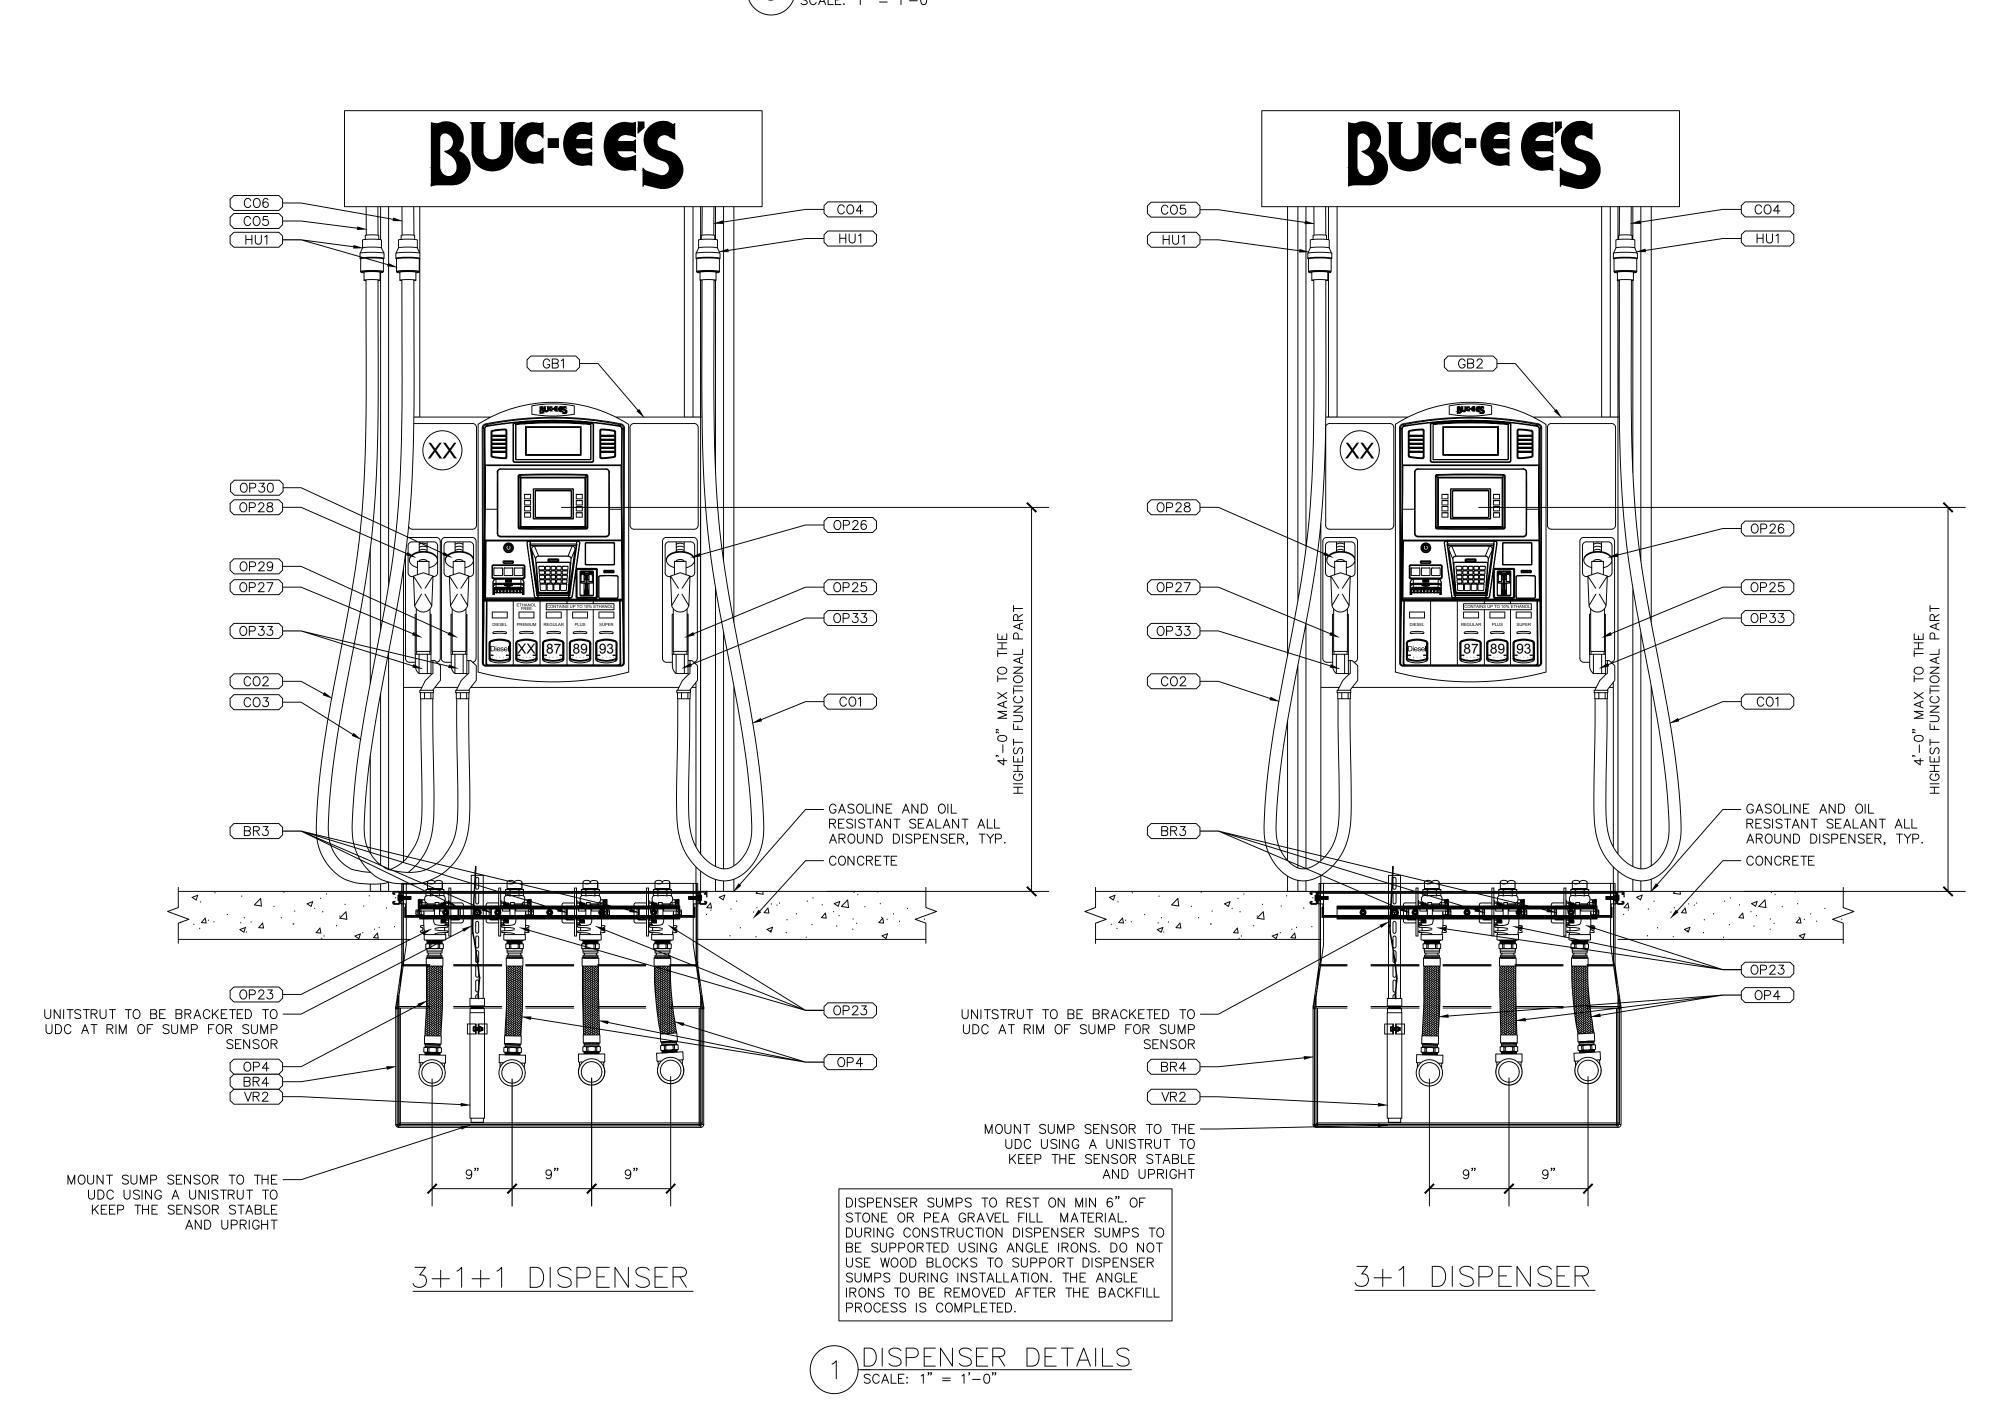



A DEVELOPMENT OF

Buc-ee's Benton, LLC. Saline County, AR

TEL: (979) 230-2920 229

HIGHWAY S 72019 STATE 30 BENTON,

LAWRENCE S. LEVINSON, A.I.A.

7800 Washington Ave., Suite 600 main: 713.600.3600

CORE STATES

Houston, TX 77007


www.laarc.com

GROUP CORESTATES, INC.

212 SE 34th Street Suite 2 Bentonville, AR 72712 479.986.4400 core-states.com

ISSUE/REVISION LOG:

DATE No. DESCRIPTION 04/23/2025 OWNER CHANGES

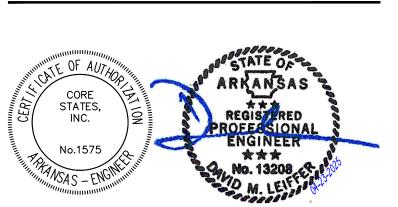


ISSUED FOR REVIEW:	04/23/2024
ISSUED FOR BID:	05/14/2024
ISSUED FOR PERMIT:	05/14/2024
DOCUMENTS PREPARED BY CORE STATES GROUP A FOR THE SPECIFIC PROJECT AND SPECIFIC USE F INTENDED. ANY EXTENSION OF USE TO OTHER PRO ANY OTHER PARTY, WITHOUT THE EXPRESSED, WRITH STATES GROUP IS DONE AT THE USER'S OWN RIS OTHER THAN THAT SPECIFICALLY INTENDED, USER W GROUP HARMLESS FROM ALL CLAIMS A	OR WHICH THEY ARE DIECTS, BY OWNER OR TEN CONSENT OF CORE SK. IF USED IN A WAY IILL HOLD CORE STATES

FS5.00

DISPENSER DETAILS

CSG PROJECT NUMBER:

LAA38552 BENTON, ARKANSAS

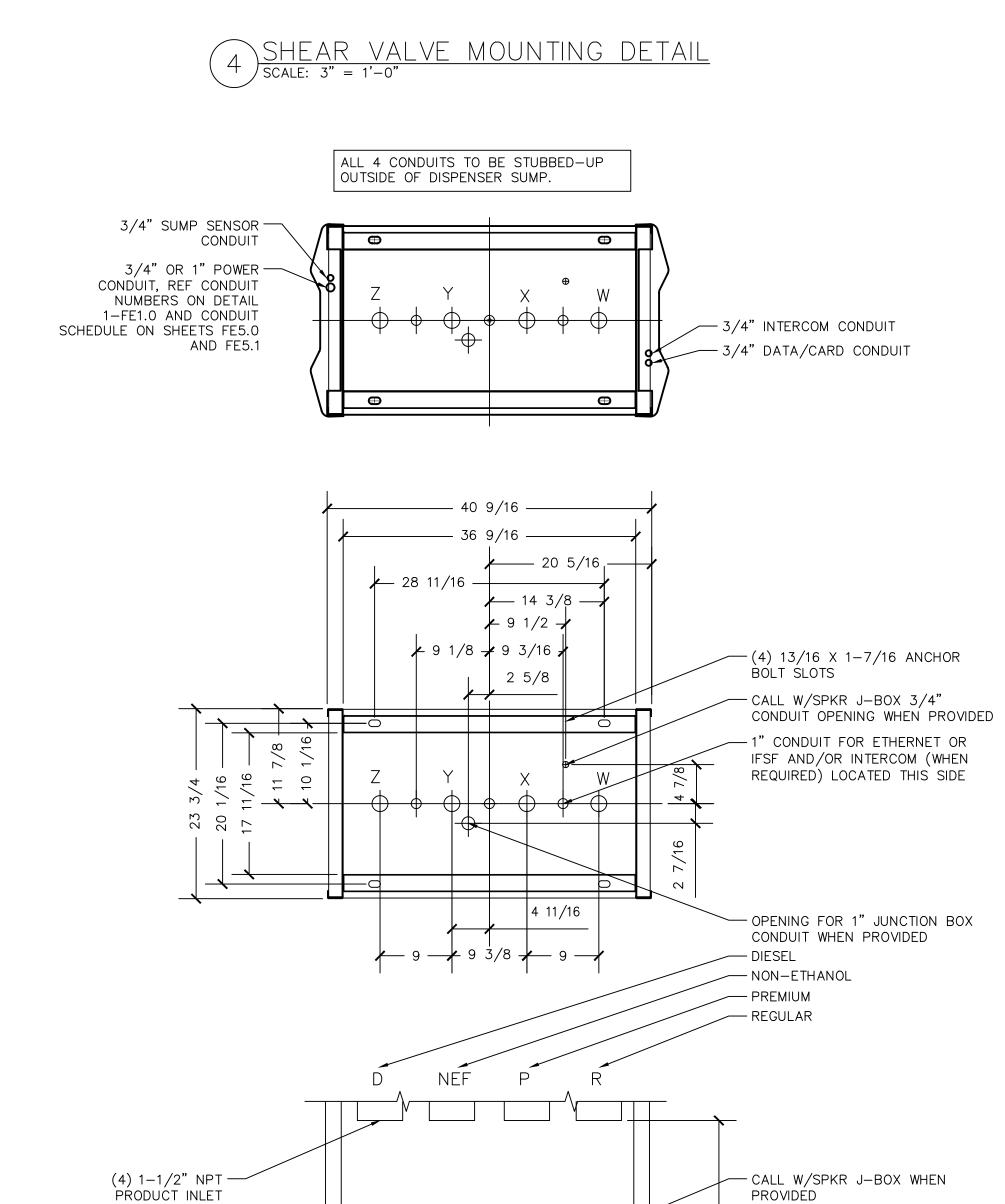

2 DISPENSER FOOTPRINT DETAILS
scale: 1" = 1'-0"

PRODUCT PIPE

SHEAR POINT OF -VALVE SET AT TOP OF ISLAND

STABILIZER — BAR KIT WITH

U-BOLT TO

SHEAR VALVE

COUPLINGS

ANCHOR

TO DISPENSER

TOP OF GRADE

– EMERGENCY

SHUT-OFF

VALVE