




3 DAMPER AND FLEX DUCT CONNECTION DETAIL NTS





2 DRYER EXHAUST VENT DETAIL NTS

1 CEILING DIFFUSER DETAIL NTS

1. FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0". EXTEND RIGID DUCT AS REQUIRED.

NOTES: REFER TO SPECIFICATIONS FOR FLEXIBLE DUCTWORK INSTALLATION REQUIREMENTS.

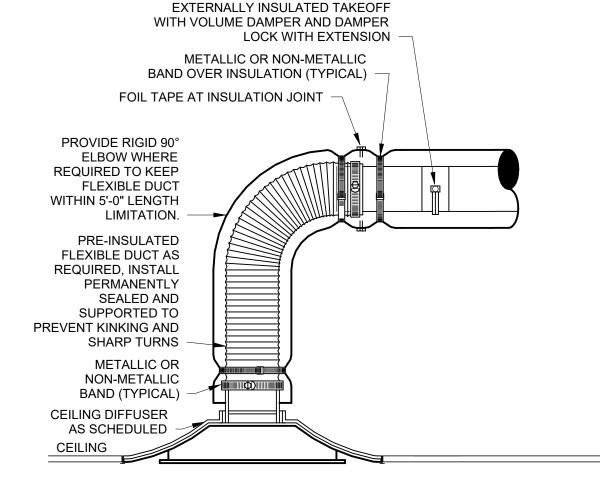


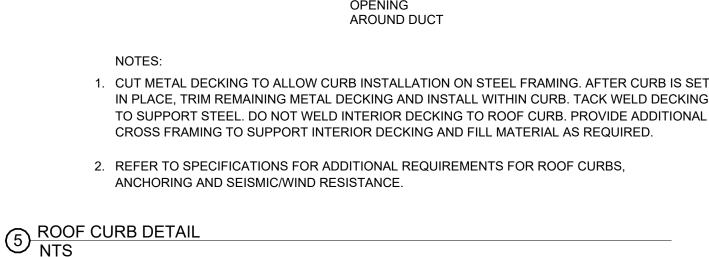

ROOFTOP UNIT ROOFTOP UNIT BASE RAIL SEALING MATERIAL SECURE UNIT TO CURB WOOD NAILER - OMIT WHERE WOOD NOT SHEET METAL FLASHING RECEIVER ALLOWED BY LOCAL BUILDING CODE HIGH-DOMED, CAPPED, GASKETED FASTENERS (APPROX. 18" O.C. AND MINIMUM TWO FASTENERS PER SIDE) G.I. COUNTERFLASHING EXTENSION OF ROOF MEMBRANE (NOT SHOWN FOR CLARITY) PROVIDE FLASHING AT ROOF CURB BASE STRUCTURE CURB INSULATION SECURE CURB TO STRUCTURE - CAULK OPENING


NOTES: 1. ARRANGEMENT SHOWN IS SCHEMATIC, ADJUST TO SUIT FIELD CONDITIONS AND MEET LOCAL CODE REQUIREMENTS.

9 HORIZONTAL HVAC UNIT DETAIL NTS

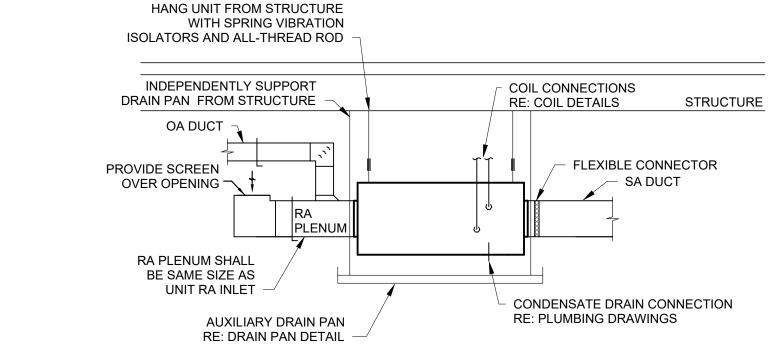

13 REGISTER MOUNTING TO RECTANGULAR DUCT DETAIL NTS

NOTES: 1. POSITION ADJUSTABLE LOUVERS DURING TESTING AND BALANCING FOR OCCUPANT COMFORT AND TO DECREASE DRAFTS IN THE SPACE.

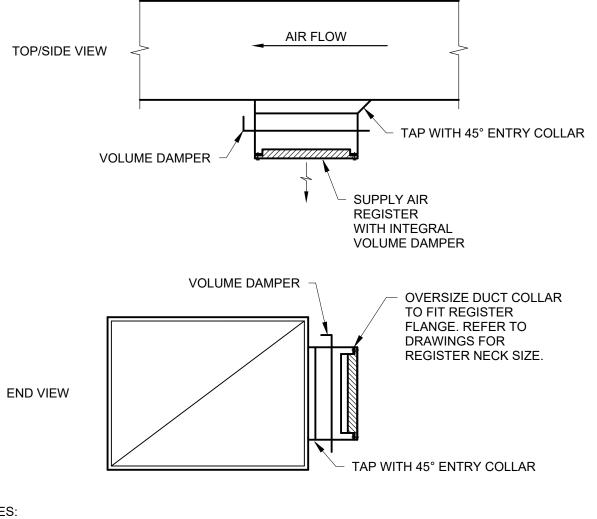

RECTANGULAR SUPPLY DUCT

