



4/24/2026 3:31:45 PM Autodesk Docs/Baxter and Vantive Mountain Home/BAXTER_VANTIVE_Mountain Home/BAXTER_VANTIVE_Mech/ELEC/CP_025.rvt

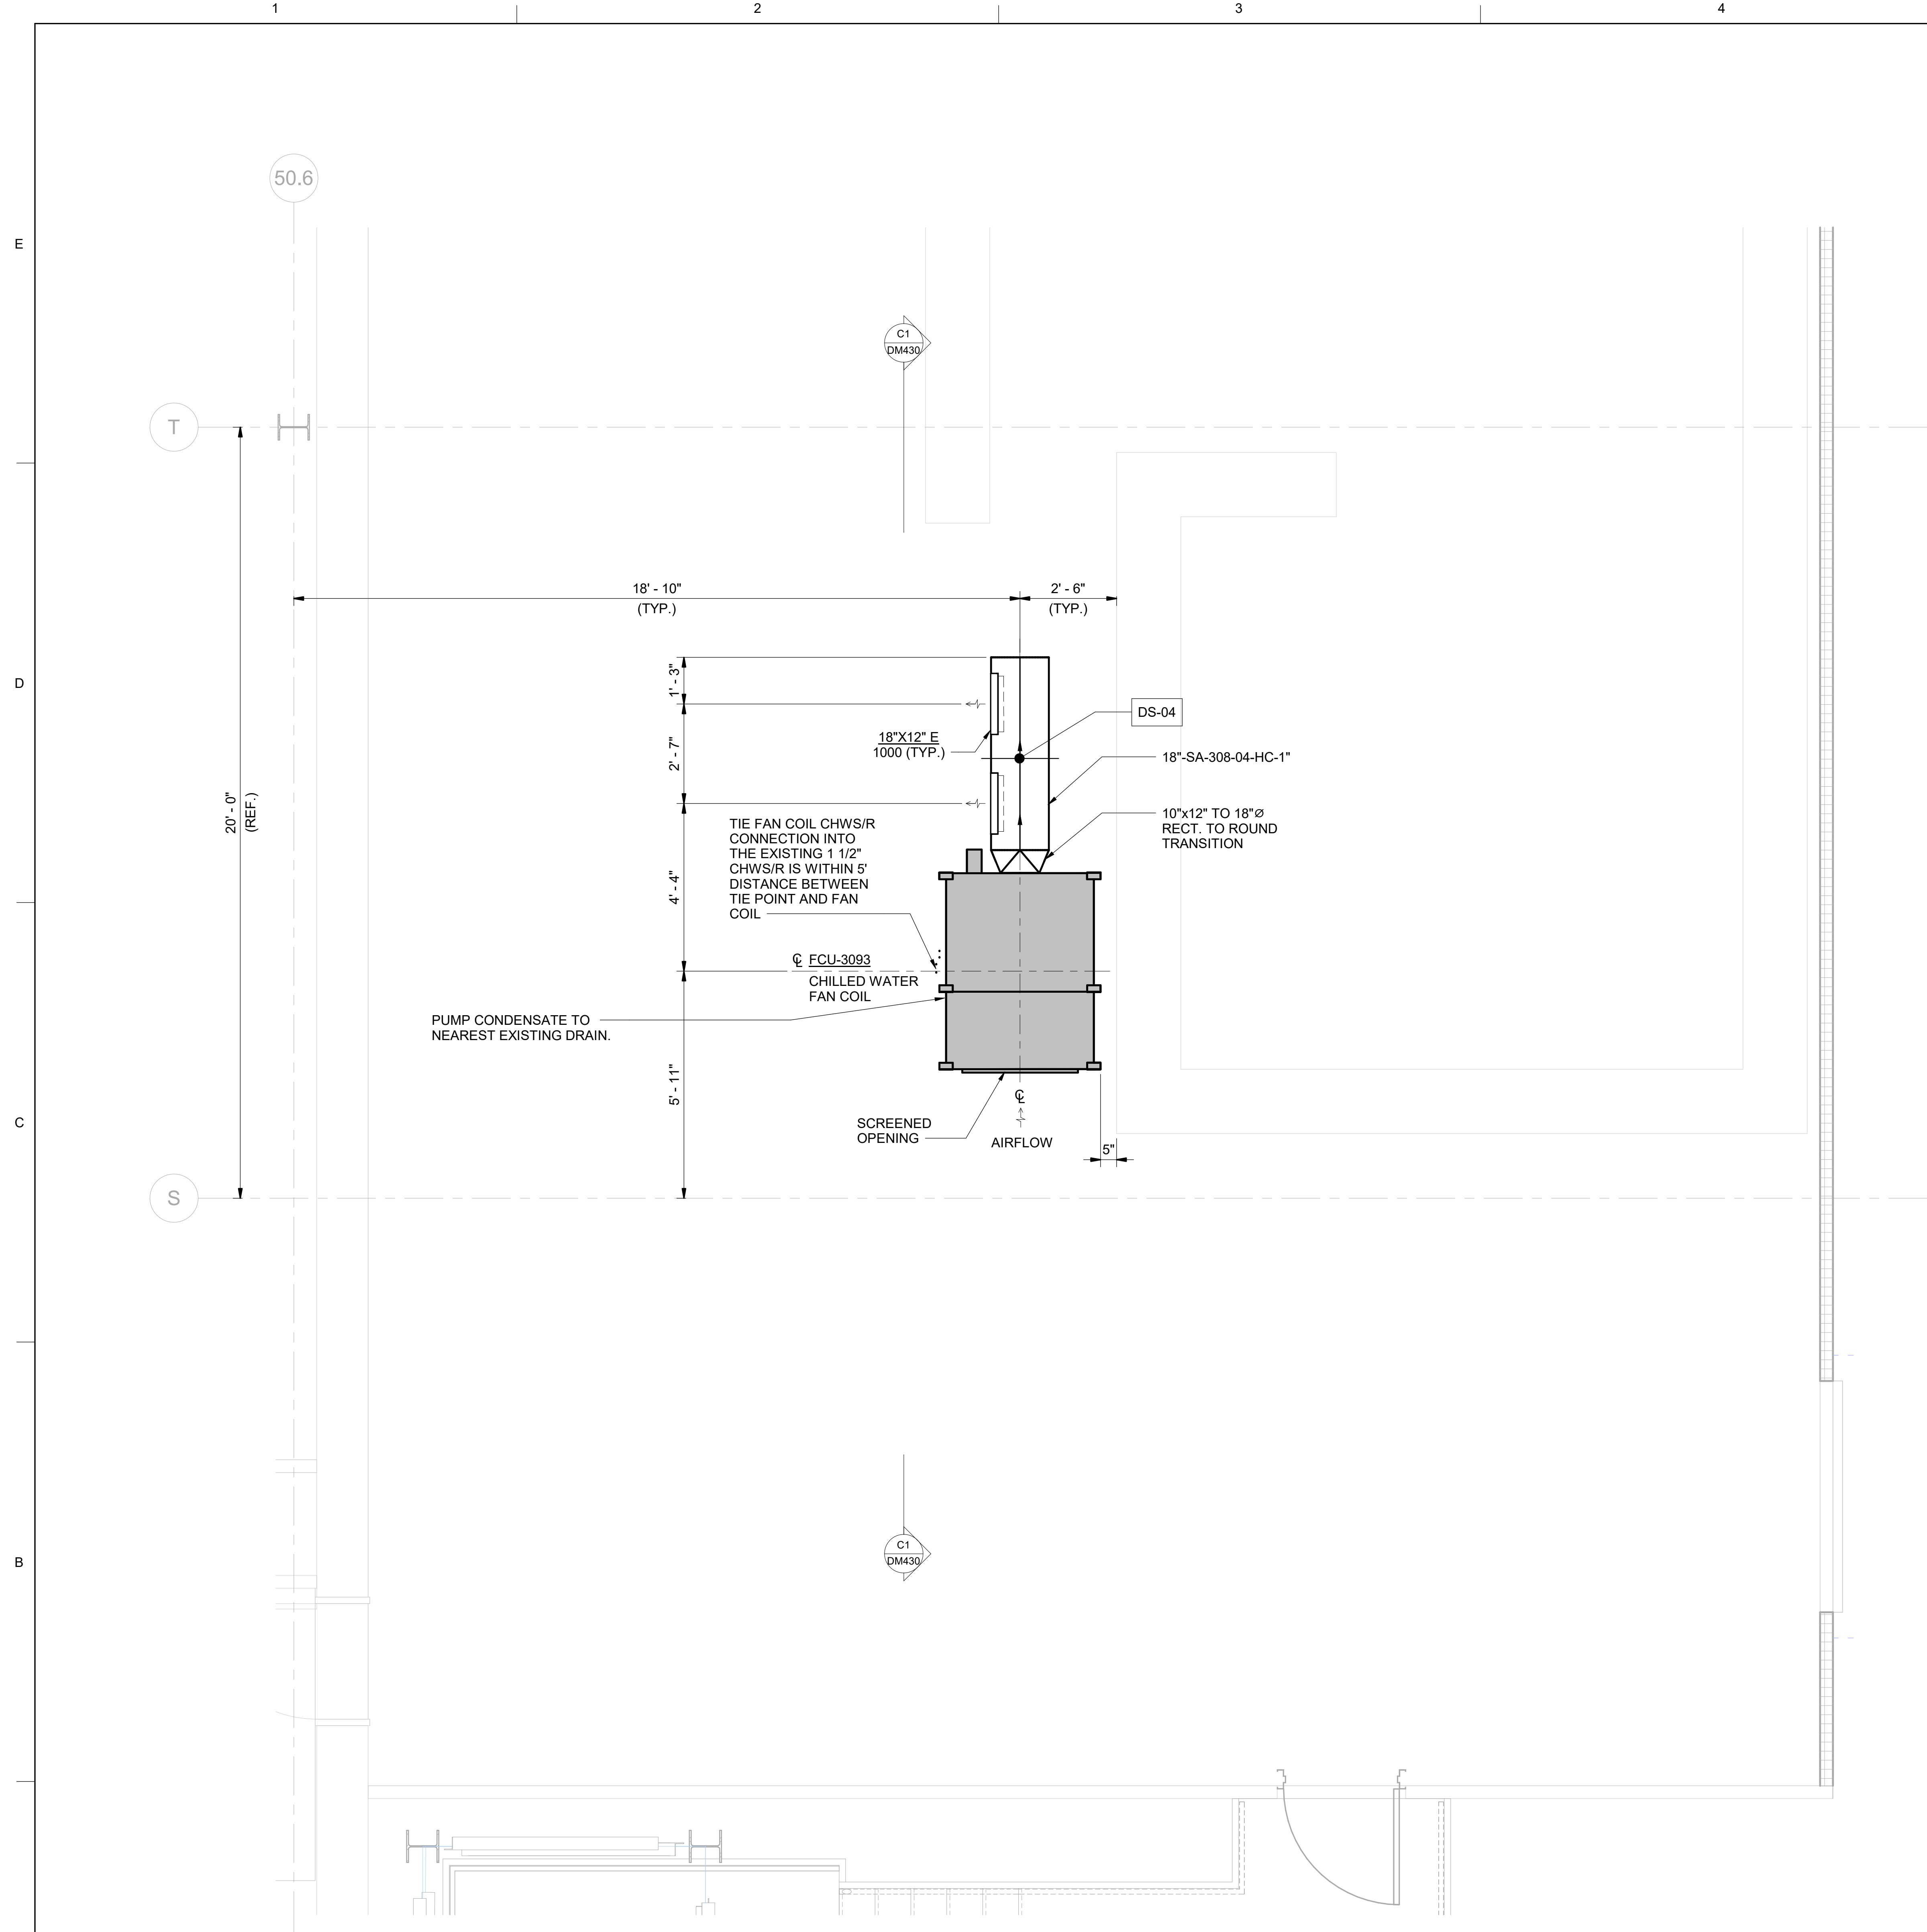

A1 DUCT - 565 PUMP ROOM ENLARGED
SCALE: 1/2" = 1'-0"

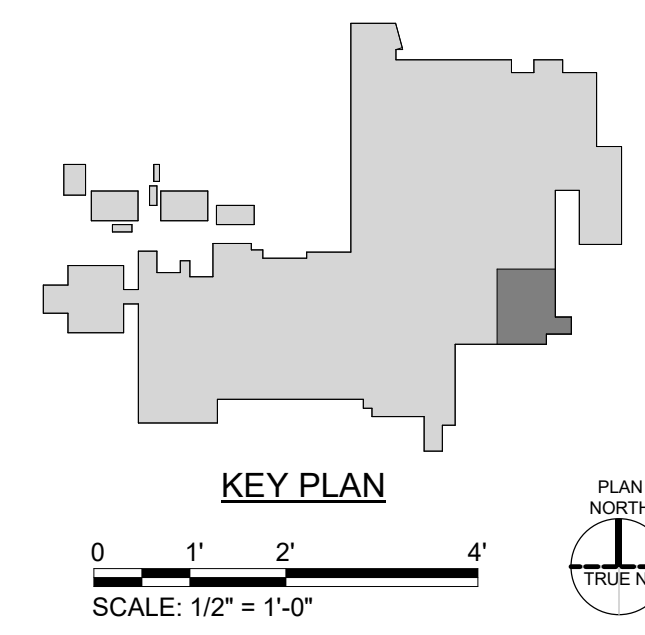

SHEET NOTES

1. REFER TO DM001 FOR PROCESS GENERAL NOTES AND DESIGN CRITERIA.
2. REFER TO DM002 FOR PROCESS ABBREVIATIONS AND LEGENDS.
3. CHILLED WATER FAN COIL FCU-3093 TO BE WALL SUPPORTED. REFER TO DM651 FOR SUPPORT DETAILS.

POND
3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092
Copyright © 2024 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

EOR/AOR SEAL

COA SEAL

CLIENT INFORMATION

Vantive

PROJECT NAME

**VANTIVE
TUBING
CLEAN ROOM**

1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

DATE	DESCRIPTION	MARK
04/24/2026	ISSUED FOR BID, EQ BID	D
01/23/2026	CLARIFICATIONS	C
11/14/2025	ISSUED FOR APPROVAL	A
	ISSUED FOR REVIEW	

DESIGNED BY: JC
DRAWN BY: JS
CHECKED BY: JC
SUBMITTED BY: CL
DATE: 04/24/2026
PROJECT #: 1241011

SHEET TITLE

**DUCT -
ENLARGED PLAN -
565 PUMP ROOM**

SHEET NUMBER

DM423

ORIGINAL SHEET SIZE:
30" X 42"

ISSUED FOR BID