

1

2

3

4

5

6

SHEET NOTES

1. REFER TO DM001 FOR PROCESS GENERAL NOTES AND DESIGN CRITERIA.
2. REFER TO DM002 FOR PROCESS ABBREVIATIONS AND LEGENDS.
3. ALL HVAC DUCTWORK, WIREWAYS, AND UTILITY PIPING IN CLEAN ROOM MUST STAY ABOVE 17'-6" INSIDE CLEAN ROOM IN PREPARATION FOR CEILING EXPANSION TO 17'-0"

POND3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092

Copyright © 2024 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

EOR/AOR SEAL

COA SEAL

CLIENT INFORMATION

Vantive

PROJECT NAME

**VANTIVE
TUBING
CLEAN ROOM**1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

04/24/2026	DATE
01/23/2026	DATE
11/14/2025	DATE

ISSUED FOR BID, EQ BID	DESCRIPTION
CLARIFICATIONS	DESCRIPTION
ISSUED FOR APPROVAL	DESCRIPTION
ISSUED FOR REVIEW	DESCRIPTION

D	C	A	MARK
---	---	---	------

DESIGNED BY:	JC
DRAWN BY:	JS
CHECKED BY:	JC
SUBMITTED BY:	CL
DATE:	04/24/2026
PROJECT #:	1241011

SHEET TITLE

**DUCT - SECTIONS
- 565 CLEAN
ROOM RETURN
AIR**

SHEET NUMBER

DM426ORIGINAL SHEET SIZE:
30" X 42"

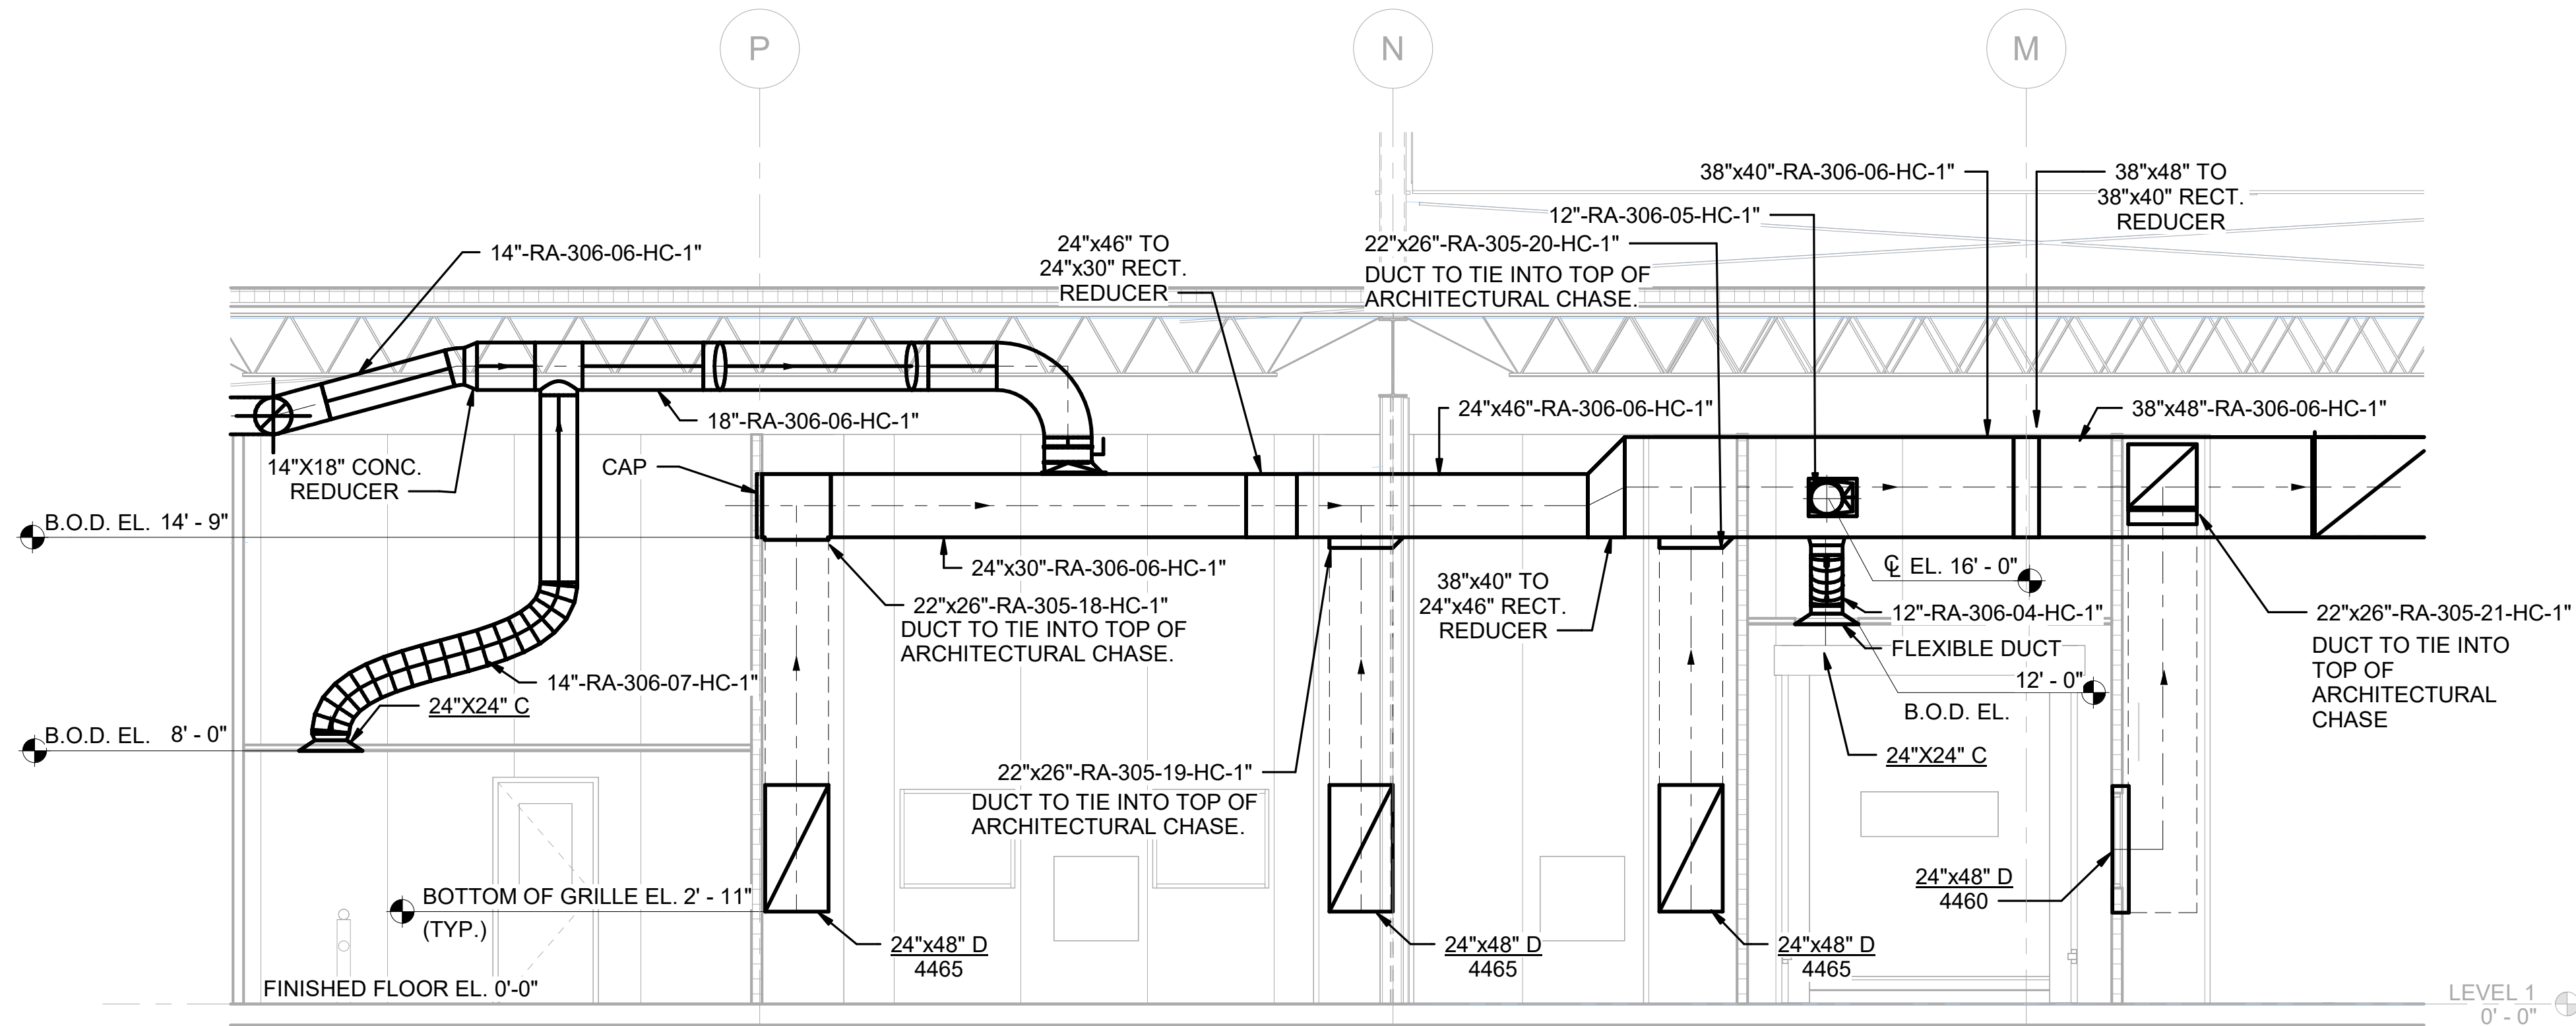
E

D

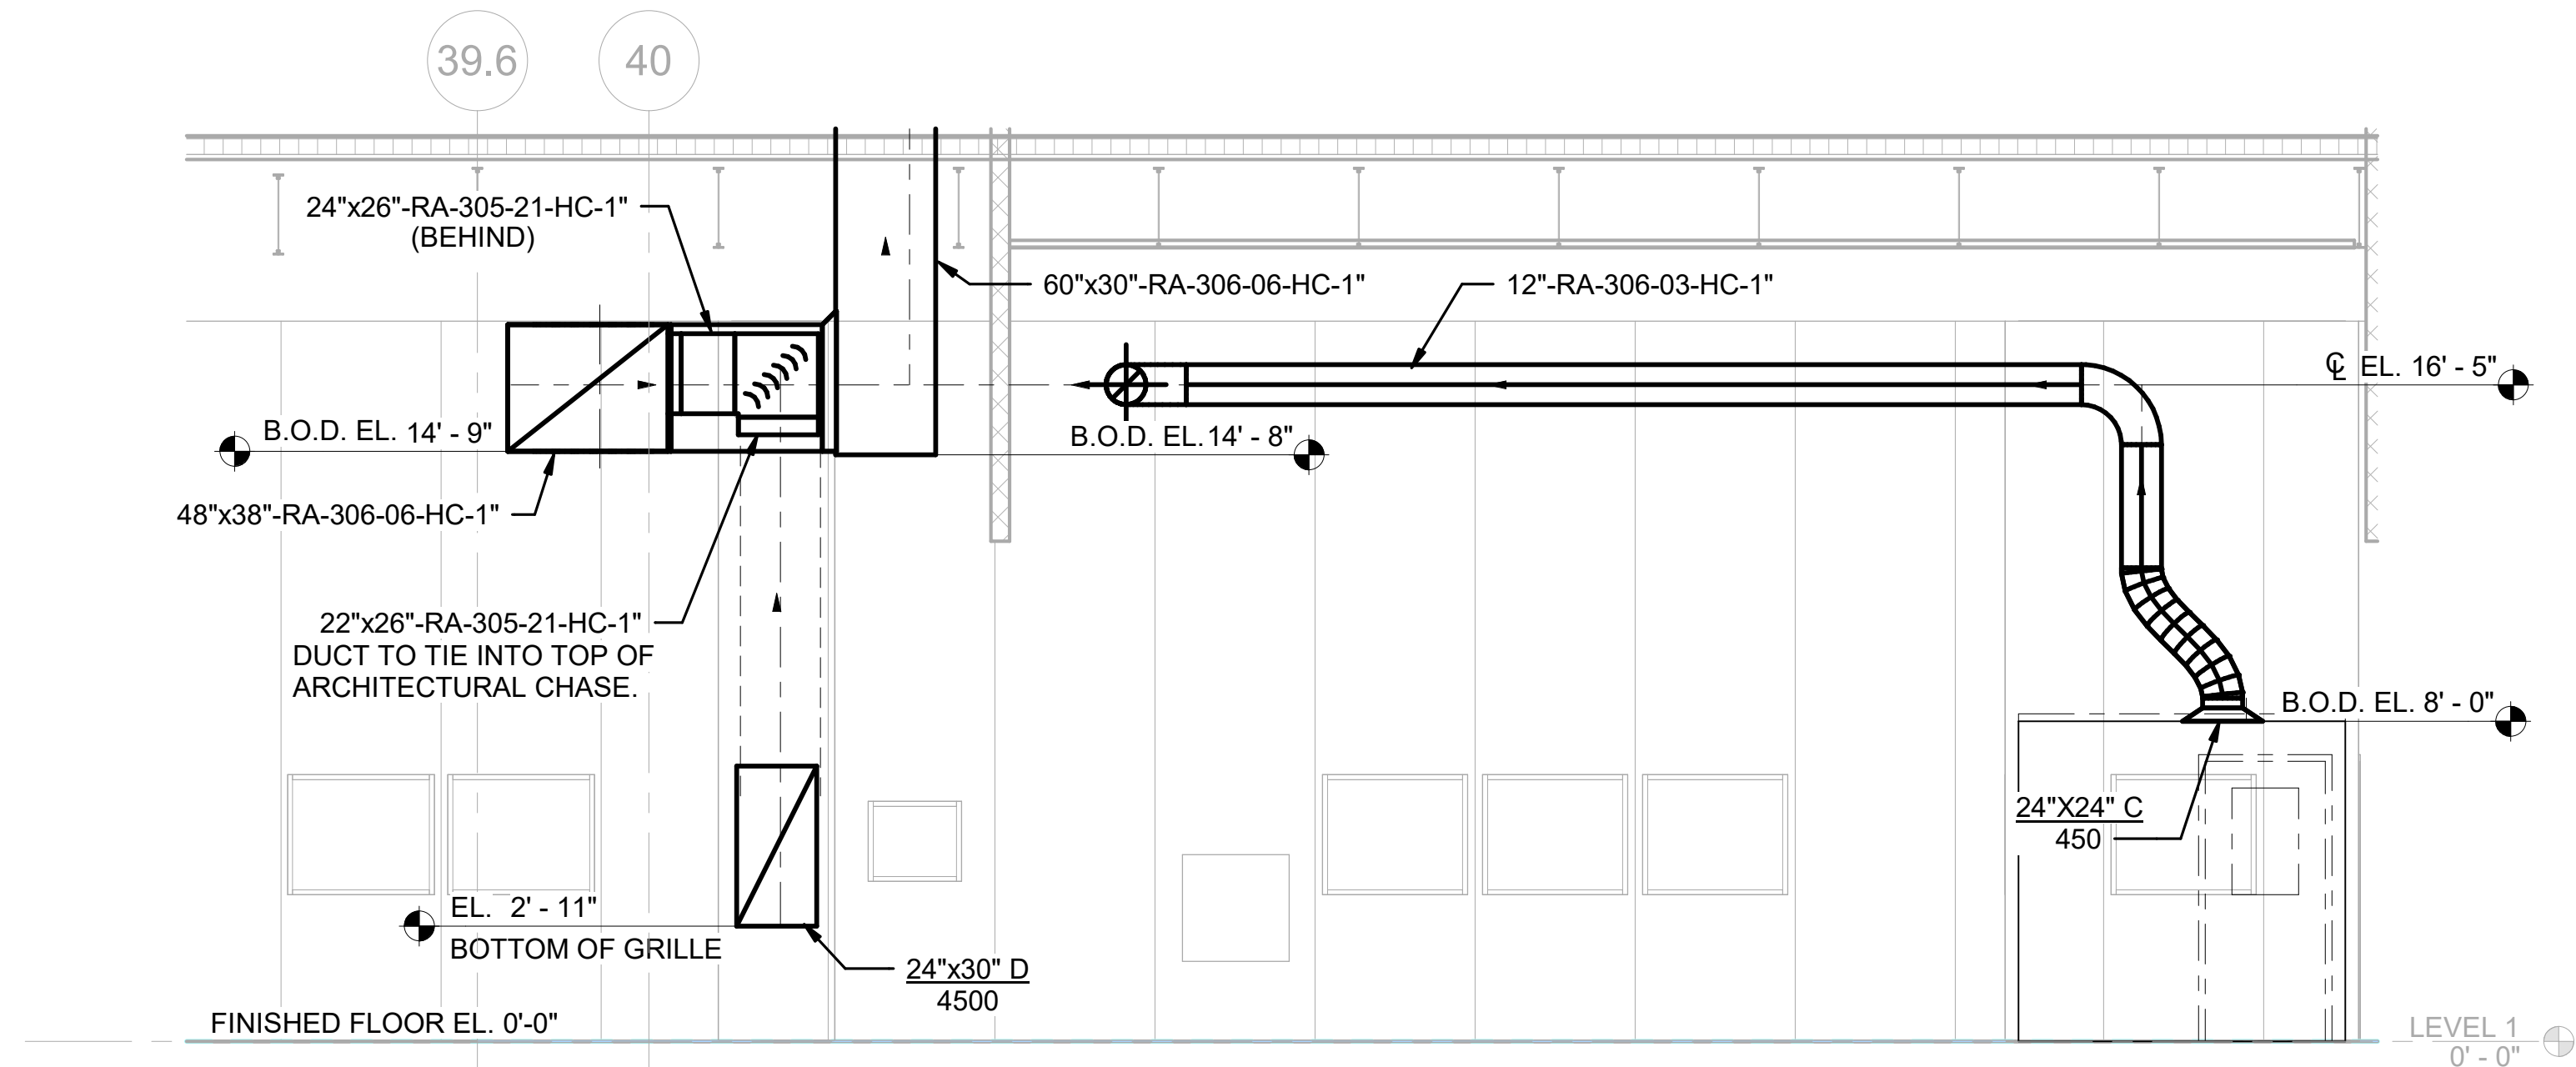
C

B

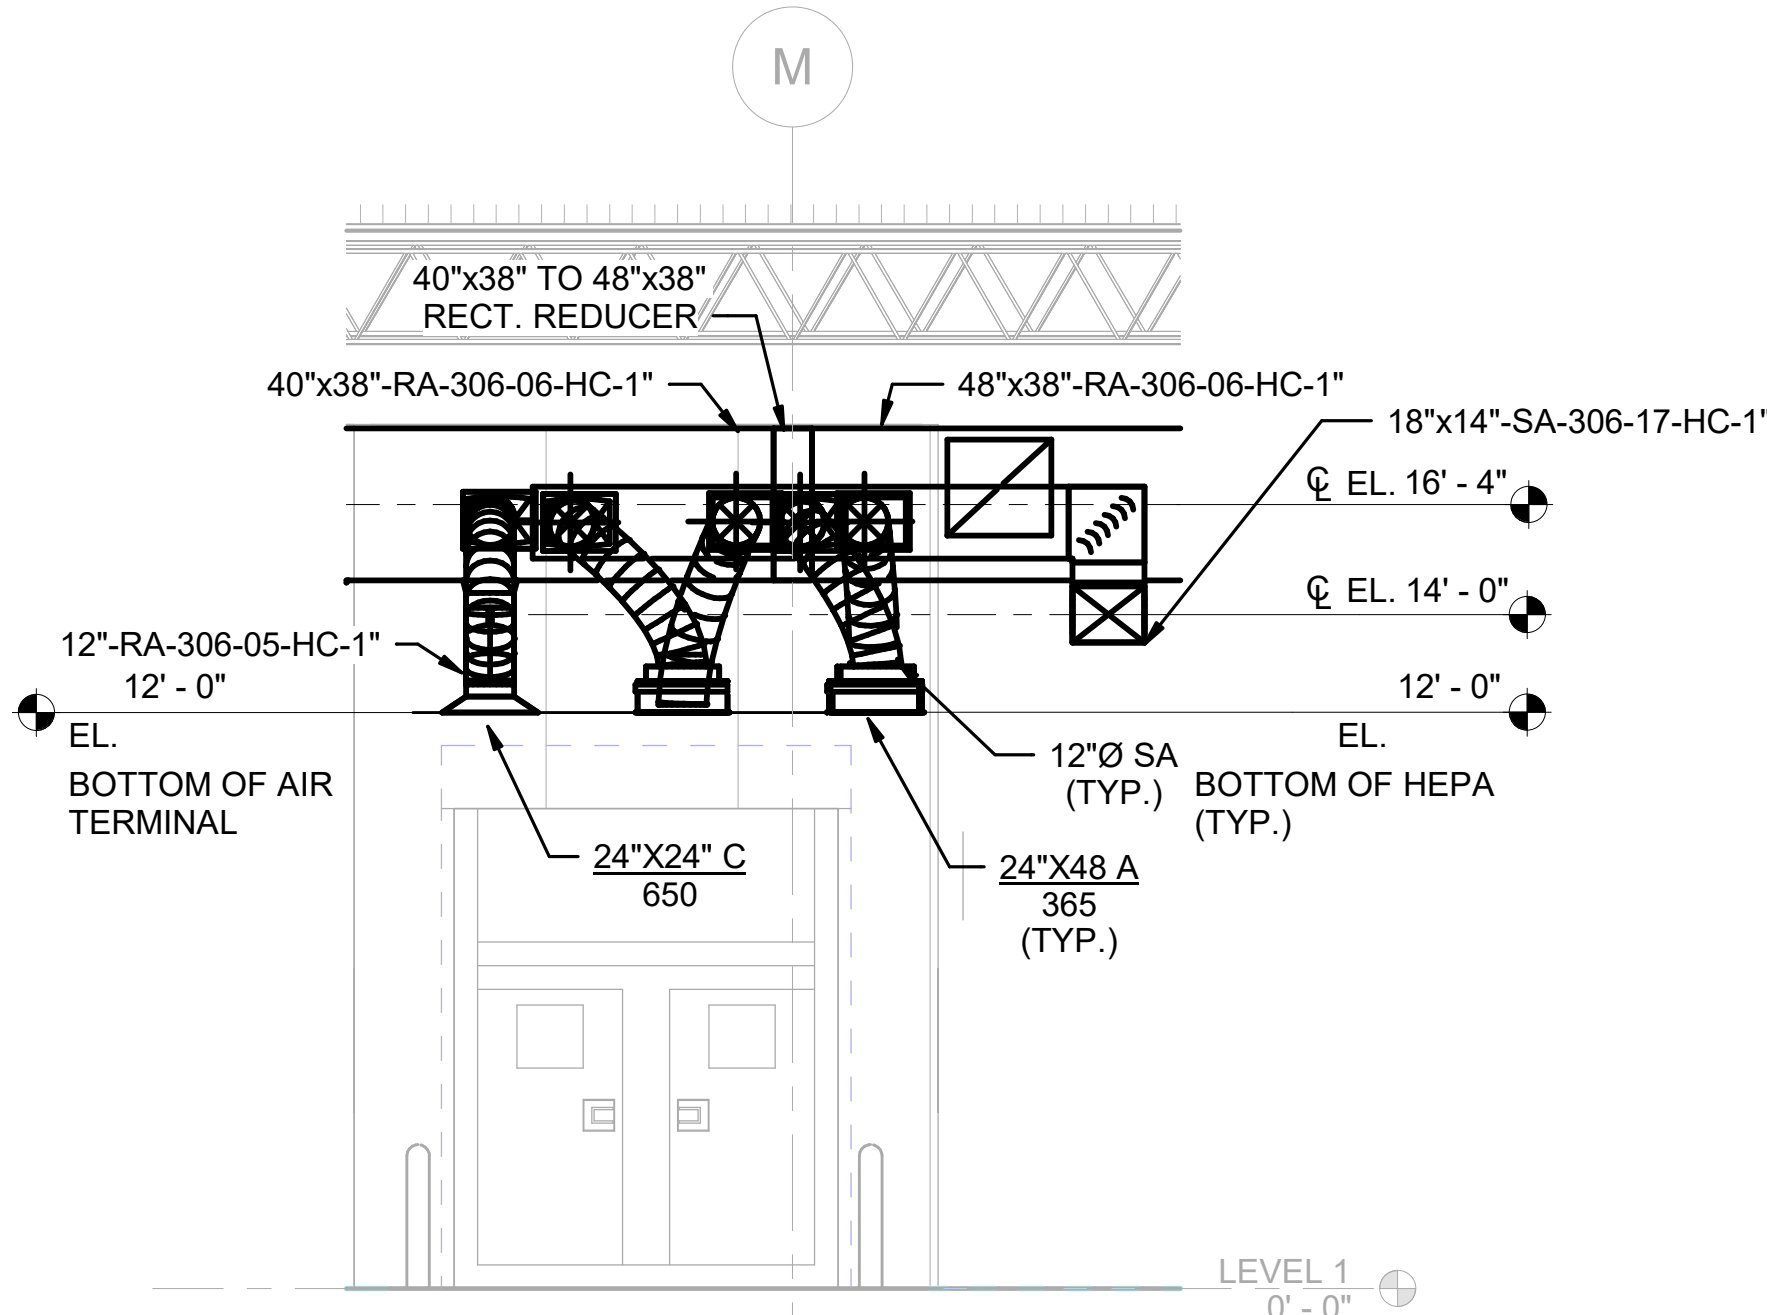
A

**D1 SOUTH - 565 RETURN AIR**

SCALE: 1/4" = 1'-0"

**C1 EAST - 565 RETURN AIR**

SCALE: 1/4" = 1'-0"

**A1 WEST - 565 MATERIAL LOCK SUPPLY AND RETURN AIR**

SCALE: 1/4" = 1'-0"

0 4' 8' 12'
SCALE: 3/16" = 1'-0"

ISSUED FOR BID