

1

2

3

4

5

6

SHEET NOTES

1. REFER TO DM001 FOR PROCESS GENERAL NOTES AND DESIGN CRITERIA.
2. REFER TO DM002 FOR PROCESS ABBREVIATIONS AND LEGENDS.
3. CHILLED WATER FAN COIL FCU-3093 TO BE WALL SUPPORTED. REFER TO DM651 FOR SUPPORT DETAILS.

POND3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092

Copyright © 2024 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

EOR/AOR SEAL

COA SEAL

CLIENT INFORMATION

Vantive

PROJECT NAME

**VANTIVE
TUBING
CLEAN ROOM**1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

04/24/2026
01/23/2026
11/14/2025
DATEISSUED FOR BID, EQ BID
CLARIFICATIONS
ISSUED FOR APPROVAL
ISSUED FOR REVIEW
DESCRIPTIOND C A
MARKDESIGNED BY: JC
DRAWN BY: JS
CHECKED BY: JC
SUBMITTED BY: CL
DATE: 04/24/2026
PROJECT #: 1241011

SHEET TITLE

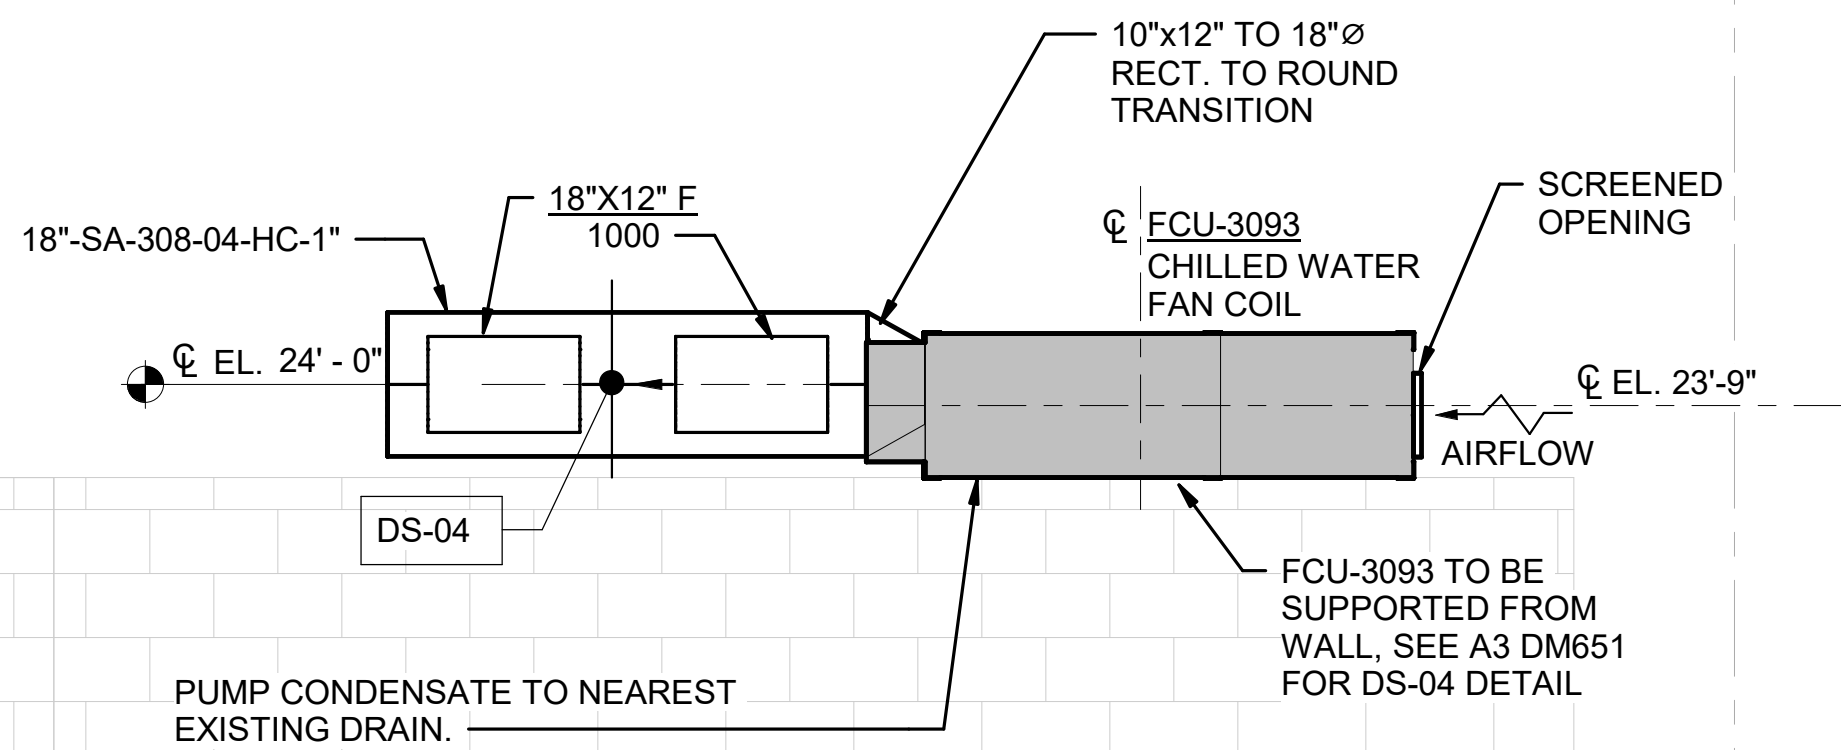
**DUCT - SECTIONS
- 565 PUMP ROOM
& OFFICE
MEZZANINE**

SHEET NUMBER

DM430ORIGINAL SHEET SIZE:
36" X 42"

T

S

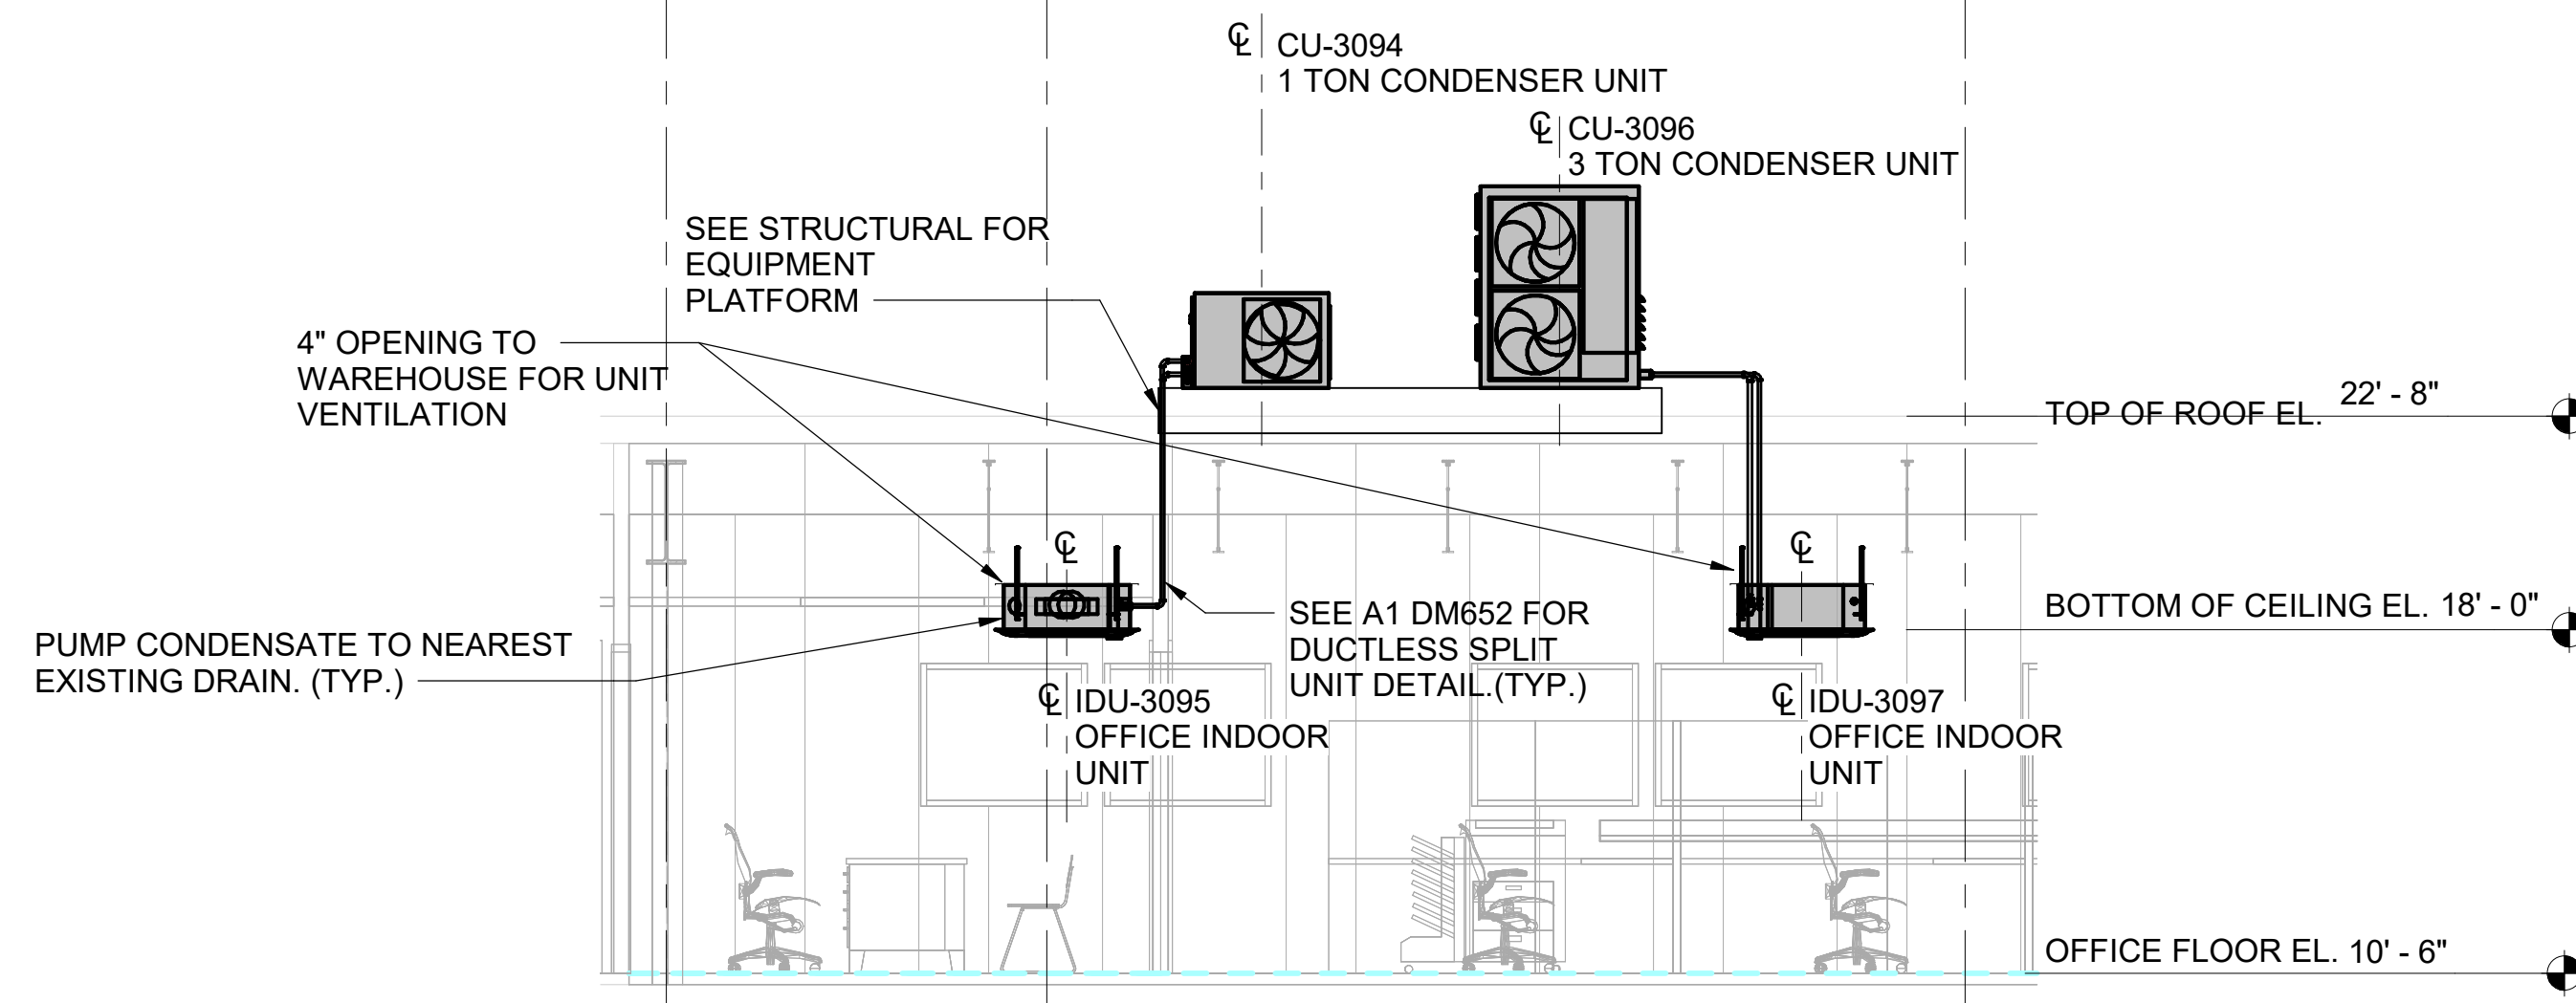
**C1 SOUTH - 565 PUMP ROOM**

SCALE: 1/2" = 1'-0"

37.3

37'

38

**B1 OFFICE MEZZANINE HVAC ELEVATIONS**

SCALE: 1/4" = 1'-0"

0 1' 2' 4'
SCALE: 1/2" = 1'-0"

ISSUED FOR BID