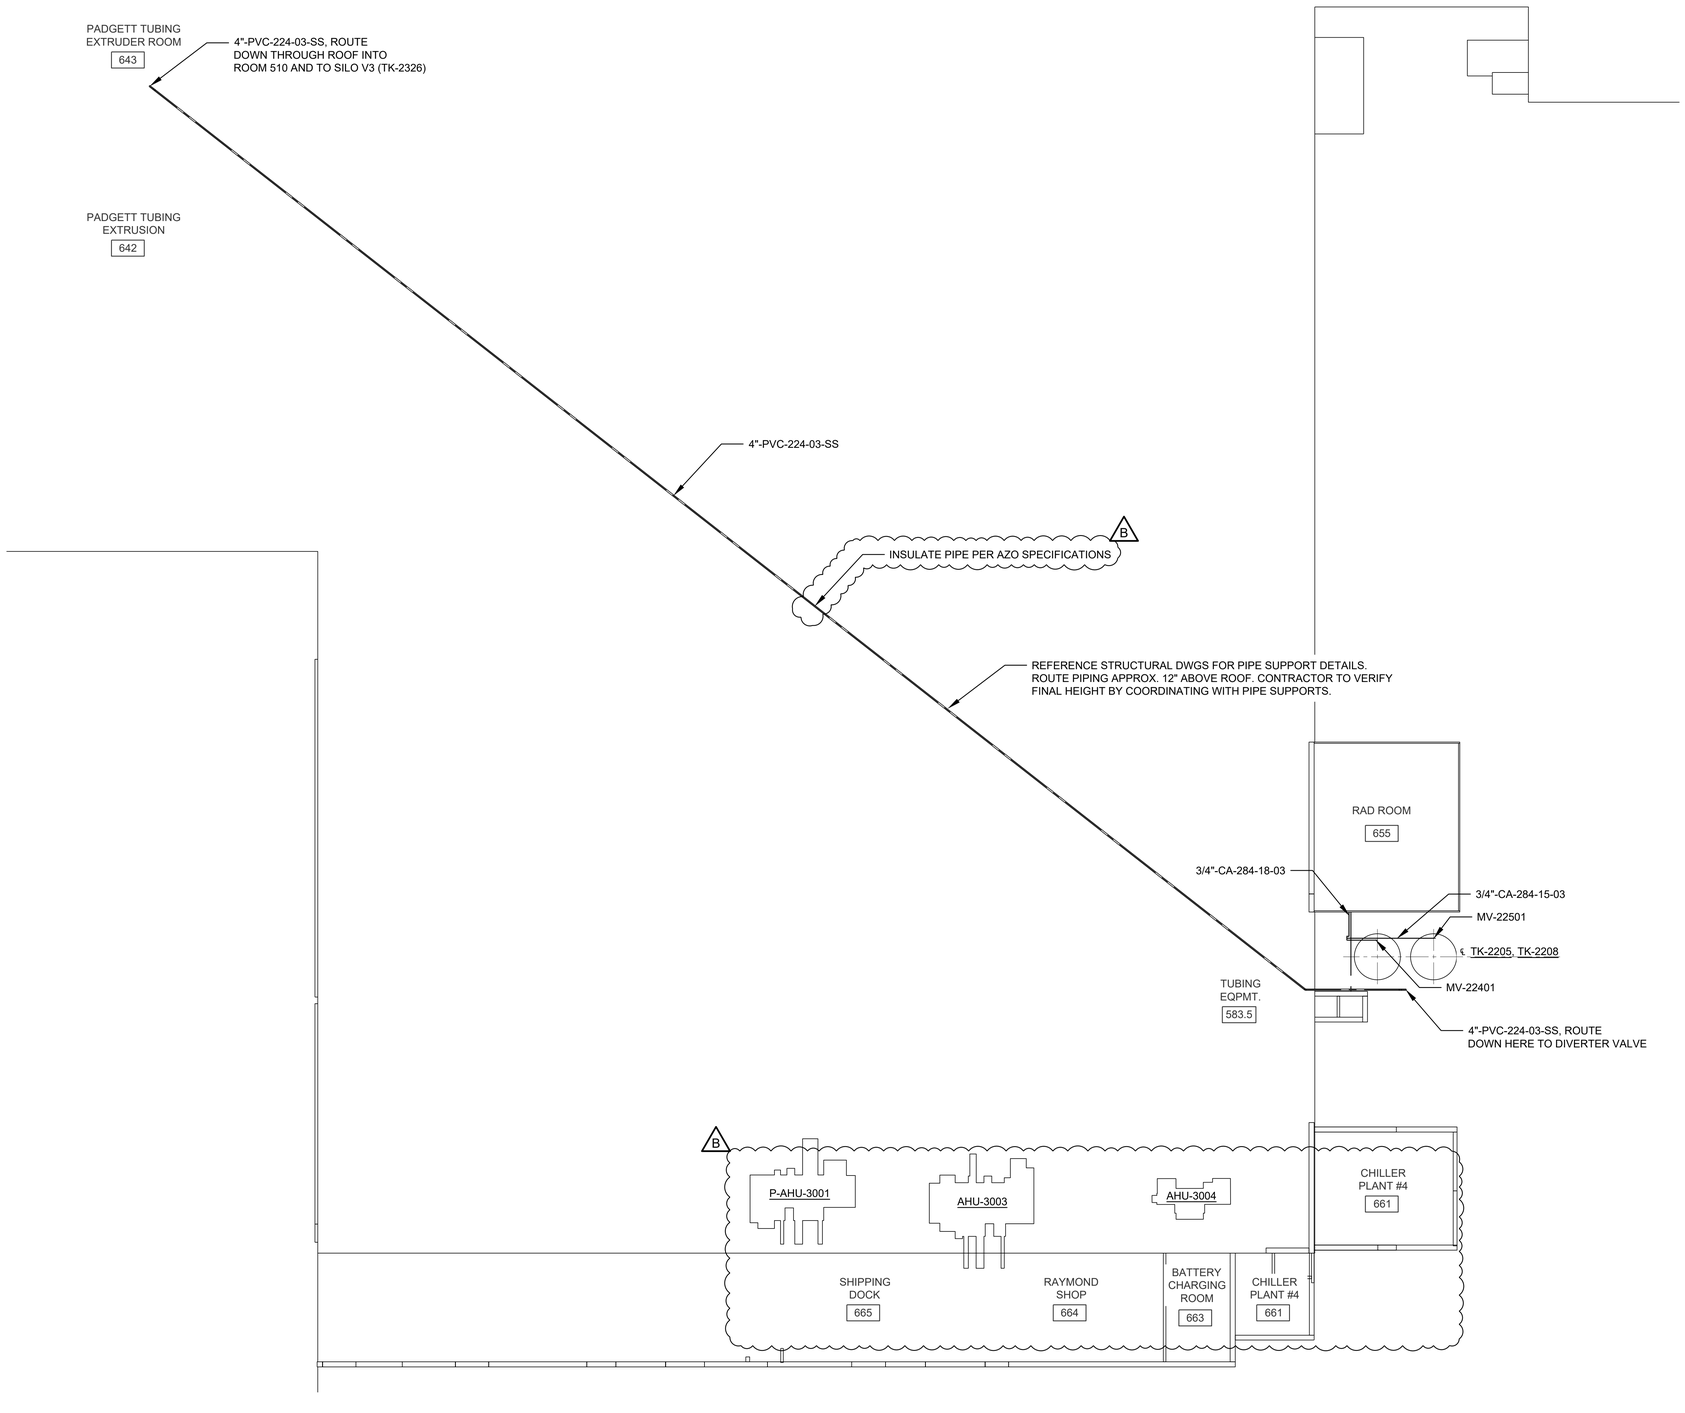

A1 ROOM 565 ROOF PIPING PLAN
1/16" = 1'-0"

SHEET NOTES:

1. SEE PIPING LINE LIST ON DMXXX FOR MATERIALS OF CONSTRUCTION.
2. SEE EQUIPMENT LIST ON DMXXX FOR EQUIPMENT RELATED TO THIS PROJECT.
3. SEE MANUAL VALVE LIST ON DMXXX FOR VALVE/DAMPER SELECTION AND SPECIFICATION.
4. ALL DIMENSIONS SHOWN ARE FIELD MEASURED. CONTRACTOR TO VERIFY BEFORE INSTALLATION.
5. ALL EQUIPMENT DIMENSIONS, MAINTENANCE SPACE, AND FINAL PLACEMENT ARE TO BE CONFIRMED BY THE CONTRACTOR PRIOR TO INSTALLATION.
6. ALL CONNECTIONS BETWEEN EQUIPMENT AND PIPING OR EQUIPMENT AND DUCT ARE TO BE CONFIRMED BY CONTRACTOR PRIOR TO INSTALLATION.
7. REFERENCE TIE POINT DWGS FOR DETAILS ON TIE POINTS.
8. REFERENCE SHEET DM600 FOR PIPE SUPPORT DETAILS.
9. B ALL AZO EQUIPMENT IS BASED OFF 3/16 SUBMITTAL PROVIDED TO VANTIVE. ANY INFORMATION MISSING OR CLASHING WILL BE COORDINATED BY CONTRACTOR BEFORE INSTALLATION.



KEY PLAN

0 8' 16' 32' 48'
SCALE: 1/16" = 1'-0"

PLAN NORTH
TRUE NORTH

POND
3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092
Copyright © 2025 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

EOR/AOR SEAL

CONSULTANT

CLIENT INFORMATION
Vantive

PROJECT NAME
VANTIVE
TUBING
CLEAN ROOM

1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

MARK	DESCRIPTION	DATE
B	ISSUED FOR BID, EQ BID CLARIFICATIONS	04/24/2026
A	ISSUED FOR BID	02/27/2026

DESIGNED BY:	CDB
DRAWN BY:	CDB
CHECKED BY:	JC
SUBMITTED BY:	CL
DATE:	02/27/2026
PROJECT #	1241011

SHEET TITLE
ROOM 565
ROOF
PIPING PLAN

SHEET NUMBER
DM442
SHEET 1 OF 1

ORIGINAL SHEET SIZE:
30" X 42"

ISSUED FOR BID