




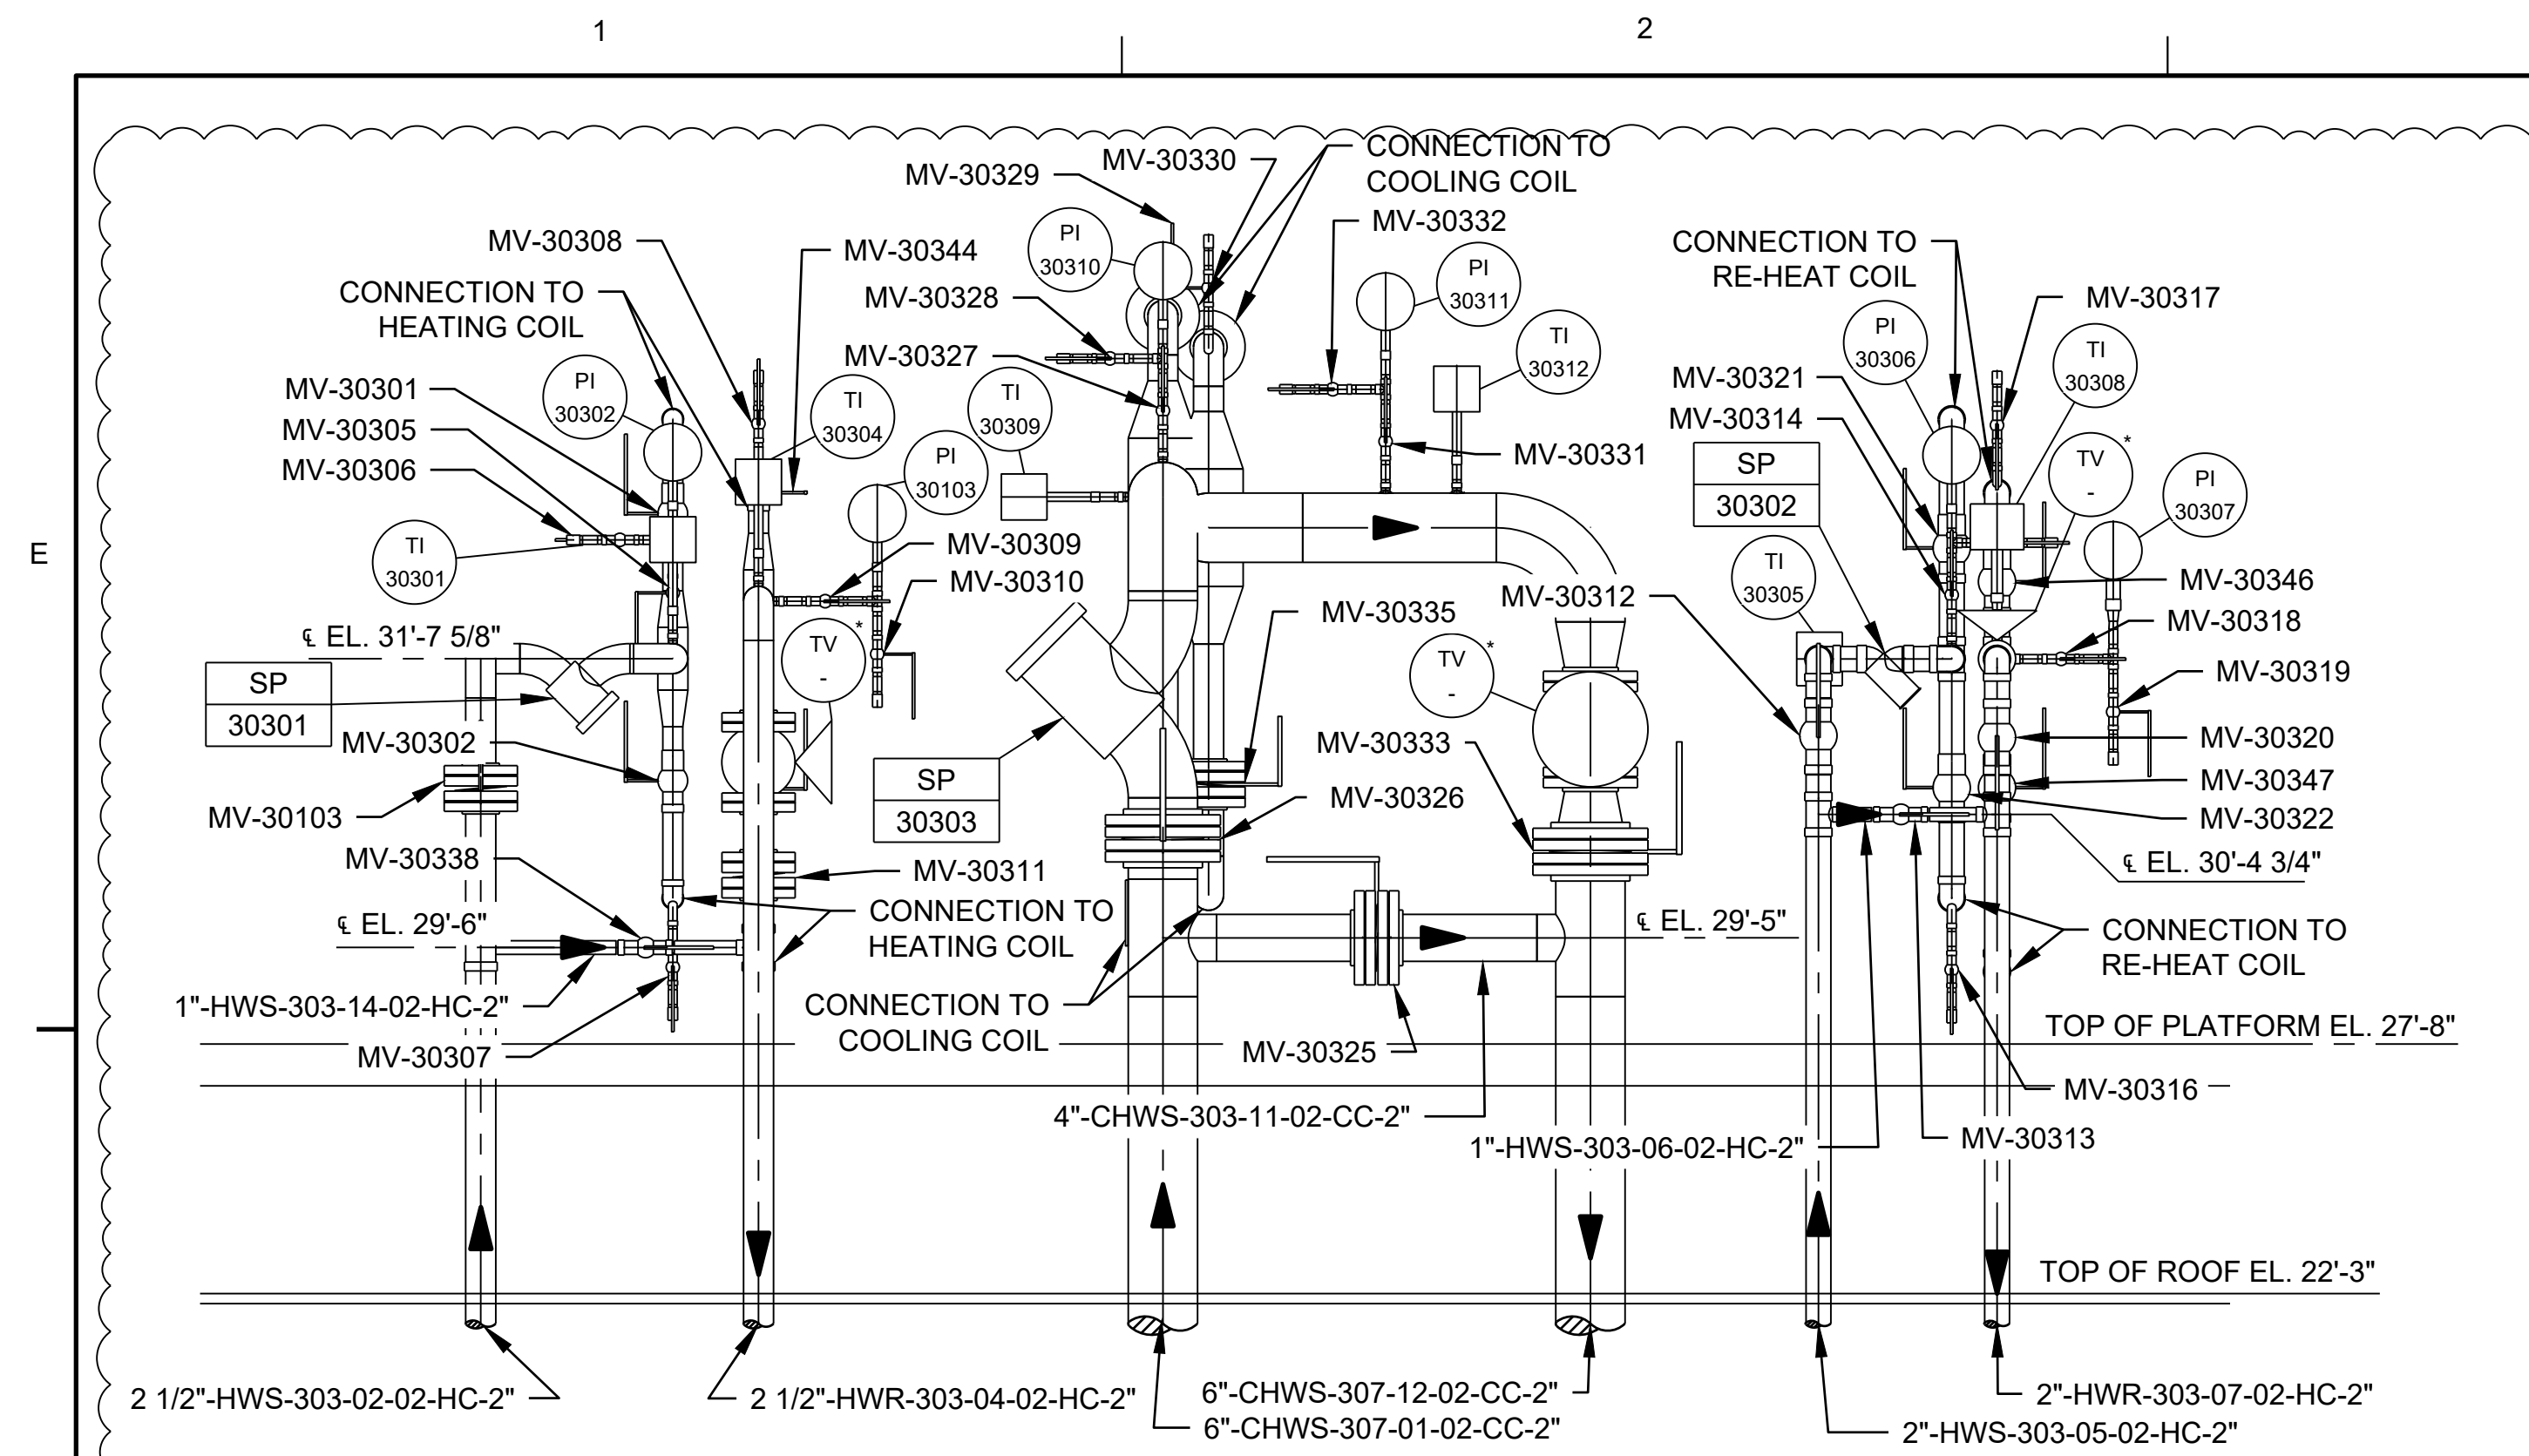


D1 ROOM 565 CLEANROOM AHU-3003 ELEVATION VIEW
1/4" = 1'-0"

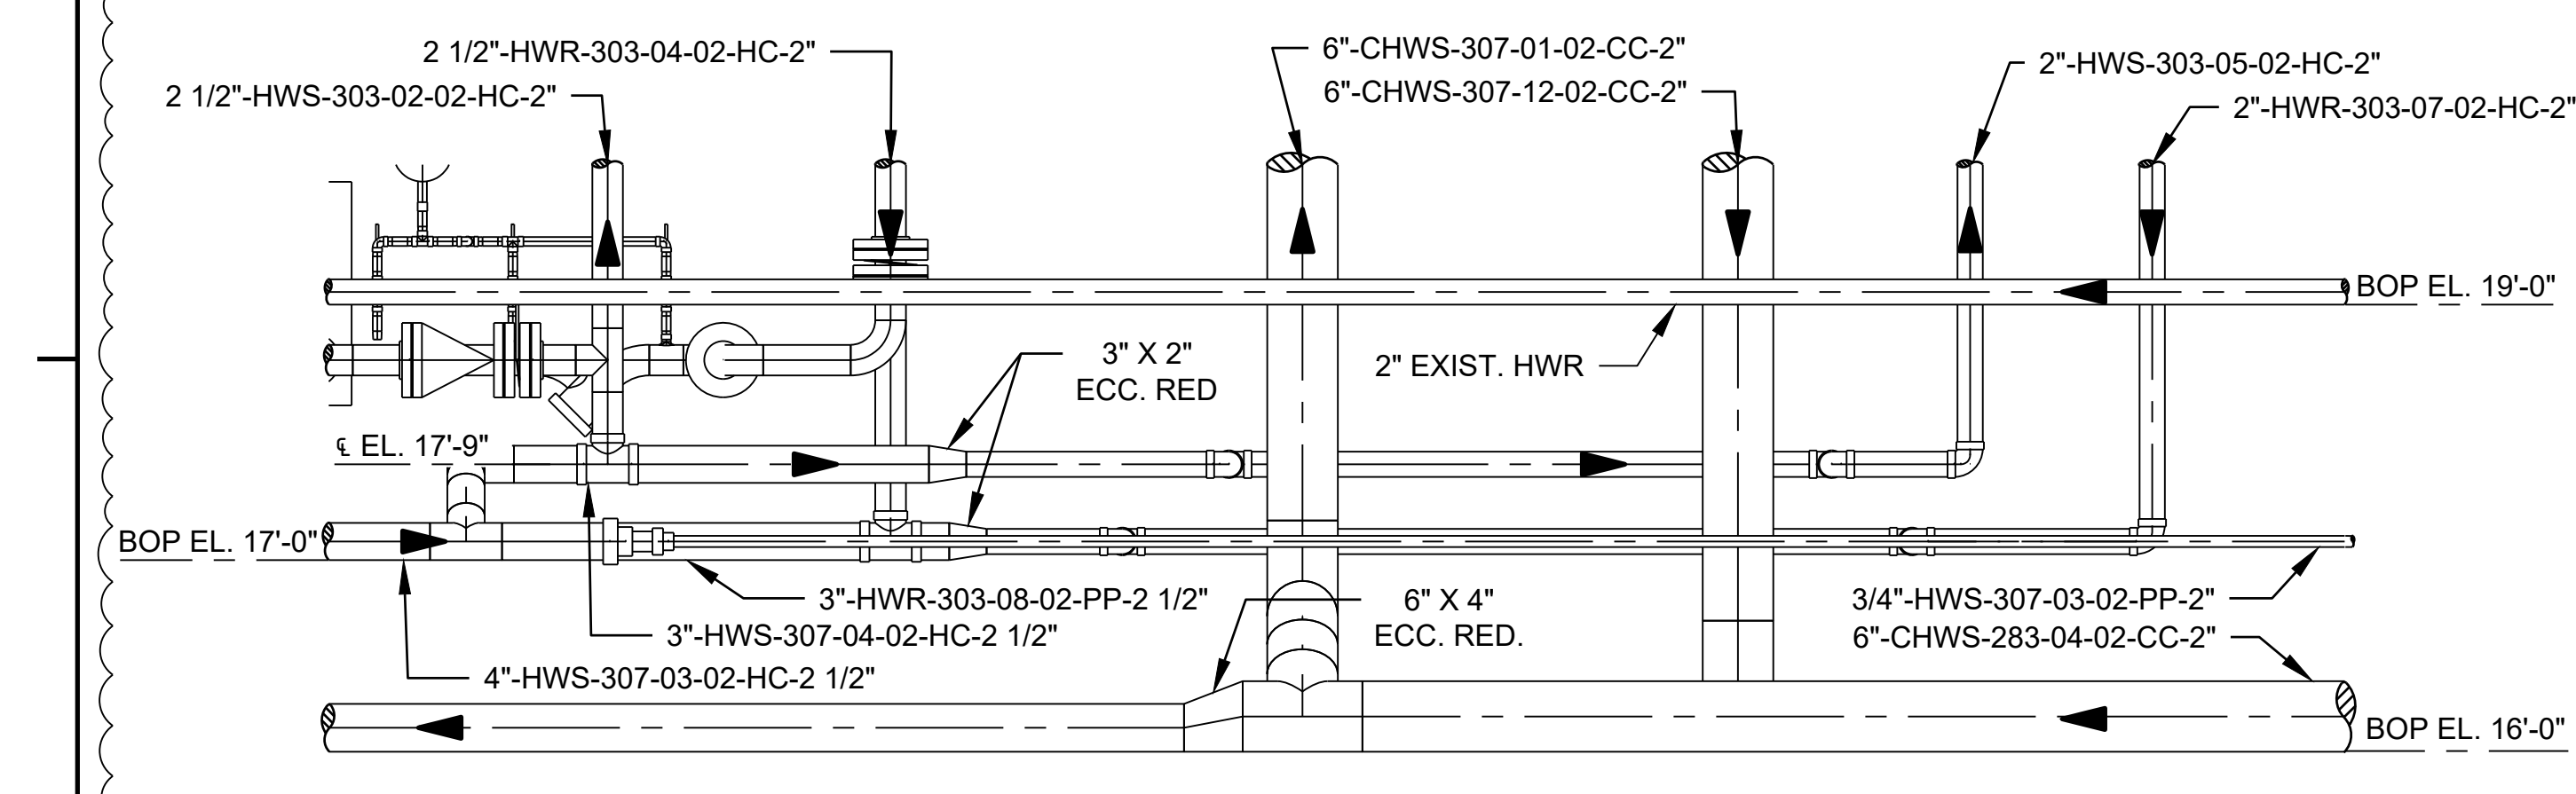


C1 CLEANROOM AHU-3003 PIPE BRIDGE ELEVATION VIEW
1/4" = 1'-0"

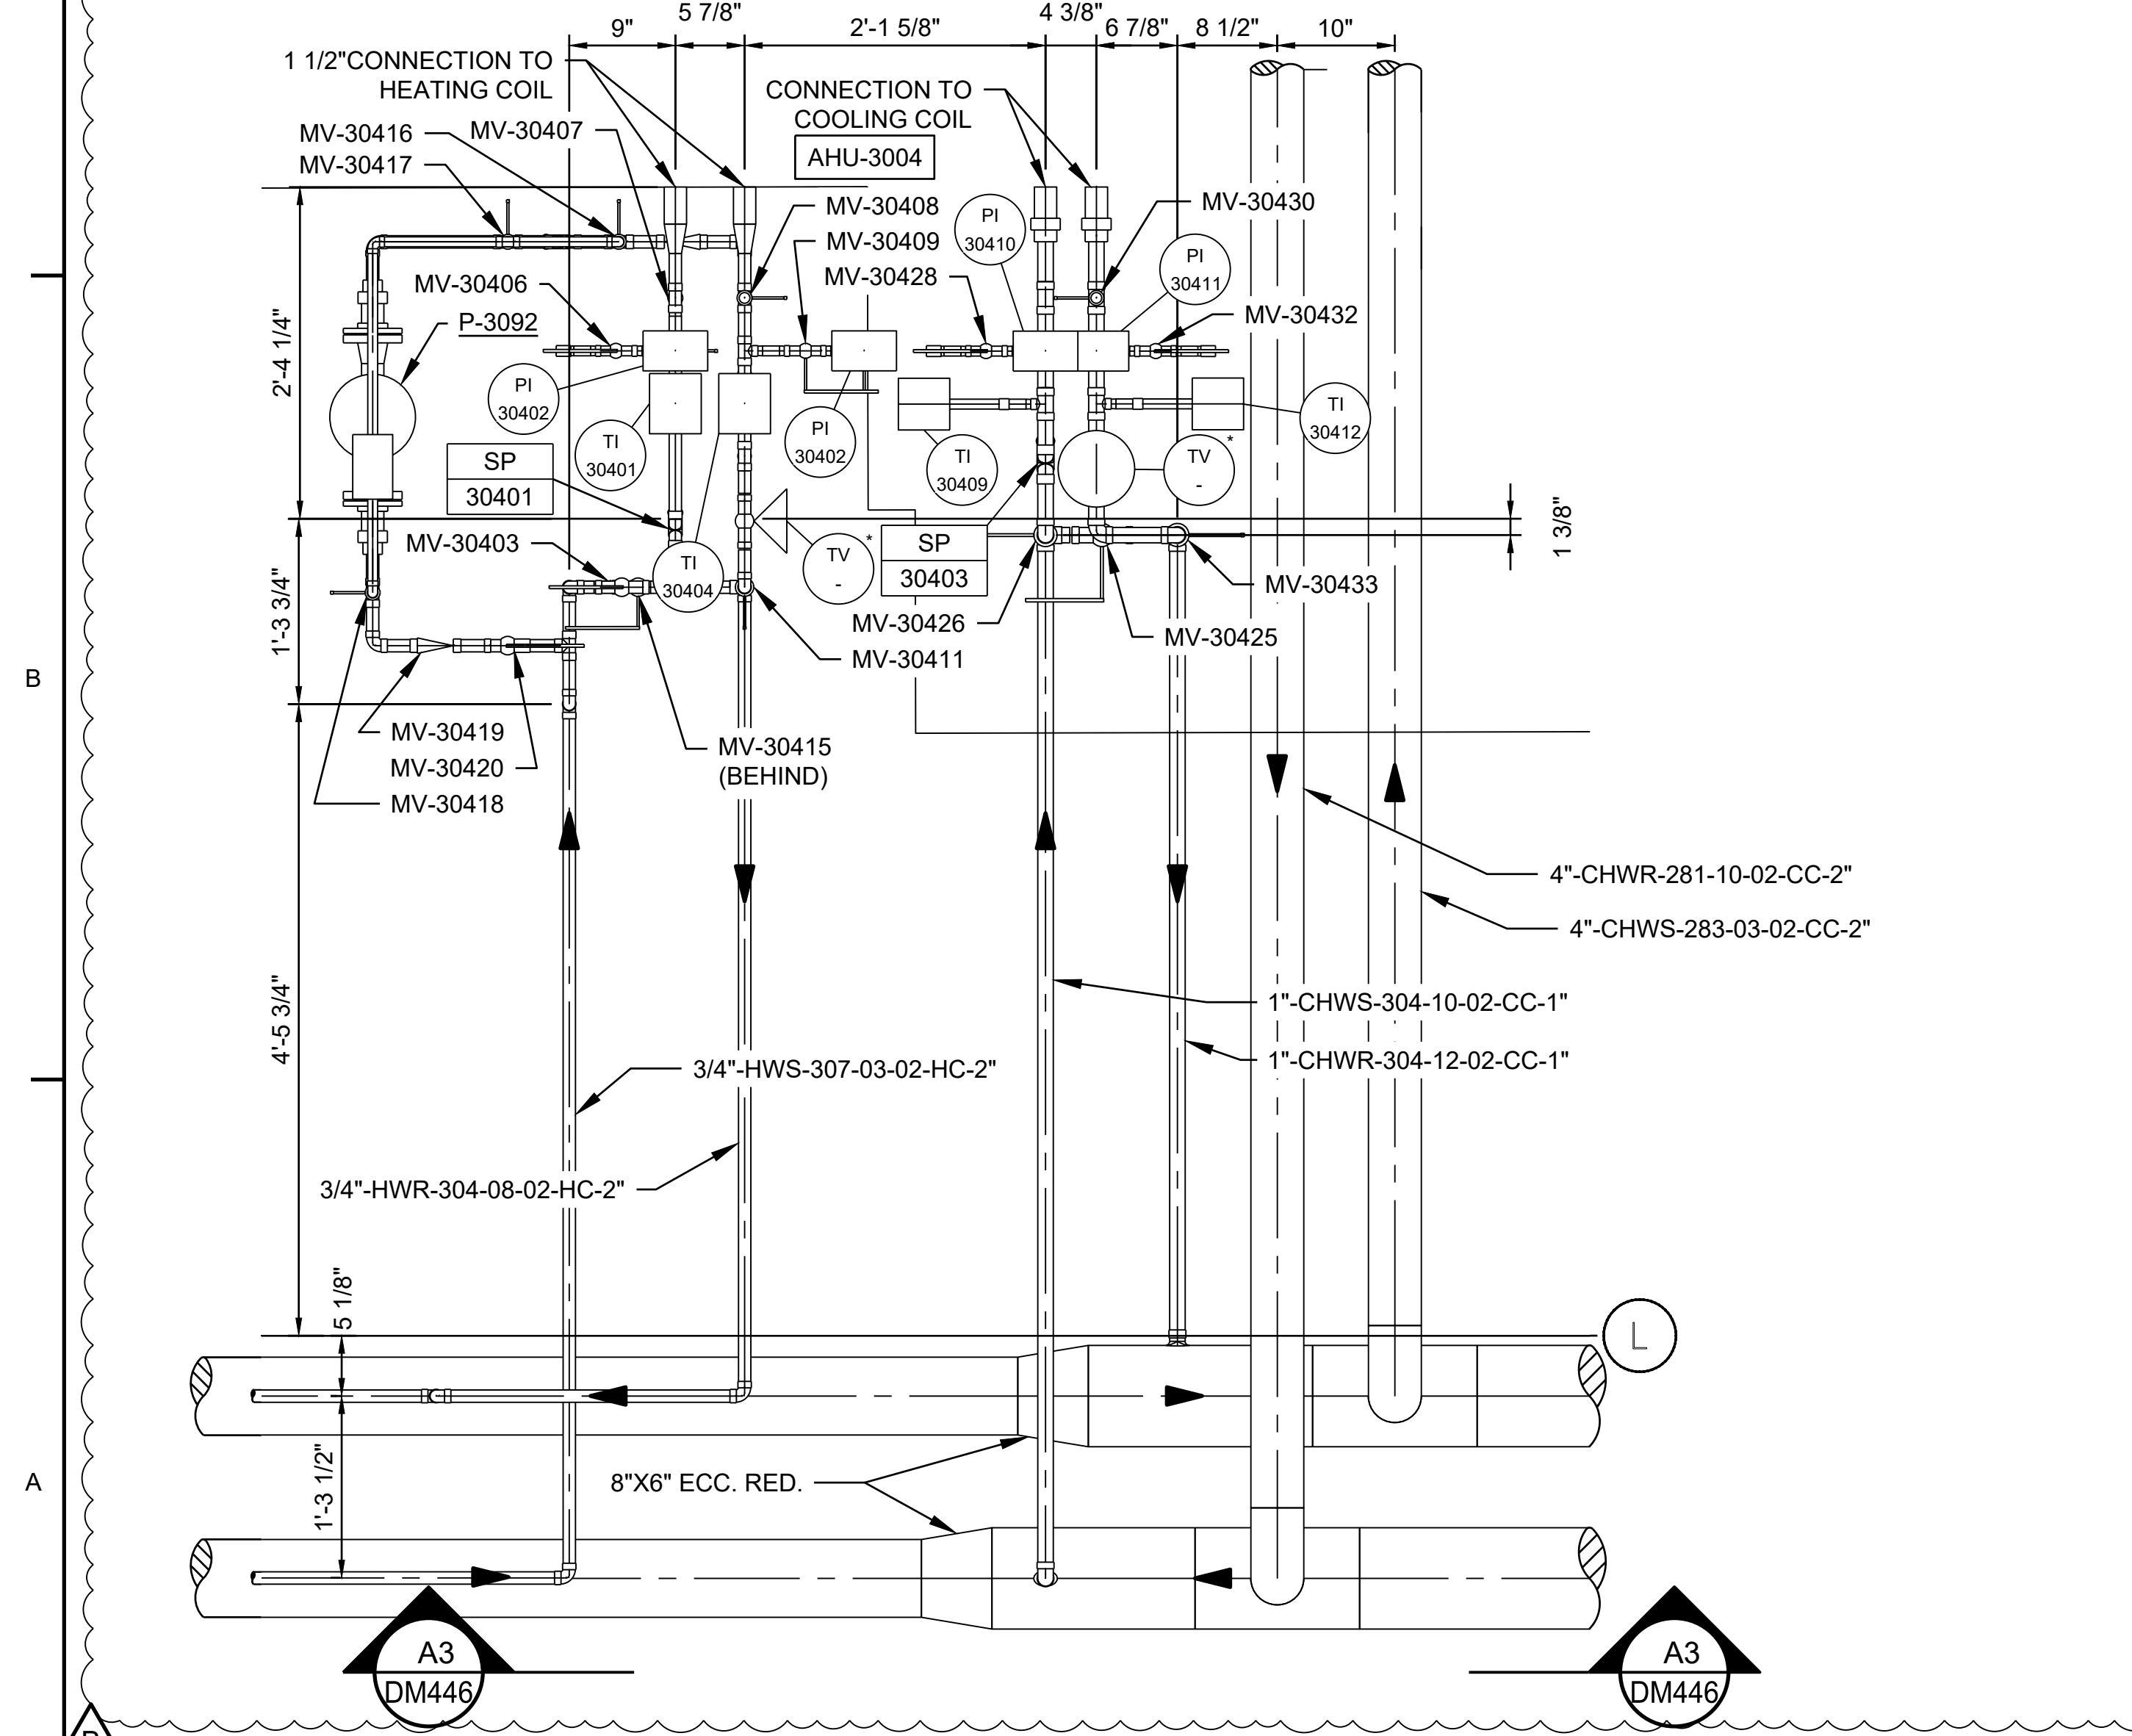

A1 ROOM 565 BREAKER PLATE ROOM AHU-3004 ENLARGED PLAN
1/4" = 1'-0"

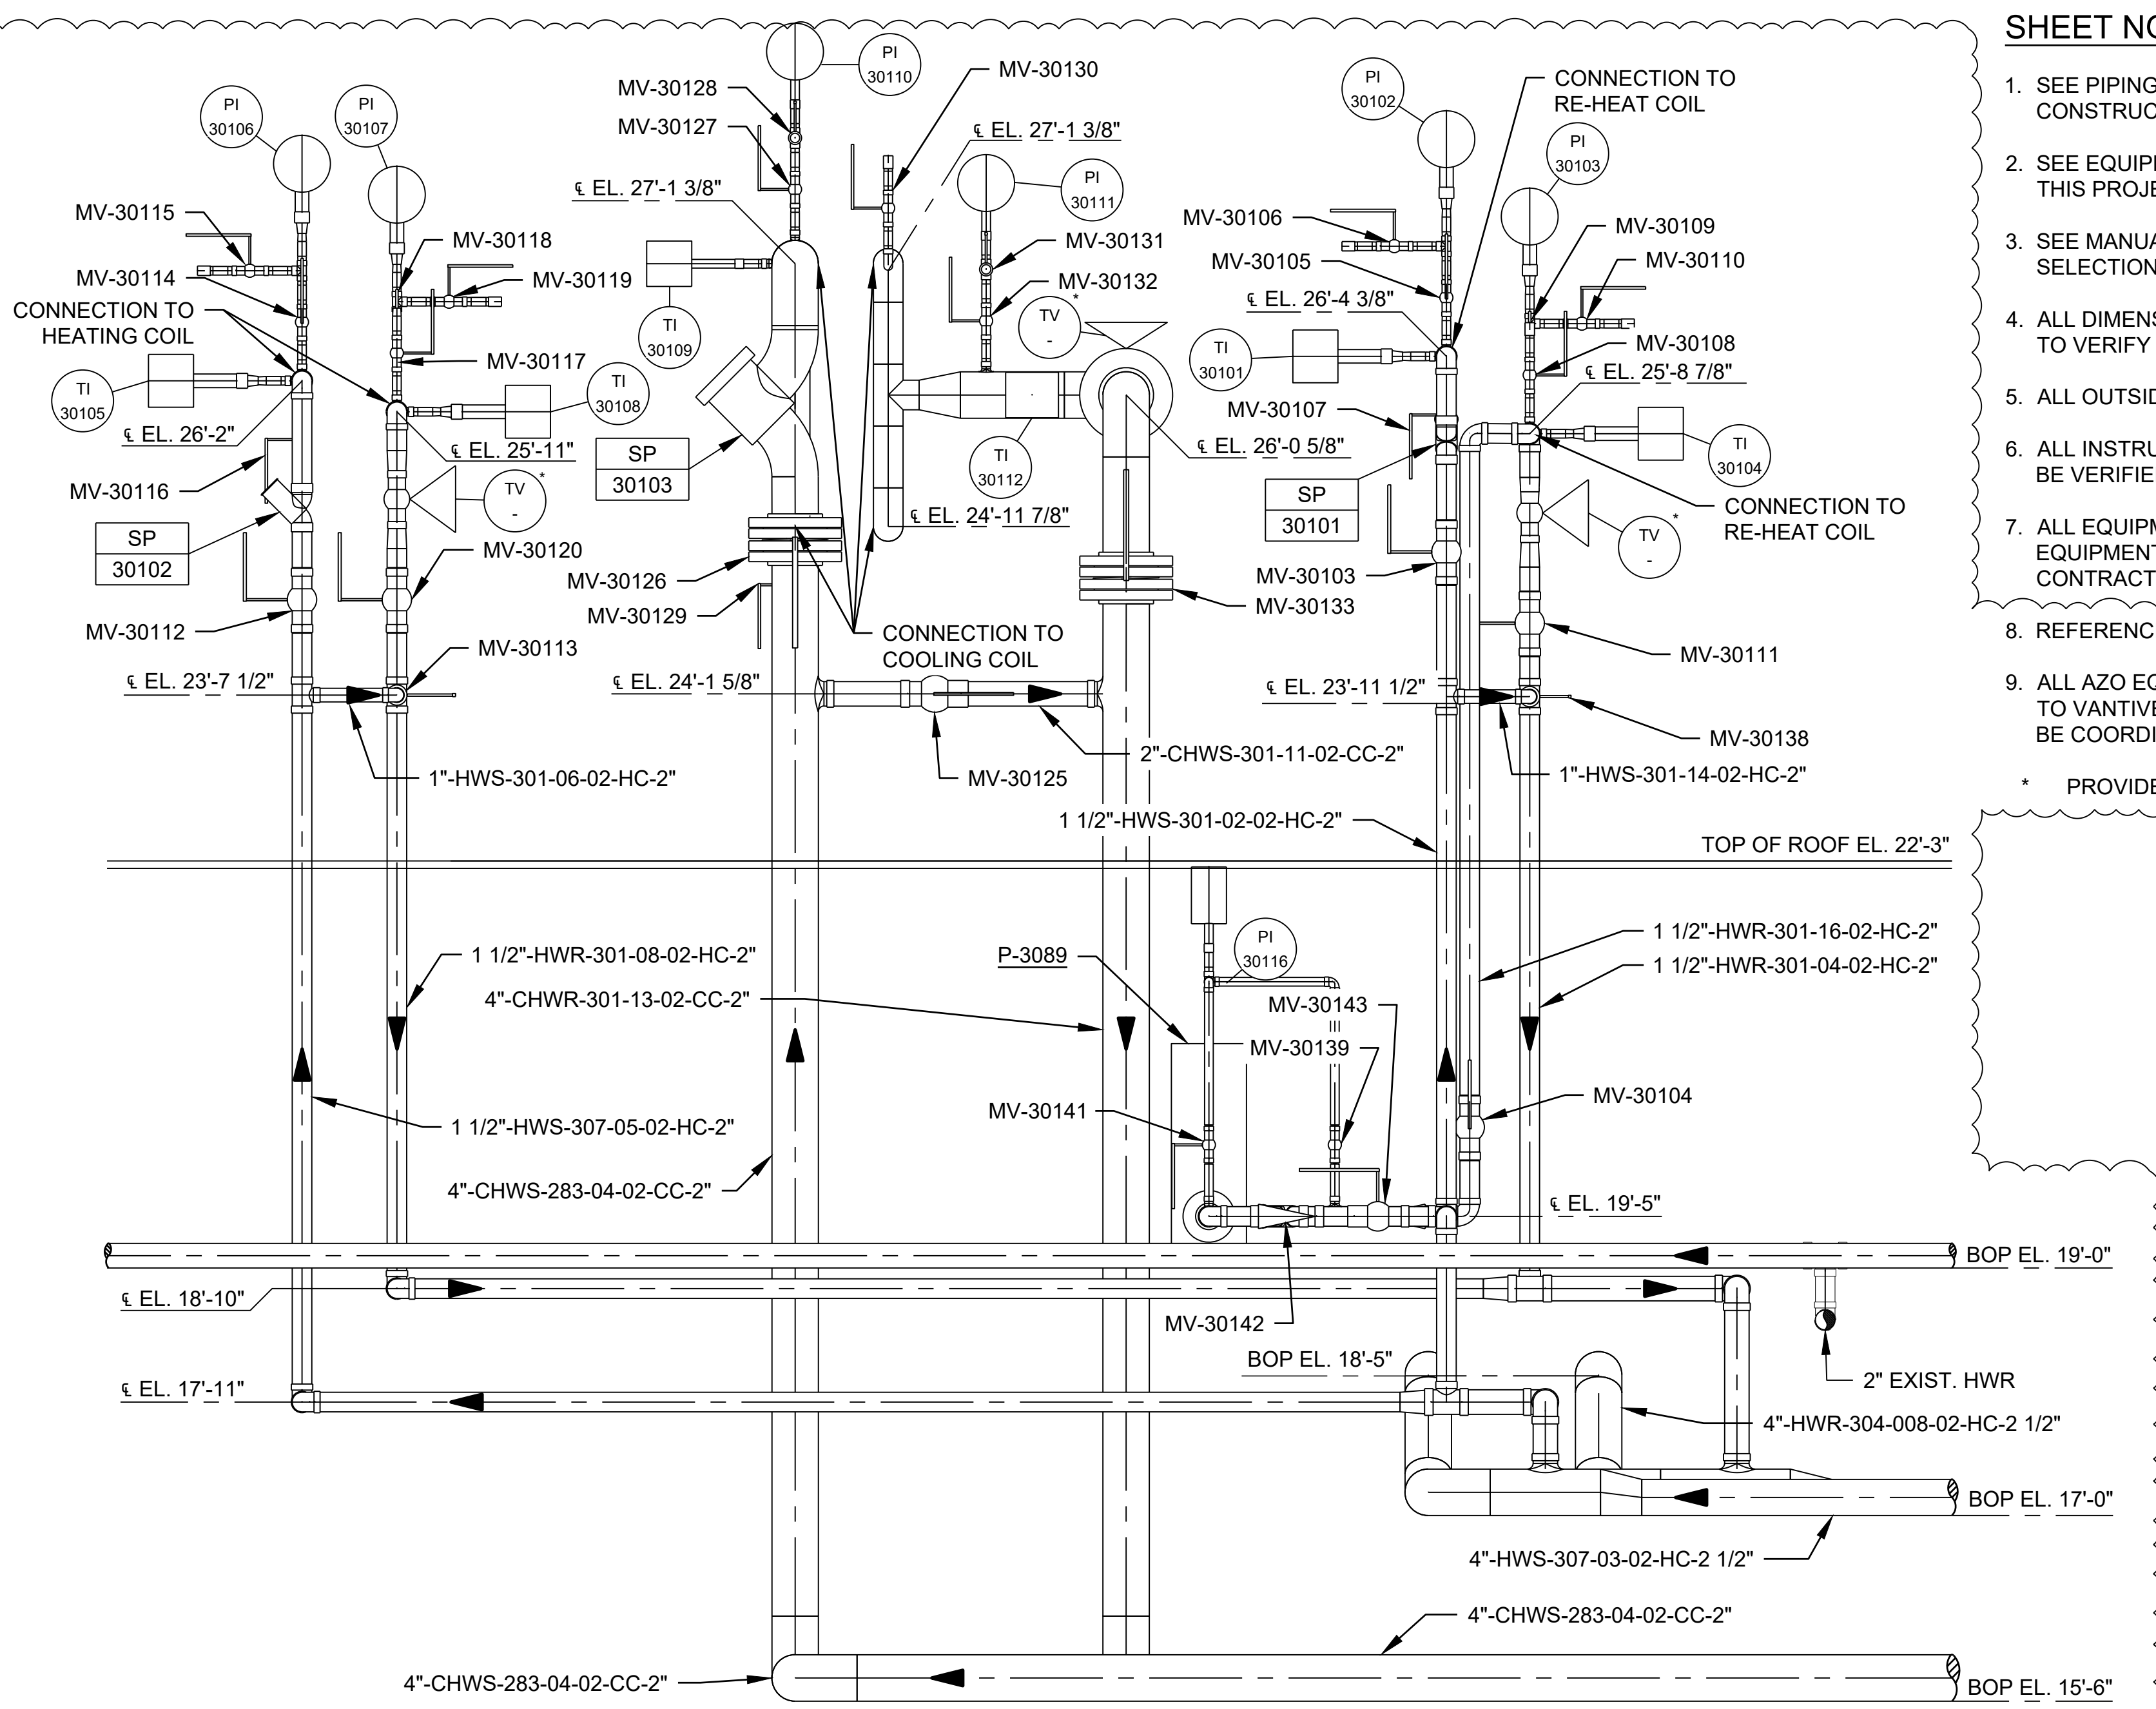

C3 ROOM 565 RELOCATED PAHU-3001 ELEVATION VIEW
1/4" = 1'-0"

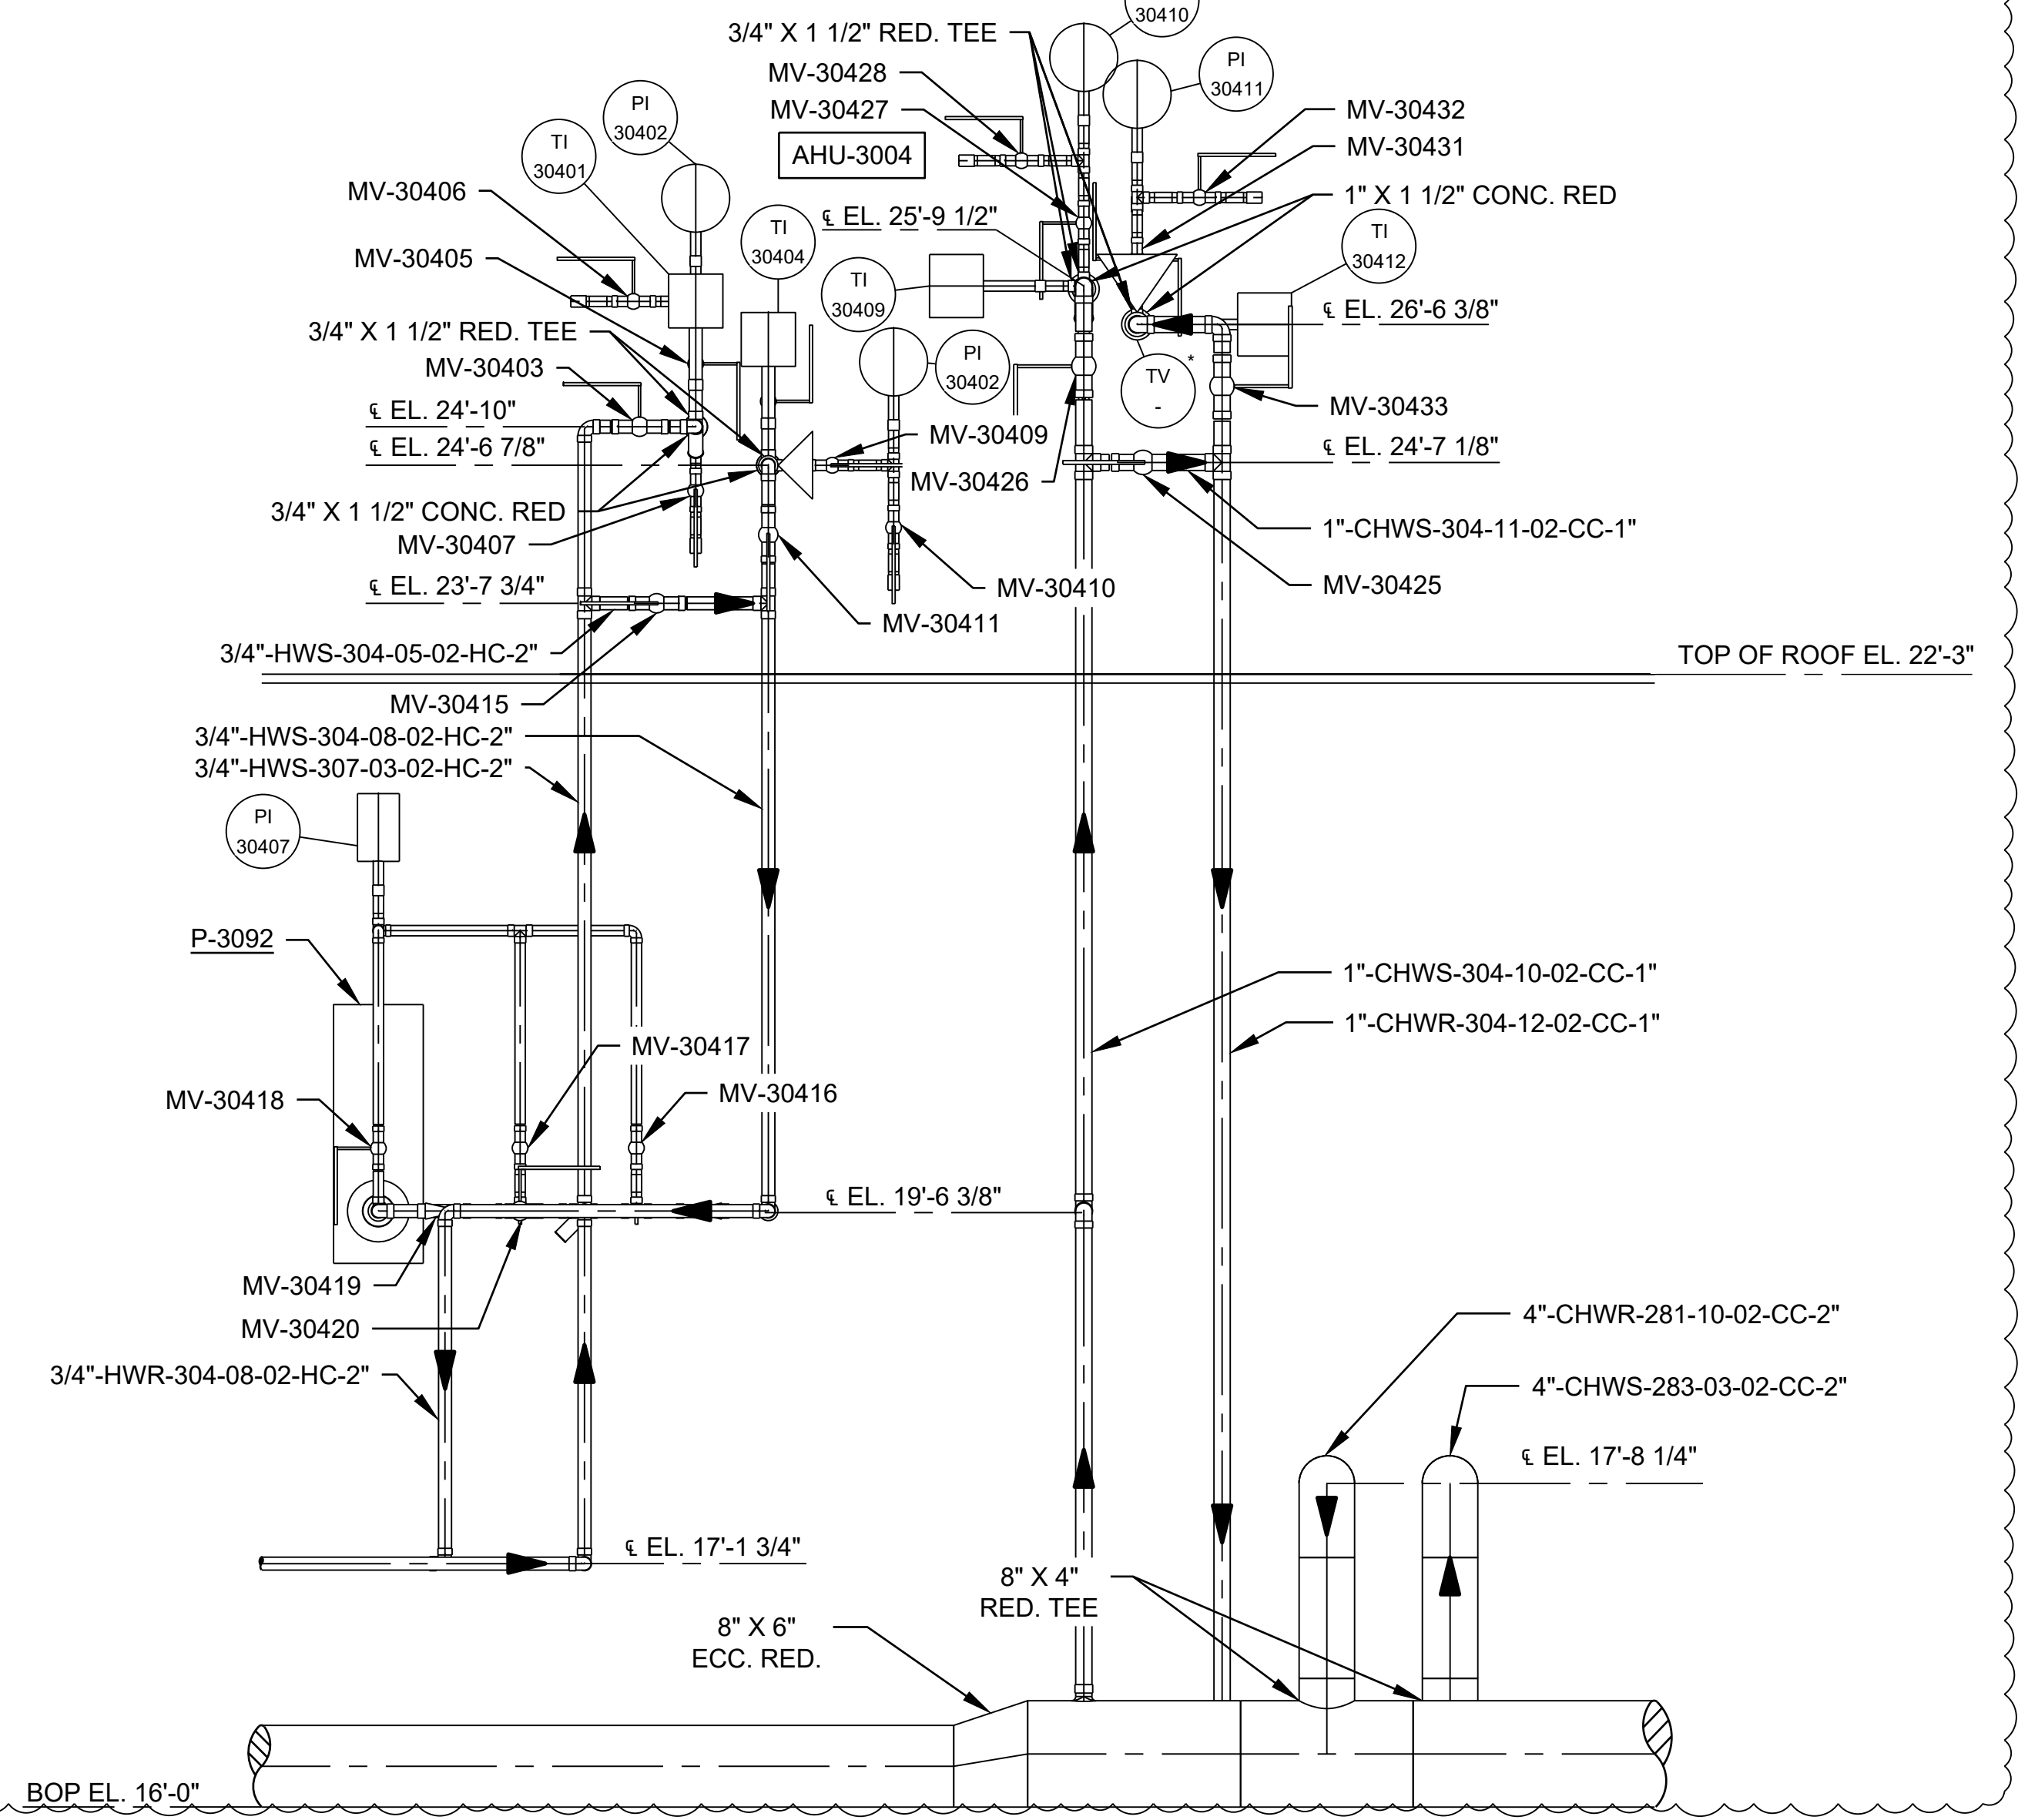

A3 ROOM 565 BREAKER PLATE ROOM AHU-3004 ELEVATION VIEW
1/4" = 1'-0"

SHEET NOTES:

1. SEE PIPING LINE LIST ON DMXXX FOR MATERIALS OF CONSTRUCTION.
2. SEE EQUIPMENT LIST ON DMXXX FOR EQUIPMENT RELATED TO THIS PROJECT.
3. SEE MANUAL VALVE LIST ON DMXXX FOR VALVE/DAMPER SELECTION AND SPECIFICATION.
4. ALL DIMENSIONS SHOWN ARE FIELD MEASURED. CONTRACTOR TO VERIFY BEFORE INSTALLATION.
5. ALL OUTSIDE PIPING TO BE HEAT TRACED.
6. ALL INSTRUMENTATION TAKEOUT AND CONNECTION SIZE TO BE VERIFIED BY CONTRACTOR PRIOR TO INSTALLATION.
7. ALL EQUIPMENT DIMENSIONS, MAINTENANCE SPACE, AND FINAL EQUIPMENT AND DUCT ARE TO BE CONFIRMED BY CONTRACTOR PRIOR TO INSTALLATION.
8. REFERENCE SHEET DM600 FOR PIPE SUPPORT DETAILS.
9. ALL AZO EQUIPMENT IS BASED OFF 3/16 SUBMITTAL PROVIDED TO VANTIVE. ANY INFORMATION MISSING OR CLASHING WILL BE COORDINATED BY CONTRACTOR BEFORE INSTALLATION.

* PROVIDED BY VENDOR

EORJAOR SEAL

CONSULTANT

CLIENT INFORMATION

Vantive

PROJECT NAME

VANTIVE
TUBING
CLEAN ROOM

1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

ISSUED FOR BID	ED BID CLARIFICATIONS	DATE	DESCRIPTION	MARK
B	ISSUED FOR BID	02/27/2026	ISSUED FOR BID	MARK

DESIGNED BY: AMW
DRAWN BY: AMW
CHECKED BY: JC
SUBMITTED BY: CL
DATE: 02/27/2026
PROJECT # 1241011


SHEET TITLE

**ROOM 565
AHU
PIPING
PLAN AND
ELEVATIONS**

SHEET NUMBER

DM446
SHEET 1 OF 1

ORIGINAL SHEET SIZE:
30" X 42"

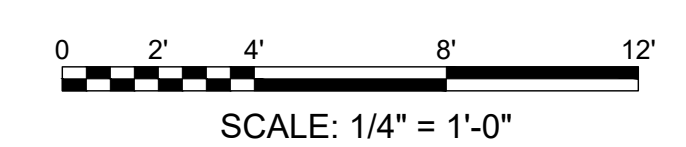

ISSUED FOR BID