4" INSULATION SHOE FOR 10" PIPE AND SMALLER

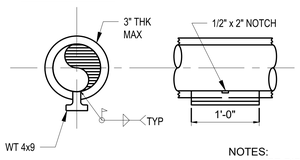

NOTES:
1. SEE PIPE SUPPORT SPEC FOR MATERIAL.

PS-01

STANDARD CARBON STEEL U-BOLT ANVIL NO. 137 OR EQUAL

SEE NOTE 1 FOR STAINLESS STEEL



NOTES:
1. FOR STAINLESS STEEL, SPECIAL CARBON STEEL U BOLT ANVIL NO. 137S OR EQUAL

PS-02

NON-INSULATED WELDED BEAM CLAMP

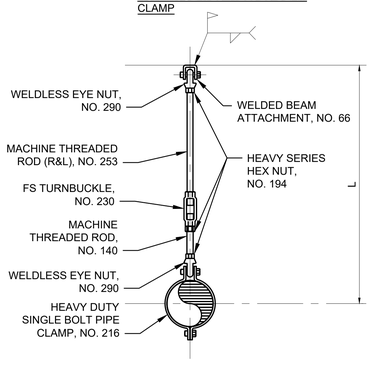

MINIMUM DISTANCE TABLE		
PIPE SIZE	L	RODØ
2"	2'-0"	3/8"
3"	2'-2"	3/8"
4"	2'-4"	1/2"
6"	2'-5"	5/8"
8"	2'-9"	3/4"
10"	2'-11"	3/4"
12"	3'-0"	7/8"

PS-03

INSULATED WELDED BEAM CLAMP

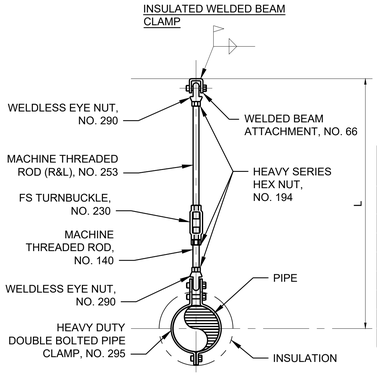

MINIMUM DISTANCE TABLE		
PIPE SIZE	L	RODØ
2"	2'-0"	3/8"
3"	2'-2"	3/8"
4"	2'-4"	1/2"
6"	2'-5"	5/8"
8"	2'-9"	3/4"
10"	2'-11"	3/4"
12"	3'-0"	7/8"

PS-04

NON INSULATED STAINLESS STEEL PIPE

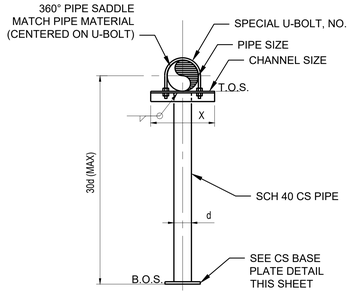

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	CHANNEL SIZE	d
3" & 4"	C6x10.5	2"
6" & 8"	C6x10.5	3"

NON INSULATED STAINLINESS STEEL PIPE

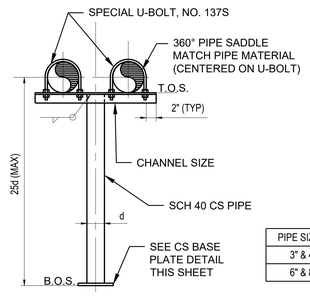

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	CHANNEL SIZE	d
3" & 4"	C6x10.5	2"
6" & 8"	C6x10.5	3"

PS-05

STAINLESS STEEL PIPE



NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	CHANNEL SIZE	d
3" & 4"	C6x10.5	2"
6" & 8"	C6x10.5	3"

STAINLESS STEEL PIPE

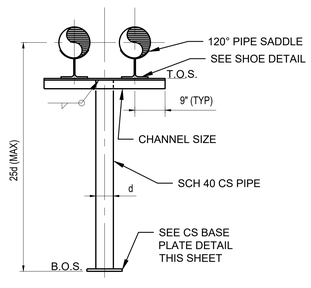

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	CHANNEL SIZE	d
3" & 4"	C6x10.5	2"
6" & 8"	C6x10.5	3"

PS-07

NON INSULATED CARBON STEEL PIPE

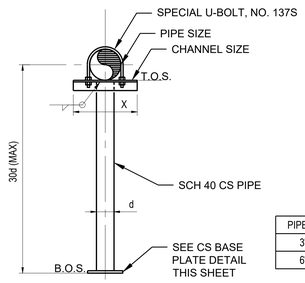

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	CHANNEL SIZE	d
3" & 4"	C6x10.5	2"
6" & 8"	C6x10.5	3"

NON INSULATED CARBON STEEL PIPE

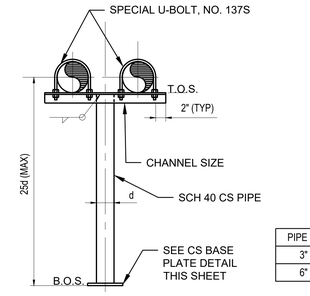

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	CHANNEL SIZE	d
3" & 4"	C6x10.5	2"
6" & 8"	C6x10.5	3"

PS-06

CARBON STEEL PIPE

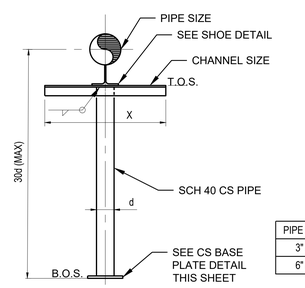

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	X	CHANNEL SIZE	d
3" & 4"	24"	C6x10.5	2"
6" & 8"	24"	C6x10.5	3"

CARBON STEEL PIPE

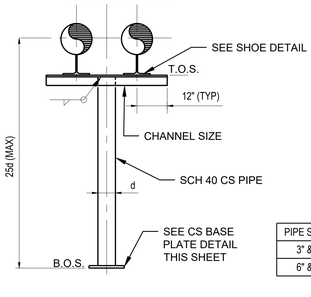

NOTES:
1. SEE DRAWING FOR BOS AND TOS.

PIPE SIZE D	X	CHANNEL SIZE	d
3" & 4"	18"	C6x10.5	2"
6" & 8"	18"	C6x10.5	3"

PS-08

SHEET NOTES:

B
1. ALL AZO EQUIPMENT IS BASED OFF 3/16 SUBMITTAL PROVIDED TO VANTIVE. ANY INFORMATION MISSING OR CLASHING WILL BE COORDINATED BY CONTRACTOR BEFORE INSTALLATION.

CS BASE PLATE

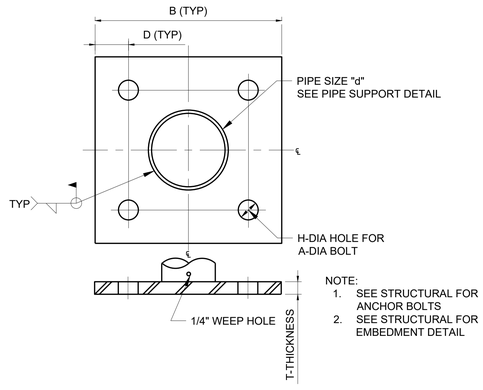

NOTE:
1. SEE STRUCTURAL FOR ANCHOR BOLTS
2. SEE STRUCTURAL FOR EMBEDMENT DETAIL

PIPE SIZE	A	B	D	H	T
2"	1"	0'-7"	2"	1 1/8"	3/4"
2 1/2"	1"	7 1/2"	2"	1 1/8"	3/4"
3"	1"	8"	2"	1 1/8"	3/4"
4"	1"	9"	2"	1 1/8"	3/4"
6"	1"	11 1/2"	2"	1 1/8"	3/4"

POND
3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092
Copyright © 2025 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

CONFIDENTIAL-TRADE-SECRET

EOR/AOR SEAL

CONSULTANT

CLIENT INFORMATION

Vantive

PROJECT NAME

VANTIVE
TUBING
CLEAN ROOM

1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

MARK	DESCRIPTION	DATE
B	ISSUED FOR BID, ED BID CLARIFICATIONS	04/24/2026
A	ISSUED FOR BID	02/27/2026

DESIGNED BY:	AW
DRAWN BY:	AW
CHECKED BY:	JP
SUBMITTED BY:	CL
DATE:	02/27/2026
PROJECT #	1241011

SHEET TITLE

PIPE SUPPORT DETAILS

SHEET NUMBER

DM600

SHEET 1 OF 1

ORIGINAL SHEET SIZE: 30" X 42"

ISSUED FOR BID