

E
D
C
B
A

1


2

3


4

5

6

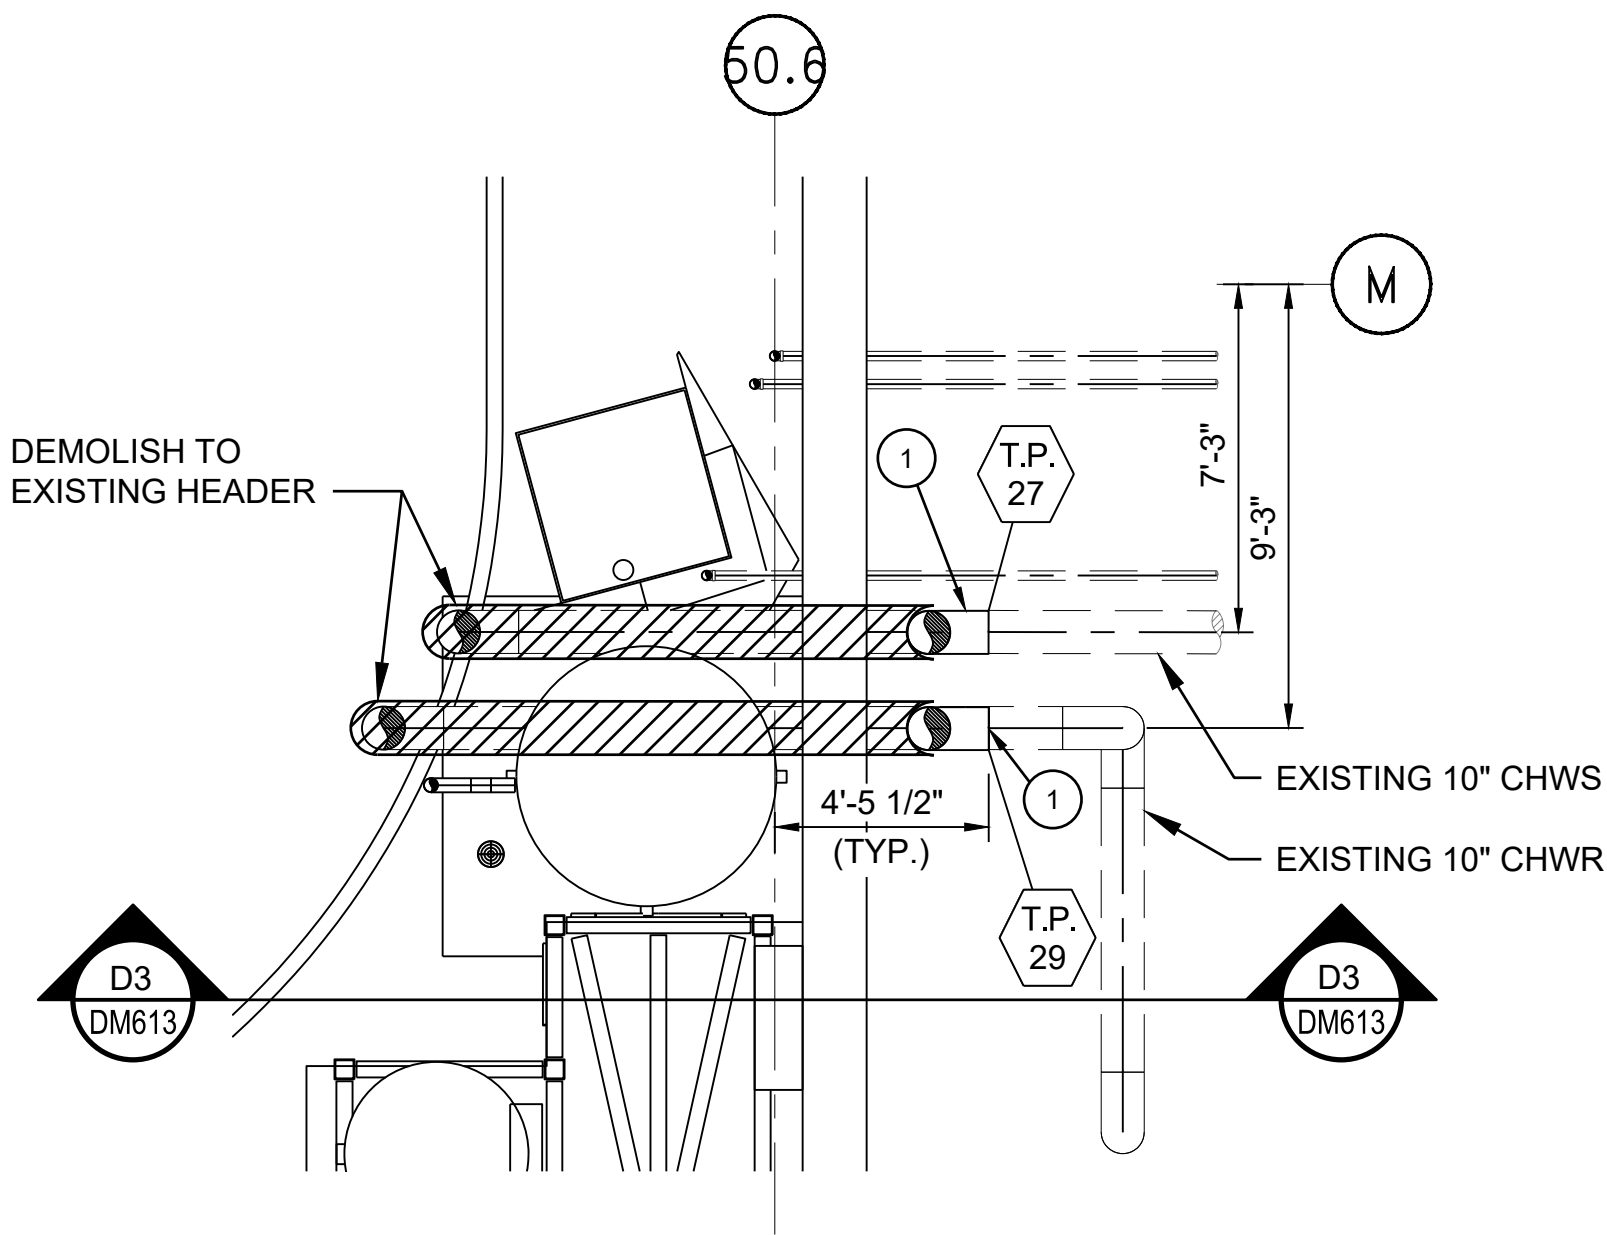

D1 PLAN VIEW
DM613 SCALE: 1/4" = 1'-0"

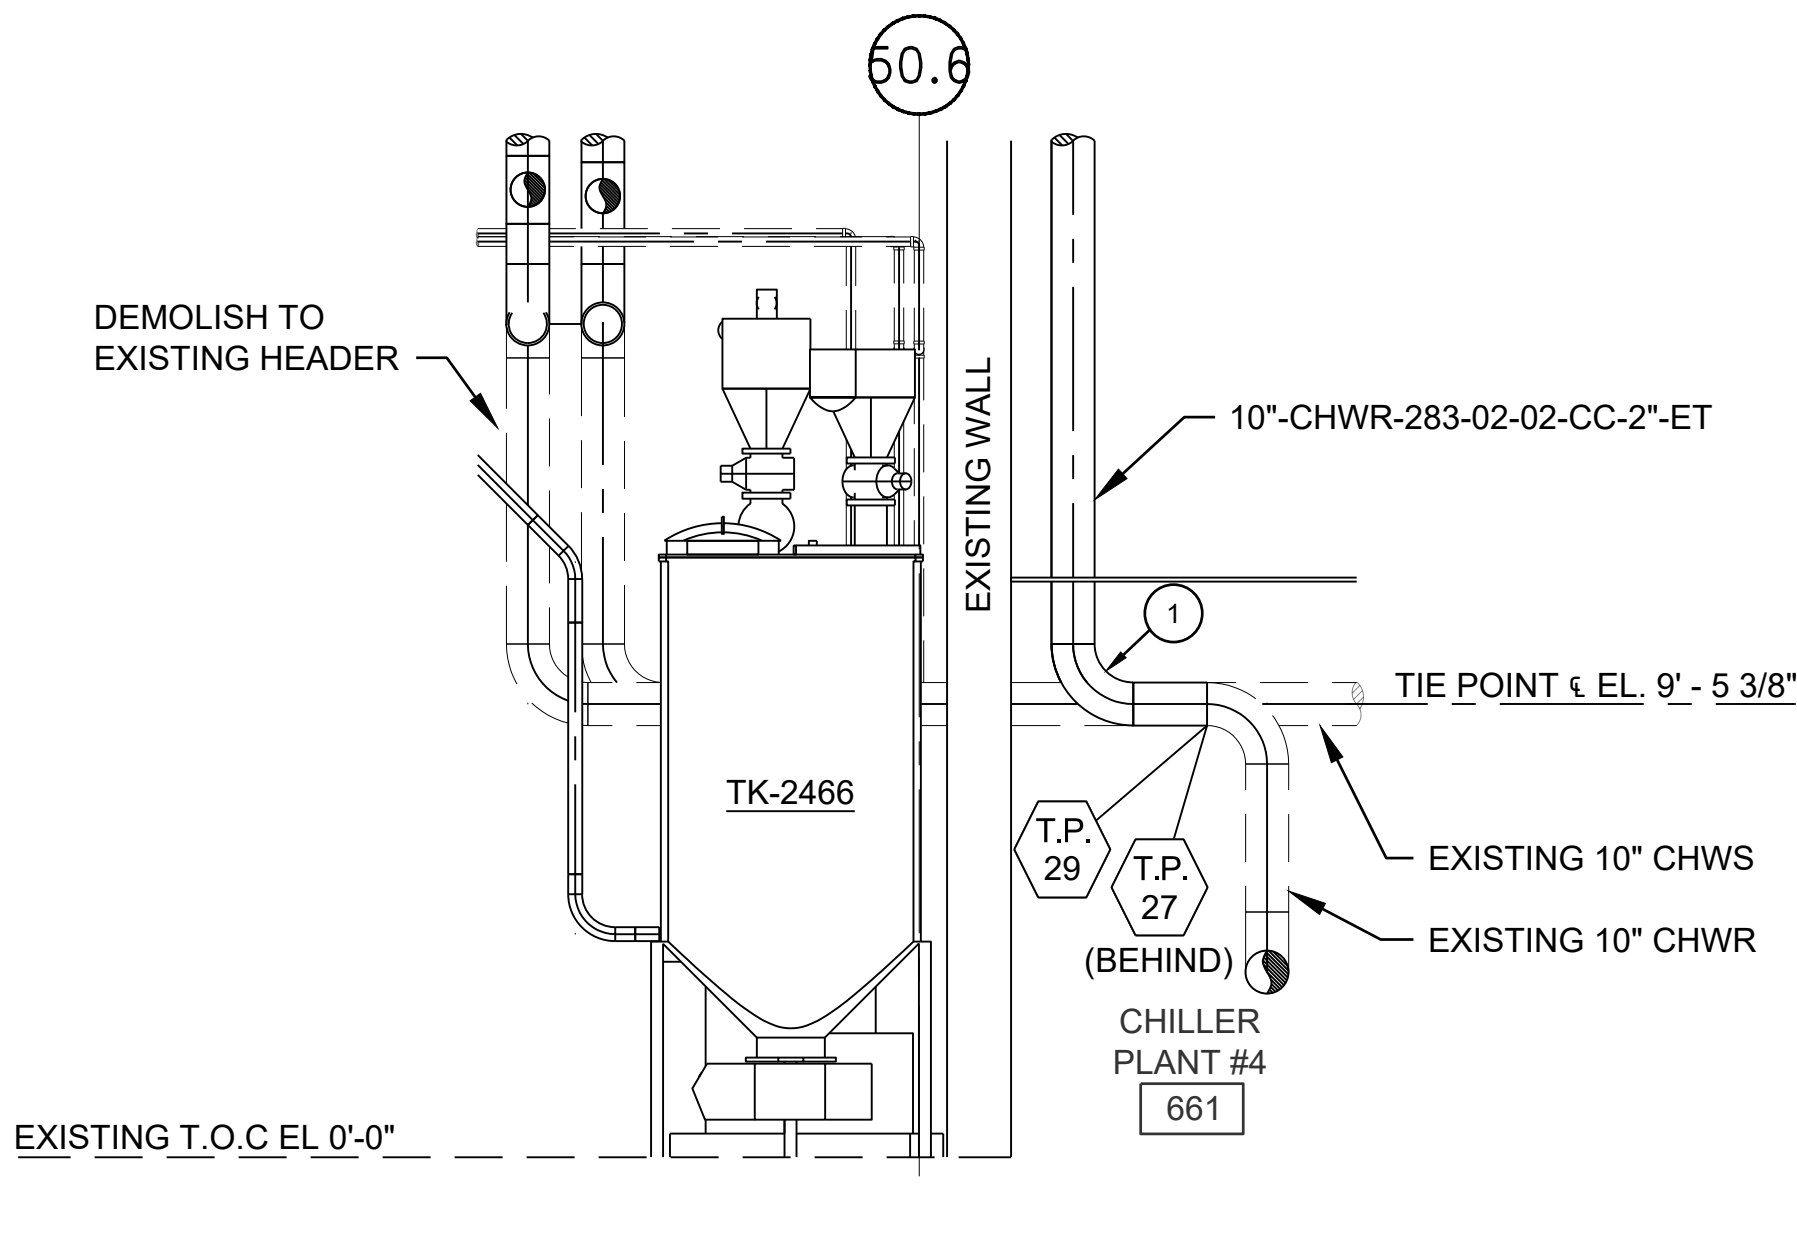


D3 SECTION VIEW
DM613 SCALE: 1/4" = 1'-0"


TIE-IN 27, 29 - CHILLED WATER SUPPLY/RETURN - CHILLER ROOM



TIE-IN 27, 29 - LOOKING NORTH

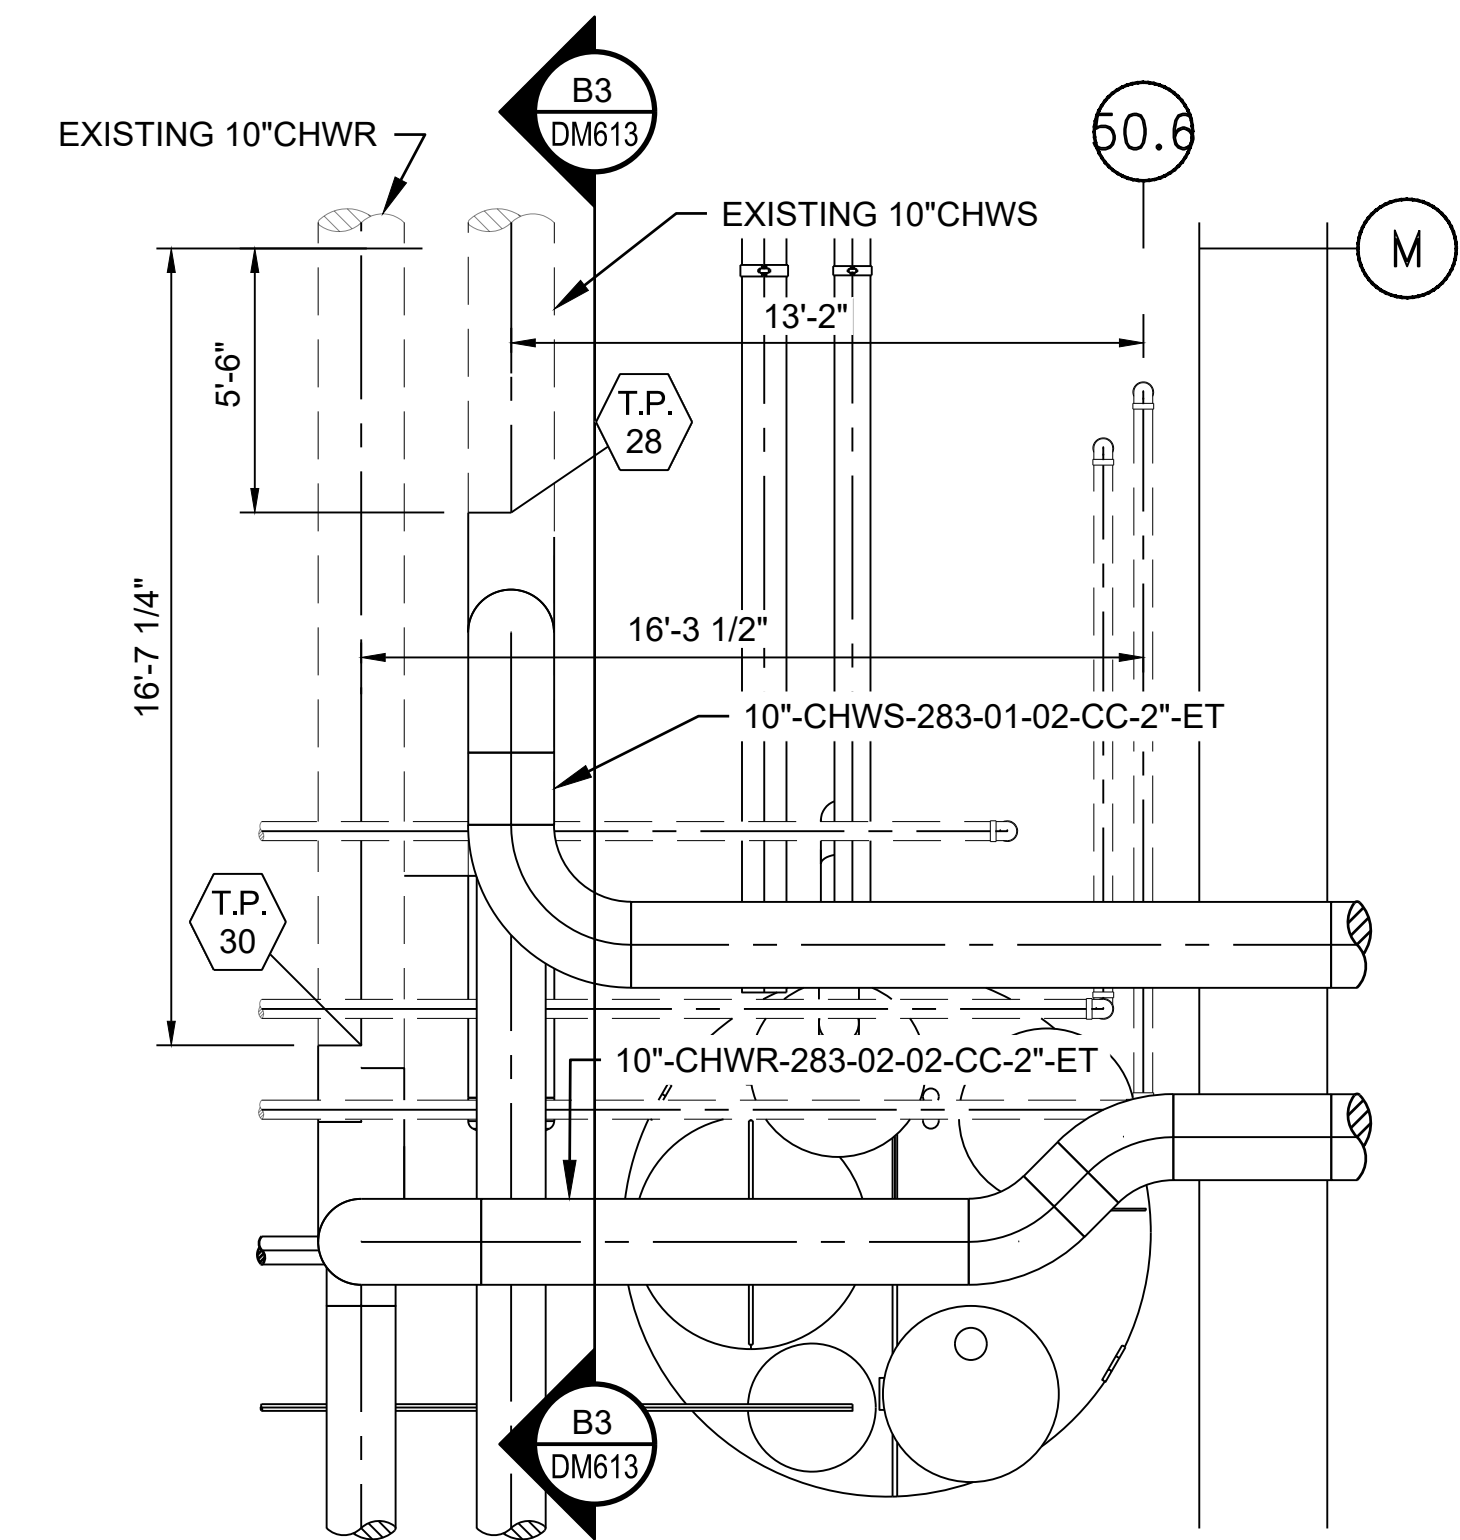


B1 PLAN VIEW
DM613 SCALE: 1/2" = 1'-0"

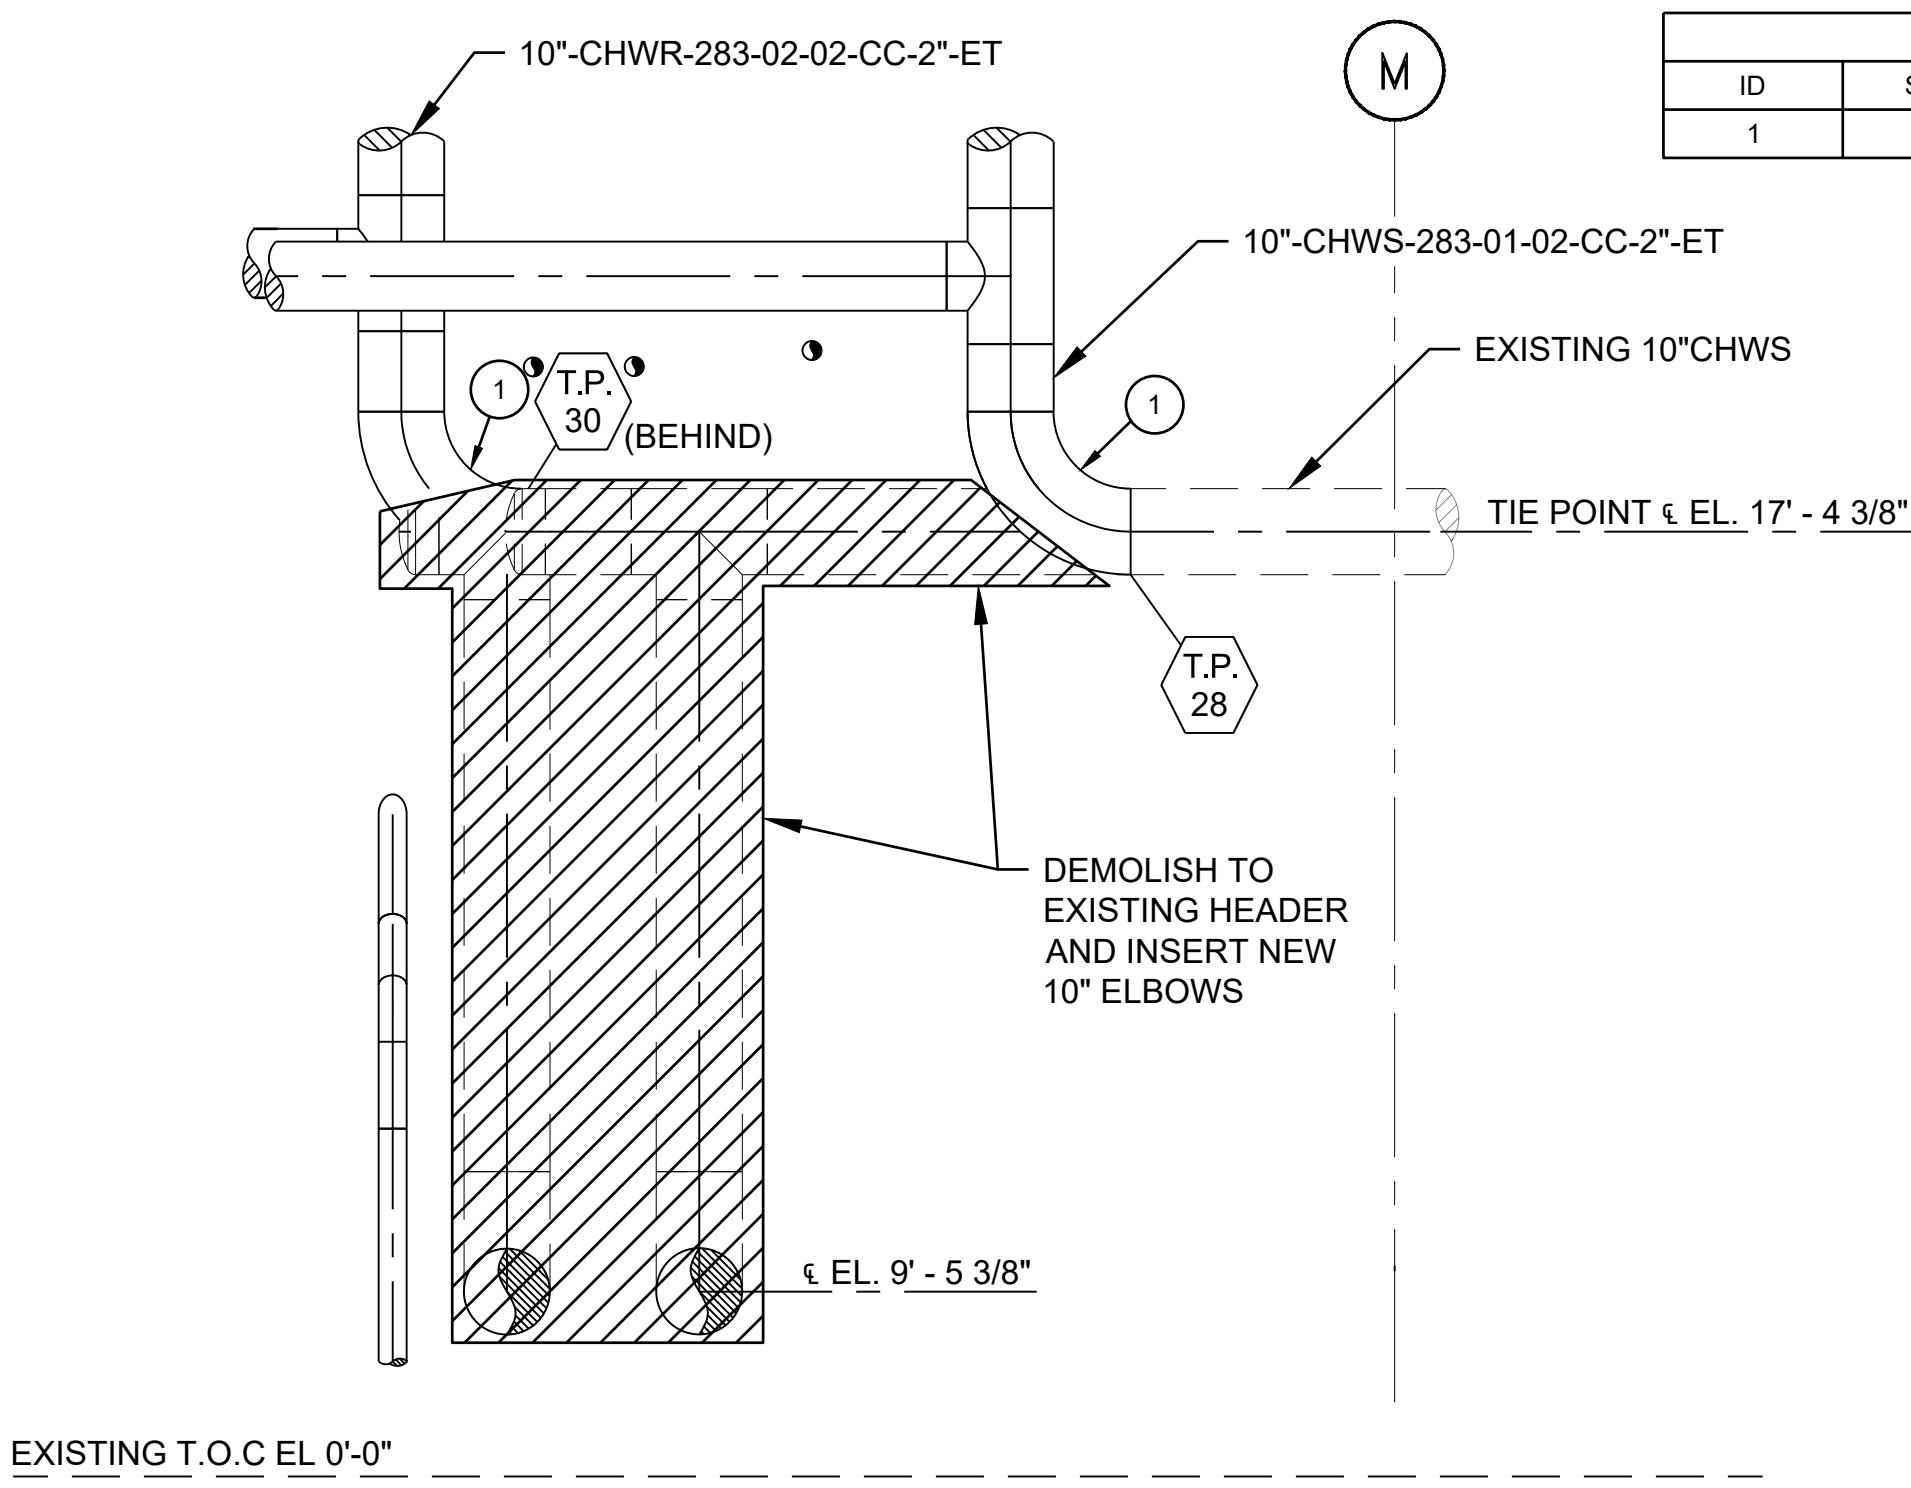


B3 SECTION VIEW
DM613 SCALE: 1/2" = 1'-0"


TIE-IN 28, 30 - CHILLED WATER SUPPLY/RETURN - ROOM 565

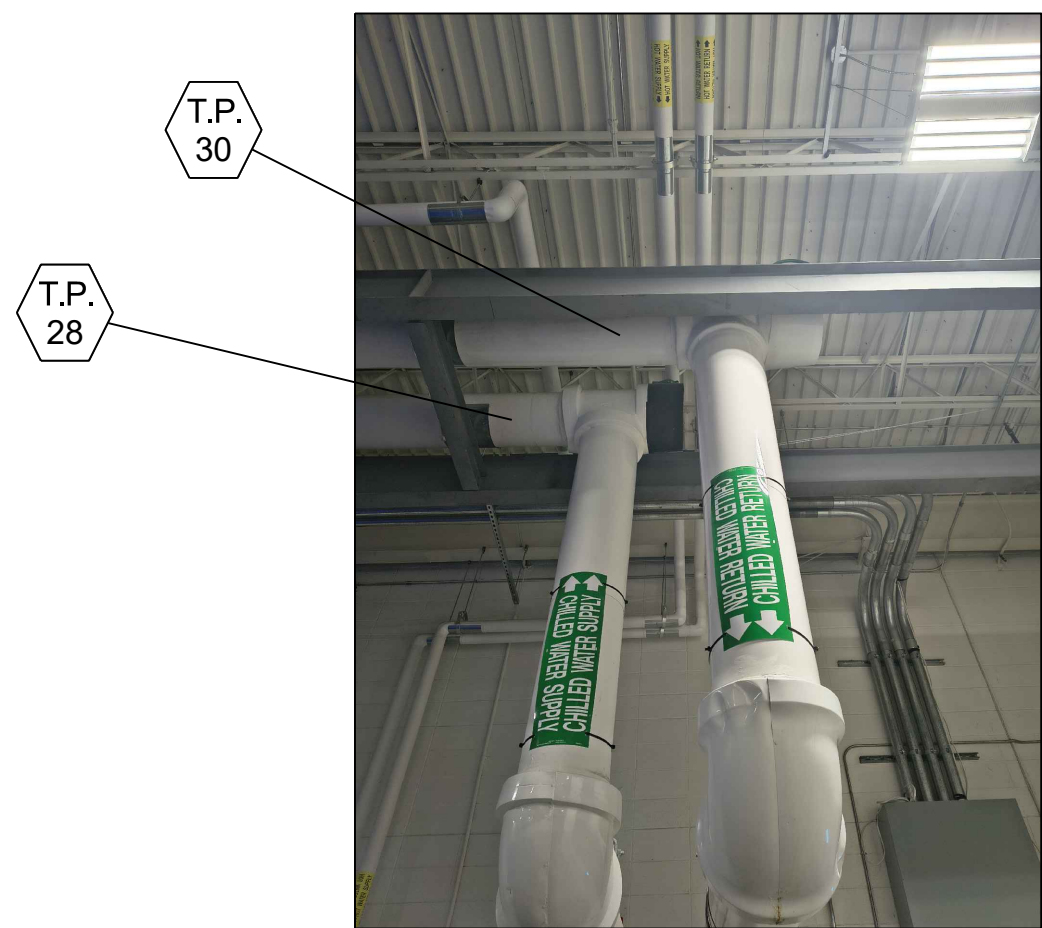

TIE-IN 28, 30 - LOOKING NORTH

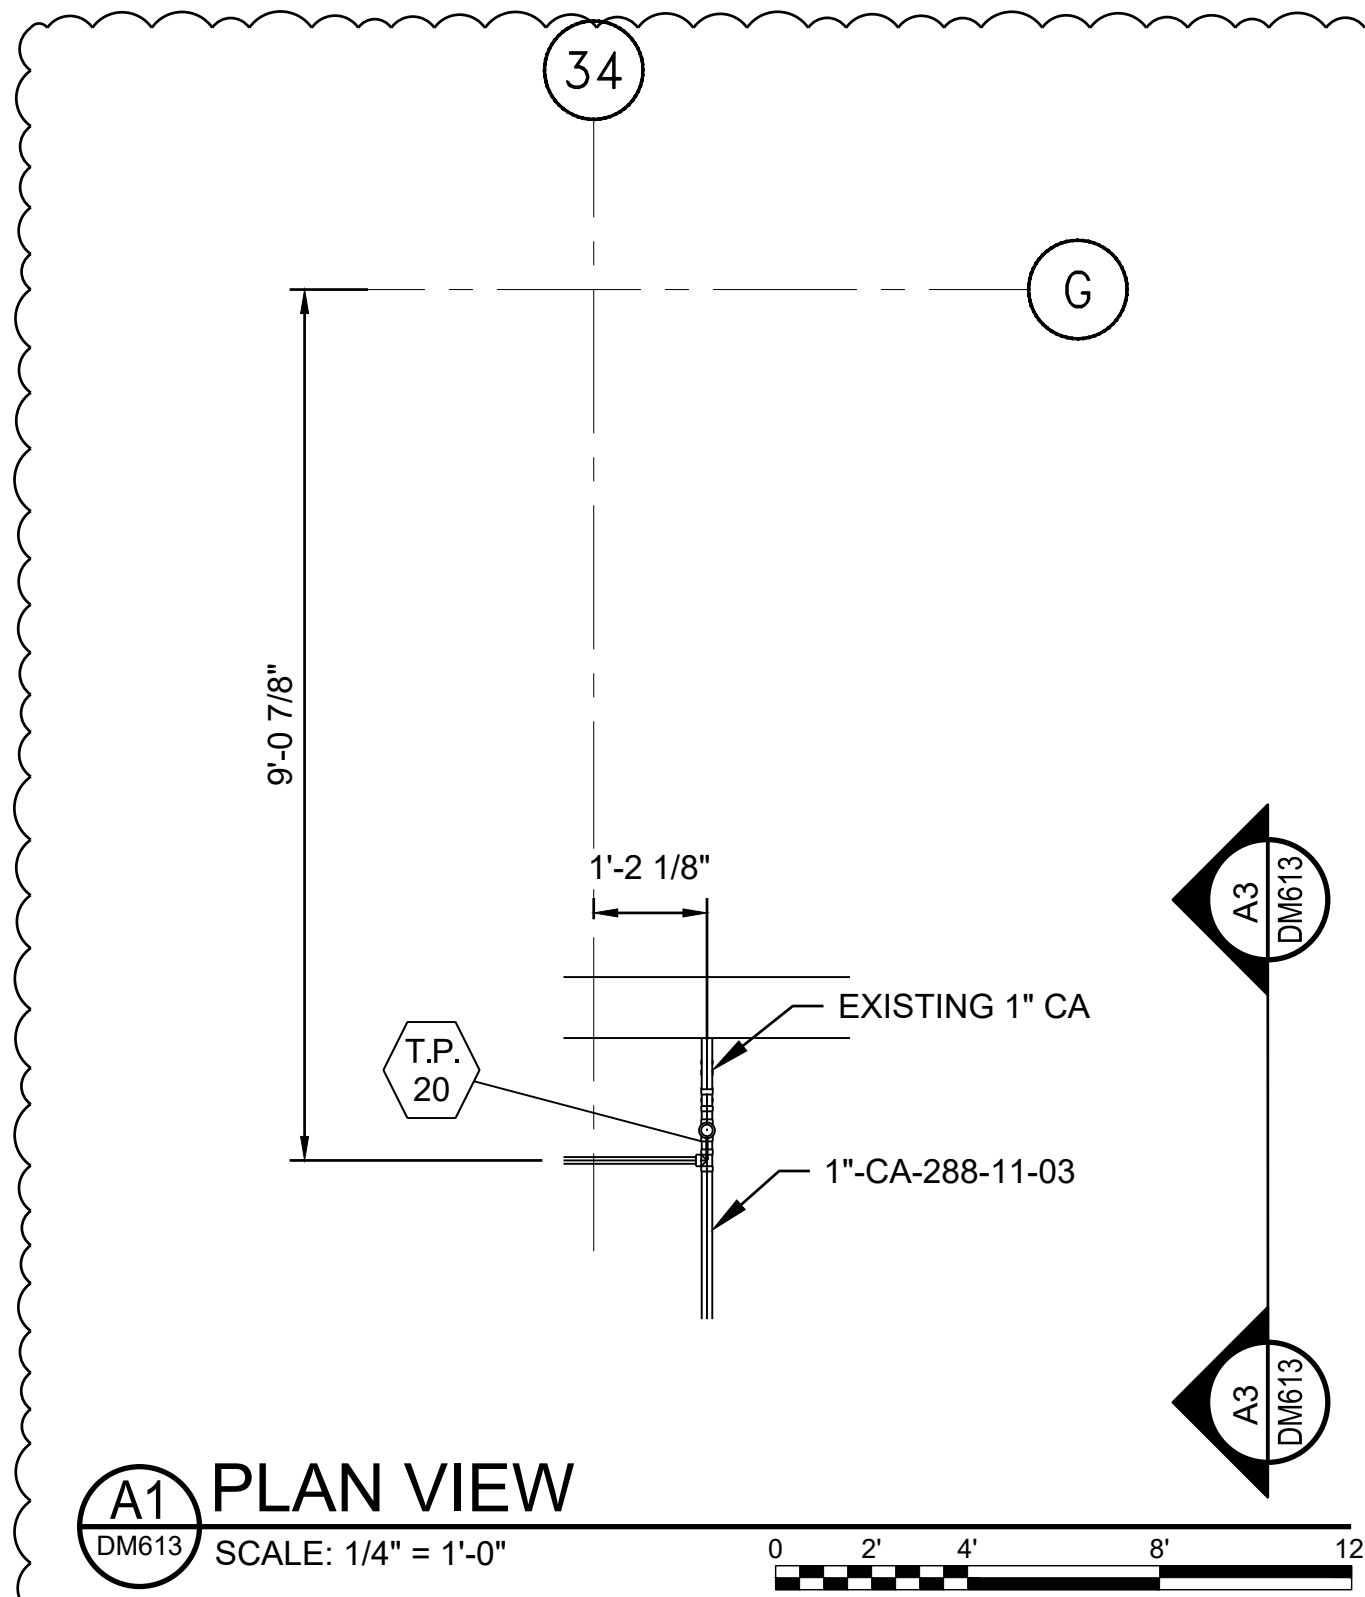


A1 PLAN VIEW
DM613 SCALE: 1/4" = 1'-0"

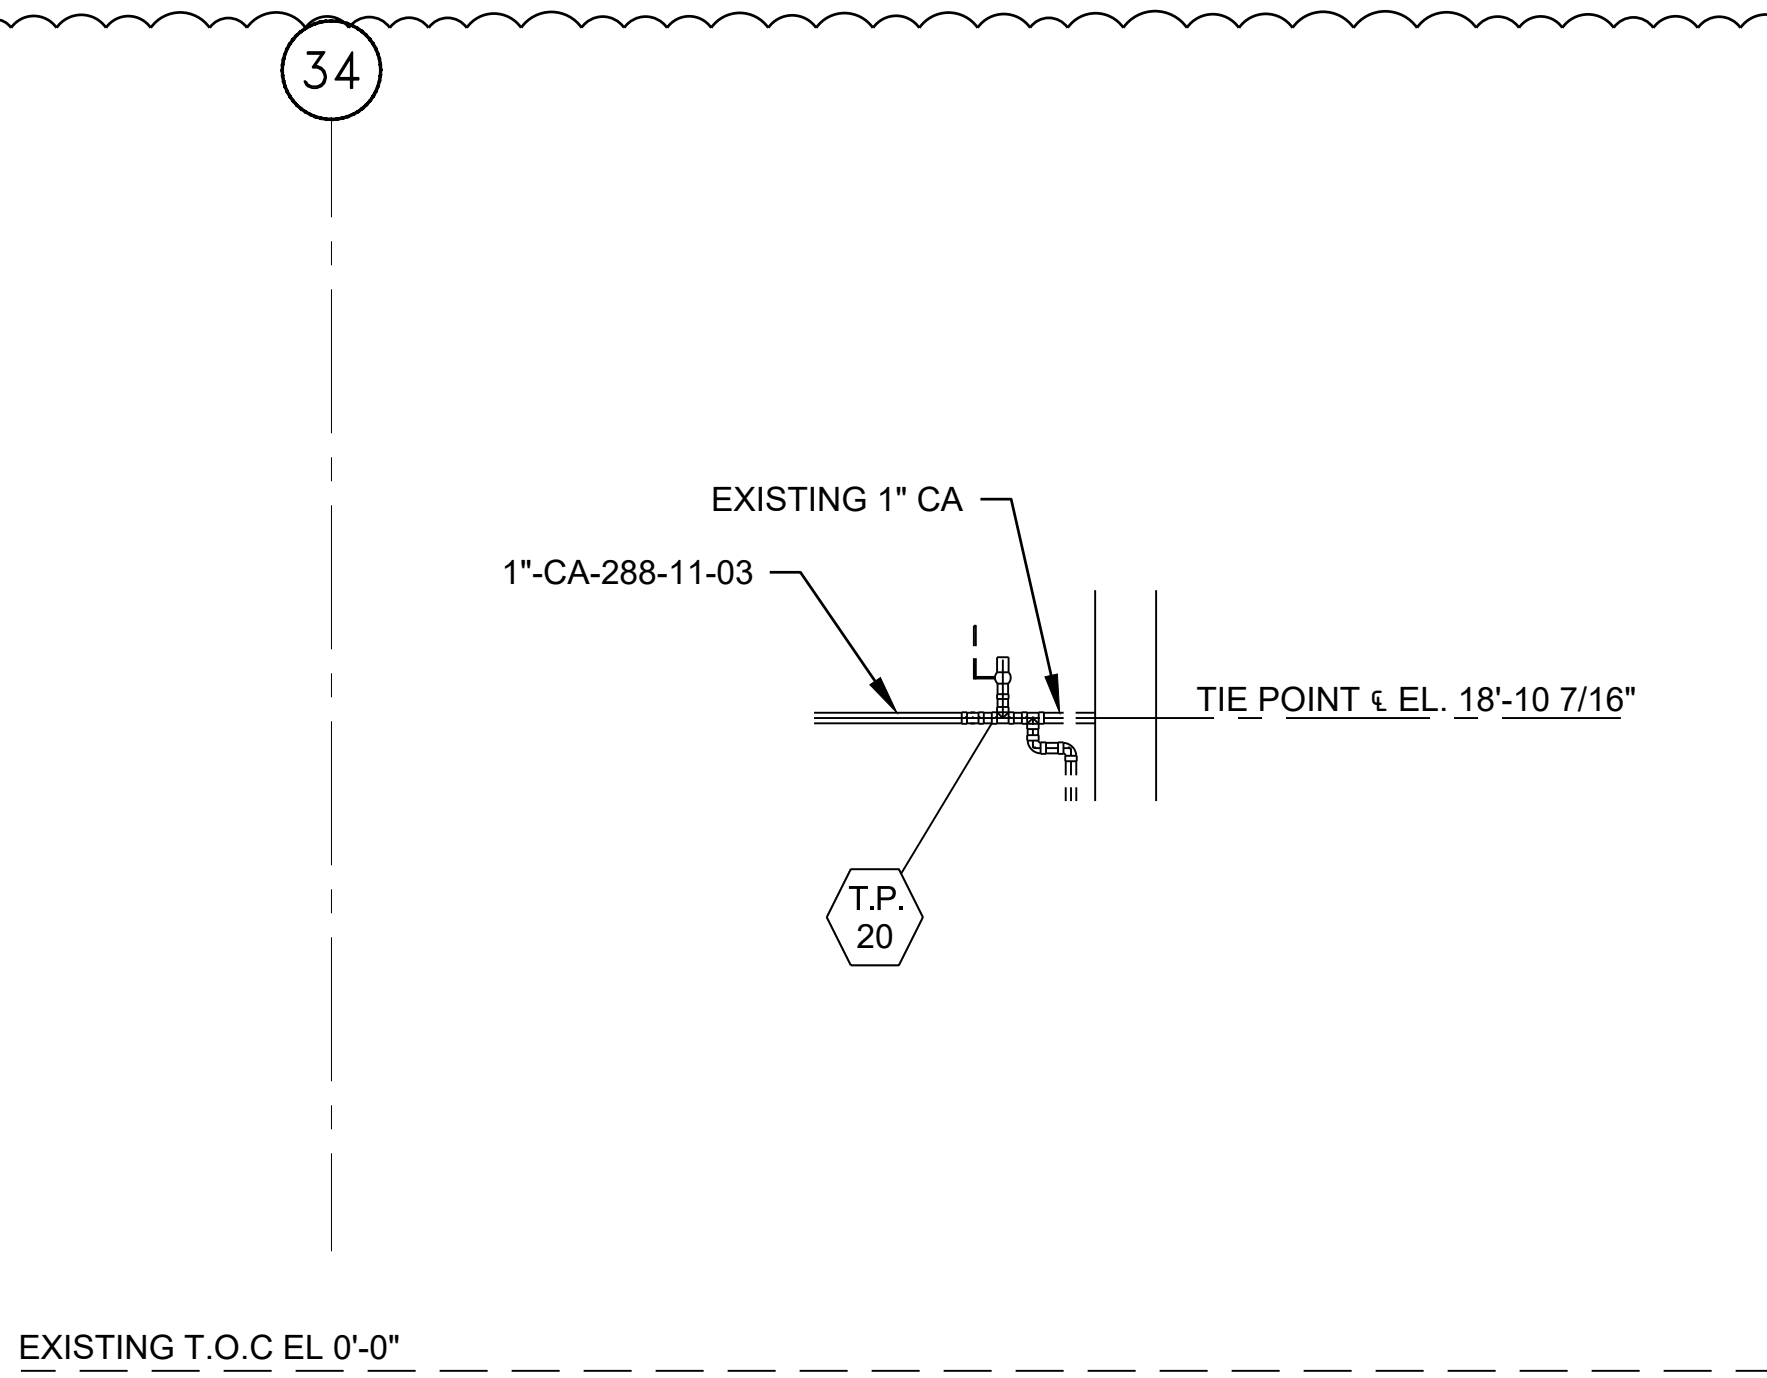


A3 SECTION VIEW
DM613 SCALE: 1 1/2" = 1'-0"

TIE-IN 20 - PLANT AIR - SECOND FLOOR - ROOM 510

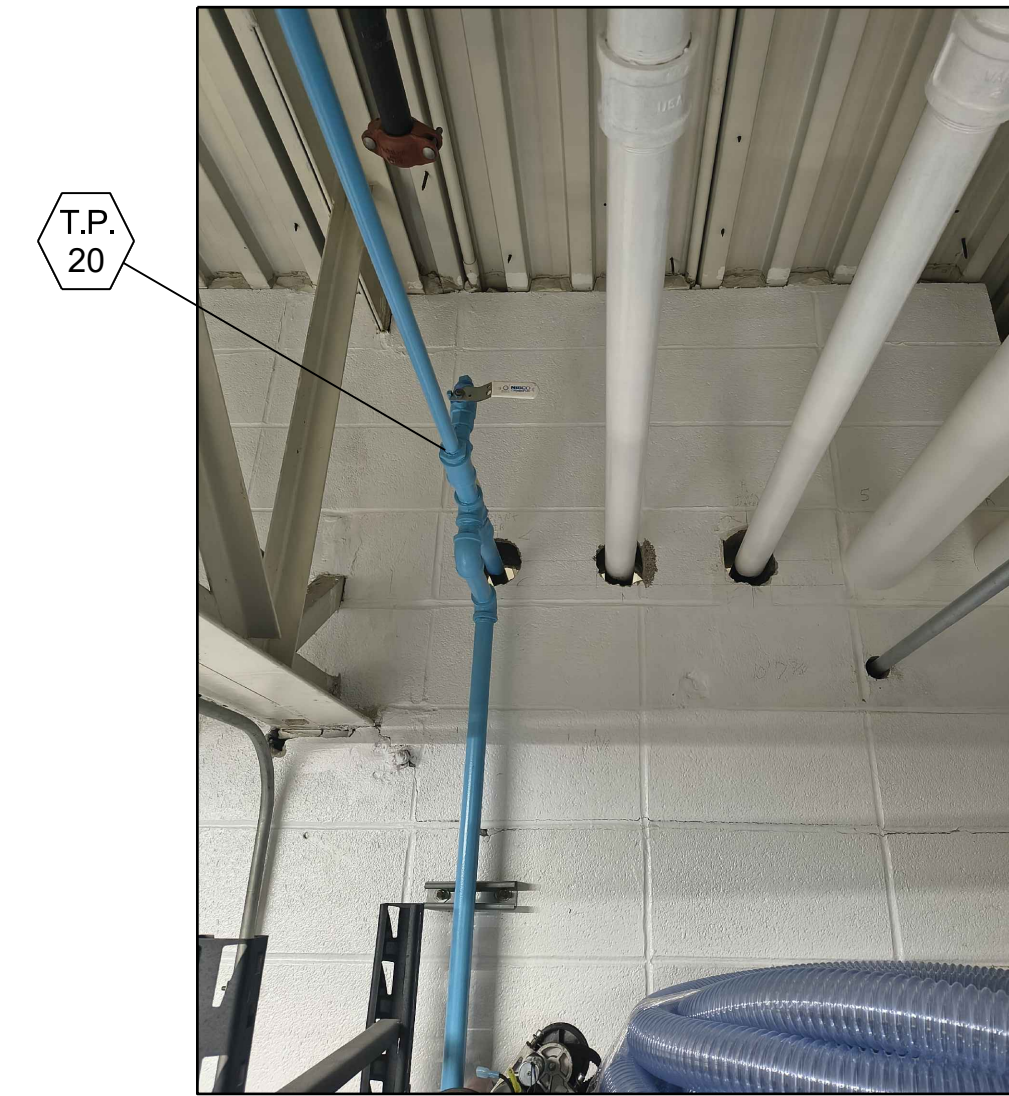

TIE-IN 20 - LOOKING WEST

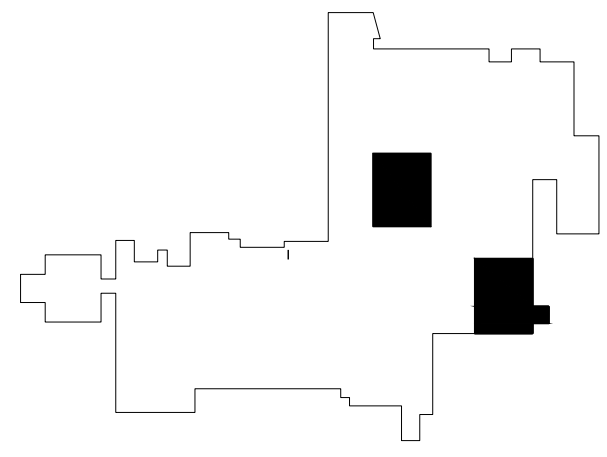

KEY PLAN



PLAN NORTH

BILL OF MATERIALS			
ID	SIZE	QTY	DESCRIPTION
1	10"	2	ELBOW 90 LR, SCH STD, BW, ASTM A234 GRADE WPB, PER ASME B16.9

BILL OF MATERIALS			
ID	SIZE	QTY	DESCRIPTION
1	10"	2	ELBOW 90 LR, SCH STD, BW, ASTM A234 GRADE WPB, PER ASME B16.9

SHEET NOTES:

- ALL PIPING SHOULD BE TESTED ACCORDING TO ASME B31.3 PROCESS PIPING.
- REFERENCE ARCH SHEETS FOR FINISHED FLOOR ELEVATIONS FOR EACH AREA.
- MATERIALS OF CONSTRUCTION TO AGREE WITH PIPING AND VALVE SERVICE INDEX. SEE DMXXX FOR PIPE SERVICE INDEX.
- EACH VALVE, INSTALLED AS A TIE-IN FOR CONTINUATION, SHOULD BE CLOSED AND LOCKED TO AVOID THE OPENING OF THE VALVE UNTIL SUCH TIME THE ASSOCIATED PIPE HAS BEEN COMPLETED.
- ALL DIMENSIONS SHOWN ARE FIELD MEASURED. CONTRACTOR TO VERIFY BEFORE INSTALLATION.
- TIE-INS ARE BASED ON ALL AZO EQUIPMENT DATED 3/16 SUBMITTAL PROVIDED TO VANTIVE. ANY INFORMATION MISSING OR CLASHING WILL BE COORDINATED BY CONTRACTOR BEFORE INSTALLATION.

POND
3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092
Copyright © 2023 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

CONFIDENTIAL-TRADE-SECRET

EOR/AOR SEAL

CONSULTANT

CLIENT INFORMATION

Vantive

PROJECT NAME

VANTIVE
TUBING
CLEAN ROOM

1900 AR-201
MOUNTAIN HOME,
ARKANSAS 72653

DRAWING ISSUE

ISSUED FOR BID: BID CLARIFICATIONS 02/27/2026 02/27/2026
BID OPENING DATE
BID OPENING MARK

DESIGNED BY: CO
DRAWN BY: CB
CHECKED BY: JP
SUBMITTED BY: CL
DATE: 02/27/2026
PROJECT # 1241011

SHEET TITLE

PROCESS
TIE POINTS
4

SHEET NUMBER

DM613

SHEET 1 OF 1

ORIGINAL SHEET SIZE:
30" X 42"