



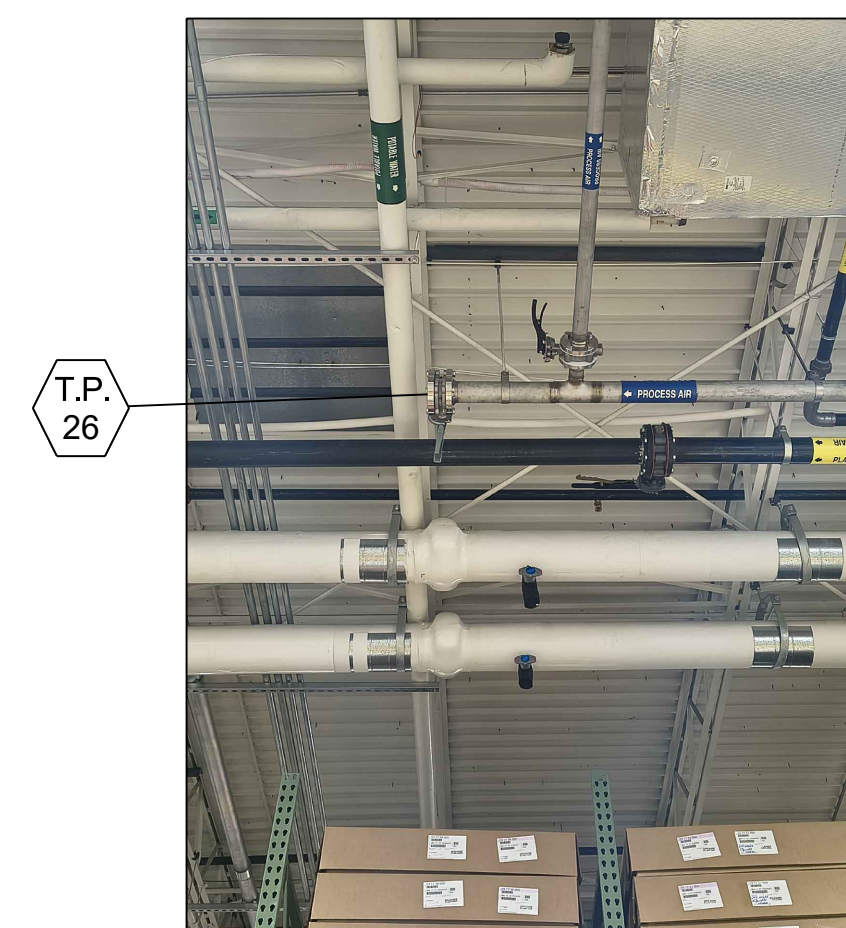



TIE-IN 26 - LOOKING EAST

1. ALL PIPING SHOULD BE TESTED ACCORDING TO ASME B31.3 PROCESS PIPING.
2. REFERENCE ARCH SHEETS FOR FINISHED FLOOR ELEVATIONS FOR EACH AREA.
3. MATERIALS OF CONSTRUCTION TO AGREE WITH PIPING AND VALVE SERVICE INDEX, SEE DMMXX FOR PIPE SERVICE INDEX.
4. EACH VALVE, INSTALLED AS A TIE-IN FOR CONTINUATION, SHOULD BE CLOSED AND LOCKED TO AVOID THE OPENING OF THE VALVE UNTIL SUCH TIME THE ASSOCIATED PIPE HAS BEEN COMPLETED.
5. ALL DIMENSIONS SHOWN ARE FIELD MEASURED. CONTRACTOR TO VERIFY BEFORE INSTALLATION.

6. TIE-INS ARE BASED ON ALL AZO EQUIPMENT DATED 3/16 SUBMITTAL PROVIDED TO VANTIVE. ANY INFORMATION MISSING OR CLASHING WILL BE COORDINATED BY CONTRACTOR BEFORE INSTALLATION.

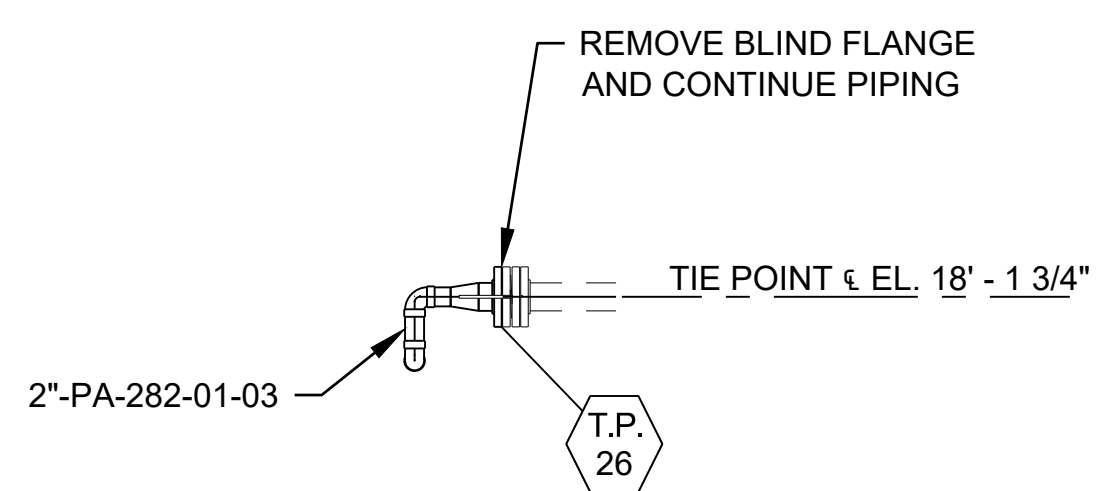



TIE-IN 26 - PROCESS AIR - ROOM 565

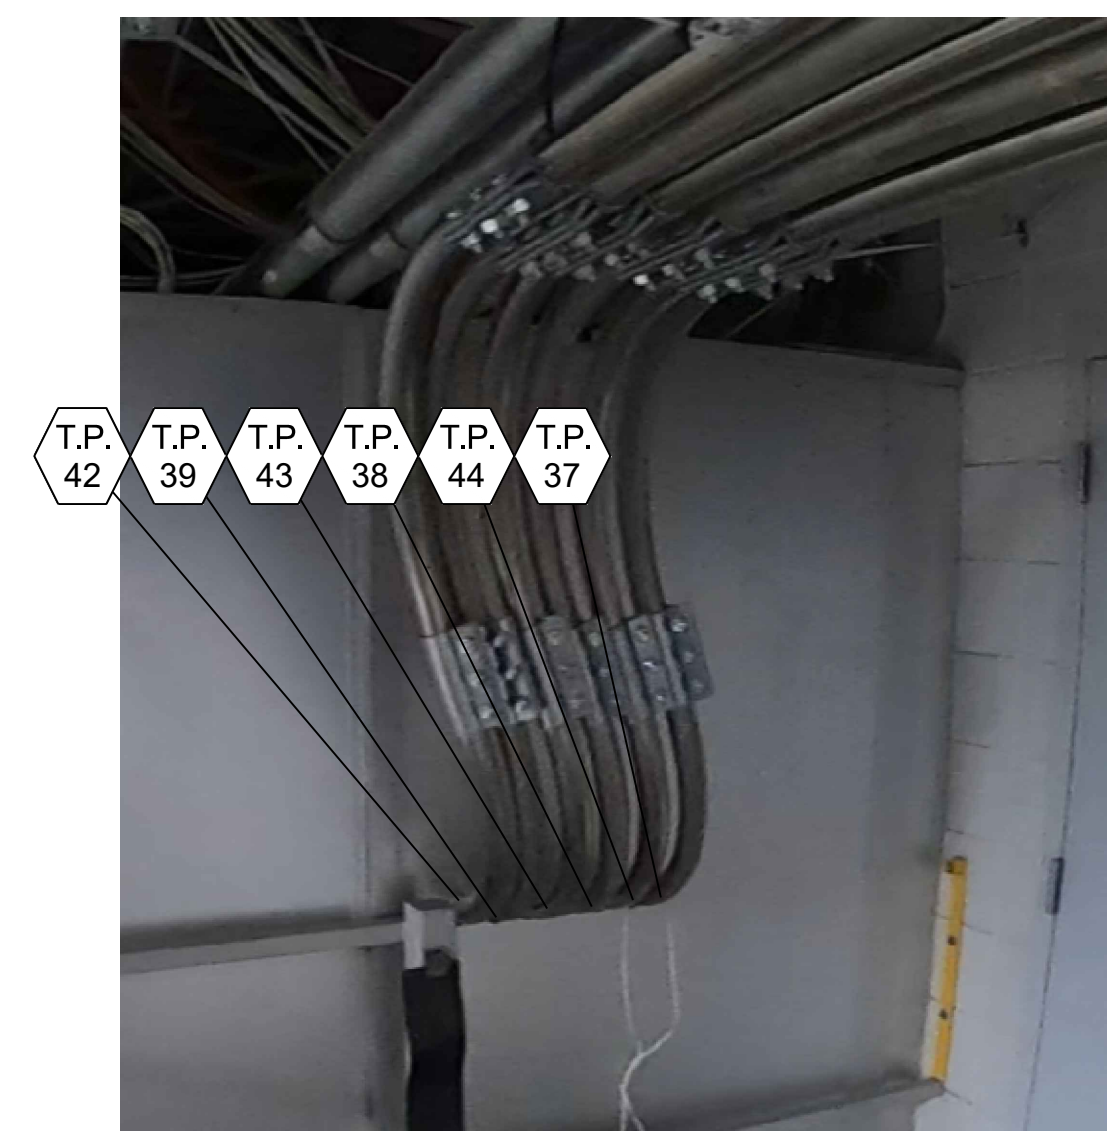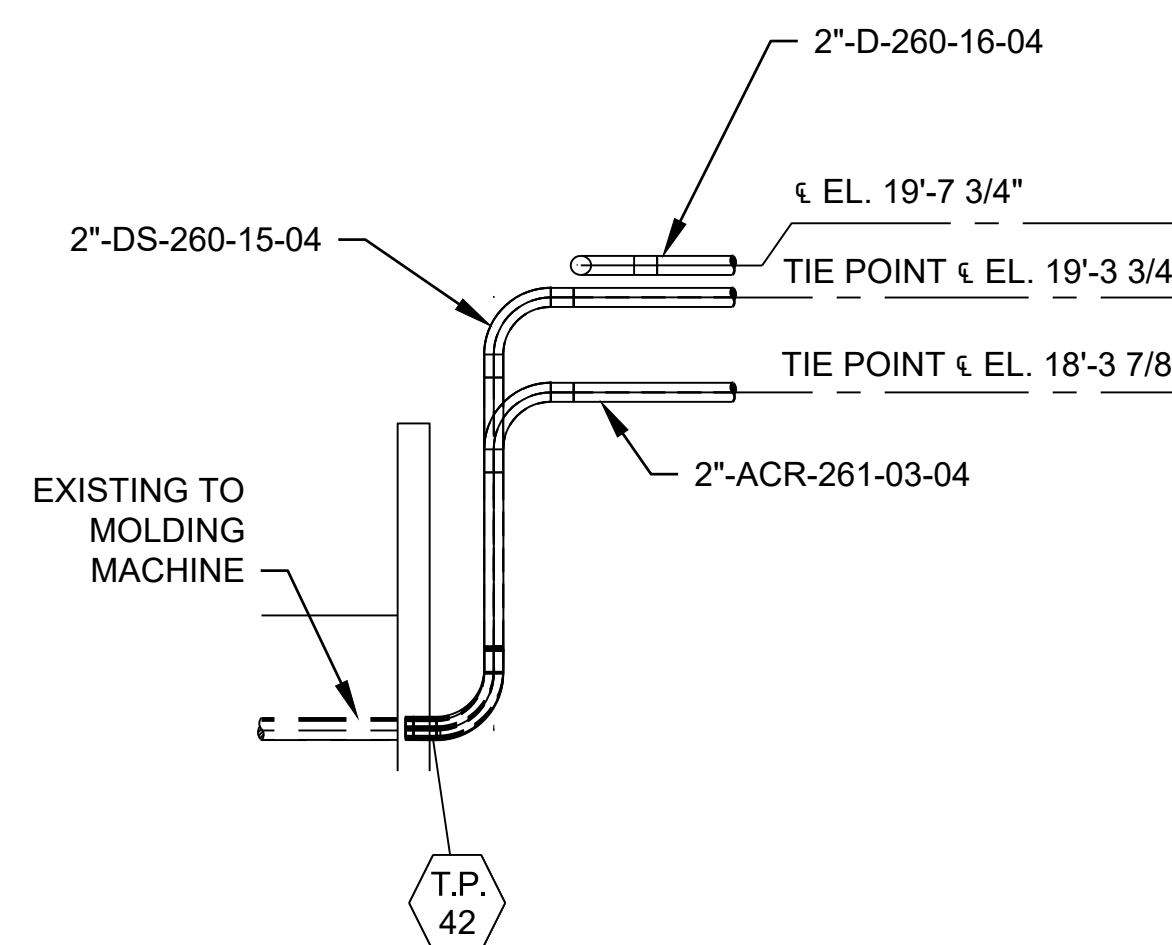

TIE-IN 37, 38, 39, 42, 43, & 44 - LOOKING WEST




TIE-IN 37, 38, 39, 42, 43, & 44 - ACRYLICS AREA

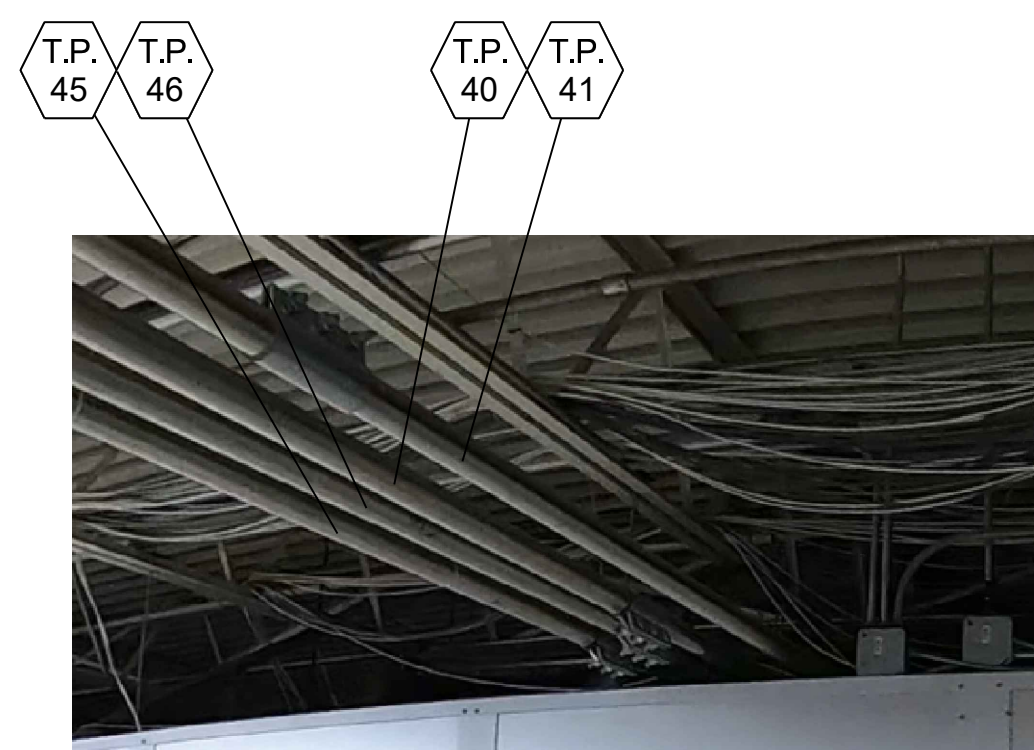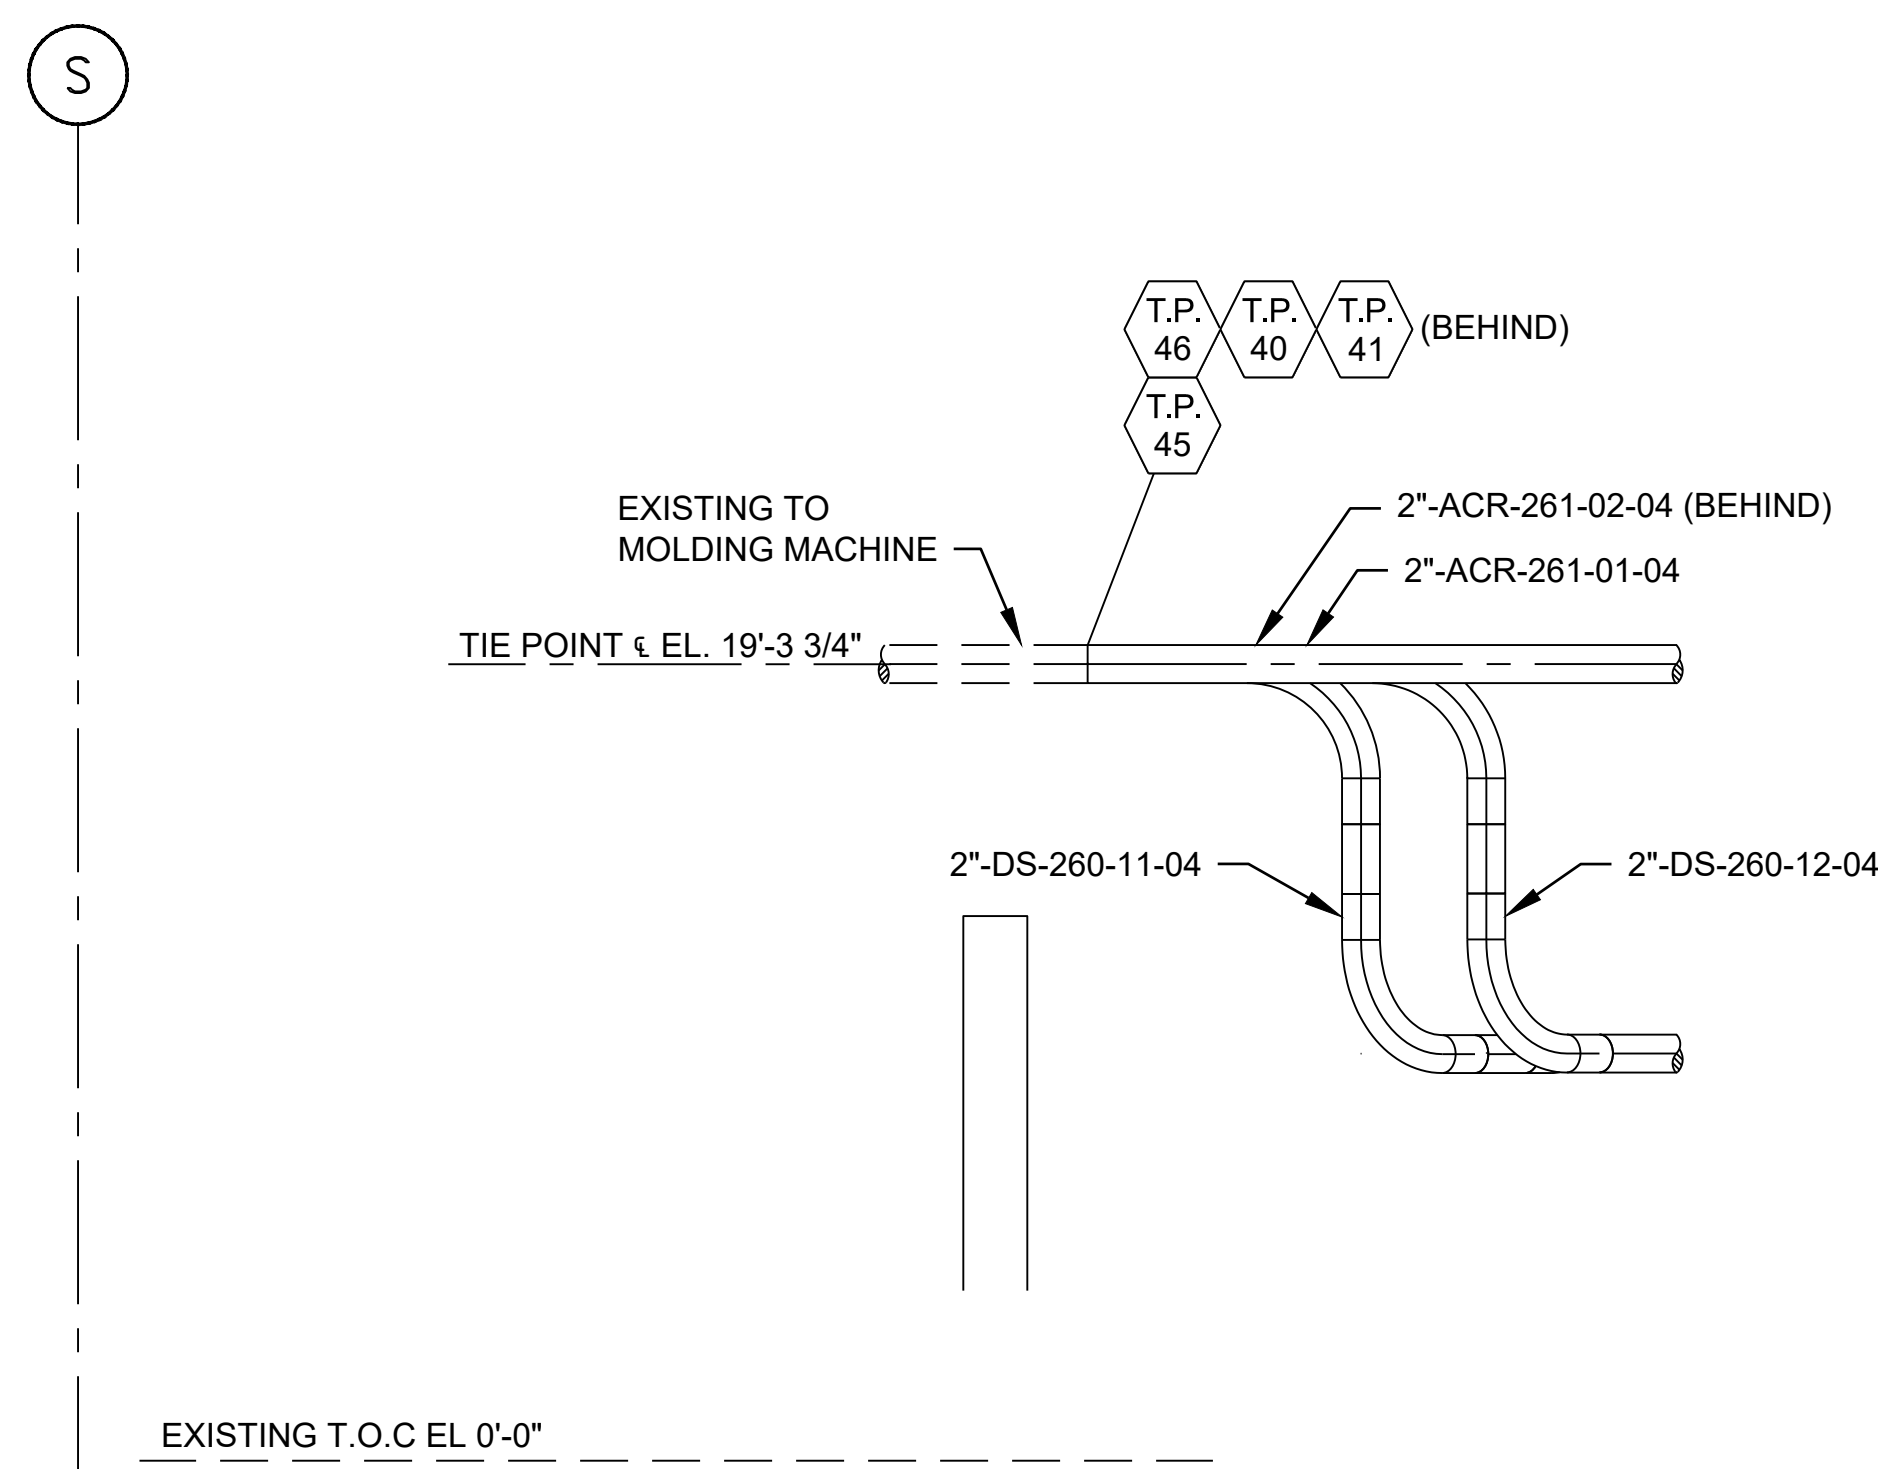

TIE-IN 40, 41, 45, & 46 - LOOKING EAST



TIE-IN 40, 41, 45, & 46 - PROCESS AIR - ROOM 565

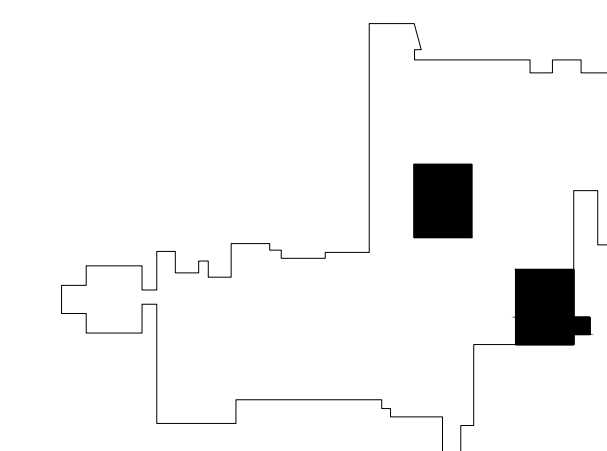

KEY PLAN

