


SHEET NOTES:


1. ALL PIPING SHOULD BE TESTED ACCORDING TO ASME B31.3 PROCESS PIPING.
2. REFERENCE ARCH SHEETS FOR FINISHED FLOOR ELEVATIONS FOR EACH AREA.
3. MATERIALS OF CONSTRUCTION TO AGREE WITH PIPING AND VALVE SERVICE INDEX, SEE DMXXX FOR PIPE SERVICE INDEX.
4. EACH VALVE, INSTALLED AS A TIE-IN FOR CONTINUATION, SHOULD BE CLOSED AND LOCKED TO AVOID THE OPENING OF THE VALVE UNTIL SUCH TIME THE ASSOCIATED PIPE HAS BEEN COMPLETED.
5. ALL DIMENSIONS SHOWN ARE FIELD MEASURED, CONTRACTOR TO VERIFY BEFORE INSTALLATION.
6. TIE-INS ARE BASED ON ALL AZO EQUIPMENT DATED 3/16 SUBMITTAL PROVIDED TO VANTIVE. ANY INFORMATION MISSING OR CLASHING WILL BE COORDINATED BY CONTRACTOR BEFORE INSTALLATION.

BILL OF MATERIALS				
ID	QTY	ND	SCH/CLASS	DESCRIPTION
1	2	4"	STD	TEE, SCH STD, BW, ASTM A234 GRADE WPB, PER ASME B16.9

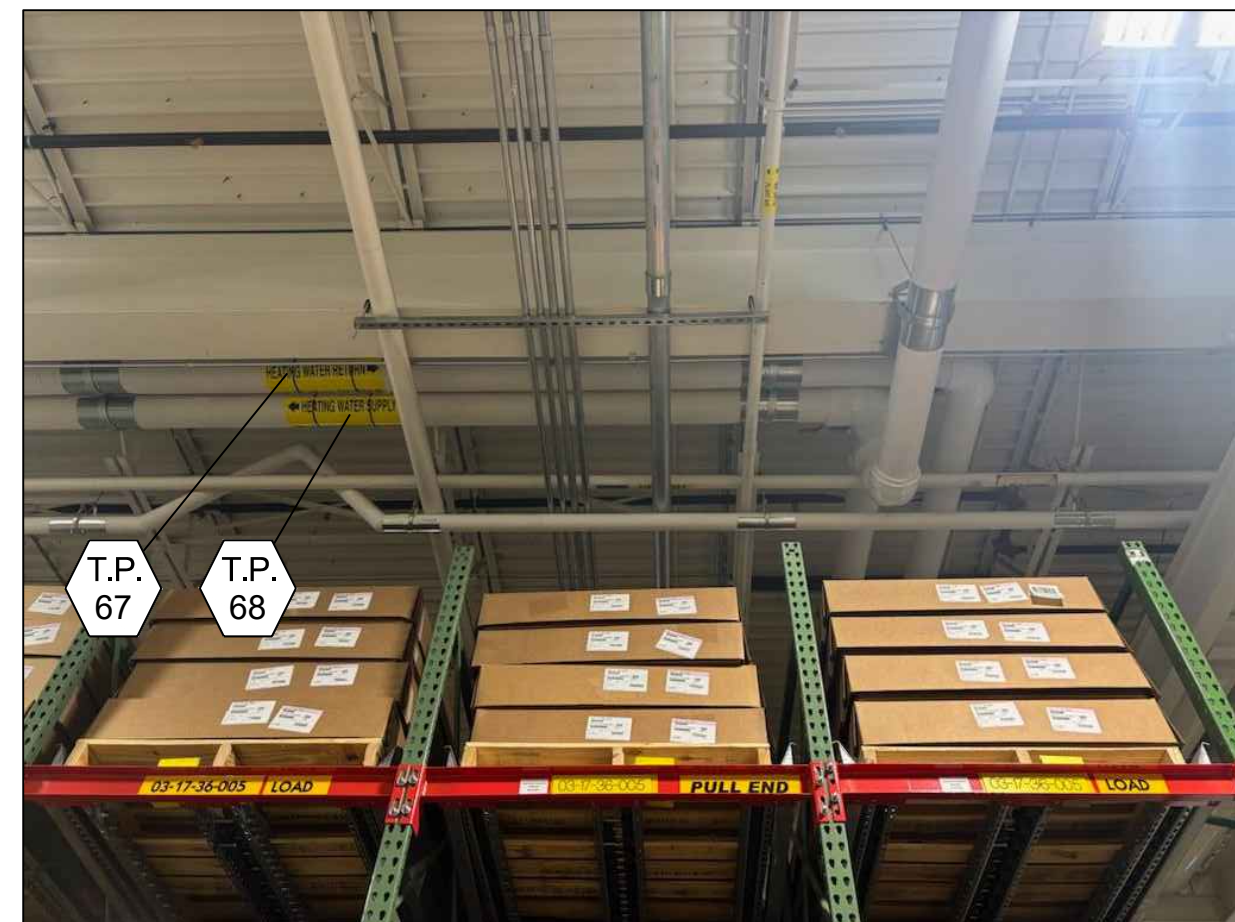


TIE-IN 67 & 68 - LOOKING WEST

BILL OF MATERIALS				
ID	QTY	ND	SCH/CLASS	DESCRIPTION
1	2	6"x2"	3000	THREAOLET, CLASS 3000, BWXFT, ASTM A105, PER MSS SP-97


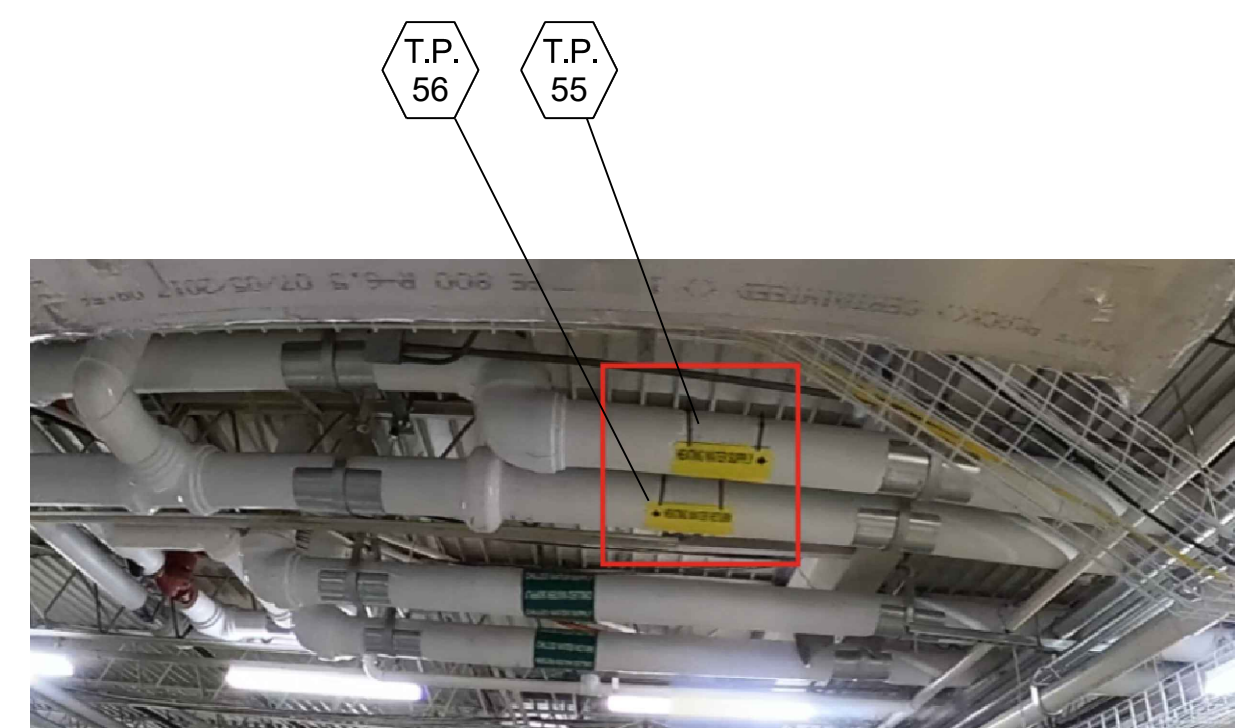


TIE-IN 55 & 56 - LOOKING WEST


BILL OF MATERIALS				
ID	QTY	ND	SCH/CLASS	DESCRIPTION
1	2	6"x4"	STD	TEE (RED), SCH STD, BW, ASTM A234 GRADE WPB, PER ASME B16.9

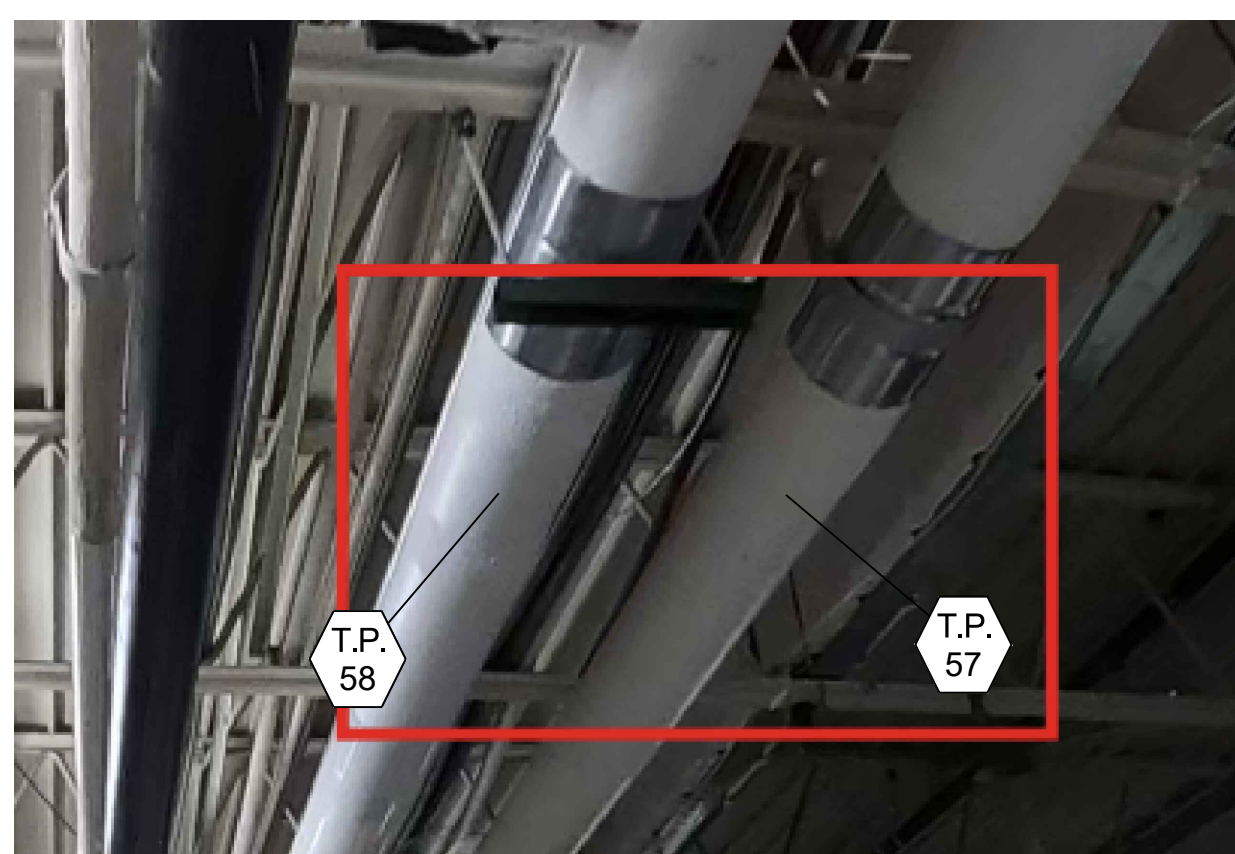


TIE-IN 57 & 58 - LOOKING EAST

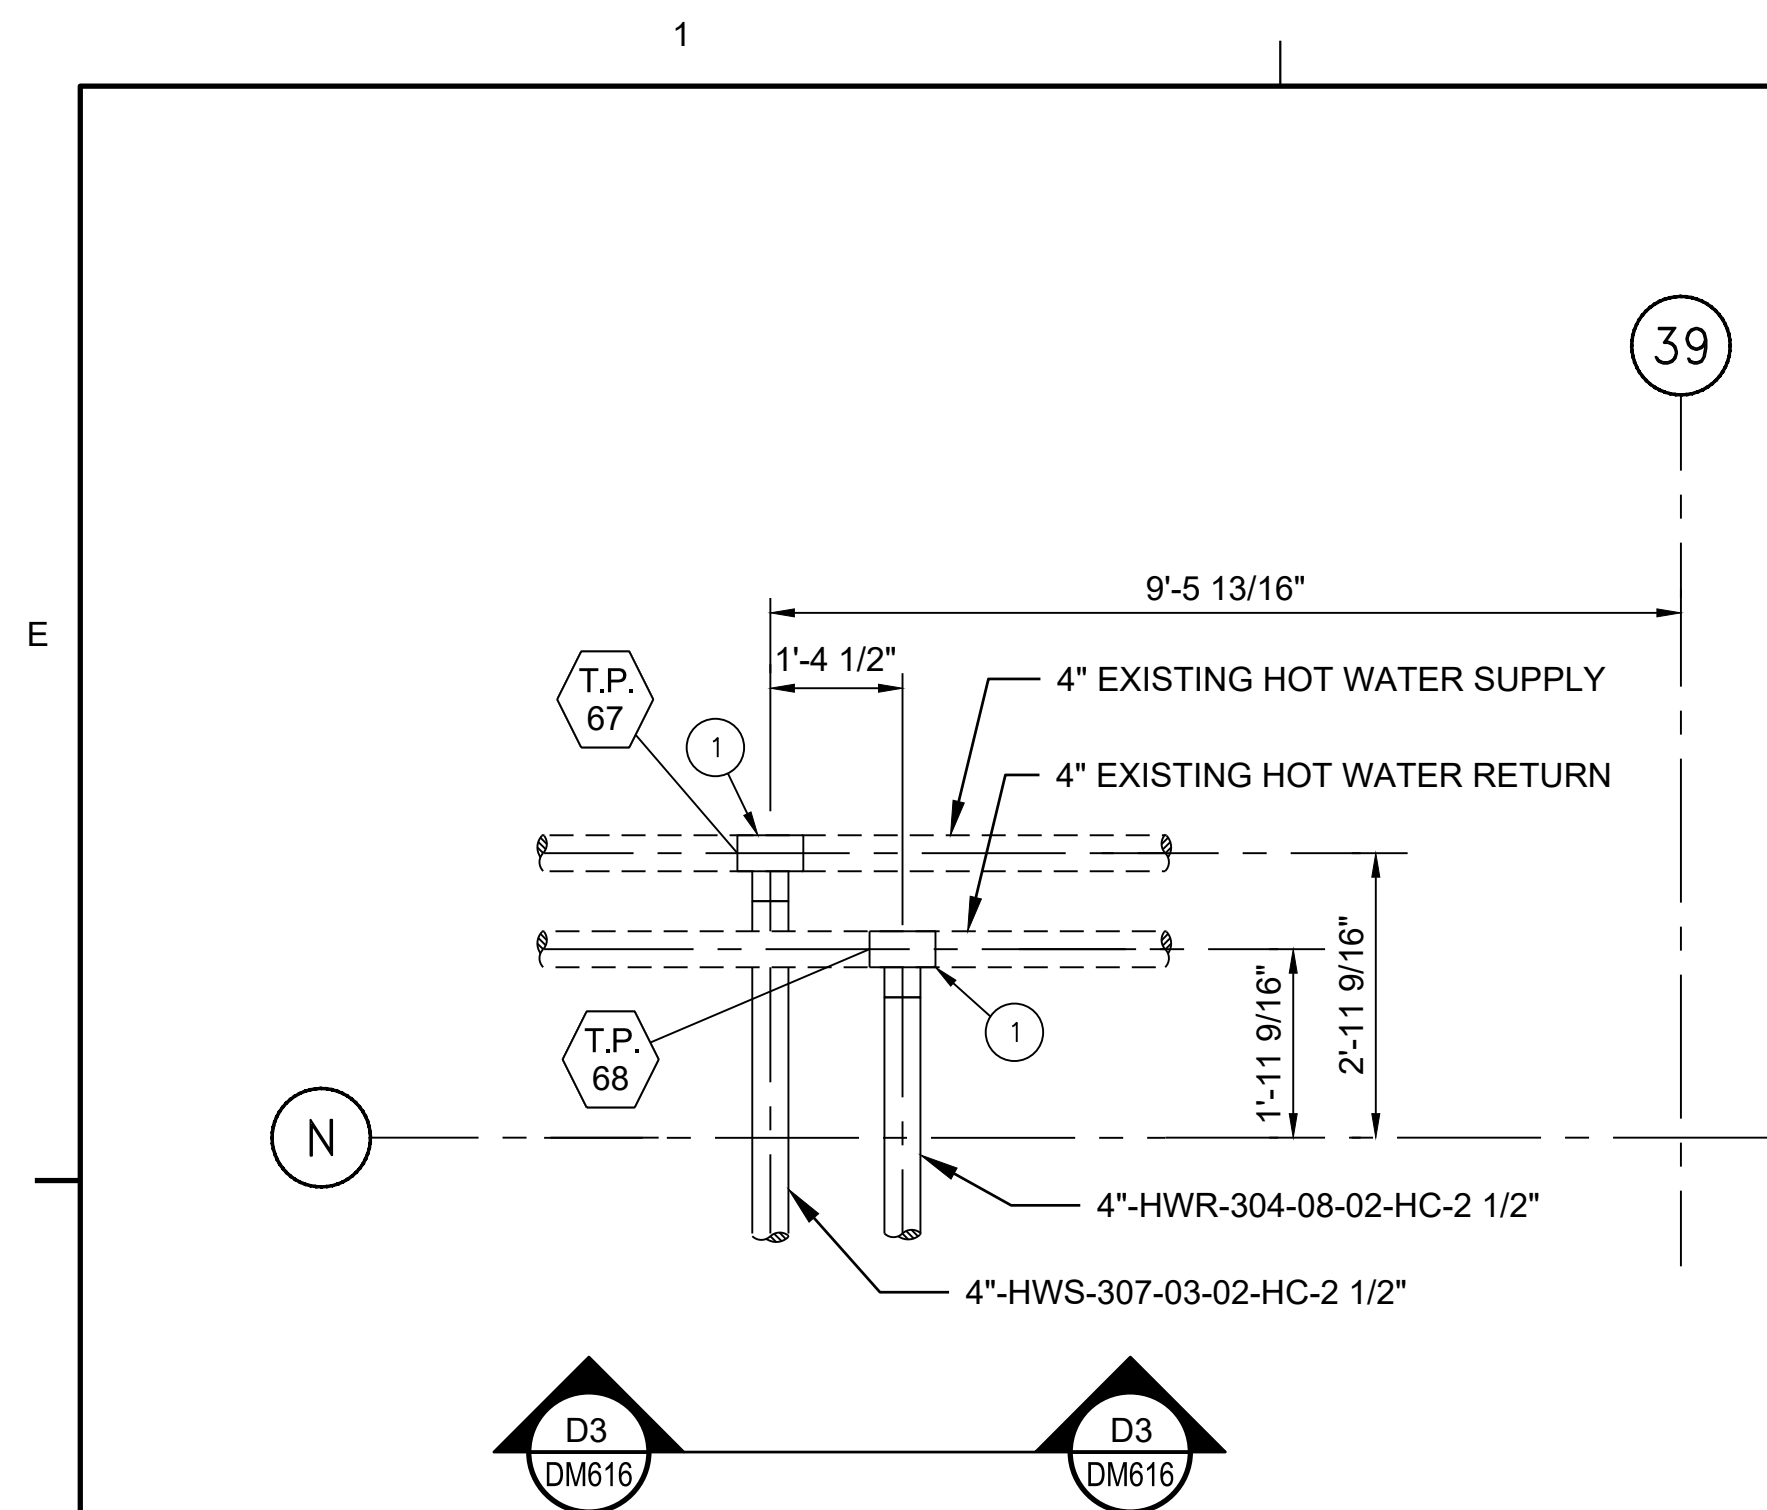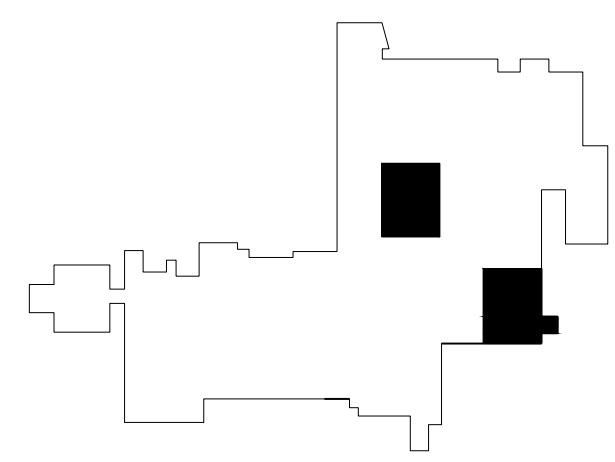


D1 PLAN VIEW
DM616 SCALE: 1/2" = 1'-0"

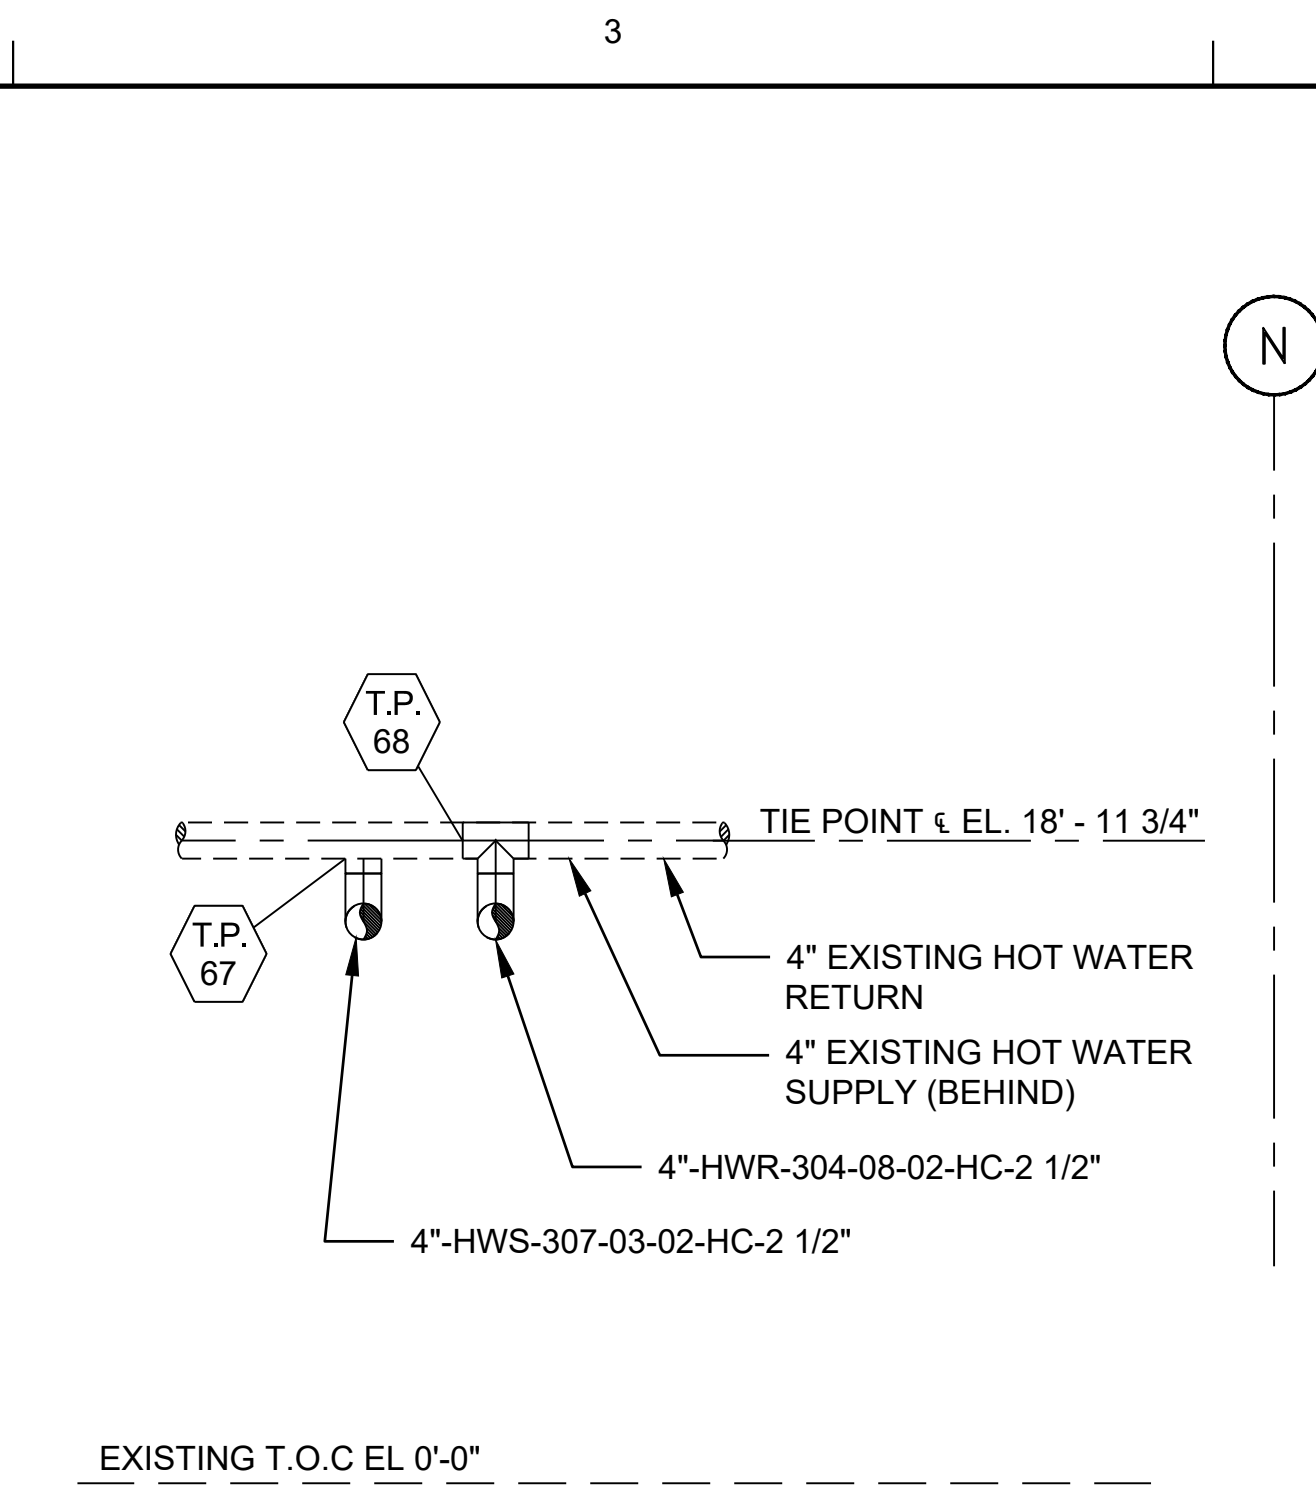


D3 SECTION VIEW
DM616 SCALE: 1/2" = 1'-0"

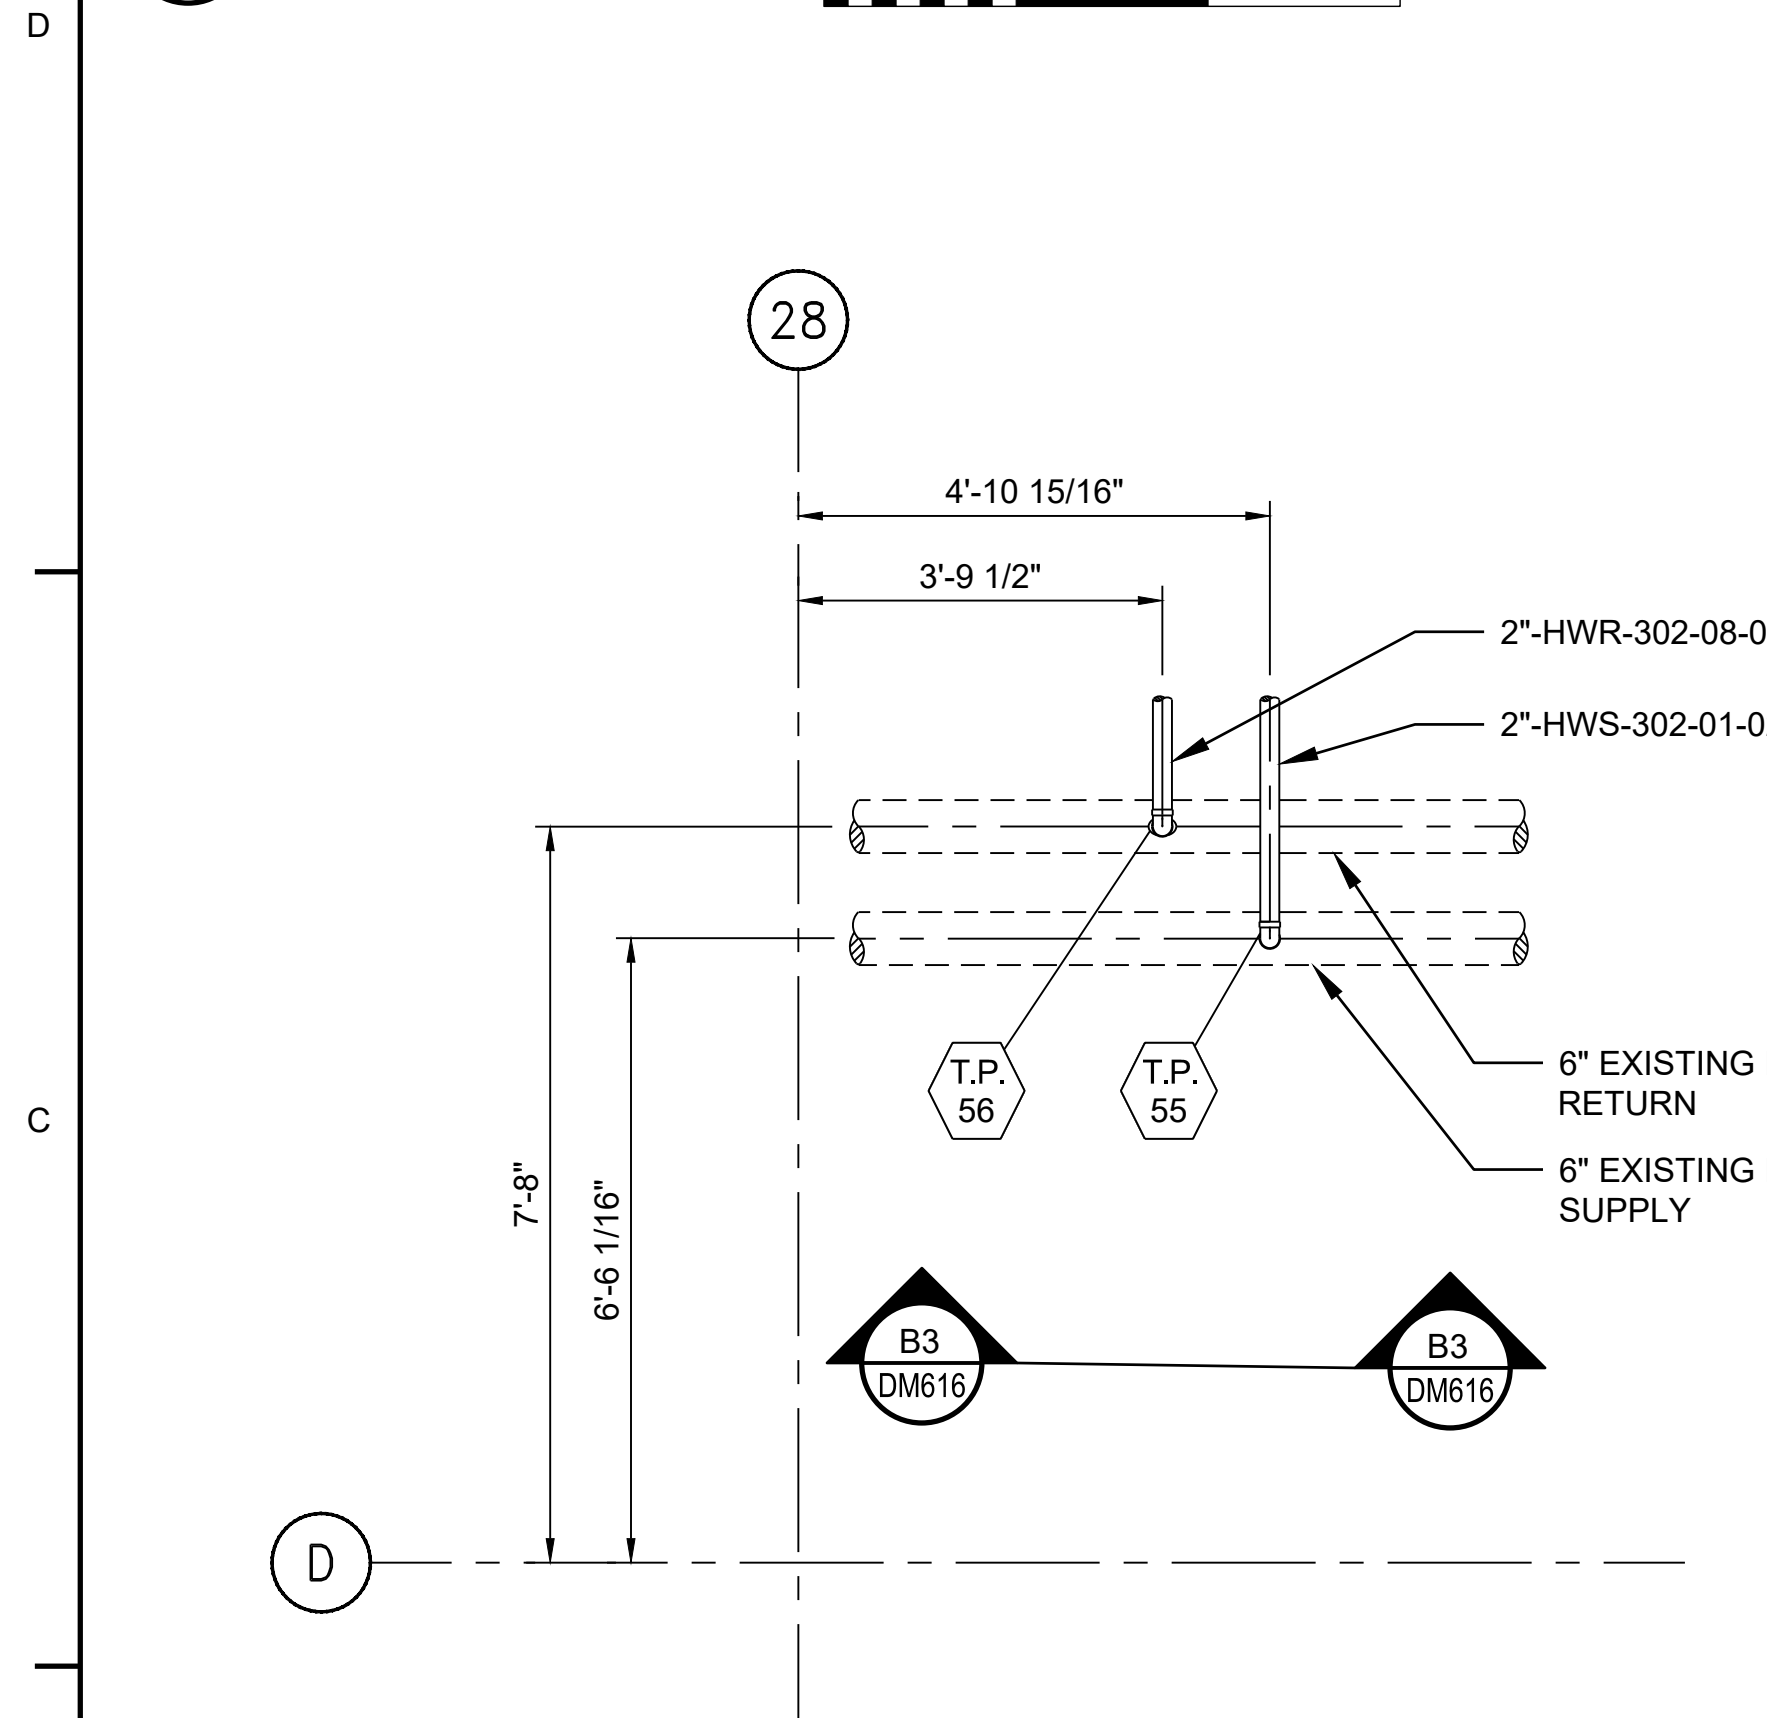


B1 PLAN VIEW
DM616 SCALE: 1/2" = 1'-0"

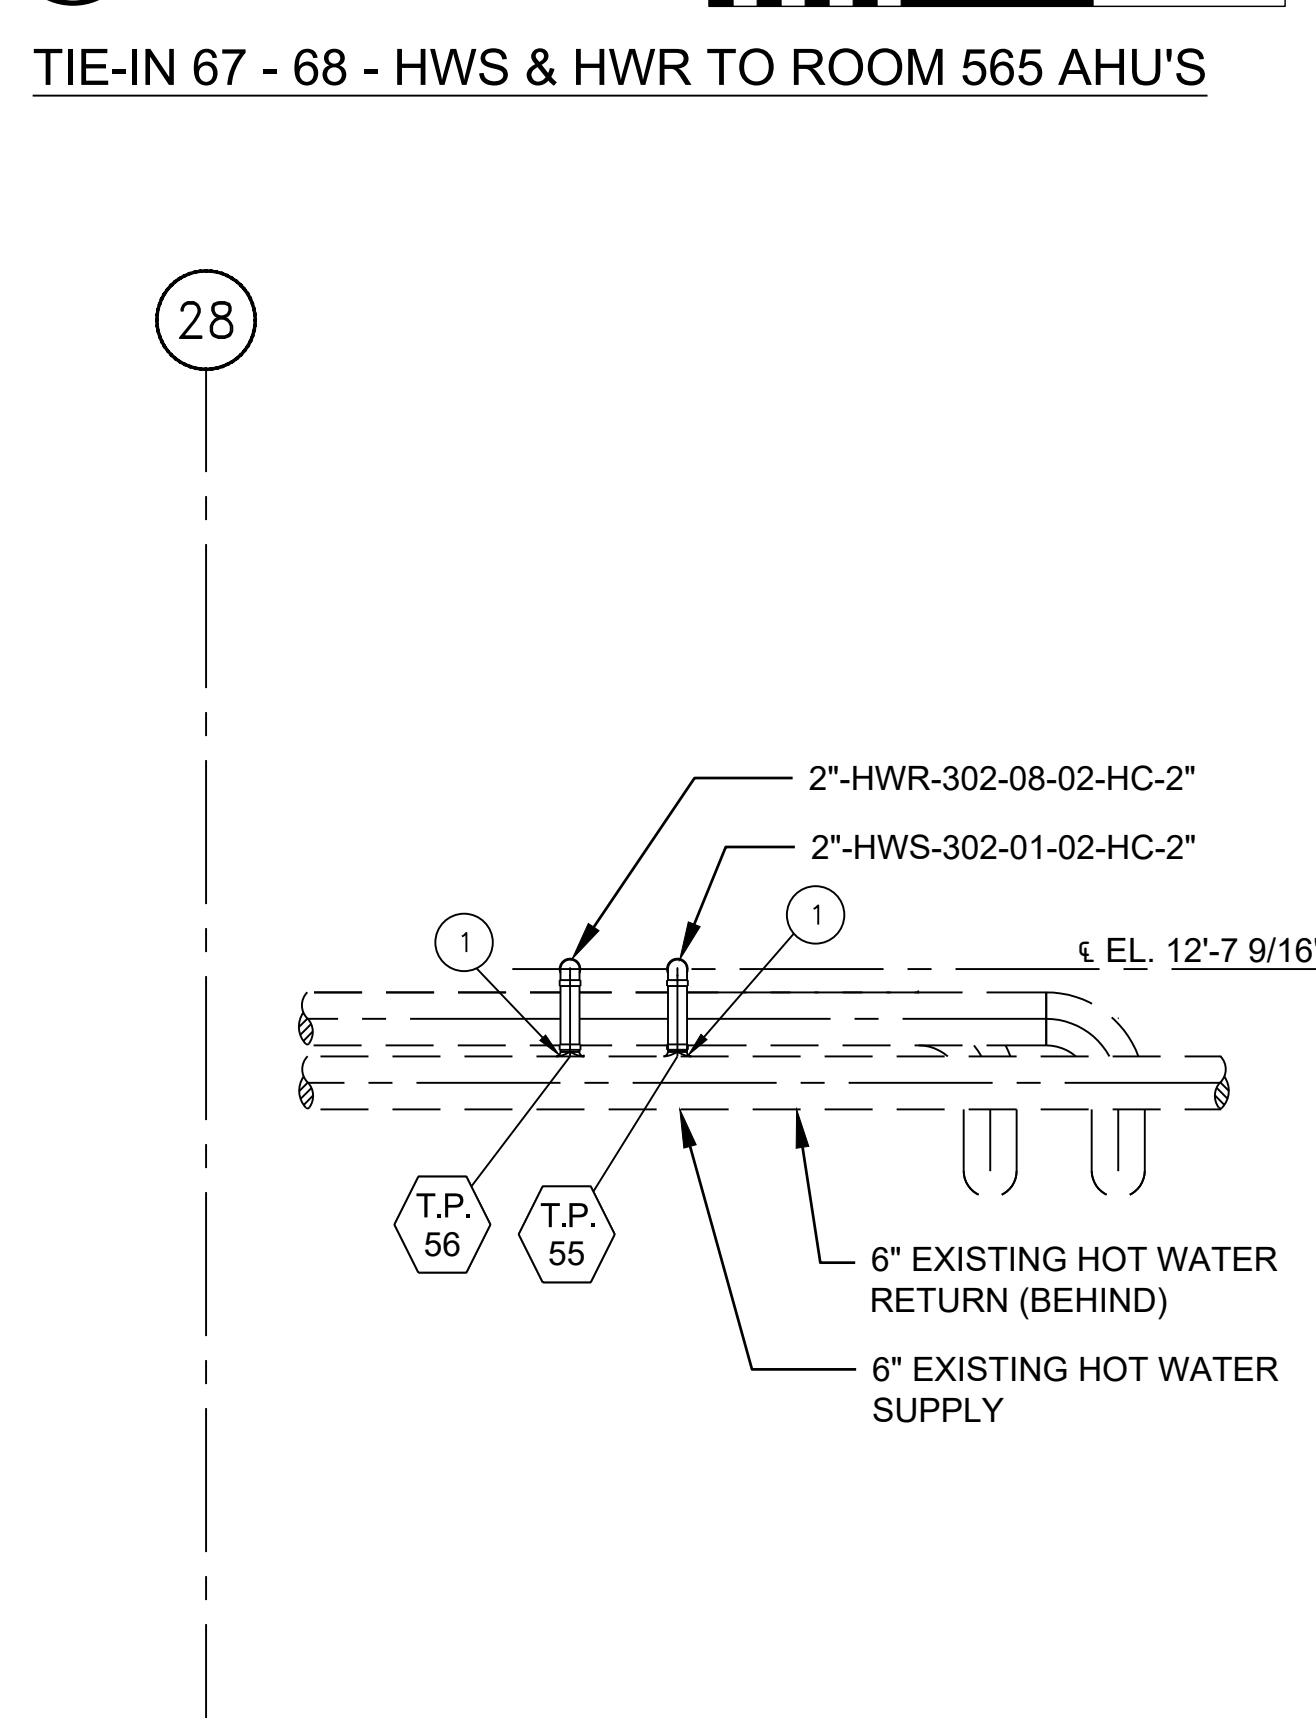

B3 SECTION VIEW
DM616 SCALE: 1/2" = 1'-0"

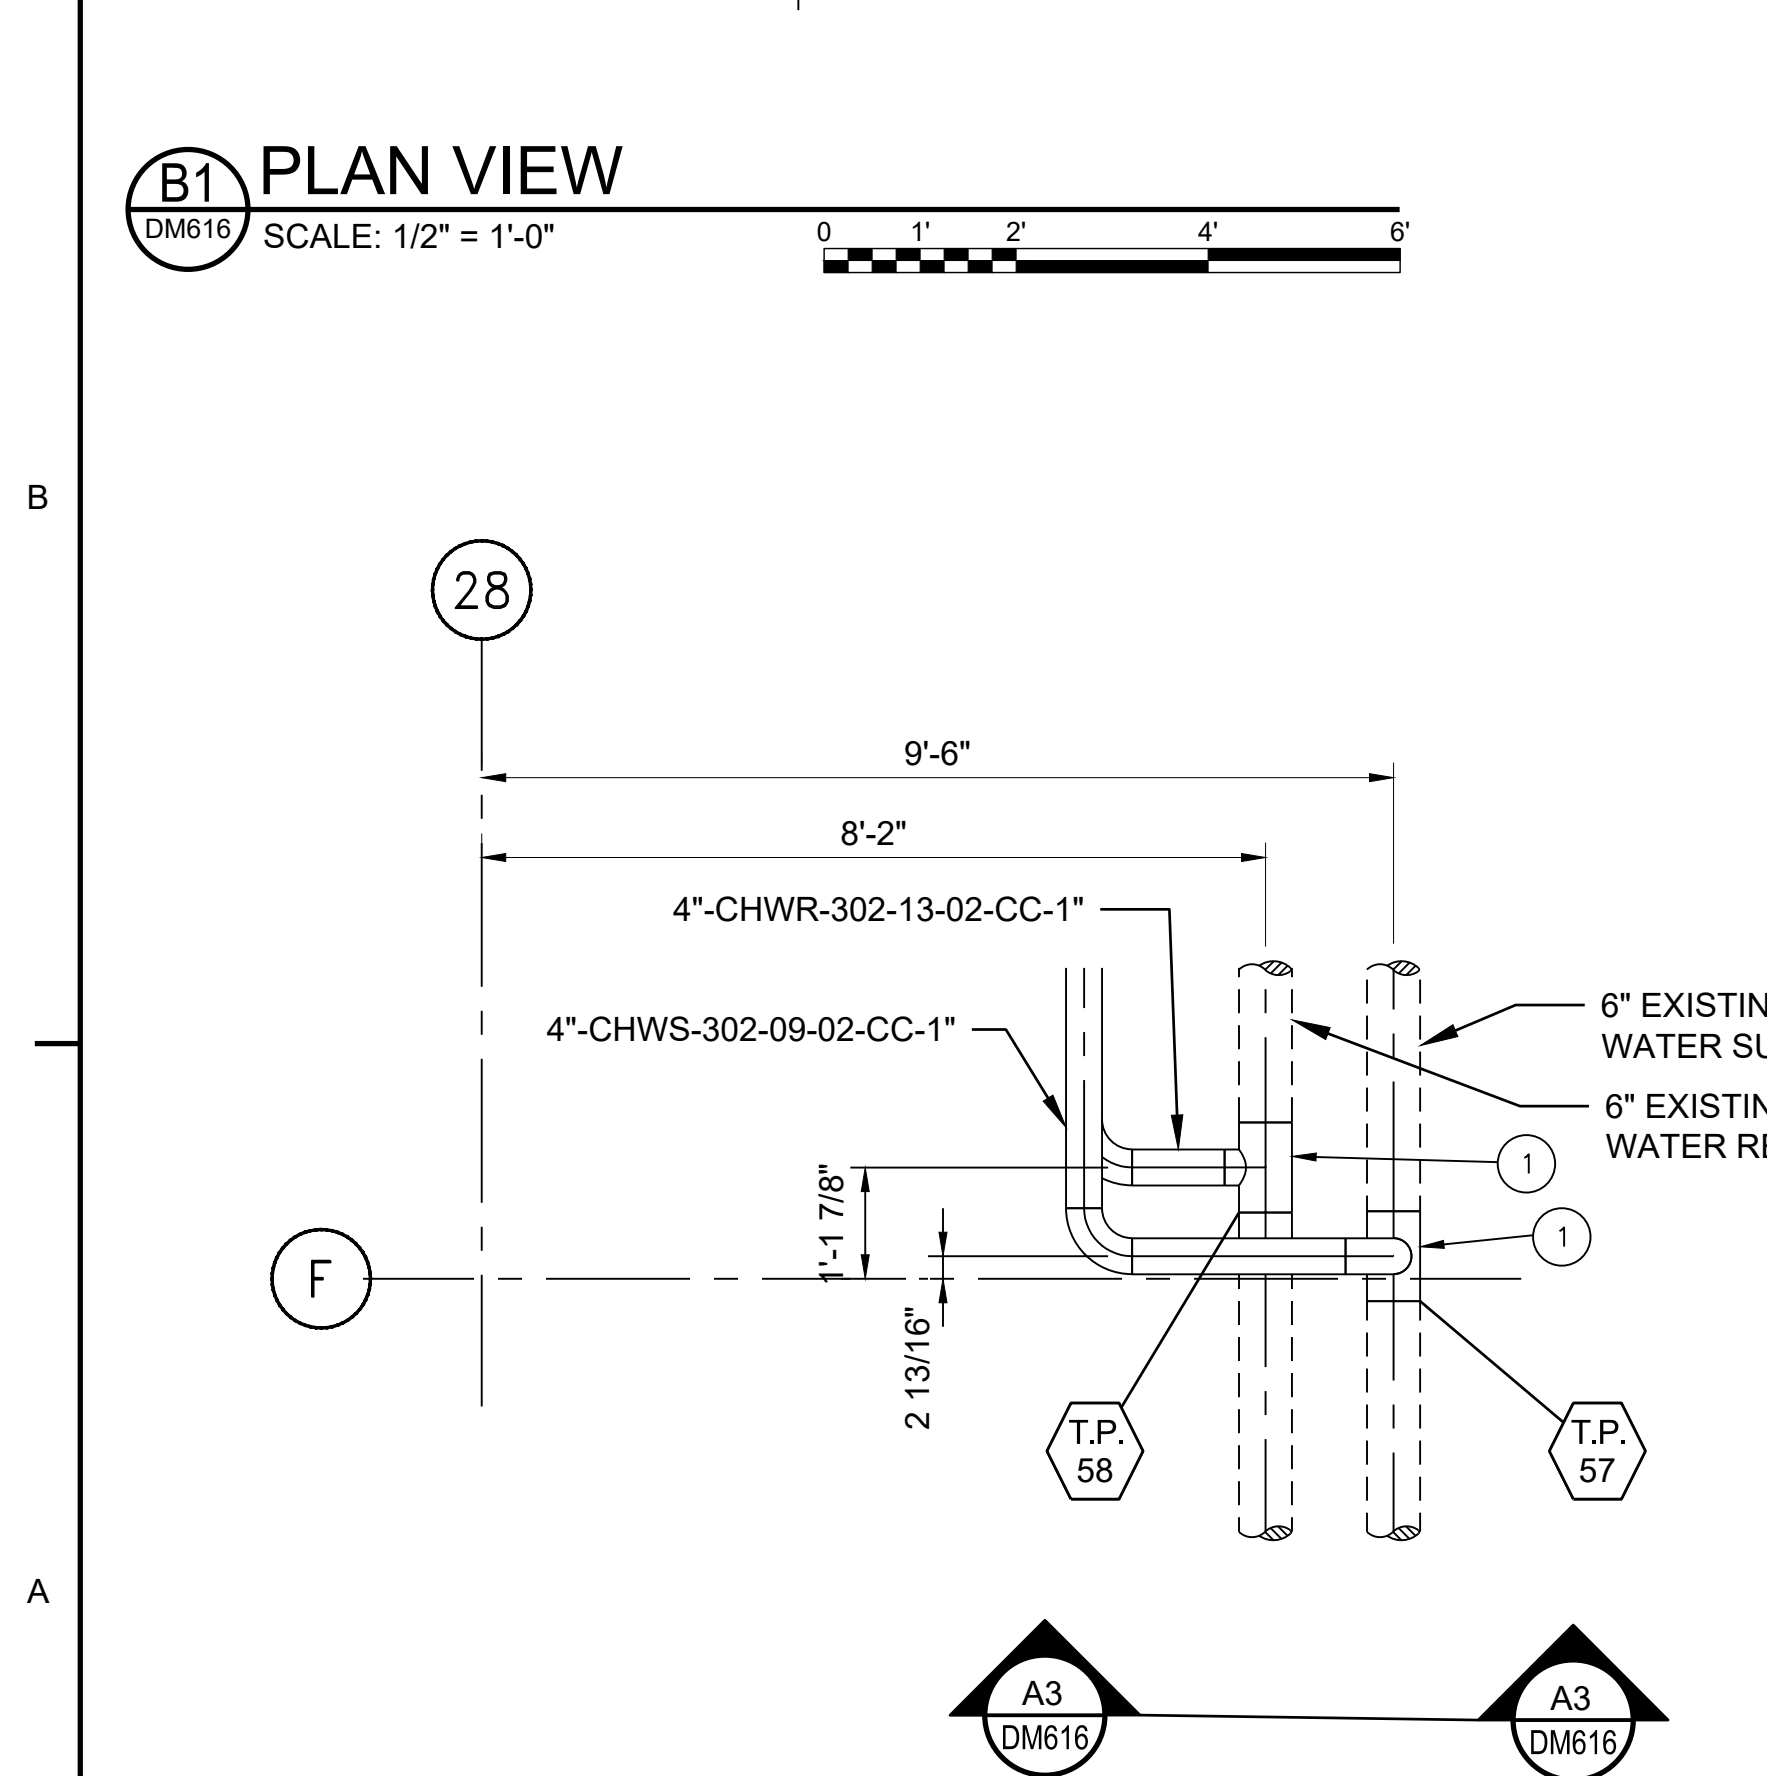

A1 PLAN VIEW
SCALE: 1/2" = 1'-0"

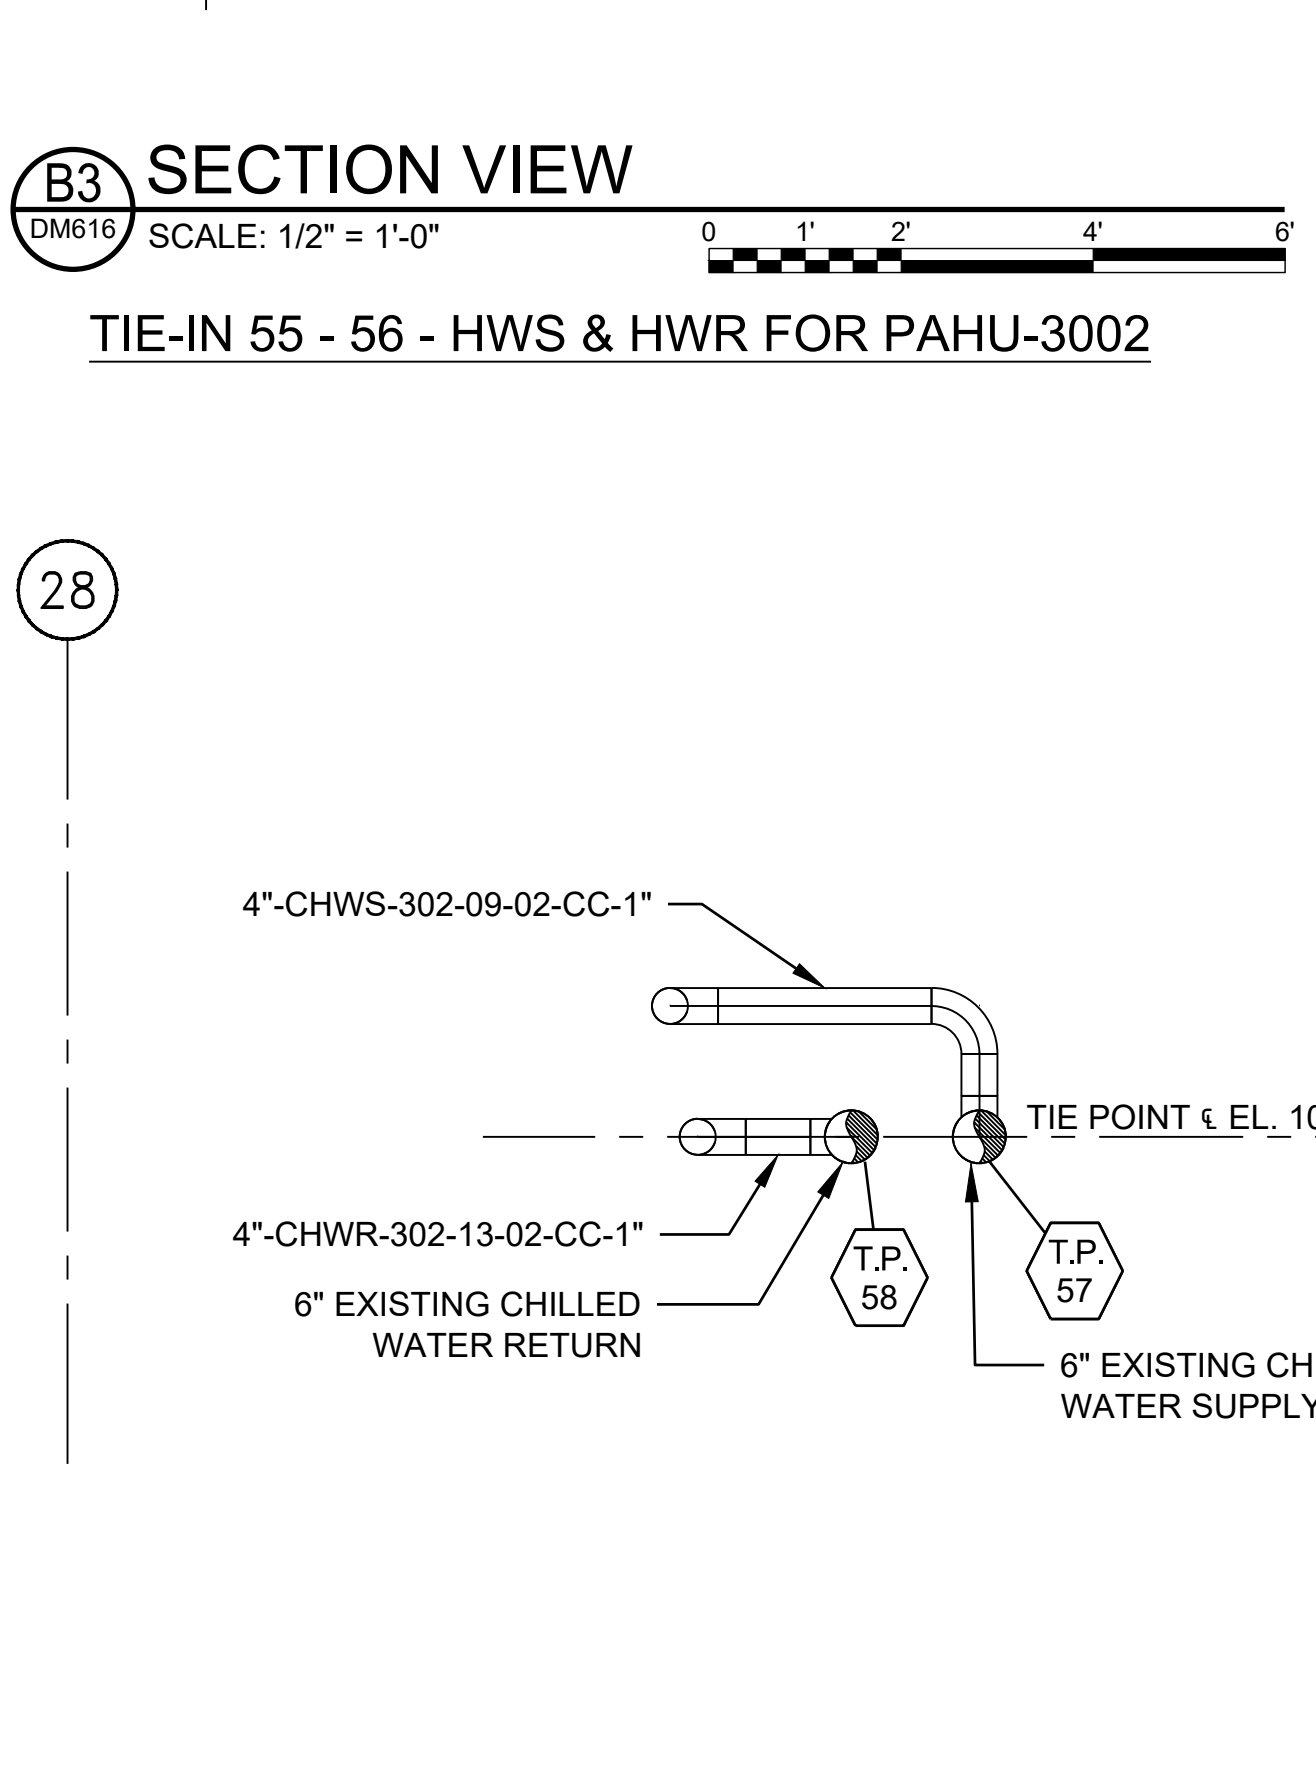

A3 SECTION VIEW
DM616 SCALE: 1/2" = 1'-0"