


DETAIL B
1/8" = 1'-0"

- GENERAL NOTES**
1. ALL EXTERIOR EXPOSED CONDUIT SHALL BE RIGID ALUMINUM (RAC) EXCEPT WHERE NOTED FOR PVC COATED RIGID (CRSC).
 2. ALL EXTERIOR EXPOSED CONDUIT FOR FINAL CONNECTIONS TO ROTATING EQUIPMENT OR CONTROL DEVICES SHALL BE SEALTITE.
 3. ALL UNDERGROUND CONDUIT SHALL BE SCHEDULE 40 PVC (PVC40).
 4. ALL TRANSITIONS FROM BELOW TO ABOVE GRADE SHALL BE CRSC EXCEPT WHERE THE CONDUIT STUB-UPS ARE CONCEALED BY EQUIPMENT SUCH AS MOTOR CONTROL CENTERS. CONCEALED STUB-UPS MAY BE PVC40.
 5. ALL INTERIOR CONDUIT SHALL BE RAC OR AS NOTED ON PLAN SHEETS.

ONE INCH
AT FULL SIZE
IF NOT ONE INCH
SCALE ACCORDINGLY

REVISION	DATE

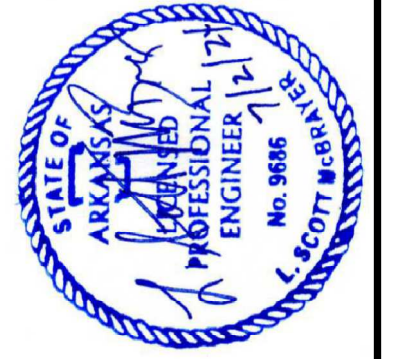

HAWKINS-WEIR ENGINEERS, INC.
BLACK & VEATCH

CITY OF ROGERS, ARKANSAS
ROGERS POLLUTION CONTROL FACILITY (PCF)
SOLIDS HANDLING IMPROVEMENTS, PHASE II
PROCESS INSTRUMENTATION PLAN
FOR: ROGERS WATER UTILITIES

DATE: AUGUST 2024
SCALE: 1/8" = 1'-0"
DESIGNED BY: Designer
DRAWN BY: Author
HWEI NO.: 2020043
FILENAME: E-DRYER-ELEC RM
SHEET NO. EA-15