


**DETAIL**  
 3/16" = 1'-0"  
 1

GENERAL NOTES

1. ALL EXTERIOR EXPOSED CONDUIT SHALL BE RIGID ALUMINUM (RAC) EXCEPT WHERE NOTED FOR PVC COATED RIGID (CRSC).
2. ALL EXTERIOR EXPOSED CONDUIT FOR FINAL CONNECTIONS TO ROTATING EQUIPMENT OR CONTROL DEVICES SHALL BE SEALTITE.
3. ALL UNDERGROUND CONDUIT SHALL BE SCHEDULE 40 PVC (PVC40).
4. ALL TRANSITIONS FROM BELOW TO ABOVE GRADE SHALL BE CRSC EXCEPT WHERE THE CONDUIT STUB-UPS ARE CONCEALED BY EQUIPMENT SUCH AS MOTOR CONTROL CENTERS. CONCEALED STUB-UPS MAY BE PVC40.
5. ALL INTERIOR CONDUIT SHALL BE RAC OR AS NOTED ON PLAN SHEETS.

1"  
 ONE INCH  
 AT FULL SIZE  
 IF NOT ONE INCH  
 SCALE ACCORDINGLY

REVISION	DATE

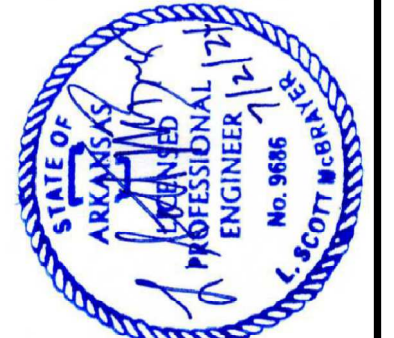

**HAWKINS-WEIR ENGINEERS, INC.**  
**BLACK & VEATCH**

CITY OF ROGERS, AR  
 ROGERS POLLUTION CONTROL FACILITY (PCF)  
 SOLIDS HANDLING IMPROVEMENTS, PHASE II  
**MAINTENANCE BUILDING ELECTRICAL PLAN**  
 FOR: ROGER WATER UTILITIES

DATE: JANUARY 2024  
 SCALE: 3/16" = 1'-0"  
 DESIGNED BY: SM  
 DRAWN BY: DS  
 HWEI NO.: 2020043  
 FILENAME: E-MAIN BLDG

SHEET NO.  
**EB-02**