



8/27/2024 9:45:02 AM / RLG / DRYER BUILDING


Autodesk Docs: //406493 - Rogers PCF Solids Phase 2/406493-Solids Building-BV.rvt

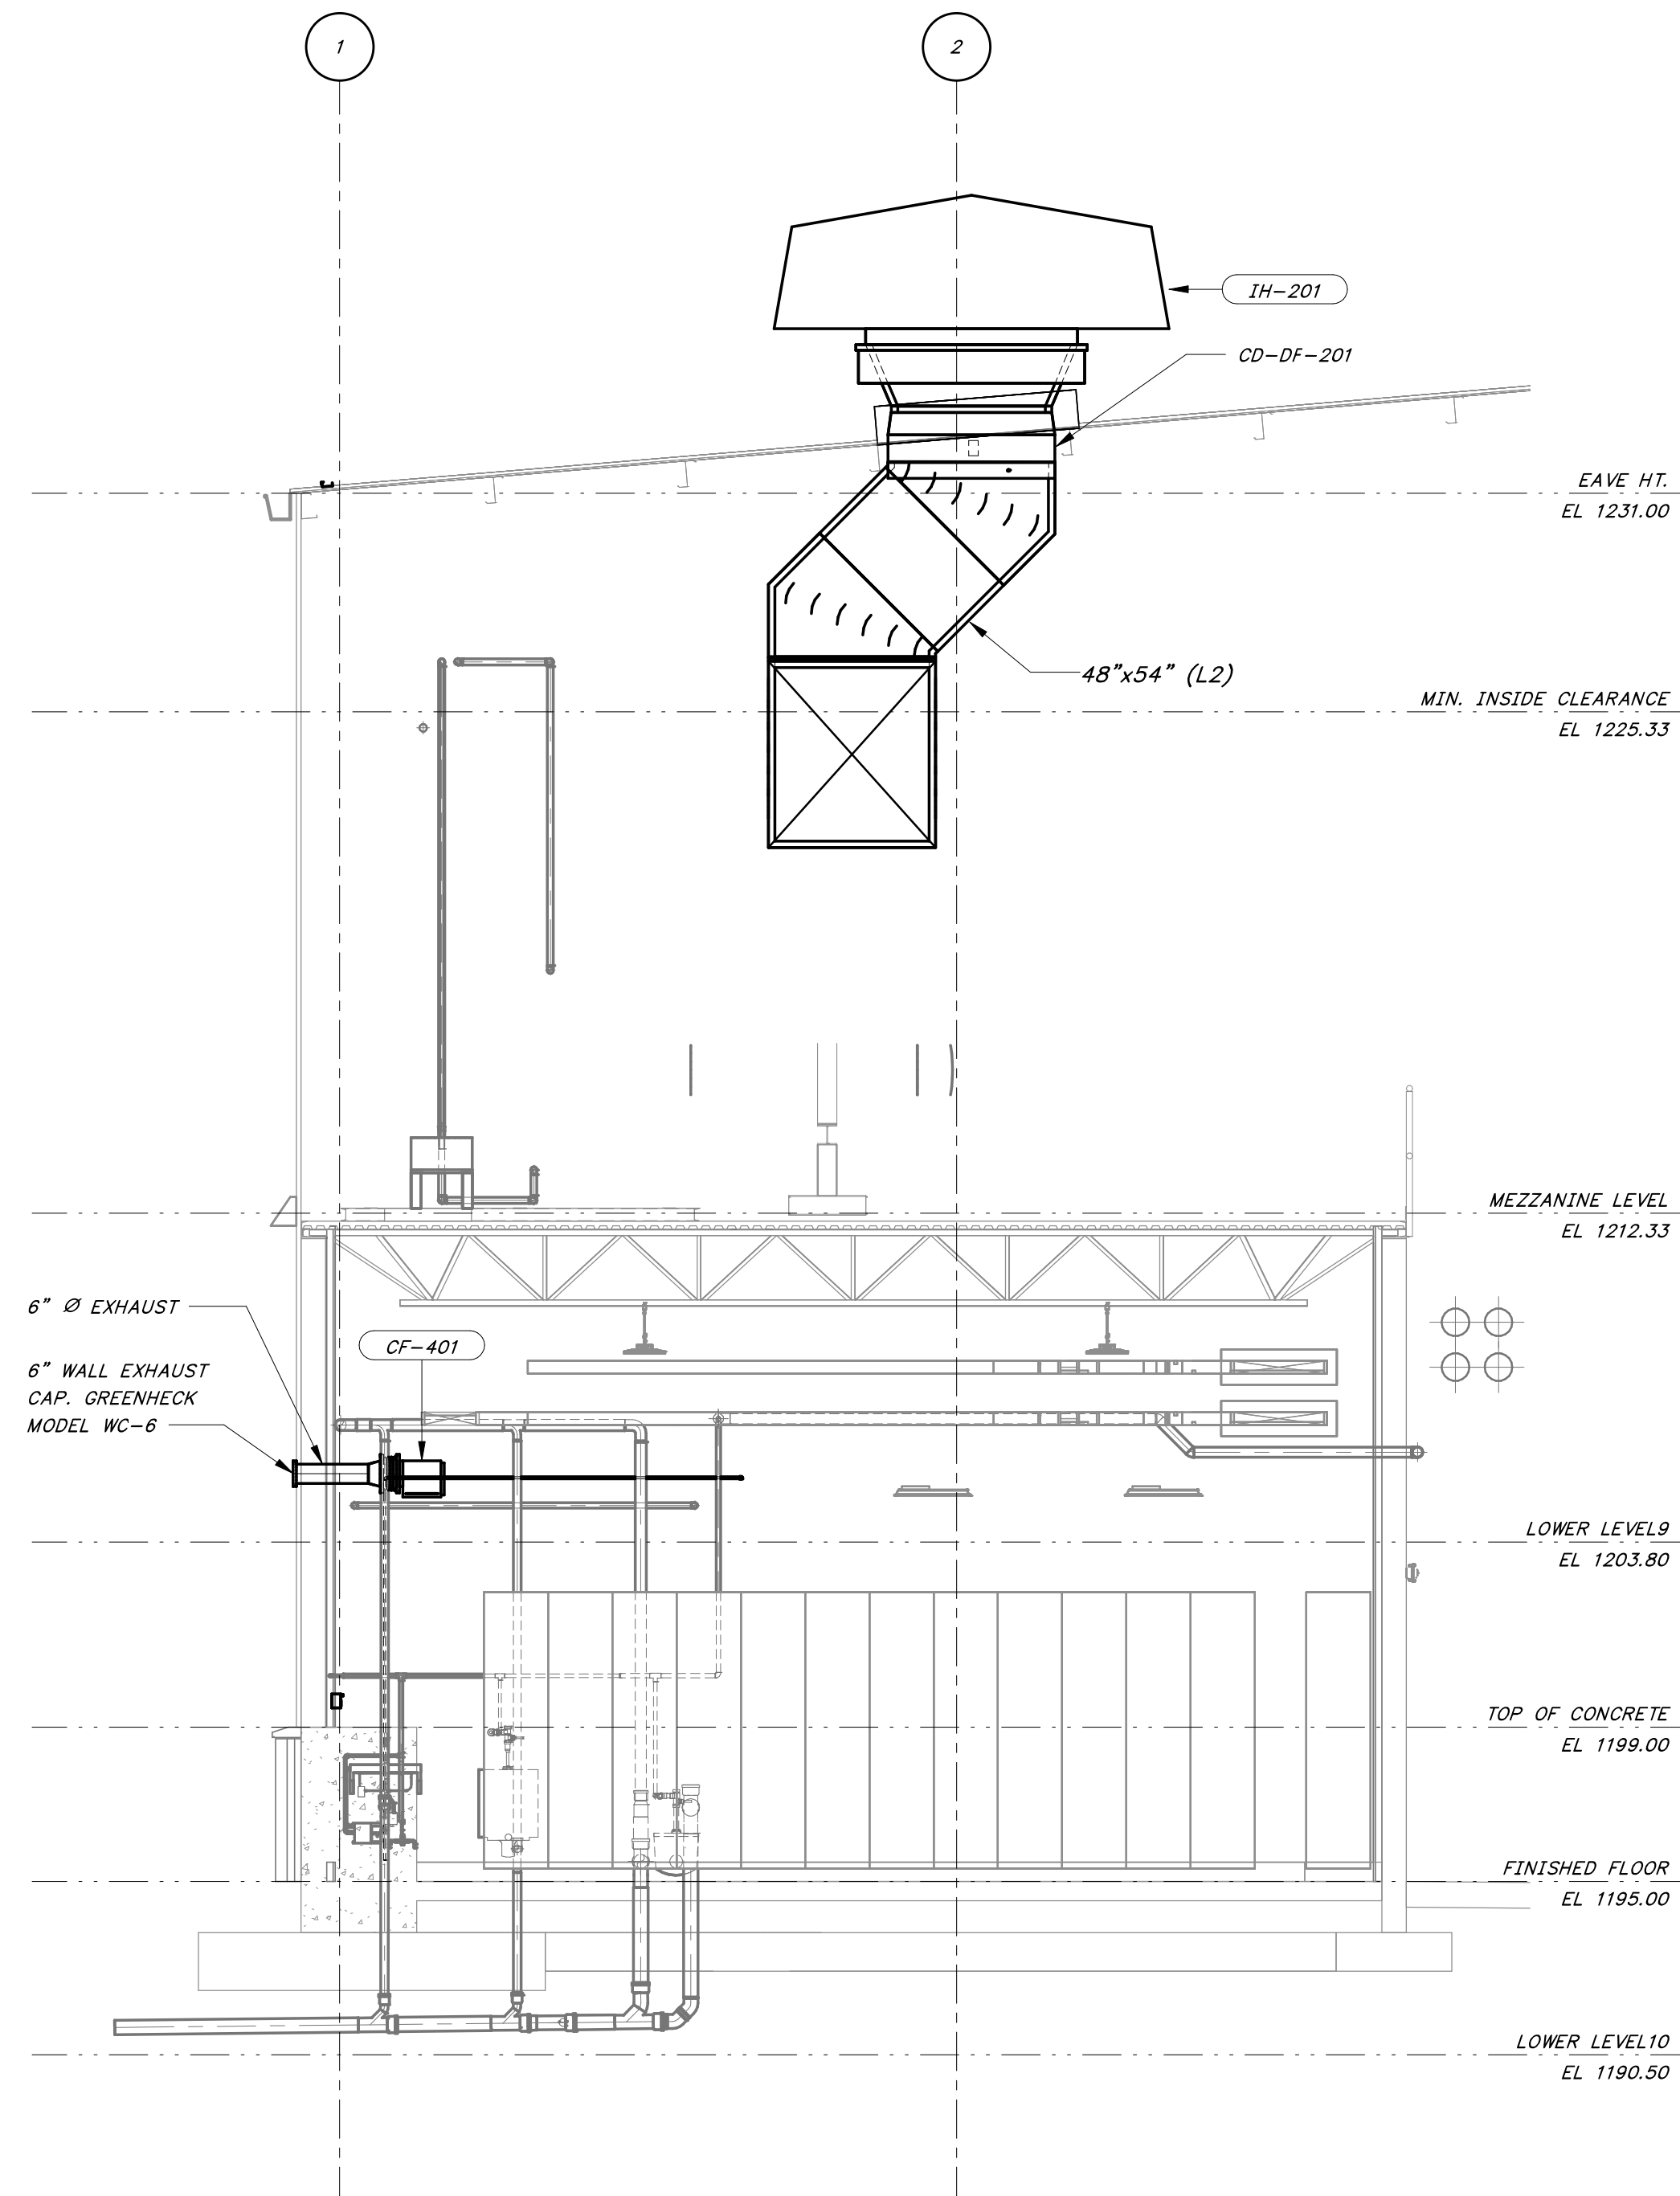

1 DRYER ROOM & BOILER ROOM SECTION - SOUTH
HA-02 1/4" = 1'-0"

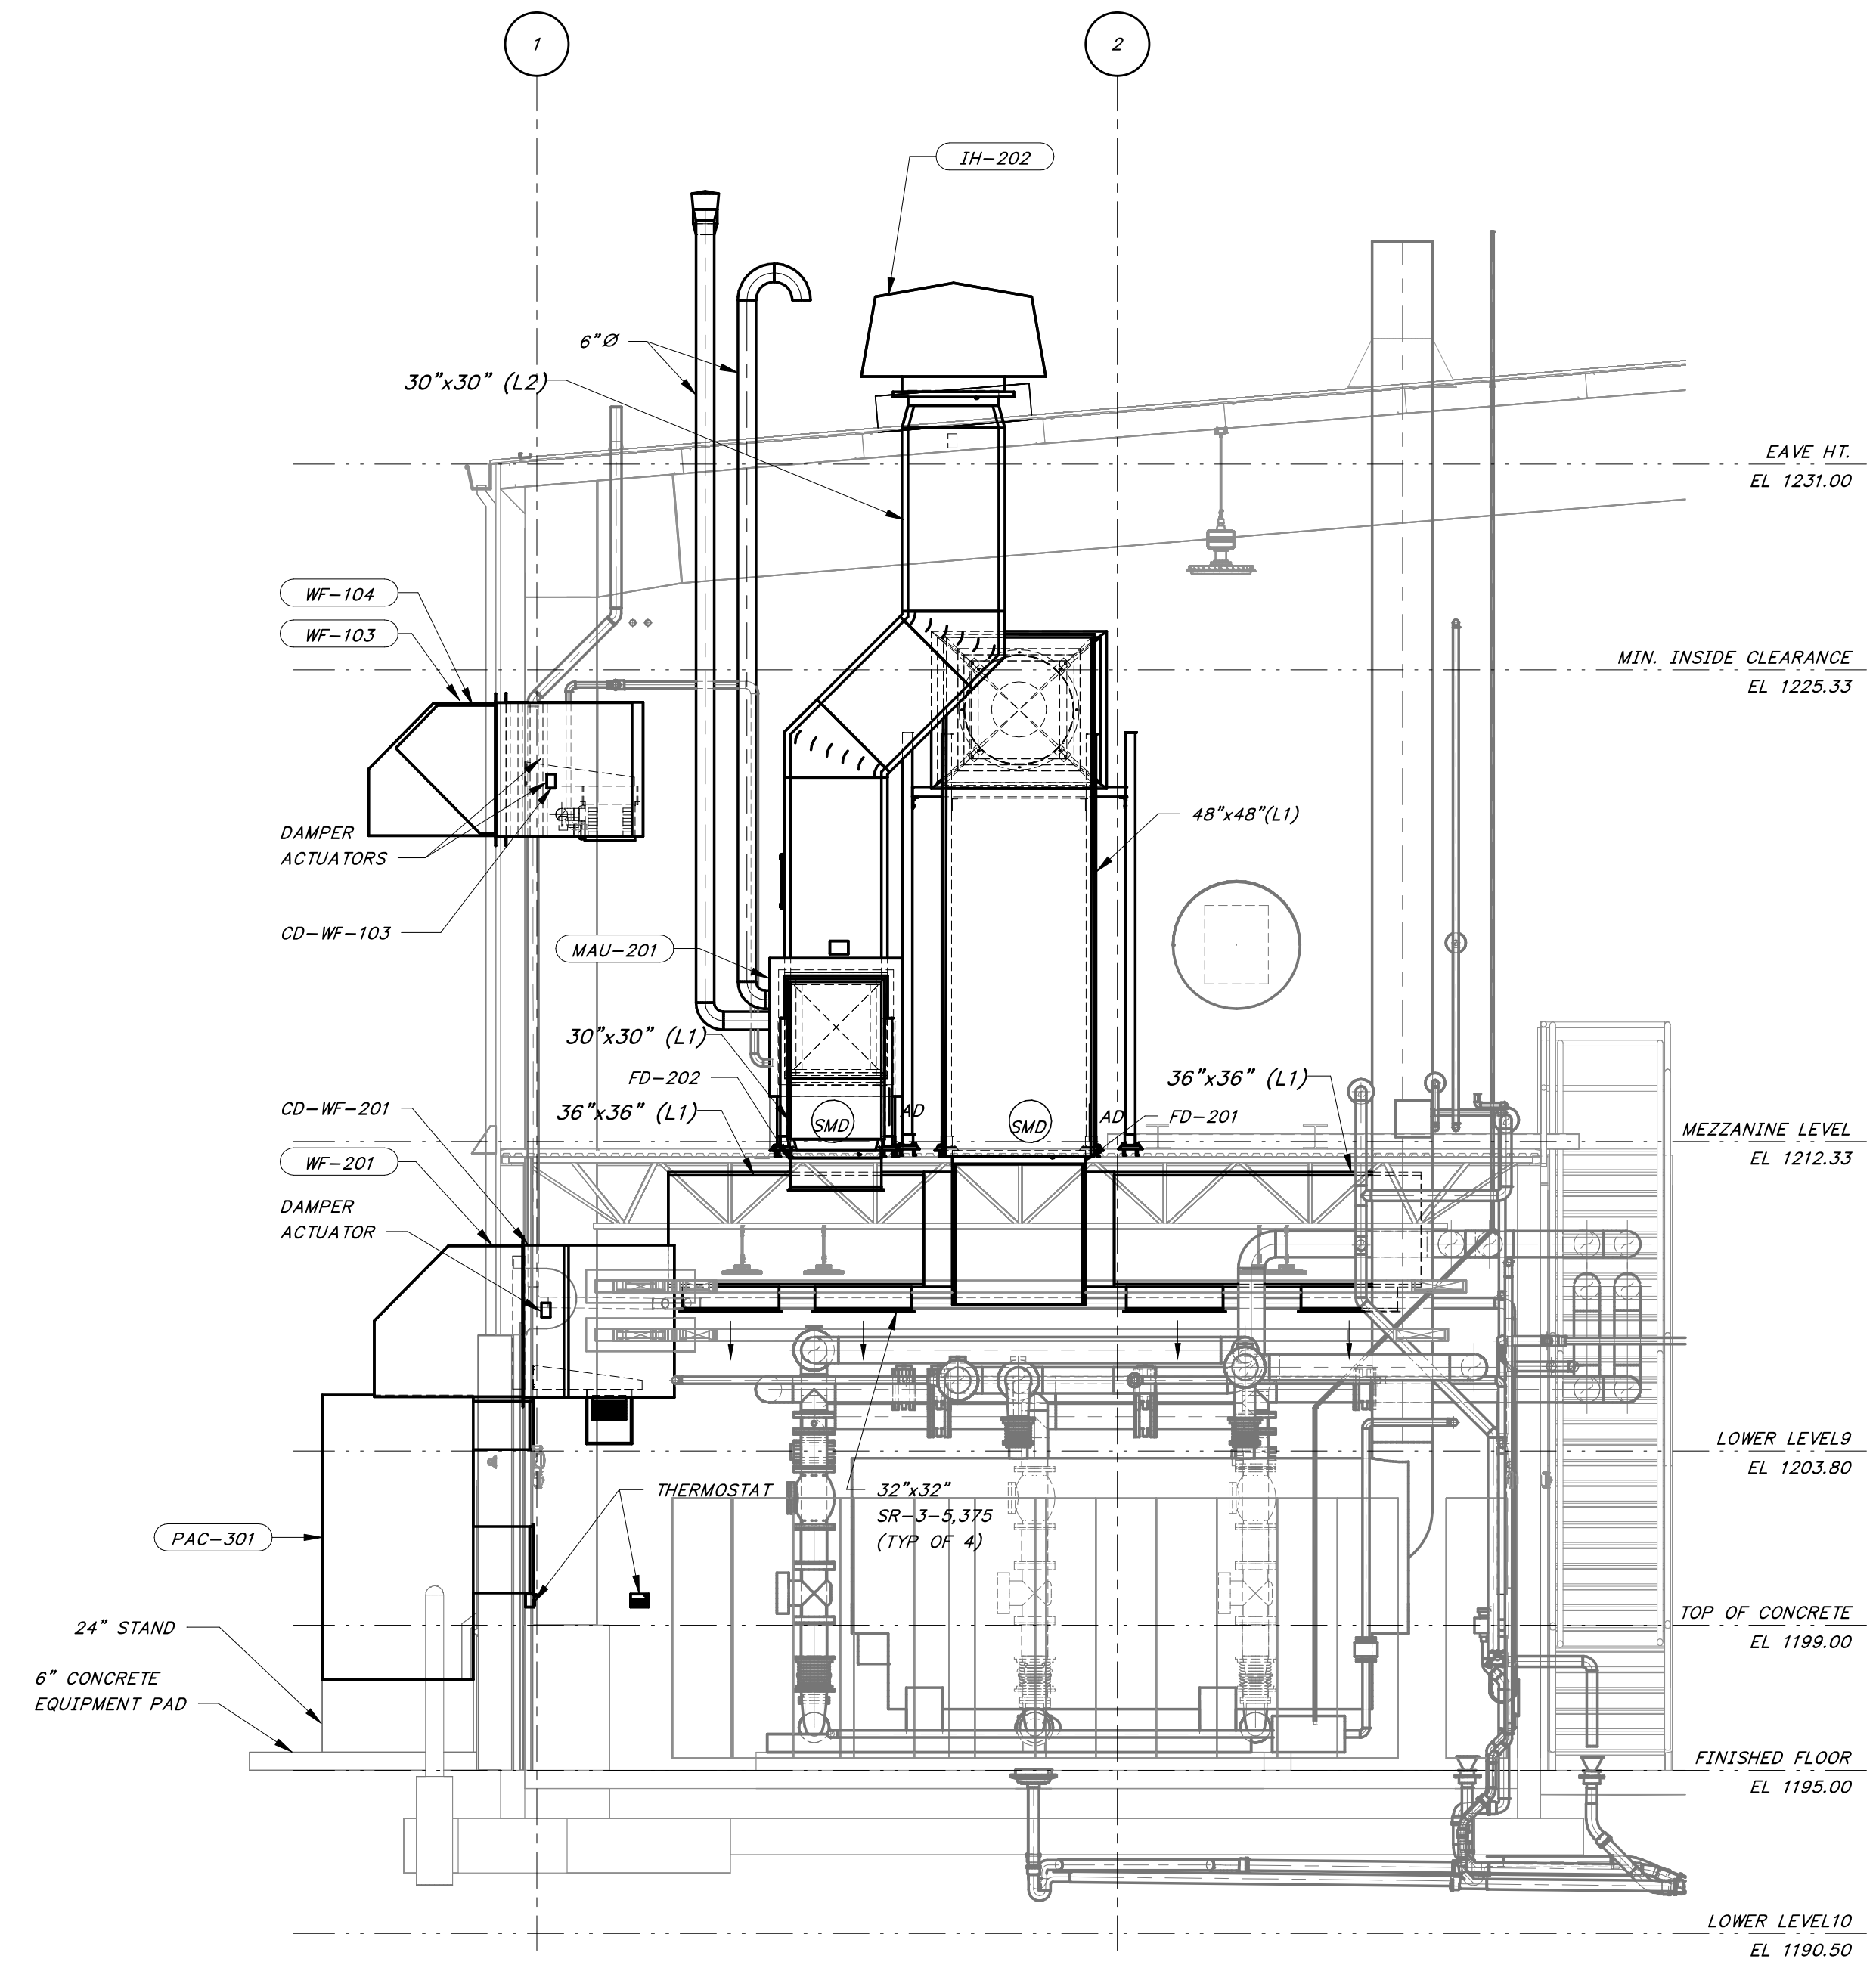


2 DRYER ROOM & BOILER ROOM SECTION - SOUTH
HA-04 1/4" = 1'-0"

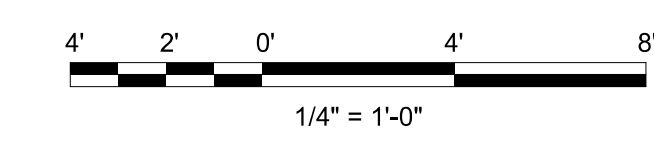

ONE INCH
AT FULL SIZE
IF NOT ONE INCH
SCALE ACCORDINGLY

REVISION	DATE

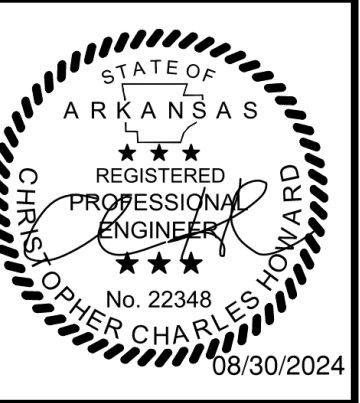

HAWKINS WEIR ENGINEERS, INC.
BLACK & VEATCH

ROGERS, ARKANSAS
ROGERS POLLUTION CONTROL FACILITY (PCF)
SOLIDS HANDLING IMPROVEMENTS, PHASE II
DRYER BUILDING
HVAC SECTIONS
FOR: ROGERS WATER UTILITIES

DATE: AUGUST 2024
SCALE: 1/4" = 1'-0"
DESIGNED BY: APL
DRAWN BY: RLG
HWEI NO.: 2020043
FILENAME:

SHEET NO.
HA-08

HAWKINS-WEIR ENGINEERS, INC. 2023