


Z:\20\2020043 ROGERS SOLIDS HANDLING IMPROVEMENTS, PH 2\DRAWINGS\CONSTRUCTION DRAWINGS\WWT\IB-01.DWG, 8/26/2024 11:25 AM, MATT WEIR, LAYOUT1

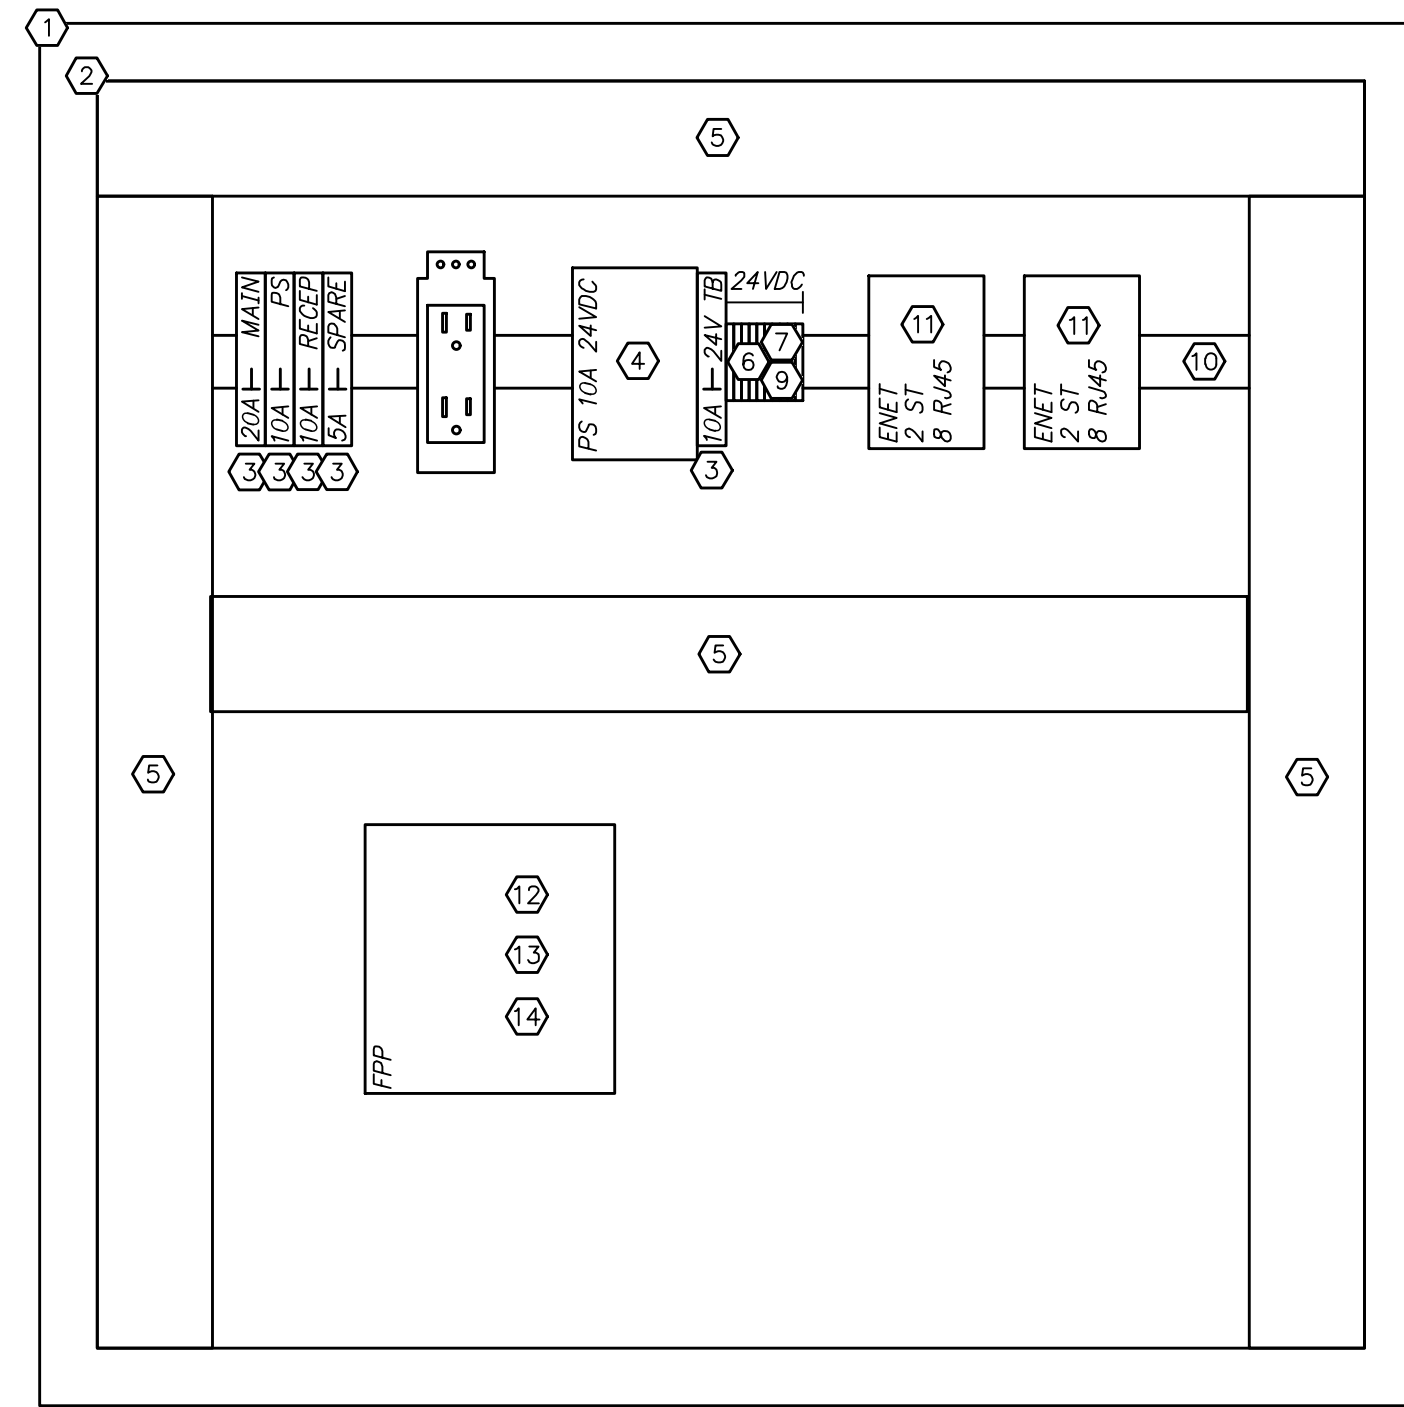

MAINTENANCE BUILDING  
CONTROL PANEL CP-MNT

DETAIL **A**  
-  
NTS

KEY	QTY	ITEM	CAT. #	MANUFACTURER	EQUAL
①	1	ENCLOSURE 36" x 36" x 10"	EN4SD363610GY	HAMMOND	YES
②	1	SUBPANEL FOR 36" x 36" PANEL	EP3636	HAMMOND	YES
③	5	CIRCUIT BREAKER	1489-M	ALLEN-BRADLEY	YES
④	1	POWER SUPPLY	SDN10-24-100P	SOLA HEVI-DUTY	YES
⑤	AR	3" DUCT & 3" COVER	181-34004 & 181-93008	HELLERMAN TYTON	YES
⑥	AR	TERMINAL BLOCK BLUE	KN-T12BLU	AUTOMATION DIRECT	YES
⑦	AR	TERMINAL BLOCK END COVER	KN-ECT6BLU	AUTOMATION DIRECT	YES
⑧	AR	GROUND TERMINAL BLOCK	KN-G12SP-10	AUTOMATION DIRECT	YES
⑨	AR	TERMINAL BLOCK JUMPER	KN-10J12	AUTOMATION DIRECT	YES
⑩	AR	35MM DIN RAIL	DN-R35SAL1	AUTOMATION DIRECT	YES
⑪	2	ENET SWITCH W/ 2 ST 8 COPPER PORTS	110FX2-ST	RED LION	YES
⑫	1	2 PLATE FIBER PATCH PANEL	PWS2-A-1	RLH INDUSTRIES	YES
⑬	1	12 FIBER ST ADAPTER PLATE	AP-ST12-LSMM-G	RLH INDUSTRIES	YES
⑭	1	FIBER PATCH CORD ST-ST 3 FT	RLH-JDR2MM-STST-01M	RLH INDUSTRIES	YES


THE CONTRACTOR SHALL PROVIDE ALL OTHER REQUIRED MISCELLANEOUS PARTS, INCLUDING FUSES, TERMINAL MARKERS, CONTROL RELAYS, WIRE LABELS, MTW WIRE, AND SHIELDED CABLE.

CONTROL PANEL CP-MNT

DETAIL **B**  
-  
N.T.S.

1"  
ONE INCH  
AT FULL SIZE  
IF NOT ONE INCH  
SCALE ACCORDINGLY

DATE	REVISION

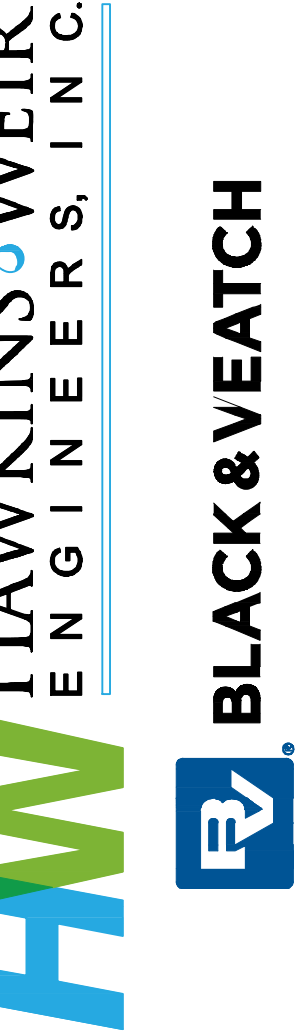

ROGERS, ARKANSAS  
ROGERS POLLUTION CONTROL FACILITY (PCF)  
SOLIDS HANDLING IMPROVEMENTS, PHASE II  
  
MAINTENANCE BUILDING CP-MNT  
CONTROL PANEL B.O.M. AND DETAILS  
  
FOR: ROGERS WATER UTILITIES

DATE: AUGUST 2024  
SCALE: NTS  
DESIGNED BY: LSM  
DRAWN BY: LSM  
HWEI NO.: 2020043  
FILENAME: IB-01

SHEET NO.  
**IB-1**

© HAWKINS-WEIR ENGINEERS, INC. 2024