


MEZZANINE LEVEL FLOOR PLAN
DETAIL 1
1/8" = 1'-0"

GENERAL SHEET NOTES:


- SEE PROCESS FLOW DIAGRAMS FOR EQUIPMENT SUPPLIED BY THE THERMAL SLUDGE DRYING SYSTEM SUPPLIER.
- CONTRACTOR SHALL PROVIDE INSULATION FOR THERMAL DRYER WATER PIPING, INCLUDING HWS, HWR, AND AIR SYSTEMS.

KEYED NOTES:

- GENERAL PIPE ROUTING SHOWN FOR THE HEAT RECOVERY SYSTEM, VALVING AND INSTRUMENTATION SHOWN ON THE PFD'S TO BE PROVIDED FOR A COMPLETE SYSTEM.
- CONTRACTOR TO PROVIDE TUBULAR DRAG CHAIN CONVEYOR SUPPORTS IN ACCORDANCE WITH SECTION 15140.
- CONTRACTOR TO FIELD ROUTE GAS TRAIN VENTS TO THE ROOF.
- DRYER EXHAUST PIPING SHALL BE SLOPED 1% TOWARDS LOW POINT LOCATION AS INDICATED ON DRAWINGS.
- CONTRACTOR SHALL PROVIDE INSULATION FOR PIPING WITHIN 8 FT FROM PLATFORM.
- SEE SHEET NO. SA-05 AND SA-06 FOR EQUIPMENT SUPPORT DETAILS.
- 3" DRAIN - SEE SHEET NO. MA-01 FOR CONT.
- 2" NPW - SEE SHEET NO. MA-01 FOR CONT.

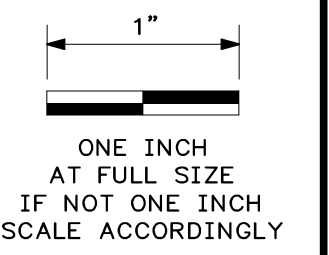

DATE	REVISION

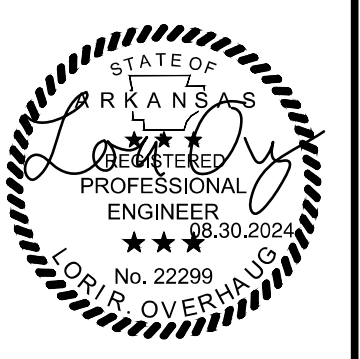

ROGERS, ARKANSAS
ROGERS POLLUTION CONTROL FACILITY (PCF)
SOLIDS HANDLING IMPROVEMENTS, PHASE II
DRYER BUILDING OVERALL FLOOR PLAN
(MEZZANINE LEVEL)
FOR: ROGERS WATER UTILITIES

DATE: AUGUST 2024
SCALE: 1/8" = 1'-0"
DESIGNED BY: KJU/MNH
DRAWN BY: JCD
HWEI NO.: 2020043
FILENAME:

SHEET NO.
MA-02

