



C:\P\WORKING\BWL-AMERICAS\159427\ME-03.DWG, 8/27/2024 9:43 AM, DONAVANT, JOSEPH C., ME-03

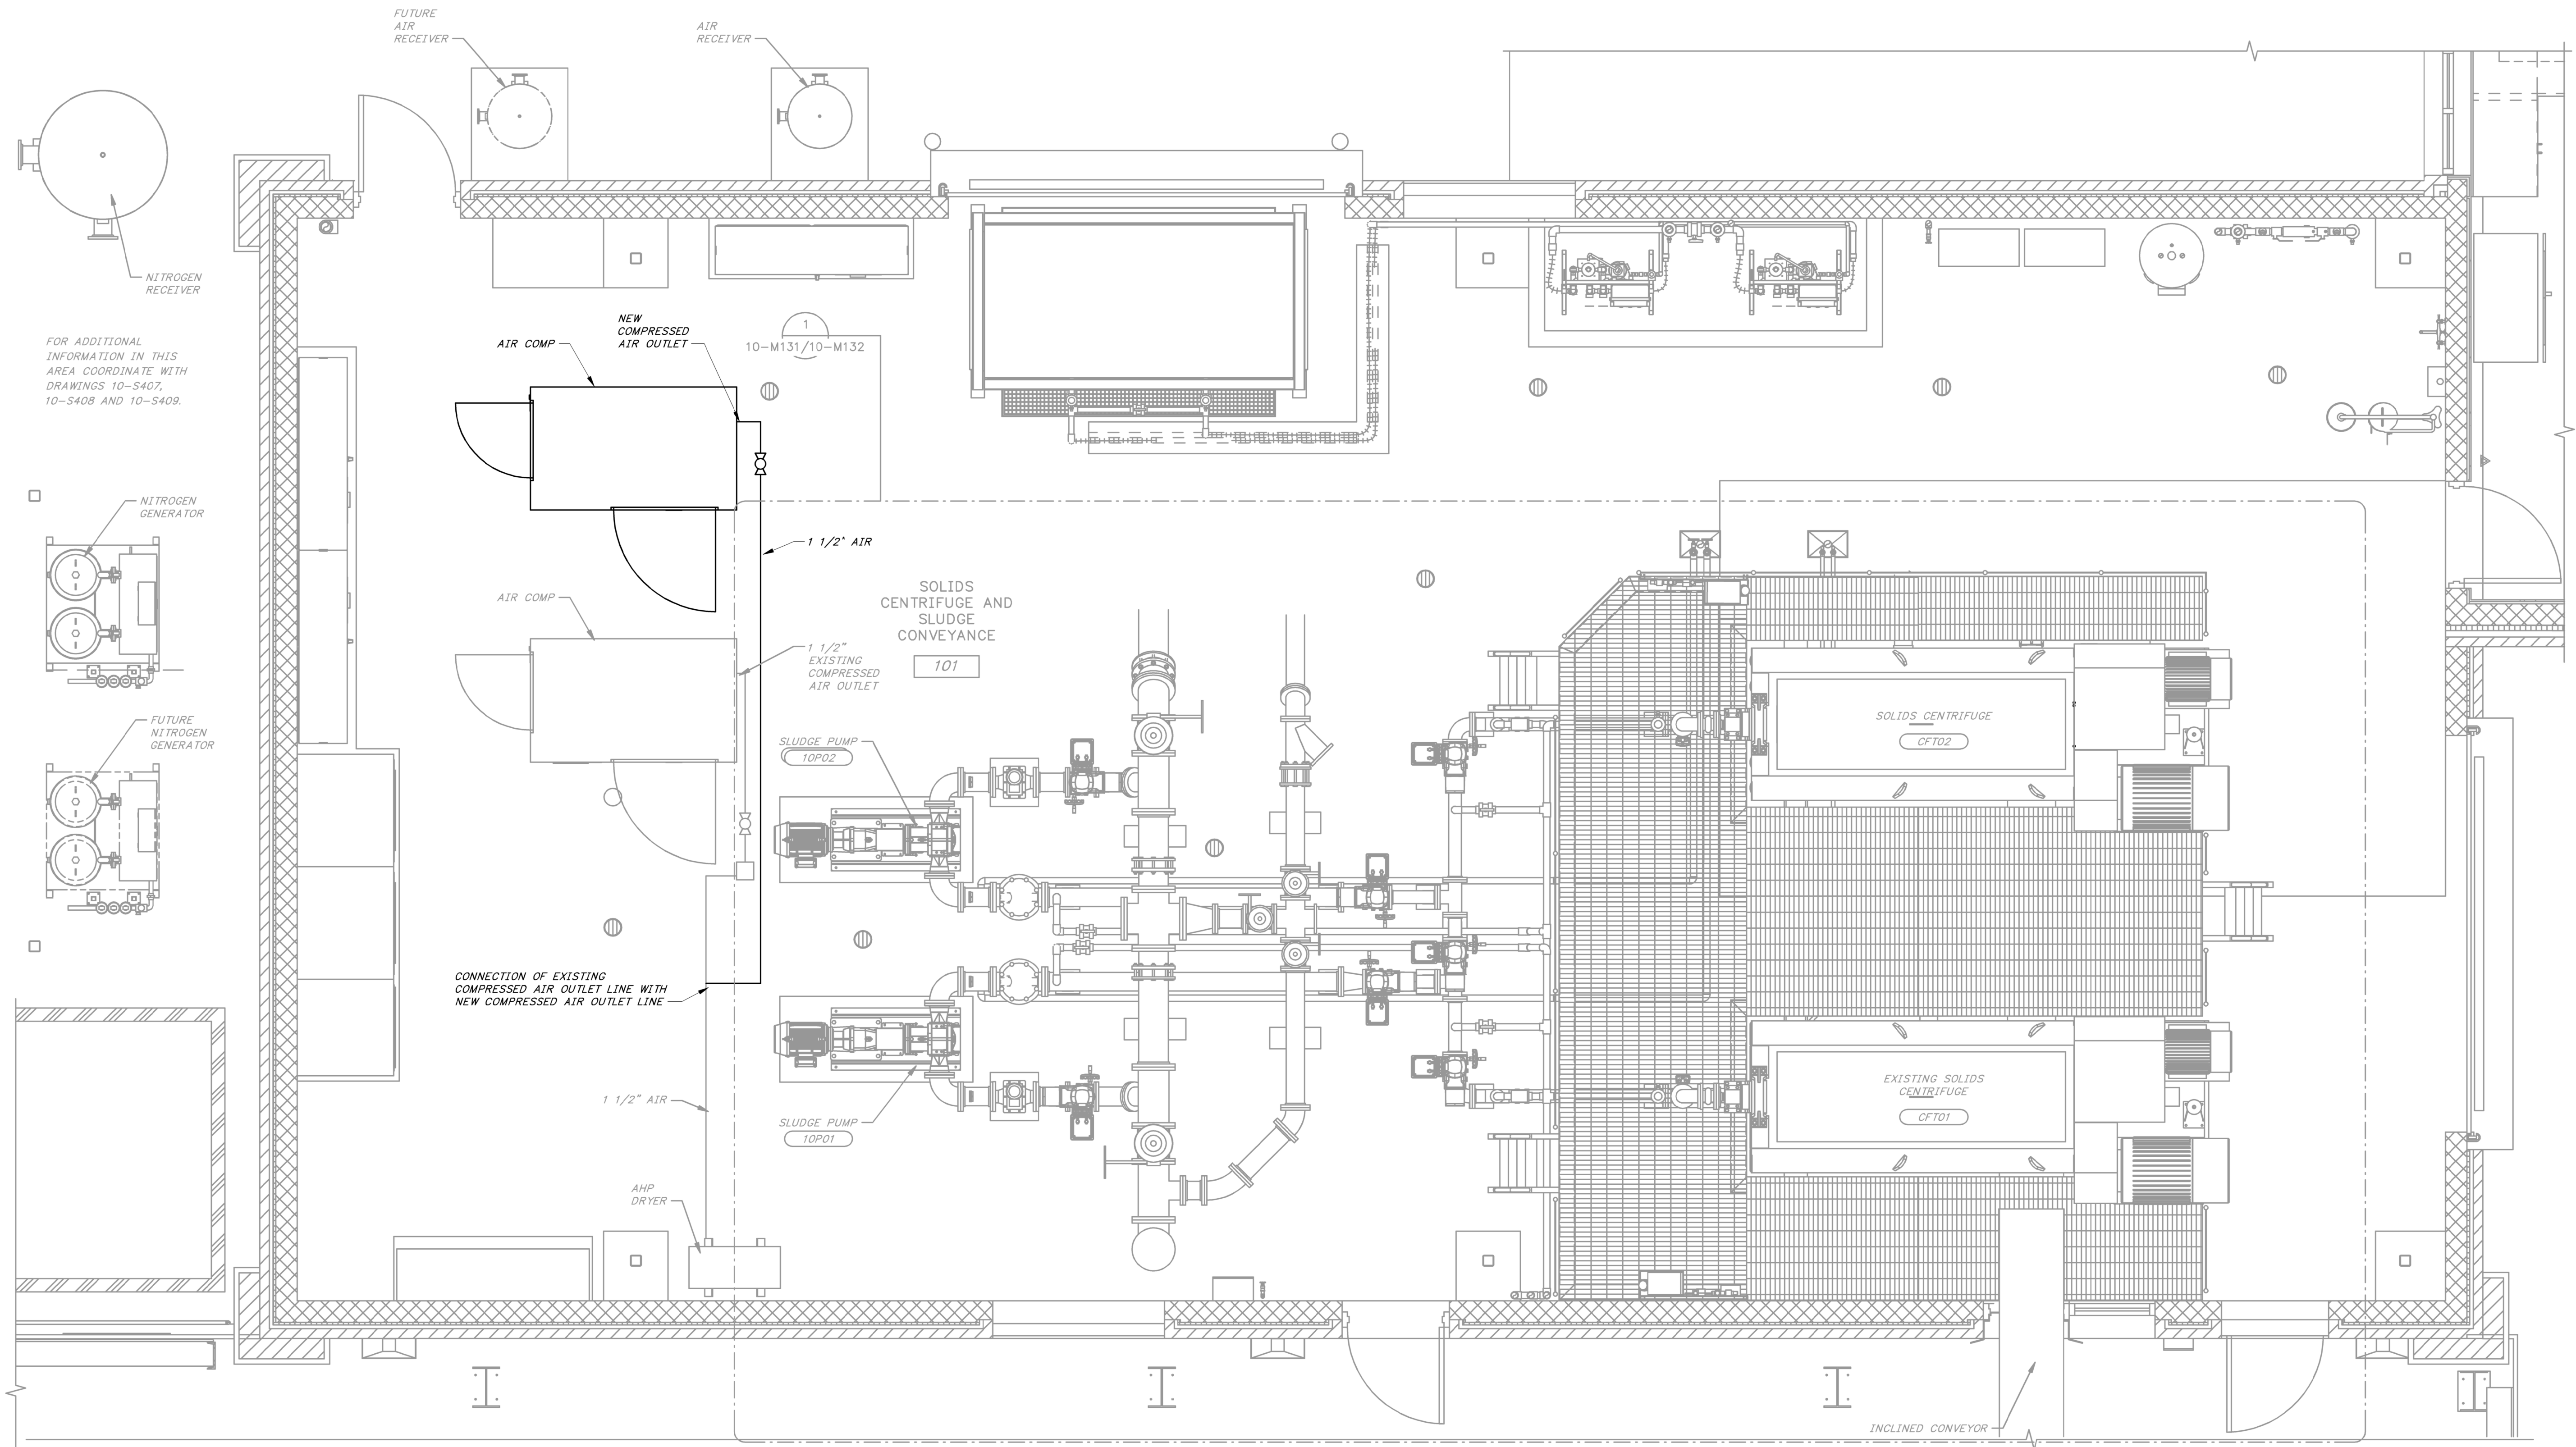

**NOTES**

1. THE NEW COMPRESSOR SHALL BE CONNECTED IN PARALLEL WITH EXISTING COMPRESSOR. THE COMPRESSED AIR OUTLET FROM THE NEW COMPRESSOR SHALL BE CONNECTED TO THE 1/2 INCH COMPRESSED AIR OUTLET OF THE EXISTING COMPRESSOR.

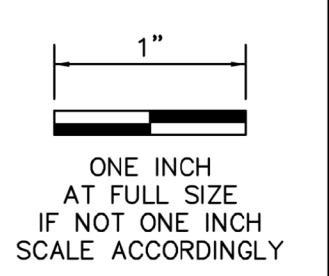

DATE	REVISION



**HAWKINS WEIR ENGINEERS, INC.**  
**BLACK & VEATCH**

ROGERS, ARKANSAS  
 ROGERS POLLUTION CONTROL FACILITY (PCF)  
 SOLIDS HANDLING IMPROVEMENTS, PHASE II  
**AIR COMPRESSOR SYSTEM  
 ARRANGEMENT PLAN**  
 FOR: ROGERS WATER UTILITIES

DATE: AUGUST 2024  
 SCALE: AS SHOWN  
 DESIGNED BY: KVP  
 DRAWN BY: AIP  
 HWEI NO.: 2020043  
 FILENAME:

SHEET NO.  
**ME-03**

AIR COMPRESSOR SYSTEM PLAN  
 DETAIL 1  
 3/8" = 1'-0"