

SMOKE SHOP

730 E MAIN ST
FARMINGTON, AR



PROJECT TEAM

Burriss Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

I HEREBY CERTIFY THAT THESE PLANS AND SPECIFICATION HAVE BEEN PREPARED BY ME, OR UNDER MY SUPERVISION. I FURTHER CERTIFY THAT TO THE BEST OF MY KNOWLEDGE THESE PLANS AND SPECIFICATIONS ARE AS REQUIRED BY LAW AND IN COMPLIANCE WITH THE ARKANSAS FIRE PREVENTION CODE FOR THE STATE OF ARKANSAS.

MEP

OMN ENGINEERING
PO BOX 2106
LOYELL, AR 72145
(479) 696-7873

STRUCTURAL

MILLER ENGINEERING
3027 S. TIMBERCREEK AVE
SUITE A
SPRINGFIELD, MO 65801
(417) 866-6664



GENERAL NOTES:

- CONTRACTOR IS TO INSPECT EXISTING CONDITIONS INCLUDING BUT NOT LIMITED TO, UNDERGROUND WATER MAINS, SEWER, TELEPHONE, AND ELECTRIC. WORK HERE UNDER ARE INDICATED ON DRAWINGS FOR DIAGRAMMATIC PURPOSES. NO GUARANTEE AS TO THE ACCURACY OR COMPLETENESS OF SUCH INFORMATION. RESPONSIBILITY FOR SUCH ACCURACY AND COMPLETENESS IS DISCLAIMED. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR LOCATING UNDERGROUND INSTALLATIONS PRIOR TO EXCAVATING.
- ALL DIMENSIONS ARE FROM FACE OF STUD, FACE OF CONC. OR CENTER LINE UNLESS NOTED OTHERWISE. DRAWINGS ARE NOT TO BE SCALED. DIMENSIONS SHALL BE IN WRITTEN INFORMATION ONLY. VERIFY DIMENSIONS PRIOR TO WORK. ALTERATIONS IN DIMENSIONS AFFECTING THE DESIGN SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PROMPTLY FOR A RESOLUTION.
- NOT ALL MATERIALS AND ASSEMBLIES HAVE BEEN SPECIFIED. CONTRACTOR IS TO VERIFY ALL NON-SPECIFIED ITEMS WITH OWNER & ARCHITECT PRIOR TO EXECUTING ANY WORK INVOLVING THESE ITEMS.
- IT IS THE CONTRACTORS RESPONSIBILITY TO SUBMIT SUBSTITUTIONS OR DEVIATIONS FROM THE CONTRACT DOCUMENTS TO THE ARCHITECT FOR APPROVAL. NON-APPROVED DEVIATIONS WILL HOLD THE ARCHITECTS AND CONSULTING ENGINEERS HARMLESS FOR SUCH ITEMS.
- ALL WORK TO CONFORM TO APPLICABLE CODES. THE MOST STRINGENT CODE SHALL APPLY. DISCREPANCIES IN CODE AND CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECTS ATTENTION IMMEDIATELY AND RESOLVED BEFORE PROCEEDING.
- ALL MATERIALS ARE TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND AS SUCH ALL SUBCONTRACTORS ARE TO INSURE THAT ALL MANUFACTURER'S WARRANTIES WILL BE HONORED.
- ALL SUBCONTRACTORS ARE RESPONSIBLE FOR INSURING THEIR SAFETY AND OF THEIR PERSONNEL ON THE JOB SITE AT ALL TIMES. THEY SHALL CARRY WORKMAN'S COMPENSATION AND LIABILITY INSURANCE FOR THEMSELVES AND THEIR EMPLOYEES. SUBCONTRACTORS AND THEIR EMPLOYEES SHALL BE PERSONALLY RESPONSIBLE TO FOLLOW ALL OSHA RULES AND REGULATIONS.
- GENERAL CONTRACTOR IS TO COORDINATE ALL MECH. ELECT. AND PLUMBING AND PROVIDE NECESSARY CONSTRUCTION TO FACILITATE SUCH WORK INCLUDING SUPPORTS, BLOCKING, ROUGH OPENING ETC.
- IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW ARCHITECTURAL DRAWINGS BEFORE INSTALLATION OF MECH. ELECT OR SYSTEMS INSTALLATION, AND SHALL NOTIFY ARCHITECT IMMEDIATELY FOR ANY DISCREPANCIES, AND/ OR WORK INSTALLED IN CONFLICT WITH THE CONTRACT DOCUMENTS SHALL BE CORRECTED BY THE GENERAL CONTRACTOR AT NO EXPENSE TO THE OWNER OR ARCHITECT.
- ALL DRAWINGS, SPECIFICATIONS AND DESIGN OF THE FOLLOWING SYSTEMS ARE TO BE PROVIDED BY OTHERS AS REQUIRED. OWNER SHALL CONTRACT WITH OTHERS UNDER SEPARATE CONTRACTS.
A. CIVIL ENGINEERING

SHEET INDEX

#	SHEET NAME	ISSUE DATE	Current Revision Description	REVISION
A0.0	COVER SHEET	9-11-25		
A0.1	STANDARDS	9-11-25		
A0.2	CODE FOOTPRINT	9-11-25		
S0.0	ISOMETRIC VIEWS & SCHEDULES	9-11-25		
S0.1	GENERAL NOTES	9-11-25		
S1.0	FOUNDATION PLAN	9-11-25		
S2.0	FOUNDATION DETAILS	9-11-25		
S3.0	FRAMING PLAN	9-11-25		
S4.0	FRAMING DETAILS	9-11-25		
A1.0	FIRST FLOOR PLAN	9-11-25		
A1.1	ROOF/RCP	9-11-25		
A2.0	EXTERIOR ELEVATIONS	9-11-25		
A3.0	BUILDING SECTIONS	9-11-25		
A6.0	FINISH SCHEDULES & INTERIOR ELEVATION	9-11-25		
P0.1	PLUMBING LEGEND AND NOTES	9-11-25		
P1.0	PLUMBING SUPPLY PLANS	9-11-25		
P2.0	PLUMBING SCHEDULE AND DETAILS	9-11-25		
P3.0	PLUMBING SPECIFICATIONS	9-11-25		
M0.1	MECHANICAL TITLE SHEET	9-11-25		
M1.0	HVAC PLAN	9-11-25		
E1.0	ELECTRICAL LEGEND, LIGHTING FIXTURE SCHEDULE & NOTES	9-11-25		
E2.0	LIGHTING AND POWER PLANS	9-11-25		
E3.0	ELECTRICAL RISER DIAGRAM	9-11-25		
E4.0	ELECTRICAL SPECIFICATIONS	9-11-25		
E4.1	ELECTRICAL SPECIFICATIONS	9-11-25		
E4.2	ELECTRICAL SPECIFICATIONS	9-11-25		

LOCATION MAP

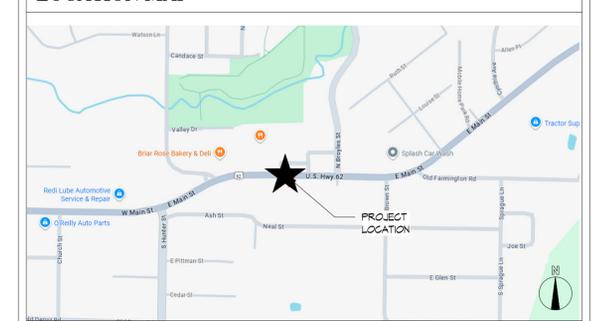

Burriss Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE SHOP
730 E MAIN ST
FARMINGTON, AR

DATE 9-11-25
JOB NO. 25089
REVISIONS

A0.0
COVER SHEET

THIS DRAWING, PLAN, SPEC, AND/OR SECTION IS THE PROPERTY OF BURRIS ARCHITECTURE AND IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. ALL RIGHTS ARE RESERVED. THE ARCHITECT ASSUMES NO LIABILITY FOR THE ACCURACY OF THE INFORMATION PROVIDED HEREON. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR THE DESIGN OR CONSTRUCTION OF ANY OTHER WORK NOT SHOWN ON THESE PLANS.

OCCUPANT LOAD BY SPACE					
Room #	Room Name	Area	Occupancy Classification	FAPO	Total Occupants
FIRST FLOOR					
101	RETAIL	621 SF	Mercantile - Grade Floors and Basement	30 SF	20.69
102	STORAGE	263 SF	Mercantile - Storage, Stock, and Shipping	300 SF	0.88
103	RR	61 SF	Business Areas	150 SF	0.40
104	BREAK	100 SF	Business Areas	150 SF	0.67
105	STORAGE	50 SF	Business Areas	150 SF	0.34
106	OFFICE	106 SF	Business Areas	150 SF	0.71
107	HALL	28 SF	(none)		
					23.64

LEGEND

FE = RECESSED FIRE EXTINGUISHER CABINET

DOOR EGRESS:

 OCCUPANTS ACTUAL
 OCCUPANTS ALLOWABLE

EGRESS DISTANCES

Exit Path	Exit Path Distance
A	39' - 4"
B	29' - 0"

-  Business Areas
-  Mercantile - Grade Floors and Basement
-  Mercantile - Storage, Stock, and Shipping

CODE SUMMARY

APPLICABLE CODES:
 INCLUDED BUT NOT LIMITED TO, THE LATEST ADOPTED ADDITIONS OF THESE CODES AS AMENDED BY THE CITY OF FARMINGTON AND THE STATE OF ARKANSAS

2021 Arkansas Fire Prevention Code Vol. I (2021 IFC w/ Arkansas Amendments)
 2021 Arkansas Fire Prevention Code Vol. II - Commercial (2021 IBC w/ Arkansas Amendments)
 2021 Arkansas Fire Prevention Code Vol. III - Residential (2021 IRC w/ Arkansas Amendments)
 2018 Arkansas Plumbing Code (IPC)
 2021 Arkansas Mechanical Code (MCC)
 2020 National Electrical Code (NEC)
 2018 Arkansas Fuel Gas Code (AFGC)
 2014 Arkansas Energy Code (AEC)
 2009 ANSI A111.1

THIS PROJECT IS A NEW BUILDING ON A PREVIOUSLY DEVELOPED SITE, SEE CIVIL PLANS FOR ALL SITE DESIGN INFO


THE BUILDING IS NOT SPRINKLERED

BUILDING DATA:
 PROPOSED USE: RETAIL
 OCCUPANCY TYPE: M

CONSTRUCTION TYPE: SB

ALLOWABLE AREA = 6000
 ALLOWABLE HT./STORIES = 55' AND 3 STORY

ACTUAL AREA : 1925 SF
 ACTUAL HT./STORIES = 15' AND 1 STORY
 OCCUPANCY = SEE CODE DIAGRAM

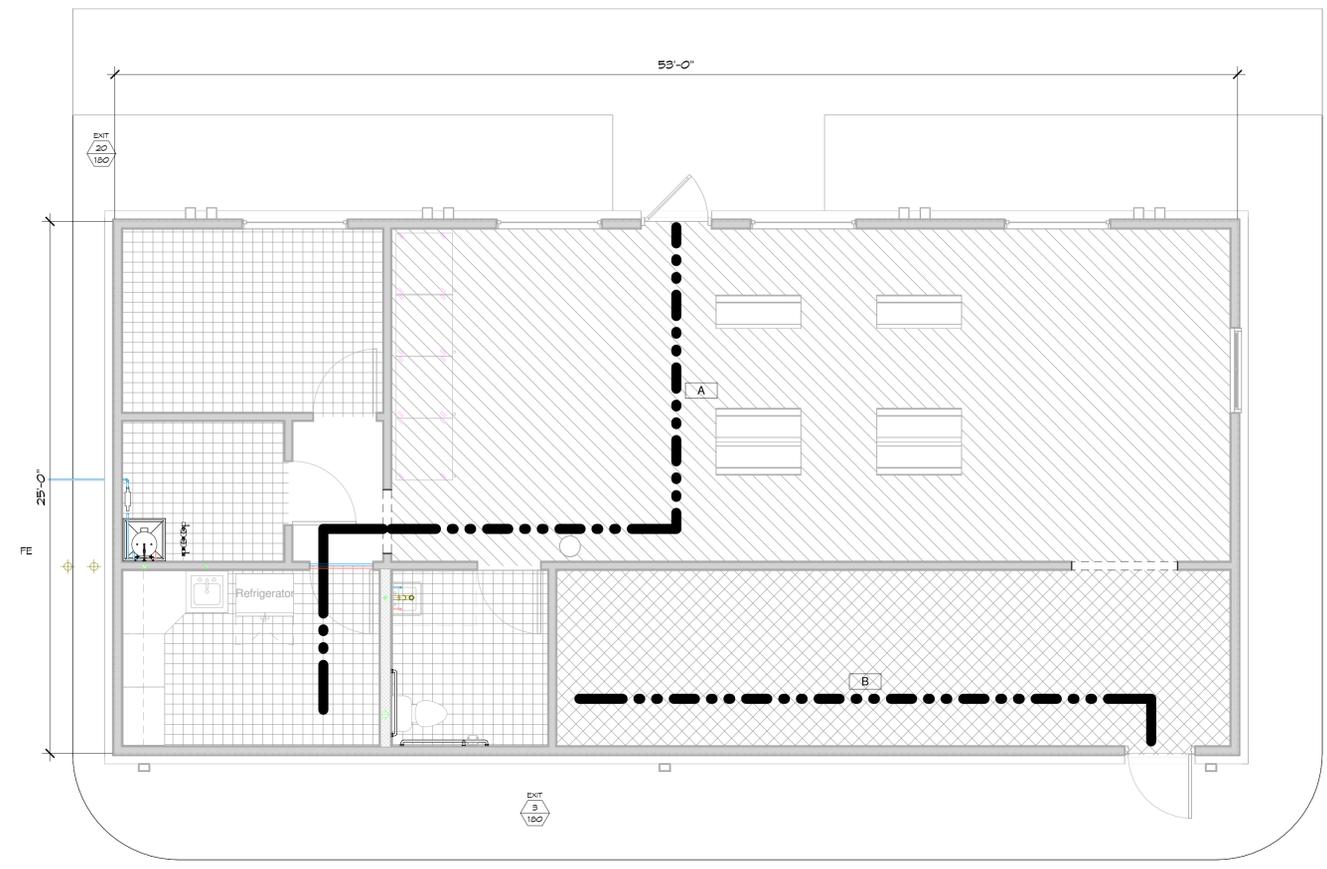

1 FIRST FLOOR LIFE SAFETY PLAN
 1/4" = 1'-0"

9-11-25
 ARCHITECTURE
 PRELIMINARY
 NOT FOR CONSTRUCTION


Burris Architecture
 820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
 479-319-6045

SMOKE SHOP
 730 E MAIN ST
 FARMINGTON, AR

DATE: 9-11-25
 JOB NO.: 25089
 REVISIONS:


A0.2
 CODE FOOTPRINT

THIS DRAWING IS PROVIDED AS AN INSTRUMENT OF SERVICE BY THE ARCHITECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. THE ARCHITECT ASSUMES NO LIABILITY FOR THE ACCURACY OF THE INFORMATION PROVIDED HEREON. THE ARCHITECT'S RESPONSIBILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED HEREON. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED HEREON. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED HEREON.

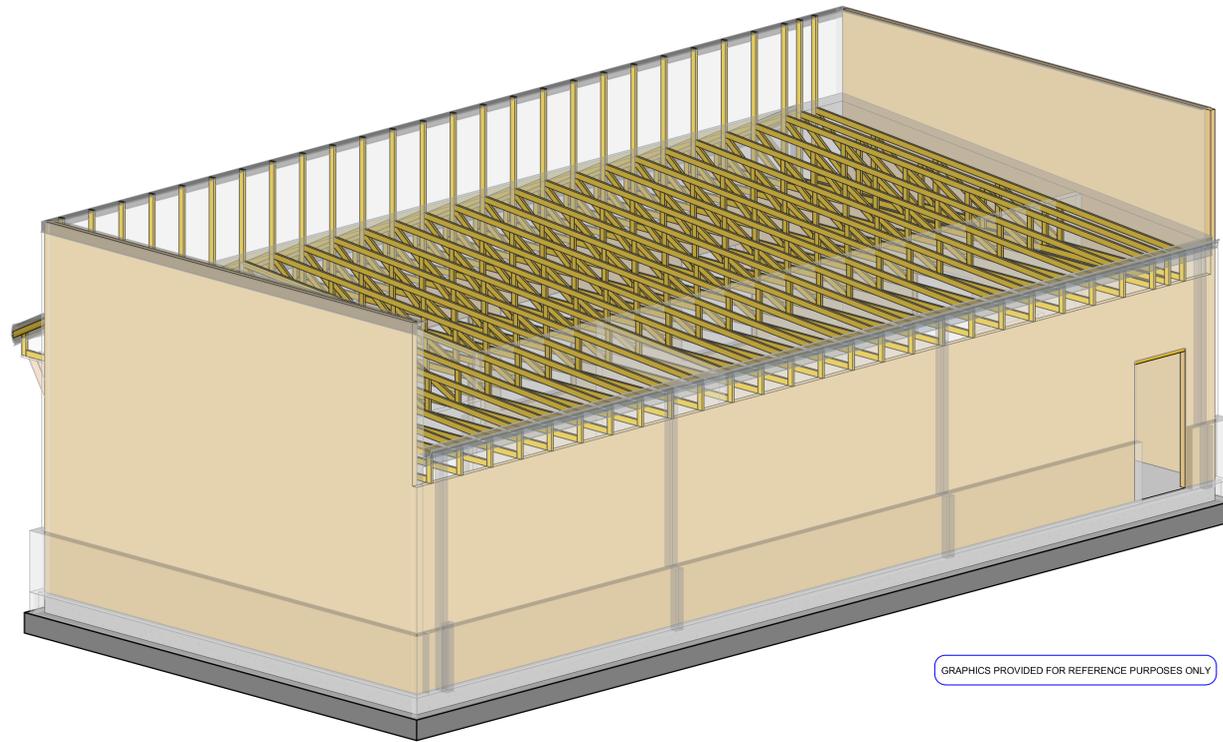

GRAPHICS PROVIDED FOR REFERENCE PURPOSES ONLY

2 BACK ISOMETRIC

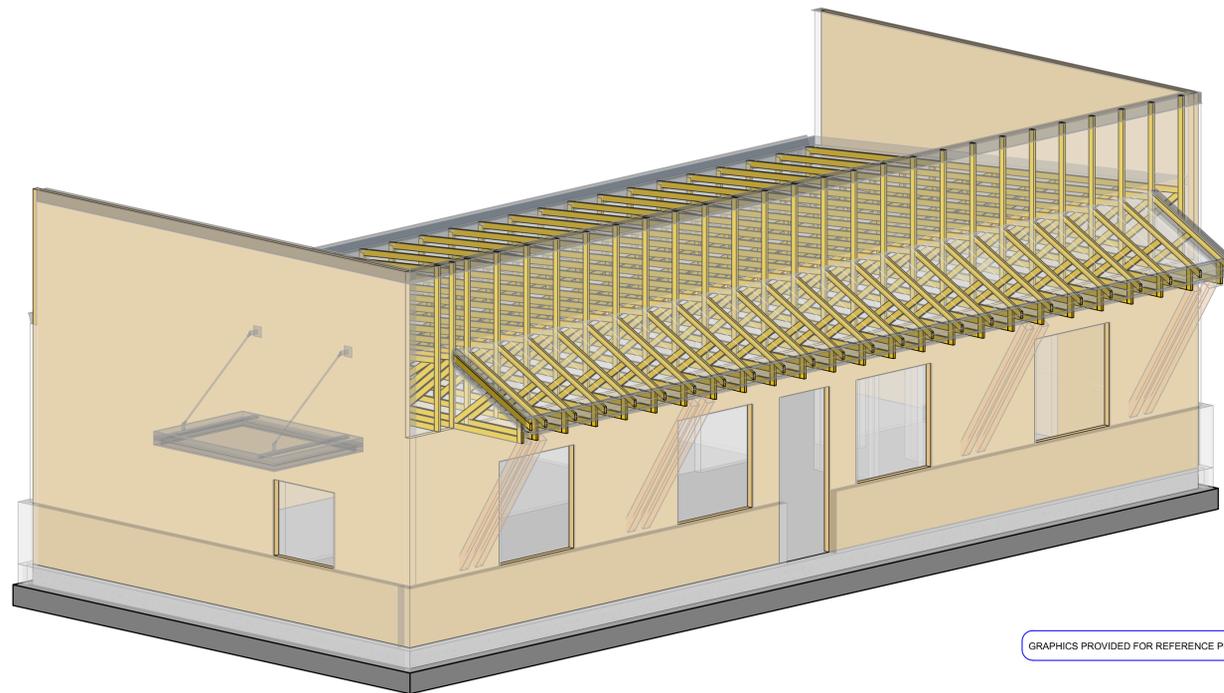

GRAPHICS PROVIDED FOR REFERENCE PURPOSES ONLY

1 FRONT ISOMETRIC

SYMBOLS LEGEND

	LEVEL / ELEVATION INDICATOR
	COLUMN CALLOUT BASE PL CALLOUT AB CALLOUT PED CALLOUT (AS APPLICABLE)
	FTG CALLOUT
	BRACE LOC INDICATOR
	BAR BEND LENGTH INDICATOR
	CENTERLINE INDICATOR
	MOMENT CONN INDICATOR
	DECK TYPE / SPAN DIRECTION
	SLOPE DIRECTION INDICATOR
	STEP INDICATOR
	SHEAR WALL TAG
	SHEAR WALL HOLD DOWN
	SNOW DRIFT LOAD
	REVISION TAG

LOAD AND DESIGN CRITERIA

SMOKE SHOP		2021 IBC
DESIGN CODE		2021 IBC
RISK CATEGORY		II
DEAD LOADS		
FLOOR	SLAB ON GRADE	50 PSF
ROOF	WOOD TRUSS ROOF (TOTAL)	20 PSF
	TOP CHORD	15 PSF
	BOTTOM CHORD	5 PSF
	CANOPY ROOF	15 PSF
LIVE LOADS		
FLOOR	SLAB ON GRADE	125 PSF
ROOF	WOOD TRUSS ROOF	20 PSF
	CANOPY ROOF	20 PSF
SNOW LOADS		
	TYPICAL FLAT ROOF DESIGN SNOW LOAD *	pf 7.0 PSF
	TYPICAL SLOPED ROOF DESIGN SNOW LOAD *	pf 7.0 PSF
	CANOPY ROOF DESIGN SNOW LOAD *	pf 7.7 PSF
	GROUND SNOW LOAD	pg 10.0 PSF
	EXPOSURE FACTOR	Ce 1.0
	THERMAL FACTOR - TYP	Ct 1.0
	THERMAL FACTOR - CANOPY	Ct 1.1
	SLOPE FACTOR	Cs 1.0
	IMPORTANCE FACTOR	Ie 1.0
DRIFT: ACCOUNTED FOR IN ROOF FRAMING DESIGN		
WIND LOAD DESIGN CRITERIA		
	BASIC WIND SPEED	V 107 MPH
	EXPOSURE CATEGORY	C
	DIRECTIONALITY FACTOR	Kd 0.85
	TOPOGRAPHIC FACTOR	Kzt 1.0
	INTERNAL PRESSURE COEFFICIENT	GCF +/- 0.18
	INTERIOR WALLS AND PARTITIONS	5 PSF
COMPONENTS AND CLADDING WIND PRESSURES: SEE SCHEDULE		
SEISMIC LOAD DESIGN CRITERIA		
	SHORT PERIOD ACCELERATION	Sh 0.157
	LONG PERIOD ACCELERATION	S1 0.104
	SITE CLASS	D
	SHORT PERIOD RESPONSE	Sds 0.167
	LONG PERIOD RESPONSE	Sd1 0.143
	SEISMIC DESIGN CATEGORY	C
	IMPORTANCE FACTOR	Ie 1.0
	ANALYSIS PROCEDURE	ELF
	SEISMIC FORCE RESISTING SYSTEM	R A15
	RESPONSE MODIFICATION FACTOR	R 6.5
	SYSTEM OVERSTRENGTH FACTOR	Do 3
	DEFLECTION AMPLIFICATION FACTOR	Cd 4.0
	SEISMIC RESPONSE COEFFICIENT	Cv 0.0258
	SEISMIC BASE SHEAR	V 0.883 KIPS
GEOTECHNICAL DESIGN CRITERIA		
	PAID FOOTING ALLOWABLE BEARING PRESSURE	2000 PSF
NOTES:		
* VALUE CONSIDERS CODE MINIMUMS, RAIN ON SNOW, AND LOCAL ORDINANCES AS APPLICABLE		

STANDARD ABBREVIATIONS

#	NUMBER	LSH	LONG SIDE HORIZONTAL
AT	ANCHOR TIE	LSL	LAMINATED STRAND LUMBER
Ø	DIAMETER	LSV	LONG SIDE VERTICAL
AB	ANCHOR BOLT / ANCHOR ROD	LVL	LAMINATED VENEER LUMBER
ADDL	ADDITIONAL	MAX	MAXIMUM
ABFF	ABOVE FINISHED FLOOR	MECH	MECHANICAL
ALT	ALTERNATE / ALTERNATING	MEP	MECHANICAL/ELECTRICAL / PLUMBING
ARCH	ARCHITECT / ARCHITECTURAL	MFR	MANUFACTURER
BB	BOND BEAM	MIN	MINIMUM
BO	BOTTOM OF	MISC	MISCELLANEOUS
BOF	BOTTOM OF FOOTING / FOUNDATION	ML	MASONRY UNTEL
BOS	BOTTOM OF STEEL	MTL	METAL
BOT	BOTTOM	NIC	NOT IN CONTRACT
BRG	BEARING	NS	NEAR SIDE
BTWN	BETWEEN	NTS	NOT TO SCALE
CANT	CANTILEVER	OC	ON CENTER
CFS	COLD FORMED STEEL	OD	OUTSIDE DIAMETER
CIP	CAST IN PLACE	OF	OUTSIDE FACE
CJ	CONTROL JOINT	OH	OVERHEAD/OVERHANG
CL	CENTER LINE	OPH	OPPOSITE HAND
CLR	CLEAR	OPNG	OPENING
CMU	CONCRETE MASONRY UNIT	OTL	OUTLOOKER
COL	COLUMN	OWSJ	OPEN WEB STEEL JOIST
CONC	CONCRETE	PAF	POWDER ACTUATED
CONN	CONNECTION / CONNECTED	PE	FASTENER
CONT	CONTINUOUS	PESTAL	PEDESTAL
CTR	CENTER/CENTERED	PEMB	PRE-ENGINEERED METAL BUILDING
DB/DBAS	DEFORMED BAR ANCHOR(S)	PEWST	PRE-ENGINEERED WOOD SCISSOR TRUSS
DBE	DECK BEARING ELEVATION	PEWT	PRE-ENGINEERED WOOD TRUSS
DBL	DOUBLE	PL	PLATE
DIA	DIAMETER	PLCS	PLACES
DIM/DIMS	DIMENSION(S)	PROJ	PROJECTION
DL	DEAD LOAD	PSL	PARALLEL STRAND LUMBER
DWL/DWLS	DOWEL(S)	PVMT	PAVEMENT
E	EACH	QUAD	QUADRUPLE
E/A	EARTHQUAKE	REINF	REINFORCEMENT
EA	EACH FACE	REQ/REQD	REQUIRE(S)/REQUIREMENT / REQUIRE
EL	ELEVATION	RL	REQUIRED
EMBED	EMBEDMENT/EMBEDDED	RS	ROOF LIVE LOAD
EOR	ENGINEER OF RECORD	RTU	ROOF TOP UNIT
EPA	EFFECTIVE PROJECTED AREA	SCHED	SCHEDULE
EQ	EQUAL/EQUIVALENT	SIM	SIMILAR
EQUIP	EQUIPMENT	SIP/SIPS	STRUCTURAL INSULATED PANEL(S)
ETC	ETCETERA	SL	SNOW LOAD
EW	EACH WAY	SPA	SPACING / SPACED
EXP	EXPANSION	SPEC	SPECIFICATIONS
EXST	EXISTING	SOG	SLAB ON GRADE
EXT	EXTERIOR	SQ	SQUARE
FDTN	FOUNDATION	SS	STAINLESS STEEL
FF EL	FINISHED FLOOR ELEVATION	STL	STEEL
FIN	FINISH	SYMM	SYMMETRICAL
FLR	FLOOR	T&B	TOP & BOTTOM
FS	FAR SIDE	TBE	TRUSS BEARING ELEVATION
FTG	FOOTING	TEMP	TEMPORARY/TEMPERATURE
FV	FIELD VERIFY	TO	TOP OF
GA	GAUGE/GAGE	TOB	TOP OF BEAM
GALV	GALVANIZED	TOC	TOP OF CONCRETE
GC	GENERAL CONTRACTOR	TOF	TOP OF FOOTING / FOUNDATION
GEN	GENERAL	TOM	TOP OF MASONRY
HAS	HEADED STUD ANCHOR	TOS	TOP OF STEEL
HDR	HEADER	TOW	TOP OF WALL
HI	HIGH	TRANS	TRANSVERSE
HORIZ	HORIZONTAL	TRIP	TRIPLE
ID	INSIDE DIAMETER	TYP	TYPICAL
INFO	INFORMATION	UNO	UNLESS NOTED OTHERWISE
INSUL	INSULATED/INSULATION	VERT	VERTICAL
INT	INTERIOR	VLD	VERTICAL LEG DOWN
JBE	JOIST BEARING ELEVATION	VLU	VERTICAL LEG UP
JST	JOIST	w	WITH
K	KIPS (1000 LBS)	WL	WIND LOAD
L / L	ANGLE	WIP	WORK POINT
LAT	LATERAL	WWR	WELDED WIRE REINF. (MESH/FABRIC)
LBS	POUNDS		
LL	LIVE LOAD		
LLH	LONG LEG HORIZONTAL		
LLV	LONG LEG VERTICAL		
LO	LOCATION(S)		
LOC/LOCS	LOCATION(S)		
LONG	LONGITUDINAL		

NOTES:
1. NOT ALL ABBREVIATIONS ARE USED ON EACH SHEET. THIS INFORMATION IS FOR REFERENCE ONLY.

STATE OF ARIZONA
REGISTERED PROFESSIONAL ENGINEER
No. 23572
MICHAEL TODD SMITH

CERTIFICATE OF AUTHORIZATION
MILLER ENGINEERING, P.C.
No. 1486
MICHAEL TODD SMITH
Digital Signature of Michael Todd Smith
Date: 2025/09/11 14:33:54 -0500

Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE	09-11-25
JOB NO.	13758
REVISIONS	

S0.0
ISOMETRIC VIEWS & SCHEDULES

MILLER ENGINEERING
structural • forensic • building enclosure

MILLER ENGINEERING, P.C.
3827 S. TIMBERCREEK AVE., STE A
SPRINGFIELD, MO 65807
417.866.6894 P
417.866.6657 F
e-mail: info@millerstructures.com


- FOUNDATION PLAN NOTES**
1. TOP OF SLAB ELEVATION = 100'-0".
 2. ALL TOP OF EXTERIOR FOOTING ELEVATIONS SHALL BE 99'-0" UNO.
 3. COORDINATE ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL PRIOR TO CONSTRUCTION.
 4. COORDINATE ALL SLAB AND FOUNDATION PENETRATIONS WITH OTHER DISCIPLINES AND NOTIFY ENGINEER IF ANY CONFLICTS ARE DISCOVERED. STRUCTURAL DRAWINGS MAY NOT INDICATE ALL PENETRATIONS.
 5. UTILITIES SHALL PASS ABOVE OR BELOW PERIMETER FOOTINGS. SEE UTILITY PIPE PENETRATION DETAIL.
 6. SEE ARCHITECTURAL DRAWINGS FOR SLAB FINISH REQUIREMENTS.
 7. DOWEL ALL SIDEWALKS TO BUILDING SLABS AT DOORWAYS w/ #4 x 24" LONG DOWELS @ 12" O.C. MAX. (12" EMBEDMENT) UNO.
 8. PROVIDE SLAB CONTROL JOINTS AS INDICATED IN PLAN AND GENERAL NOTES. SEE CONTROL JOINT DETAIL.
 9. PROVIDE SUPPLEMENTAL SLAB REINFORCING WHERE APPLICABLE. SEE TYPICAL SLAB ON GRADE REINFORCING DETAILS.
 10. PROVIDE CONTINUOUS REINFORCING IN ALL CONCRETE CONSTRUCTION. SEE CORNER BAR DETAIL.
 11. SEE THE GEOTECHNICAL INVESTIGATION REPORT FOR SITE PREPARATION REQUIREMENTS.

WOOD STUD BEARING WALL SCHEDULE

MARK	STUD SIZE	NUMBER OF STUDS	STUD SPACING	BLOCKING SPACING	LUMBER GRADE
BW1	2x4	1	16" OC	MID POINT	SYP #2
BW2	2x4	1	12" OC	MID POINT	SYP #2

NOTES:

1. NON-STRUCTURAL PARTITION WALLS ARE NOT INDICATED IN STRUCTURAL DOCUMENTS. REFER TO ARCHITECTURAL DRAWINGS FOR PARTITION WALL LOCATIONS WHERE APPLICABLE.
2. REFER TO GENERAL NOTES FOR REQUIRED TOP PLATE, SILL PLATE, AND BLOCKING LUMBER GRADES.
3. STUDS SHALL ALIGN WITH FLOOR JOISTS OR TRUSSES AS APPLICABLE.
4. MULTIPLE STUDS SHALL BE NAILED IN ACCORDANCE WITH NDS SPECIFICATION SECTION 15.3.3:
 - A. PROVIDE 10x NAILS AT DOUBLE STUDS
 - B. PROVIDE 30x NAILS AT TRIPLE STUDS
5. SEE SHEAR WALL PLANS AND DETAILS. PROVIDE ALTERNATE STUDS AND BLOCKING AS REQUIRED.
6. SEE WOOD FRAMING GENERAL NOTES FOR ADDITIONAL INFORMATION.

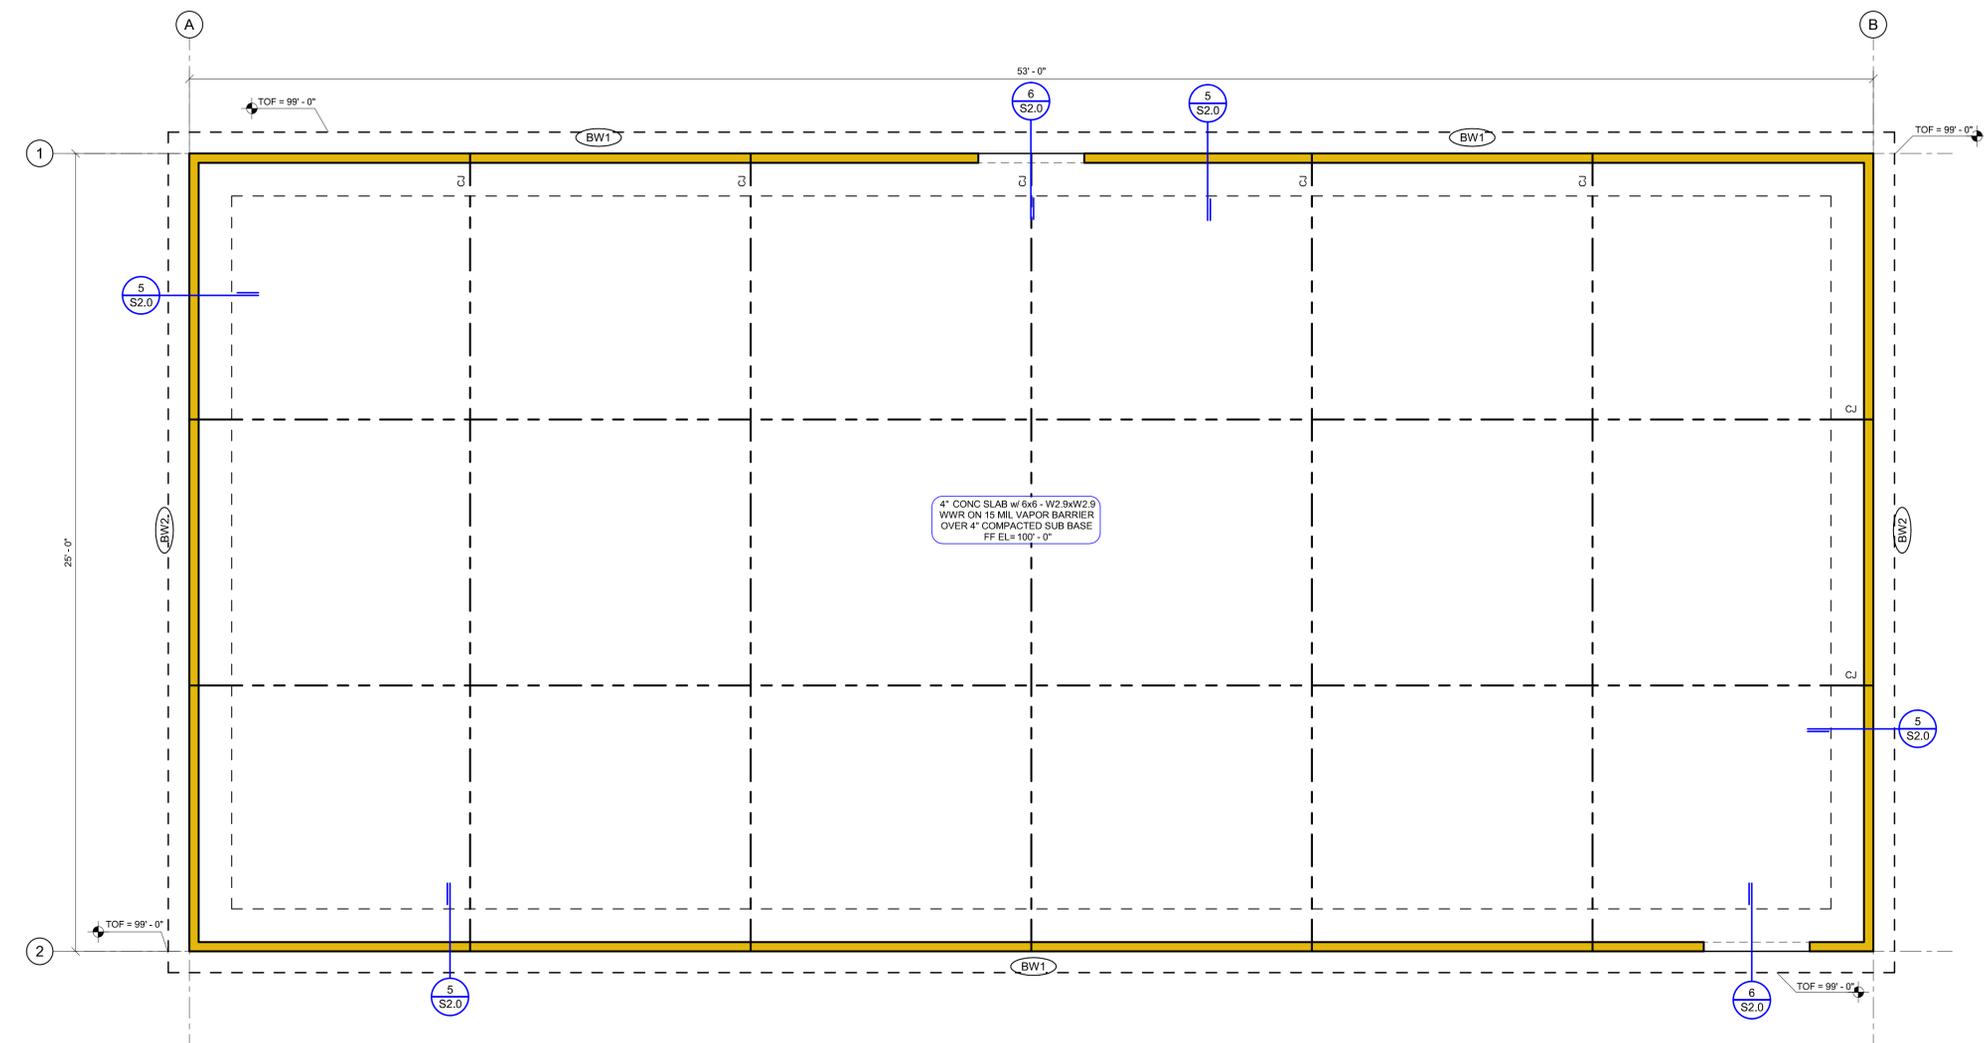

FOUNDATION PLAN
3/8" = 1'-0"



Burris Architecture
820 Tiger Blvd., Suite 4, Bentonville, AR 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR


DATE: 09-11-25
JOB NO.: 13758
REVISIONS:

S1.0
FOUNDATION PLAN


MILLER ENGINEERING
structural • forensic • building enclosure

MILLER ENGINEERING, P.C.
3827 S. TIMBERCREEK AVE., STE A
SPRINGFIELD, MO 65807
417.866.6864 P
417.866.6867 F
e-mail: info@millerstructures.com




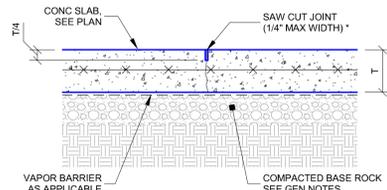


CONTRACTION JOINT
(TYP AT MONOLITHIC POUR)

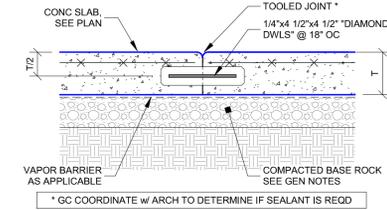


CONSTRUCTION JOINT


1 SLAB ON GRADE CONTROL JOINTS
NTS

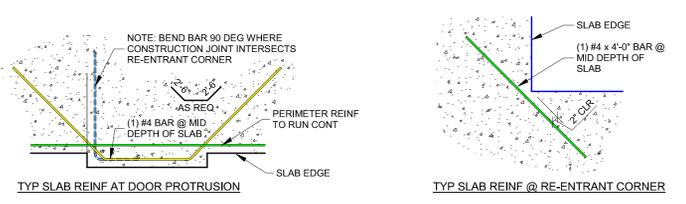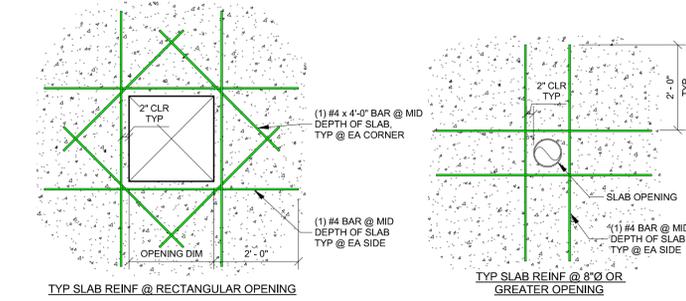


2 TYPICAL SLAB ON GRADE REINFORCING
NTS

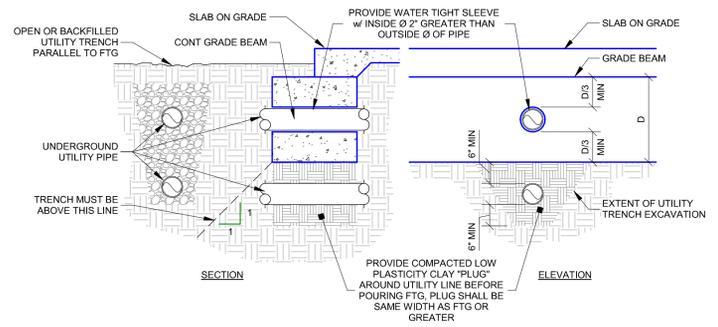

3 UTILITY PIPE PENETRATION AT FOUNDATION
1/2" = 1'-0"

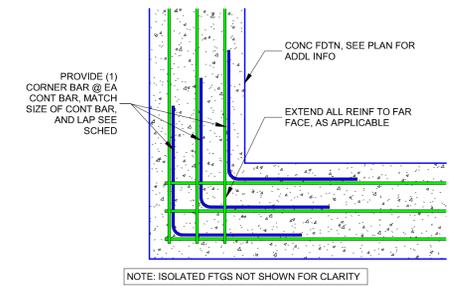


4 CORNER BAR
NTS

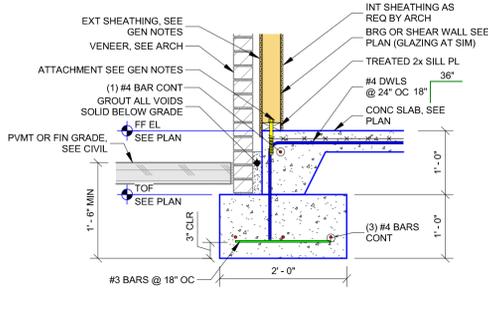


NOTE: CENTER FTG BELOW WALL UNO

5 TYPICAL TURNDOWN ON FOOTING W/ VENEER
3/4" = 1'-0"

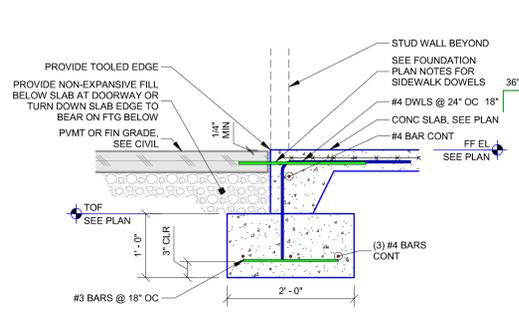

6 PERIMETER FOOTING AT DOOR OPENING
3/4" = 1'-0"

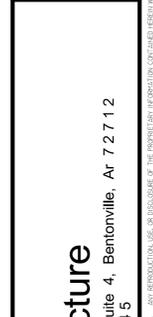

Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE: 09-11-25
JOB NO.: 13758
REVISIONS:

MILLER ENGINEERING
structural • forensic • building enclosure

MILLER ENGINEERING, P.C.
3827 S. TIMBERCREEK AVE, STE A
SPRINGFIELD, MO 65807
417.866.6994 P
417.866.6957 F
e-mail: info@millerstructures.com

S2.0
FOUNDATION DETAILS

- FRAMING PLAN NOTES**
1. ALL OPENING SIZES AND LOCATIONS, HEAD AND SILL ELEVATIONS, ETC. SHALL BE COORDINATED WITH OTHER DISCIPLINES.
 2. COORDINATE FIREPROOFING REQUIREMENTS WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS.
 3. SEE TYPICAL FRAMING DETAILS FOR CONDITIONS NOT SPECIFICALLY SHOWN IN PLAN.
 4. PROVIDE MULTIPLE STUDS TO GRADE AT HEADER OR OTHER CONCENTRATED BEARING POINTS.
 5. PROVIDE TWO KING STUDS AT HEADERS > 3'-0" SPAN.
 6. PROVIDE 2x BLOCKING BETWEEN TRUSSES AT EACH MEP FIXTURE, FINISH ELEMENT, AND ANY ITEM ANCHORED TO ROOF STRUCTURE. DO NOT DRILL THROUGH TRUSS CHORDS. COORDINATE BLOCKING LOCATIONS WITH CEILING PENETRATIONS.




Burris Architecture
 820 Tiger Blvd., Suite 4, Bentonville, Ar 72712
 479-319-6045

SMOKE
 730 E MAIN ST
 FARMINGTON, AR

DATE: 09-11-25
 JOB NO.: 13758
 REVISIONS:


S3.0
 FRAMING PLAN

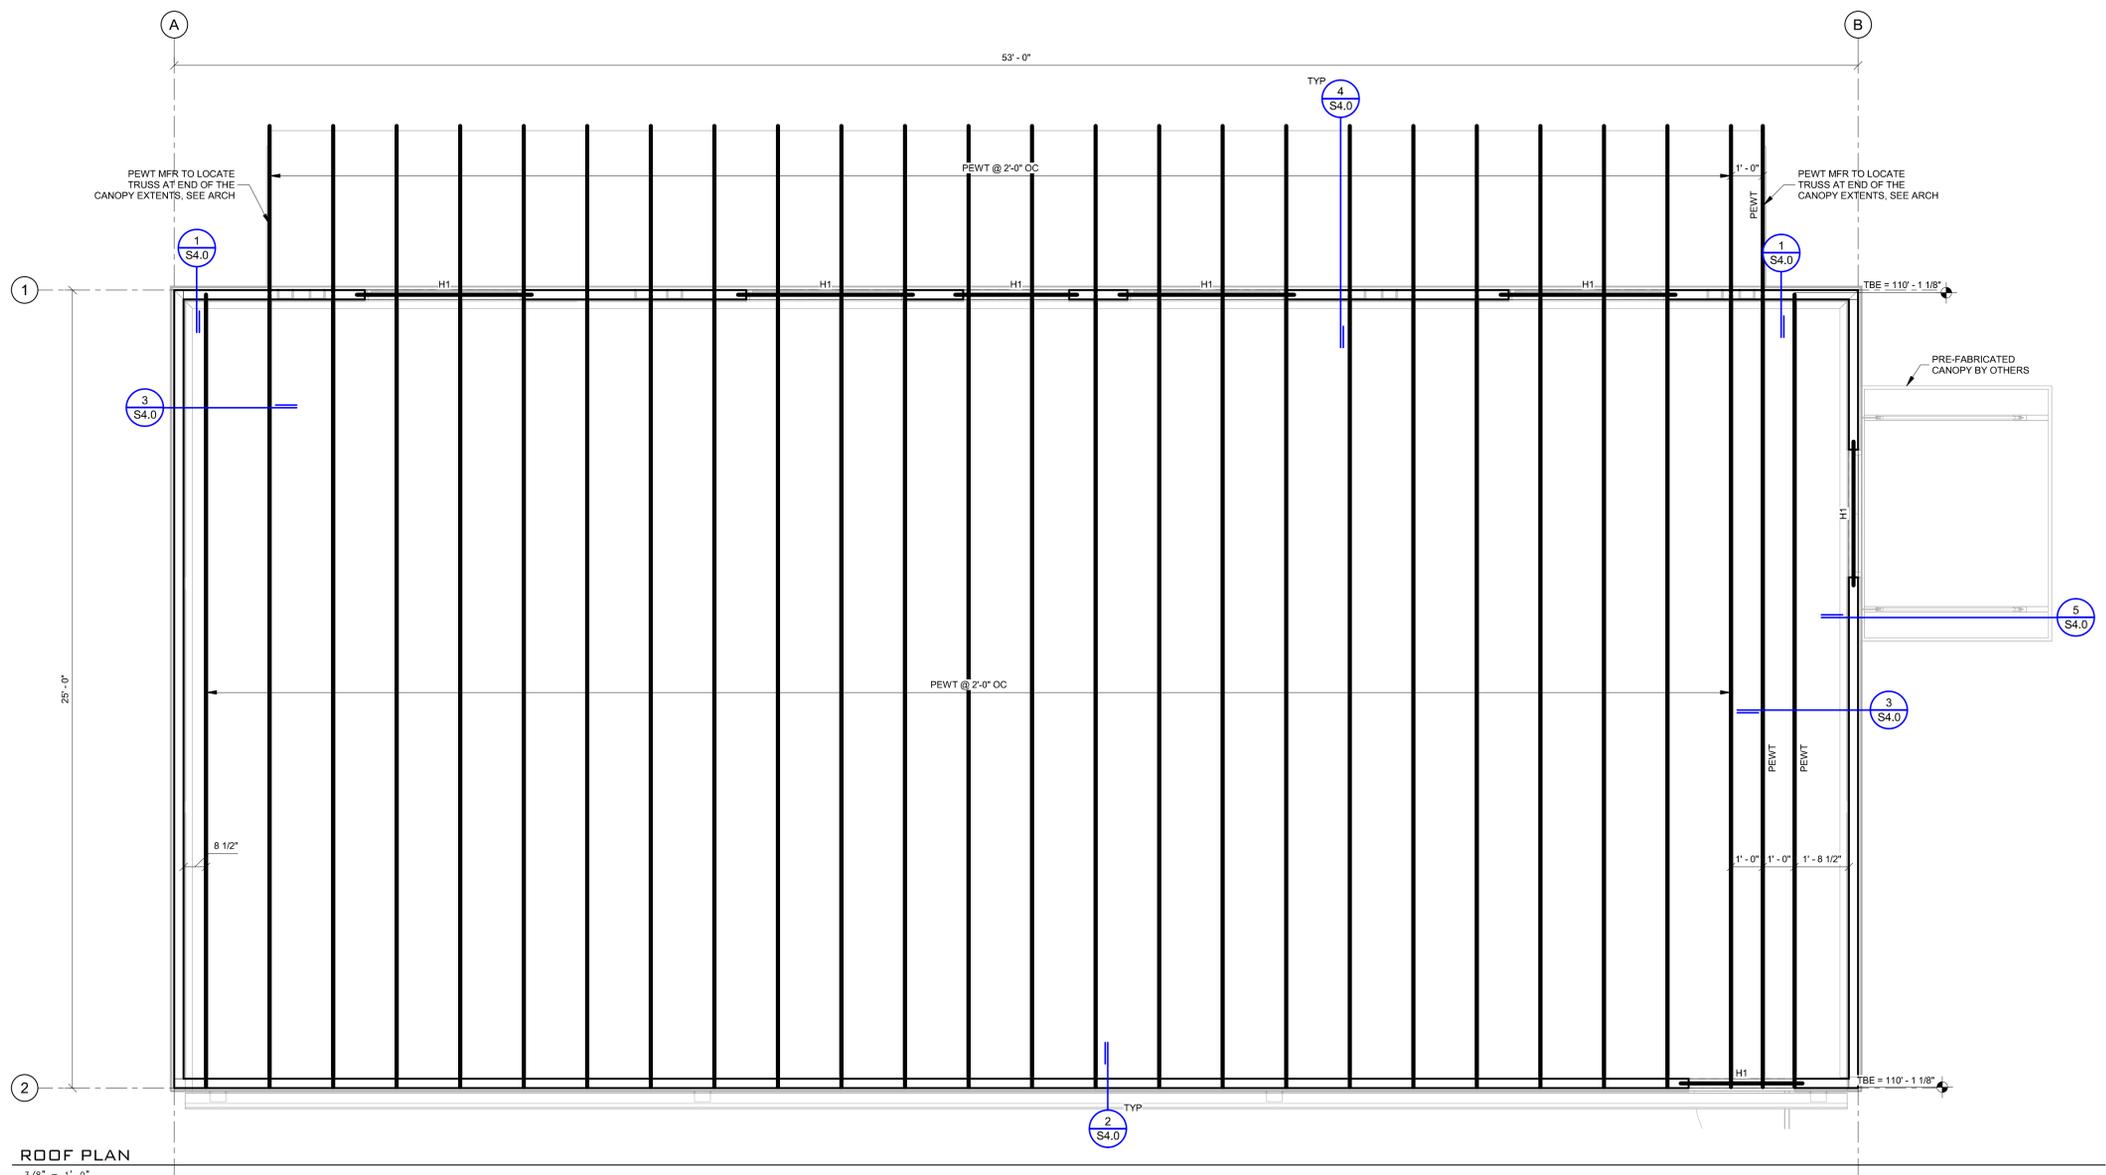


MILLER ENGINEERING
 structural • forensic • building enclosure

MILLER ENGINEERING, P.C.
 3827 S. TIMBERCREEK AVE, STE A
 SPRINGFIELD, MO 65807
 417.866.6864 P
 417.866.6857 F
 e-mail: info@millerstructures.com


THIS DRAWING IS PROVIDED AS AN INDICATION OF DESIGN ONLY. THE ARCHITECT HAS CONDUCTED VISUAL GENERAL VERIFICATION OF THE INFORMATION PROVIDED HEREON. THE ARCHITECT HAS CONDUCTED VISUAL GENERAL VERIFICATION OF THE INFORMATION PROVIDED HEREON. THE ARCHITECT HAS CONDUCTED VISUAL GENERAL VERIFICATION OF THE INFORMATION PROVIDED HEREON. THE ARCHITECT HAS CONDUCTED VISUAL GENERAL VERIFICATION OF THE INFORMATION PROVIDED HEREON.

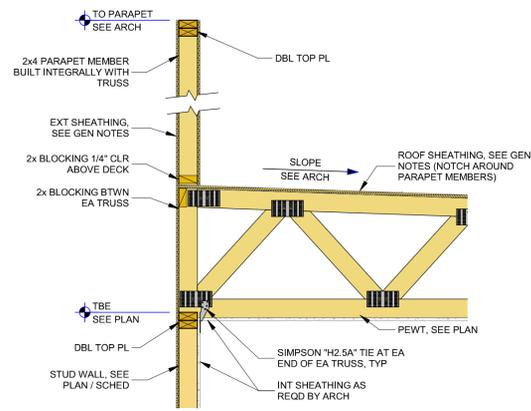


① TRUSS BEARING AT EXTERIOR WALL (HIGH END)
3/4" = 1'-0"

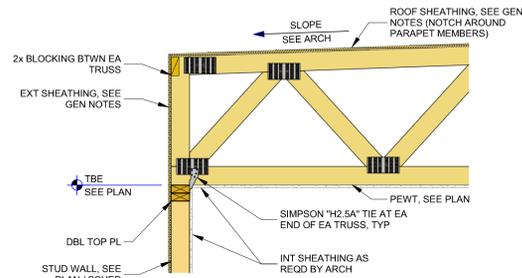


② TRUSS BEARING AT EXTERIOR WALL (LOW END)
3/4" = 1'-0"

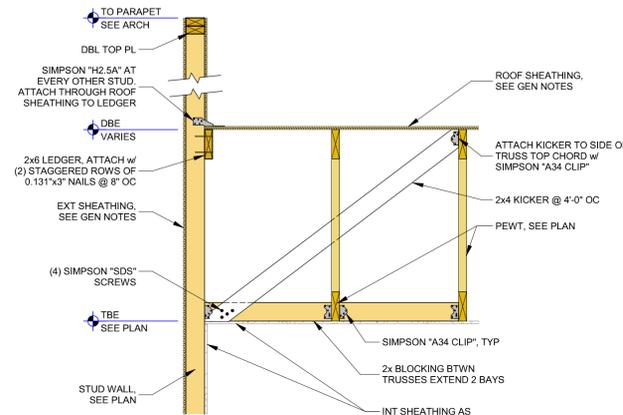



③ BALDOON WALL FRAMING
3/4" = 1'-0"

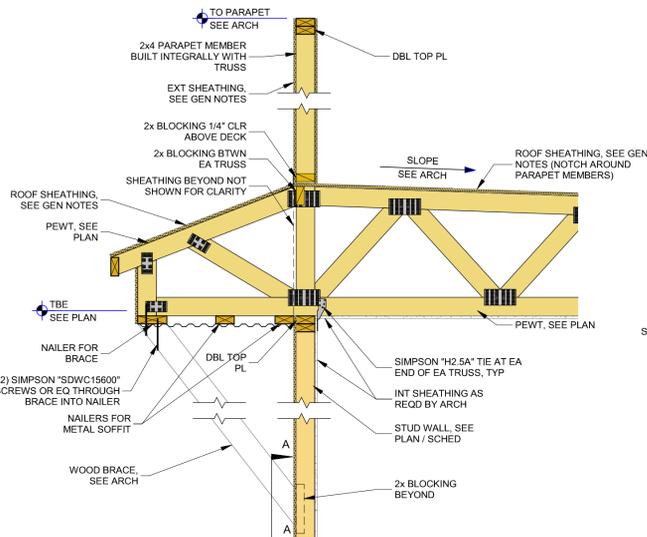

④ CANOPY TRUSS FRAMING
3/4" = 1'-0"

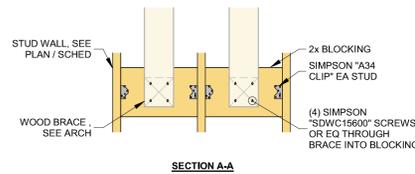

⑤ CANOPY BLOCKING FRAMING
3/4" = 1'-0"

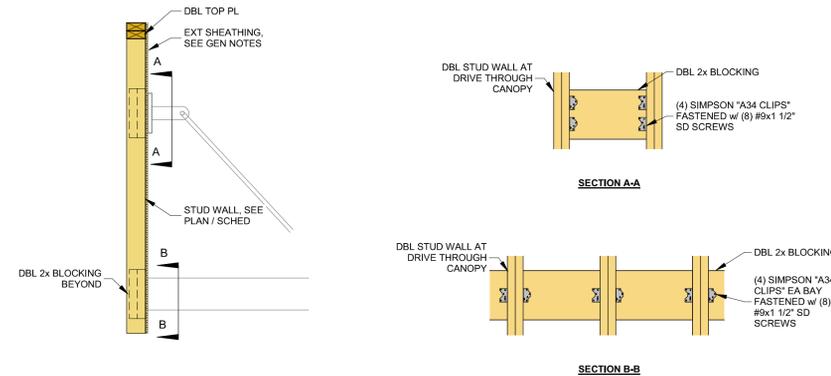

Burris Architecture
820 Tiger Blvd., Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR


DATE	09-11-25
JOB NO.	13758
REVISIONS	

MILLER ENGINEERING
structural • forensic • building enclosure

MILLER ENGINEERING, P.C.
3827 S. TIMBERCREEK AVE., STE A
SPRINGFIELD, MO 65807
417.866.6664 P
417.866.6657 F
e-mail: info@millerstructures.com

S4.0
FRAMING DETAILS

MARK	DOOR			ELEVATION	DOOR		HARDWARE SET	NOTES
	DOOR WIDTH	DOOR HEIGHT	DOOR TYPE		FRAME TYPE	DOOR TYPE		
100	3'-0"	7'-0"	1	ALUM	ALUM GLASS	1		
102	3'-0"	6'-8"	3	HM	IHM	1		
103	3'-0"	6'-8"	2	IND	SCIND	3		
104	3'-0"	6'-8"	2	IND	SCIND	4		
105	3'-0"	6'-8"	2	IND	SCIND	2		
106	3'-0"	6'-8"	2	IND	SCIND	2		MECHANICAL SOUND SEAL ON BOTTOM OF DOOR

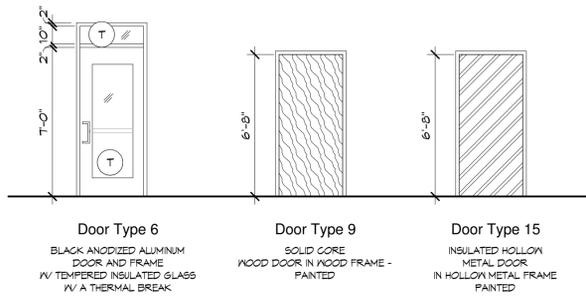

LOCK SETS:


- SET 1 - KEYED, PUSH PAD EXIT DEVICE, CLOSER, HG ALUM. THRESHOLD
- SET 2 - KEYED
- SET 3 - PRIVACY
- SET 4 - PASSAGE

NOTES:

- 1. ALL HARDWARE TO BE LEVER ACTION W/ A BRUSHED CHROME FINISH -
- 2. ALL CLOSERS TO MEET ADA REQUIREMENTS
- 3. ALL ALUM. WINDOW AND DOOR FRAMES ARE TO BE BLACK ANODIZED ALUM. FINISH

NOTE: COMPLETE ALL HARDWARE WITH NECESSARY HARDWARE INCLUDING HINGES AND DOOR STOPS




WALL TYPES

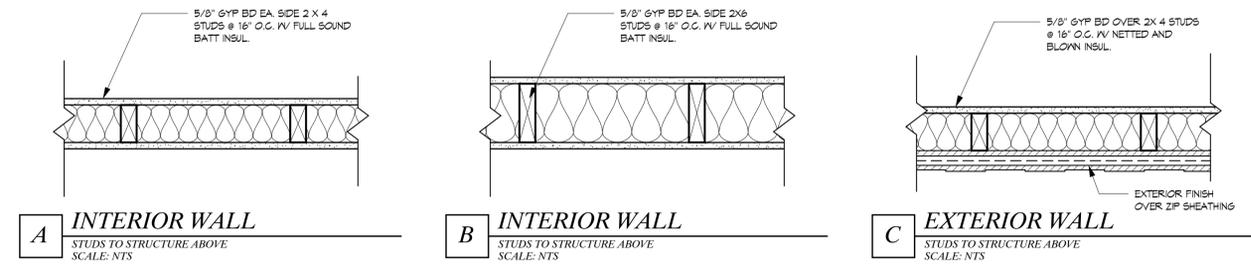

2 DOOR ELEVATIONS
1/4" = 1'-0"


WATER INTRUSION NOTES:

- PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL PROVIDE SHOP DRAWINGS OF PREFABRICATED FLASHING FOR ALL CONNECTION CONDITIONS IN THE WEATHER RESISTANT BARRIER FOR REVIEW BY THE ARCHITECT. FAILURE TO OBTAIN AN APPROVED SET OF DETAIL SHOP DRAWINGS SHALL RELIEVE THE ARCHITECT OF ANY AND ALL LIABILITY REGARDING WEATHER RESISTANT BARRIER FLASHING AND CONDITIONS.
- IT IS THE INTENT OF THESE DRAWINGS TO ILLUSTRATE THE MINIMUM REQUIREMENTS. MORE STRINGENT INSTRUCTIONS REQUIRED BY MANUFACTURERS, SUPPLIERS, OR INSTALLERS TO MAINTAIN GUARANTEES OR WARRANTIES SHALL BE COMPLETELY FOLLOWED.
- WEATHER RESISTANT BARRIER SHALL BE INSTALLED PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND ALL APPLICABLE CODES.
- ALL WINDOWS AND DOORS SHALL BE PRE-MANUFACTURED ALUM FRAMES WITH GLAZING. ALL INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS OF THE MANUFACTURER SHALL BE COMPLETELY FOLLOWED.
- SEALANTS USED SHALL BE COMPATIBLE WITH AND APPROVED BY THE MANUFACTURERS OF ALL MATERIALS AND PRODUCTS TO WHICH THESE SEALANTS ARE APPLIED. CONTRACTOR IS RESPONSIBLE FOR THE APPROPRIATE SELECTION OF THE PROPER TYPE OF SEALANT FOR THE INTENDED USE.

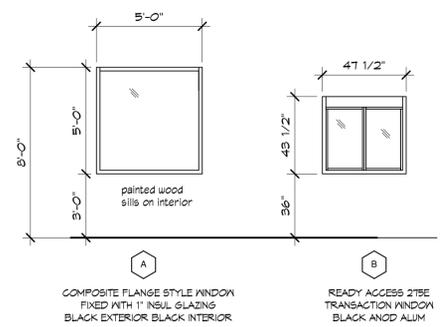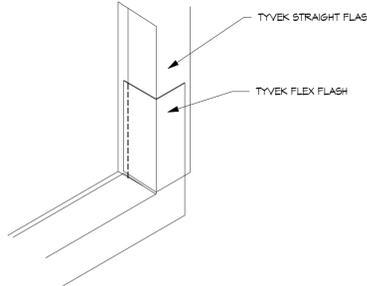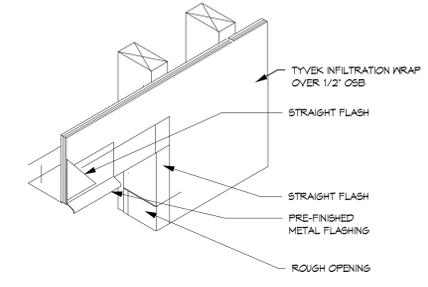


4 WINDOW FLASHING DETAILS
3" = 1'-0"

3 WINDOW ELEVATIONS
1/4" = 1'-0"

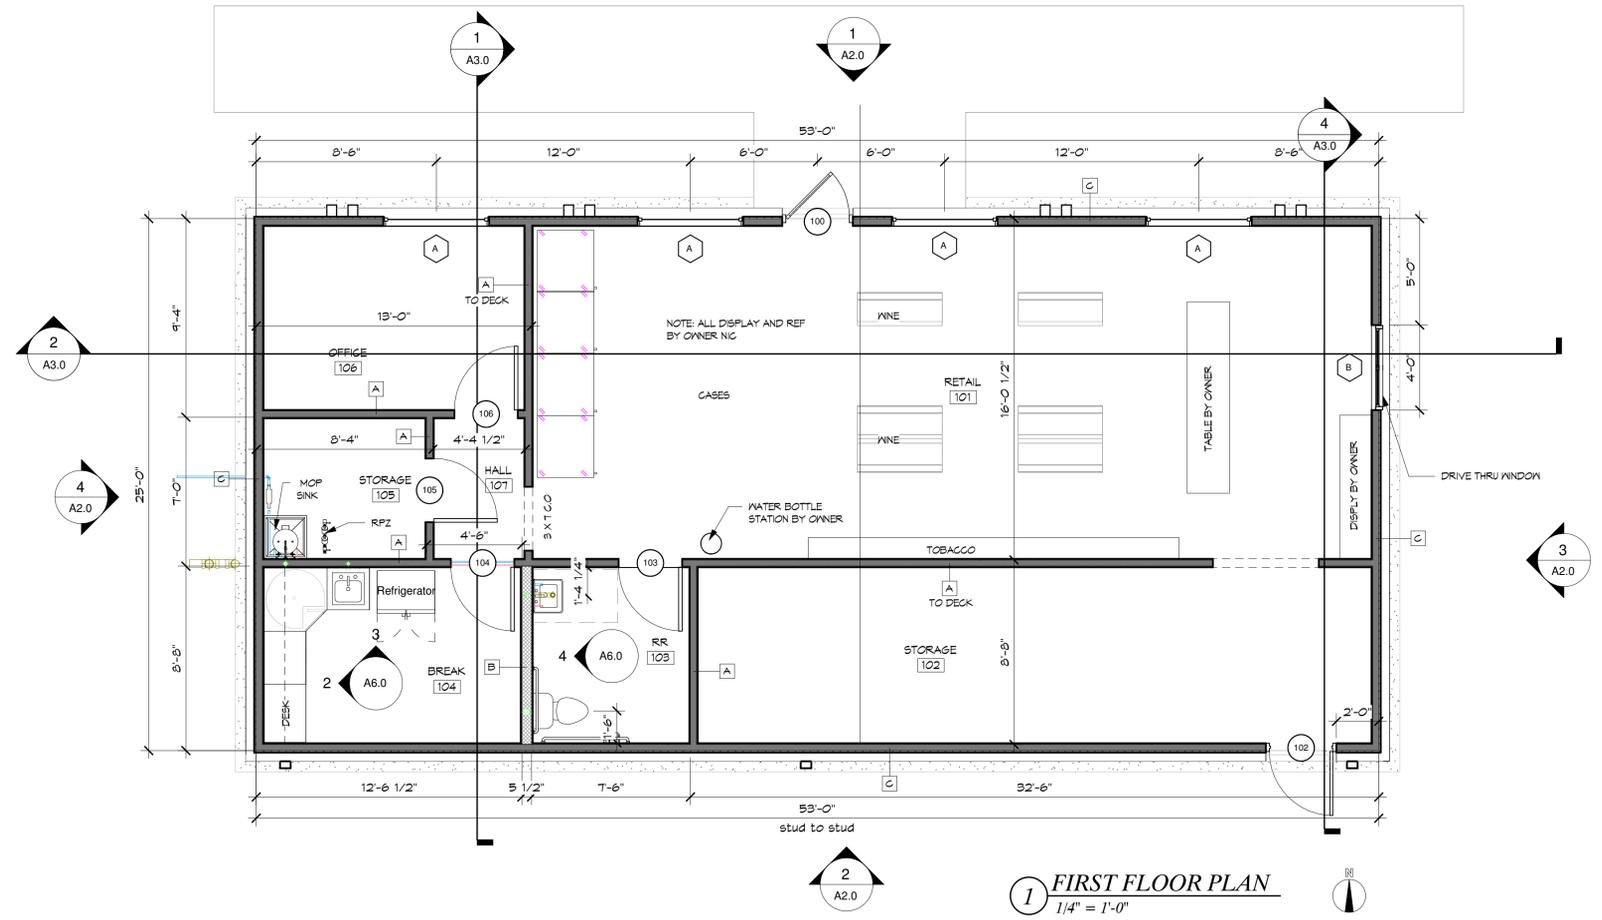

1 FIRST FLOOR PLAN
1/4" = 1'-0"




Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045


SMOKE SHOP
730 E MAIN ST
FARMINGTON, AR

DATE: 9-11-25
JOB NO.: 25089
REVISIONS:


A1.0
FIRST FLOOR PLAN

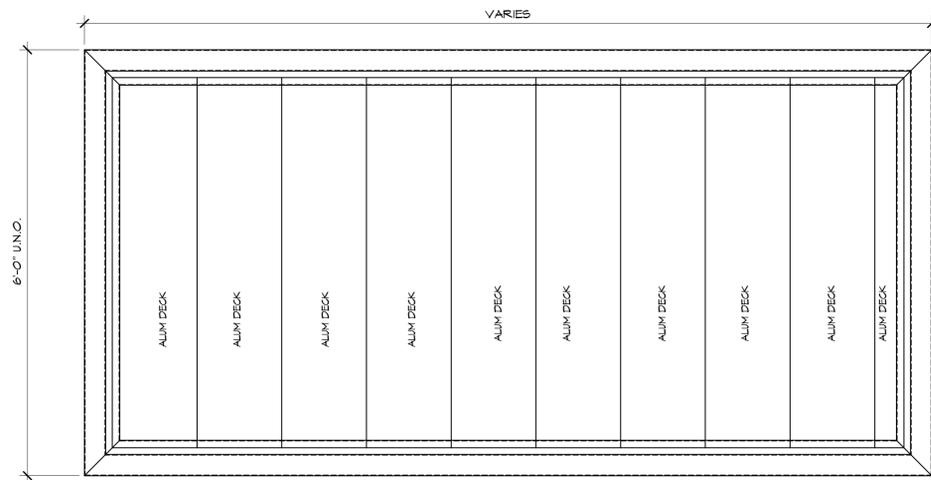


CANOPY PLAN VIEW



CANOPY SECTION




CANOPY FRAME PROFILE
14 GA ALUMINUM

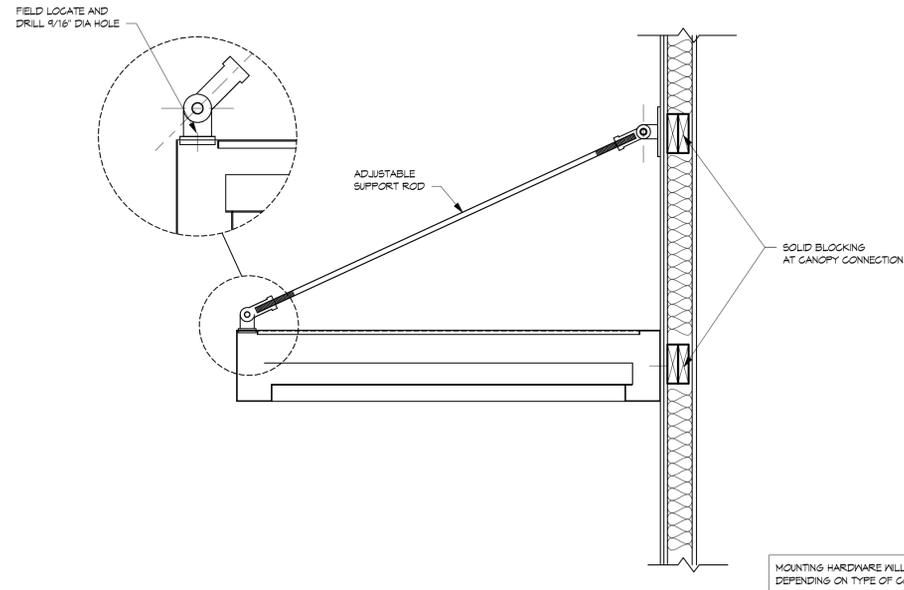


MOUNTING HARDWARE WILL VARY
DEPENDING ON TYPE OF CONNECTION

4 STI STANDARD CANOPY
1" = 1'-0"


CEILING LEGEND	
5/8" G/8 ON UNDERSIDE OF ROOF TRUSSES	
METAL SOFFIT	

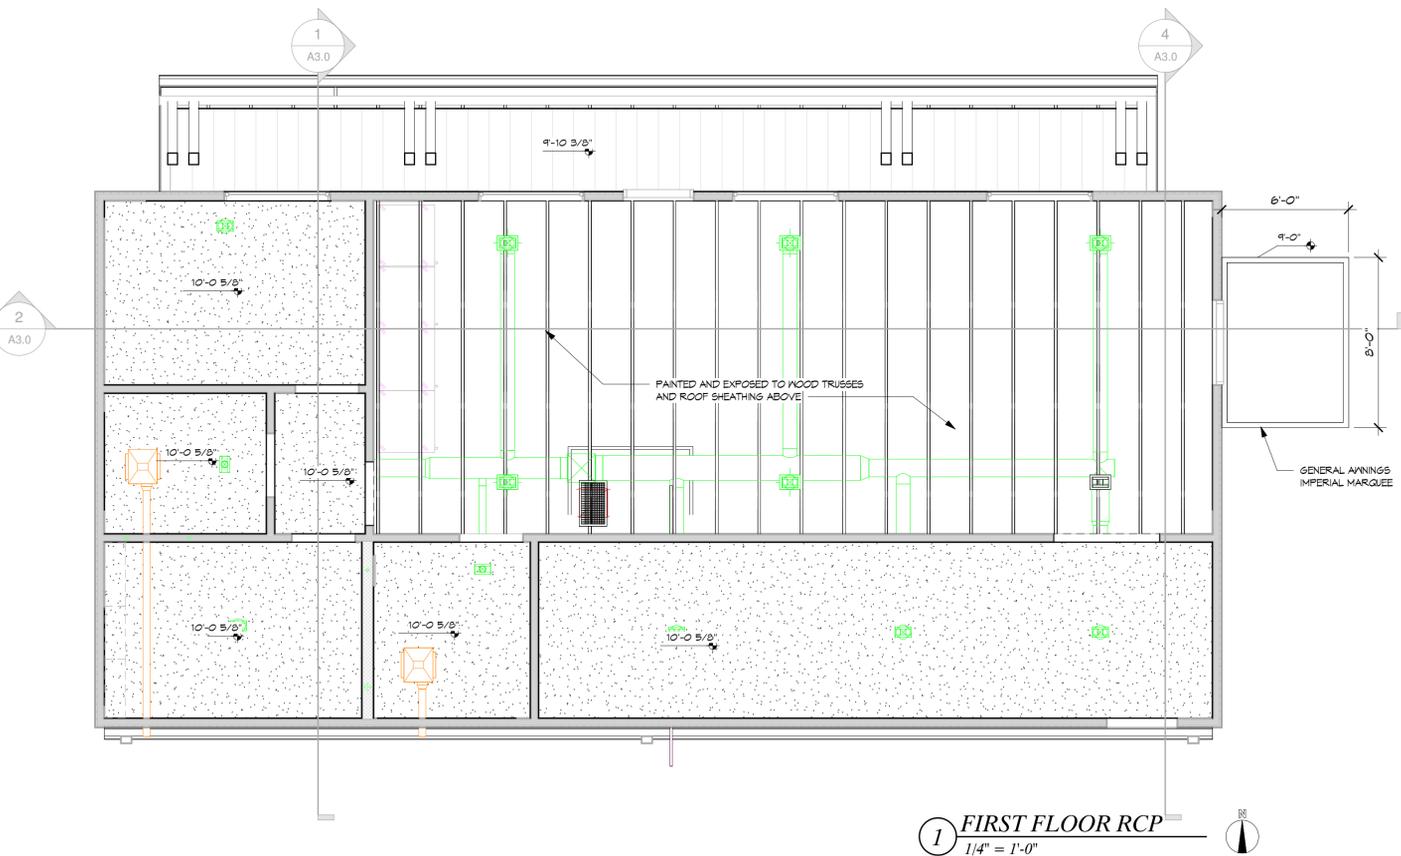

1 FIRST FLOOR RCP
1/4" = 1'-0"

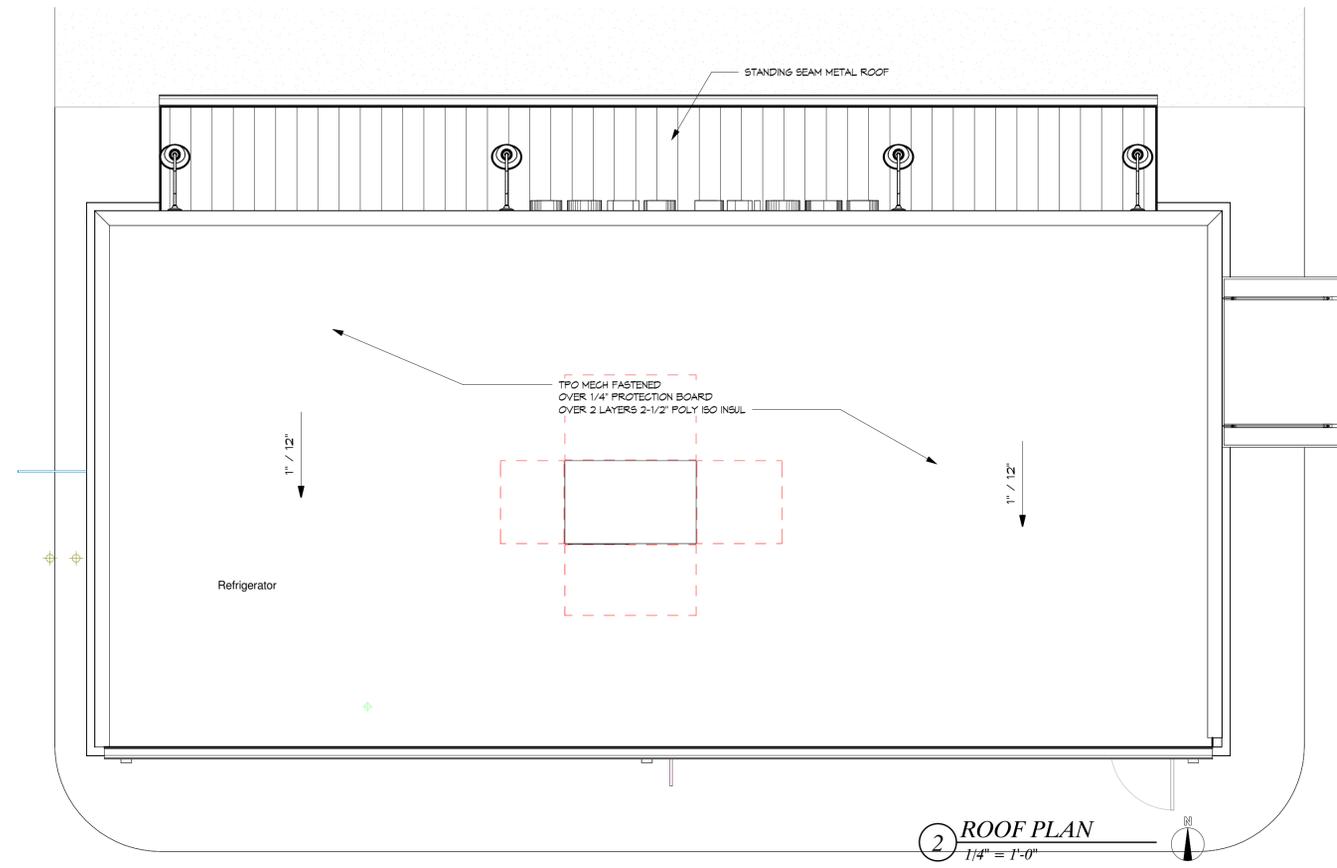

2 ROOF PLAN
1/4" = 1'-0"




Burris Architecture
8200 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE SHOP
730 E MAIN ST
FARMINGTON, AR

DATE: 9-11-25
JOB NO.: 25089
REVISIONS:

A1.1
ROOF/RCP

THIS DRAWING IS PROVIDED AS AN INSTRUMENT OF SERVICE BY THE ARCHITECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. THE ARCHITECT ASSUMES NO LIABILITY FOR THE PERFORMANCE OF THE WORK OR THE RESULTS THEREOF. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT.

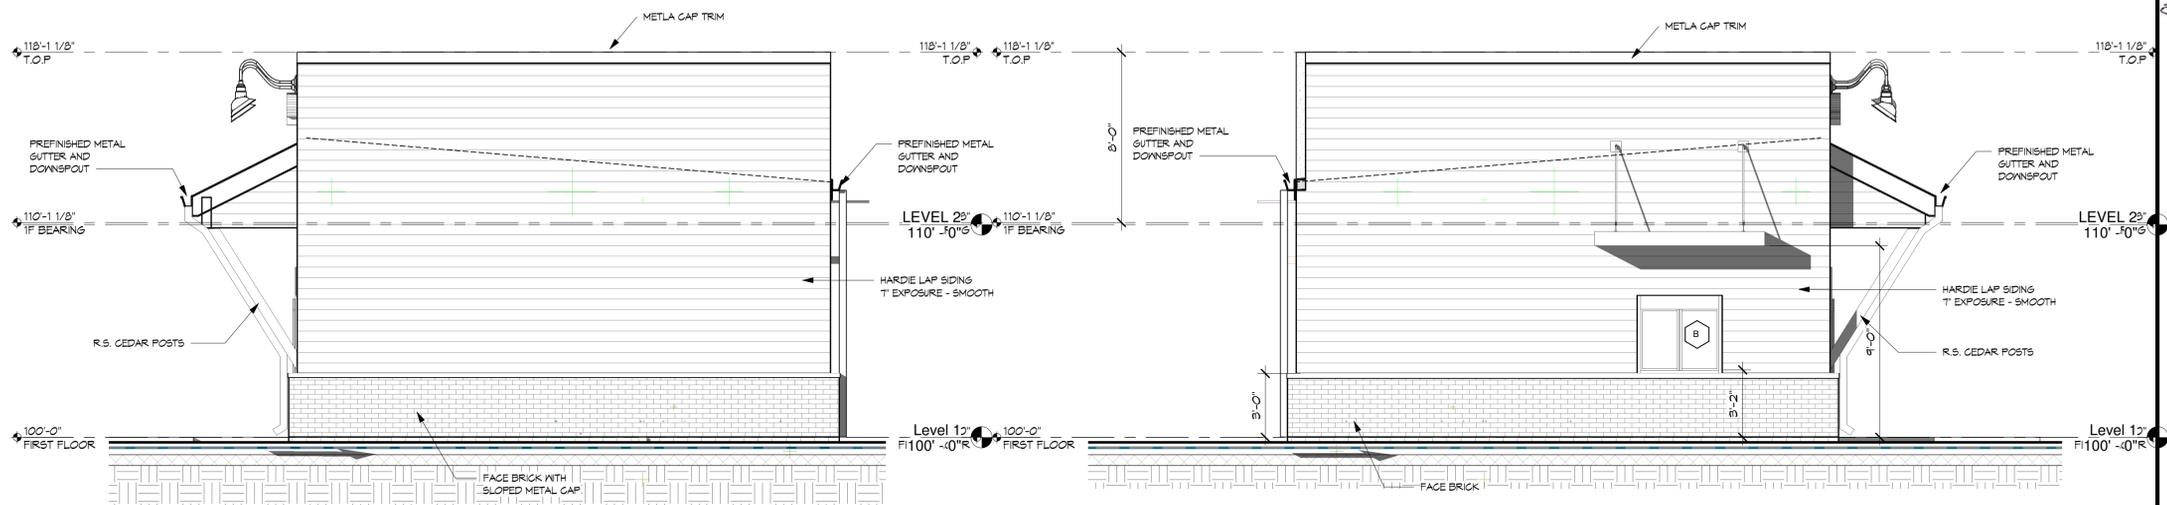


4 WEST ELEVATION
 1/4" = 1'-0"

3 EAST ELEVATION
 1/4" = 1'-0"



1 NORTH ELEVATION
 1/4" = 1'-0"

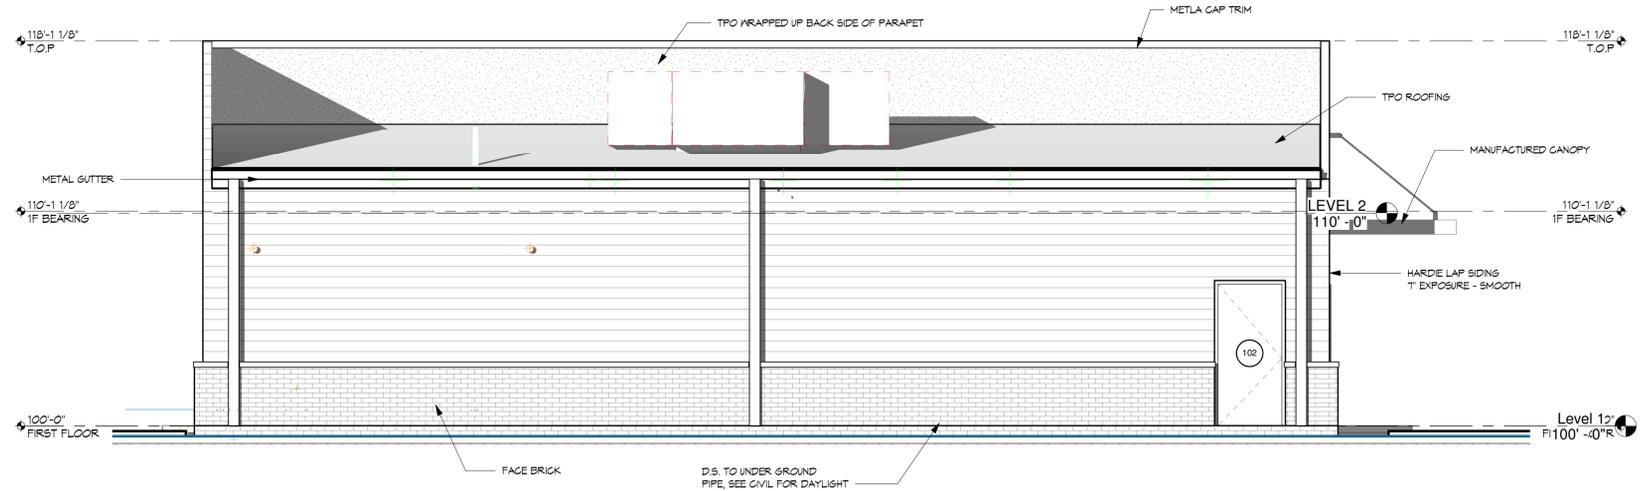

2 SOUTH ELEVATION
 1/4" = 1'-0"


Burris Architecture
 820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
 479-319-6045

SMOKE SHOP
 730 E MAIN ST
 FARMINGTON, AR


DATE
 9-11-25
 JOB NO.
 25089
 REVISIONS

A2.0
 EXTERIOR ELEVATIONS


THIS DRAWING IS PROVIDED AS AN INSTRUMENT OF SERVICE TO THE ARCHITECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF BURRIS ARCHITECTURE. ALL DIMENSIONS, SPECIFICATIONS, MATERIALS, AND FINISHES ARE TO BE AS SHOWN ON THIS DRAWING. THE ARCHITECT ASSUMES NO LIABILITY FOR THE PERFORMANCE OF THE WORK OR THE RESULTS THEREOF. THE ARCHITECT'S RESPONSIBILITY IS LIMITED TO THE DESIGN AND CONSTRUCTION OF THE ARCHITECTURE. THE ARCHITECT DOES NOT PROVIDE ENGINEERING, SURVEYING, OR OTHER PROFESSIONAL SERVICES UNLESS SPECIFICALLY NOTED OTHERWISE ON THIS DRAWING.

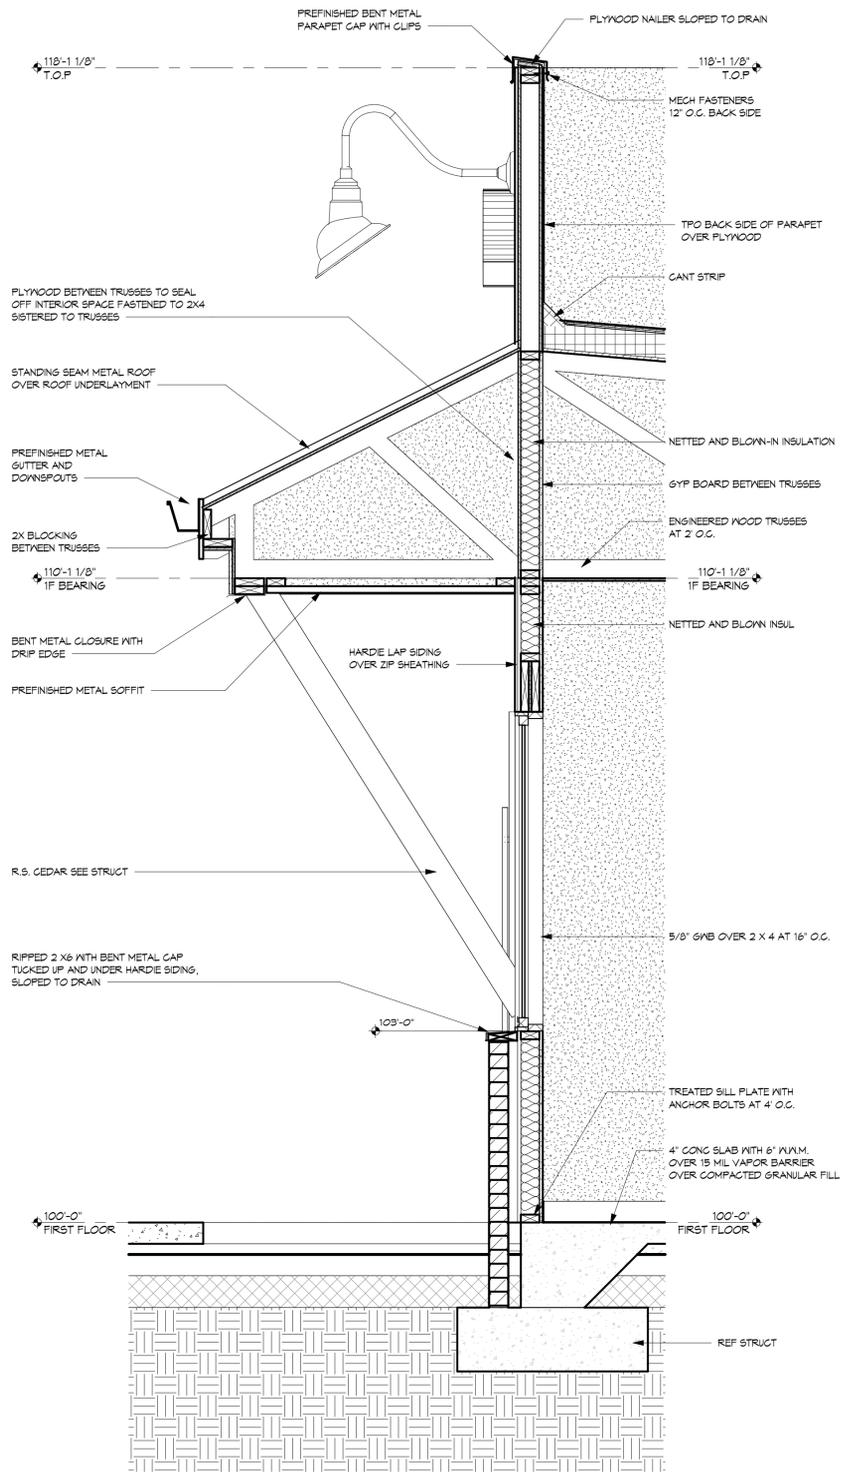


3 Section 1 - Callout 1
 3/4" = 1'-0"

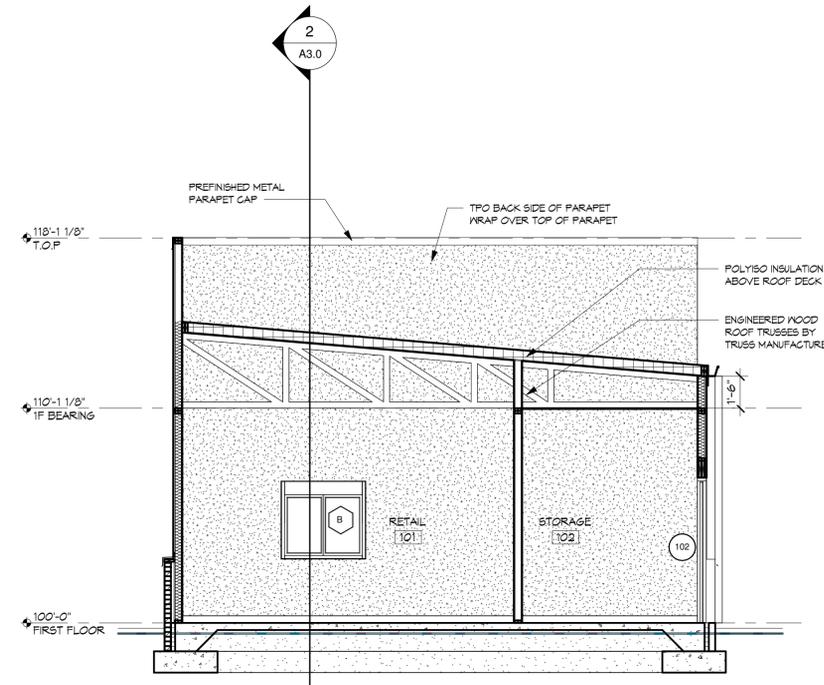

4 Section 4
 1/4" = 1'-0"

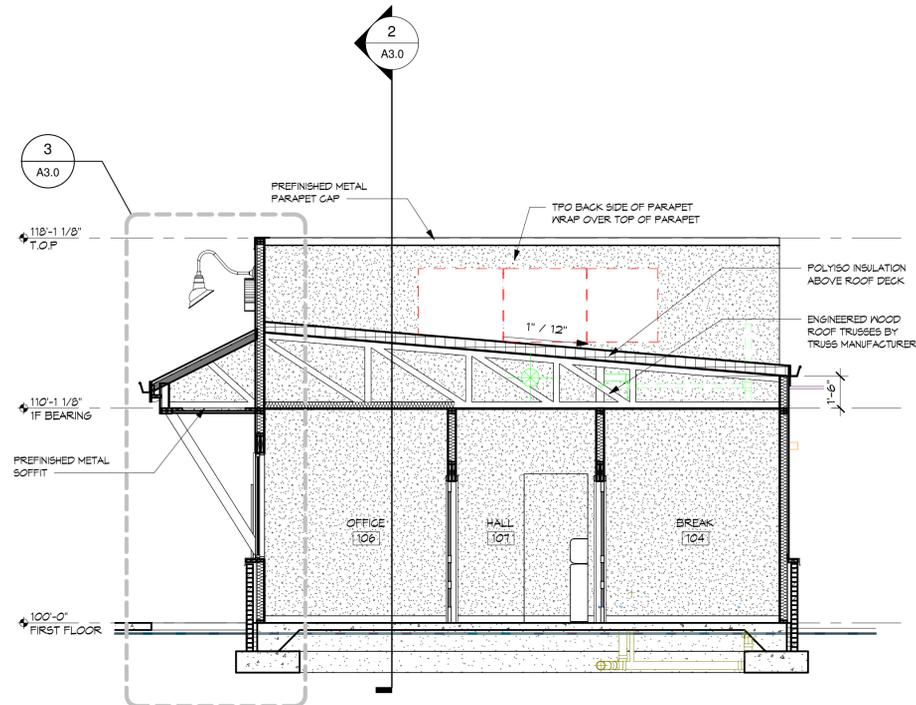


1 Section 1
 1/4" = 1'-0"

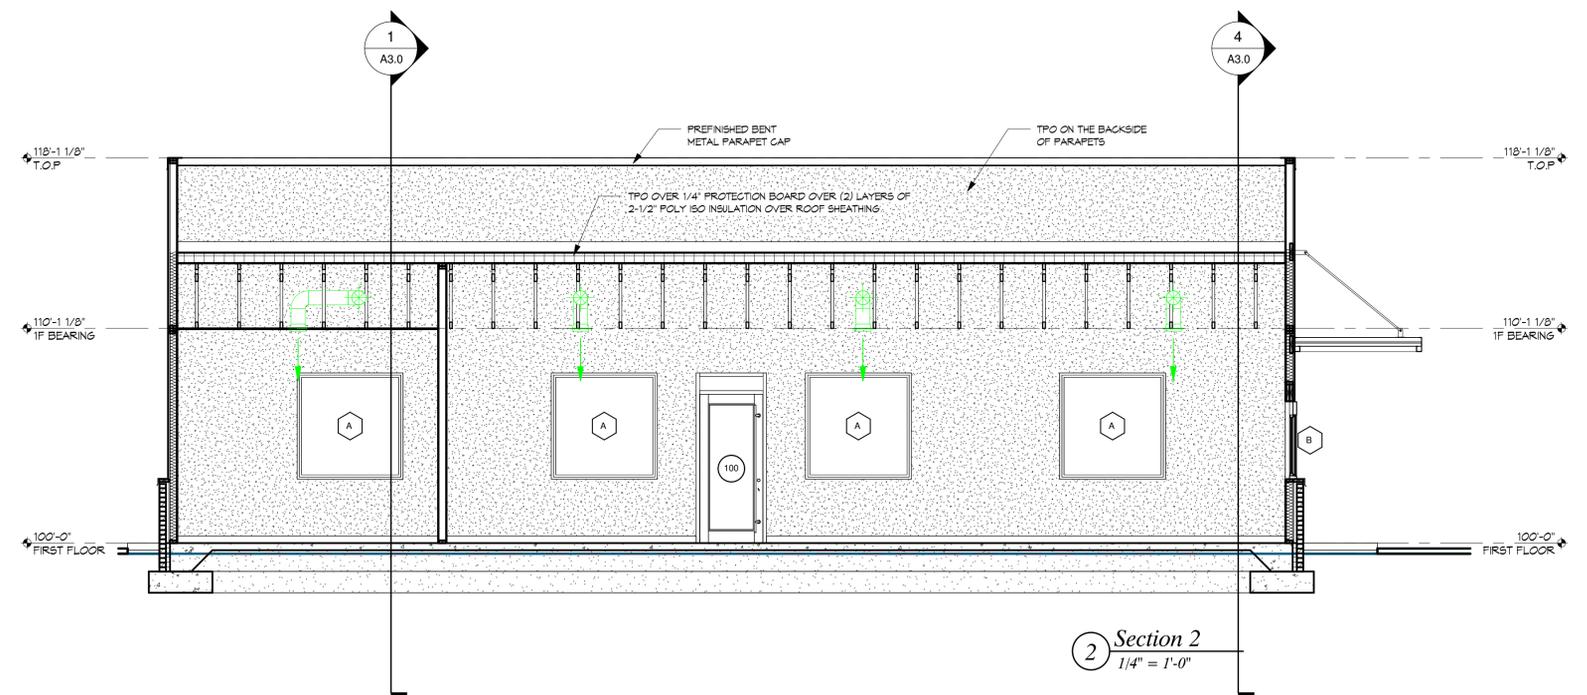


2 Section 2
 1/4" = 1'-0"


THIS DRAWING IS PROVIDED AS AN INDICATION OF THE ARCHITECT'S AND ENGINEER'S DESIGN AND SHALL BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. ALL DRAWINGS, SPECIFICATIONS, NOTES, AND CONDITIONS SHALL BE GOVERNED BY THE PROJECT MANUAL, INCLUDING ANY ADDENDUMS, AND SHALL BE SUBJECT TO THE PROVISIONS, CONDITIONS, AND LIMITATIONS OF THE PROJECT MANUAL. THE ARCHITECT'S AND ENGINEER'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED HEREIN. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED BY OTHERS. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE CONSTRUCTION OF THE PROJECT OR FOR THE PERFORMANCE OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE SAFETY OF THE PROJECT OR FOR THE WELL-BEING OF THE PROJECT PARTICIPANTS. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE LEGAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE FINANCIAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE POLITICAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE SOCIAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE ENVIRONMENTAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE HISTORICAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE CULTURAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE ECONOMIC ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE TECHNOLOGICAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE SCIENTIFIC ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE ARTISTIC ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE RECREATIONAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE EDUCATIONAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE RELIGIOUS ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE PHILOSOPHICAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE PSYCHOLOGICAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE PSYCHIATRIC ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE PSYCHOLOGICAL ASPECTS OF THE PROJECT. THE ARCHITECT AND ENGINEER SHALL NOT BE RESPONSIBLE FOR THE PSYCHIATRIC ASPECTS OF THE PROJECT.

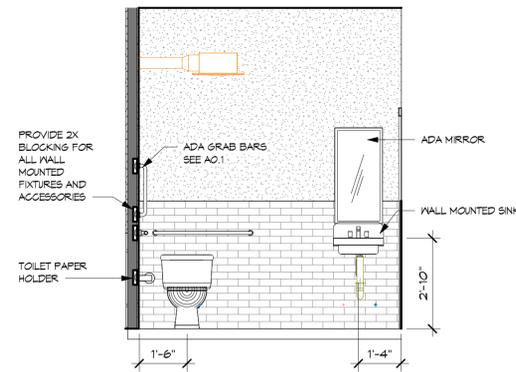

4 RR
3/8" = 1'-0"

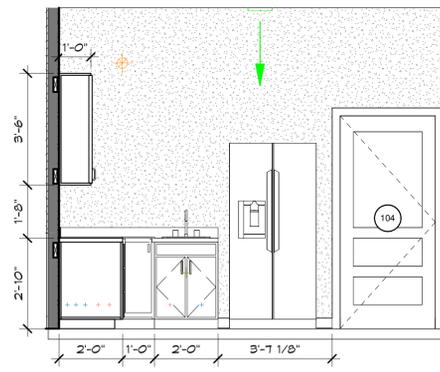

3 BREAK 2
3/8" = 1'-0"

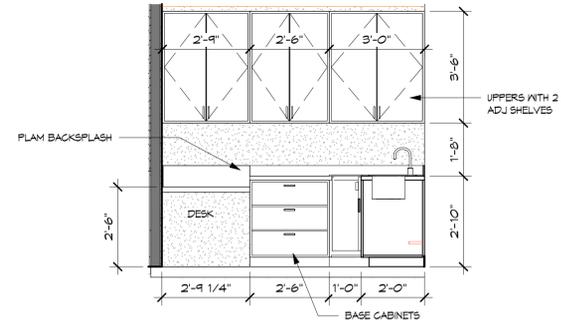

2 BREAK 1
3/8" = 1'-0"



1 FIRST FLOOR PLAN
1/4" = 1'-0"

FINISH NOTES:

HEXAGON: INDICATES FLOOR FINISH MATERIAL
 TRIANGLE: INDICATES WALL BASE MATERIAL
 CIRCLE: INDICATES WALL/ CEILING FINISH MATERIAL
 ELLIPSE: INDICATES WOOD VENEER, SOLID SURFACE, OR PLASTIC LAMINATE FINISH

WALL FINISH NOTES:

- ALL PAINTED SURFACES SHALL HAVE A SMOOTH FINISH (955 PRIMER), WITH EGGSHELL PAINT UNLESS OTHERWISE NOTED. METAL (NON-ALUMINUM) SURFACES SHALL RECEIVE ALKYD ENAMEL SEMI-GLOSS FINISH.
- CONTRACTOR SHALL SUPPLY ALL NECESSARY FINISHES AS REQUIRED BY THE PROJECT. CONTRACTOR IS RESPONSIBLE FOR QUANTITY, TAKEOFF, AND LABOR TO APPLY FINISHES. CONTRACTOR IS ALSO RESPONSIBLE FOR THE SUPPLY AND APPLICATION OF ALL PAINT AND STAIN REQUIRED BY THE PROJECT.
- PANT HM DOOR FRAMES TO MATCH COLOR OF ADJACENT WALL. (BOTH SIDES OF FRAME COULD BE DIFFERENT COLORS)
- ALL AREAS TO RECEIVE (P1) UNLESS OTHERWISE NOTED.
- PAINT TO BE LOW VOC - NON TOXIC PAINT, COLOR MATCH AS REQUIRED.
- SEE INTERIOR ELEVATIONS FOR MORE FINISH DETAILS.

PAINT:

(P1) OC-17 WHITE DOVE

WALL TREATMENT:

(MT1) WALL TILE TO 4' AFF

MILLWORK FINISHES:

(MN1) PAINT GRADE CABINETS

COUNTERTOP:

(CT1) MSI 2 CM QUARTZ TOP

FLOOR FINISH NOTES:

- ALL PRODUCTS SHALL BE AS SPECIFIED, NO SUBSTITUTIONS WILL BE ALLOWED WITHOUT PRIOR APPROVAL BY OWNER AND ARCHITECT.
- PROVIDE SMOOTH TRANSITION WHERE CHANGE IN FLOOR MATERIALS OCCURS
- ALL AREAS TO RECEIVE (B1) UNLESS OTHERWISE NOTED ON THE SCHEDULE

FLOOR FINISHES:

(PC) POLISHED CONCRETE - SALT AND PEPPER

BASE

(B1) 1 X 6 PAINTED FINGER JOINT BASE



Burris Architecture
 820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
 479-319-6045

SMOKE SHOP
 730 E MAIN ST
 FARMINGTON, AR

DATE: 9-11-25
 JOB NO.: 25089
 REVISIONS:


A6.0
 FINISH SCHEDULES &
 INTERIOR ELEVATION

THIS DRAWING IS PROVIDED AS AN INSTRUMENT OF SERVICE BY THE ARCHITECT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. THE ARCHITECT ASSUMES NO LIABILITY FOR THE PERFORMANCE OF THE WORK OR THE RESULTS THEREOF. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT.

PLUMBING SEISMIC NOTES	
1	GAS, HIGH HAZARD AND FIRE PROTECTION PIPING SHALL BE SEISMIC SUPPORTED PER THE SPECIFICATIONS. OTHER PIPING IN BOILER AND MECHANICAL EQUIPMENT ROOMS THAT IS GREATER THAN 1" AND PIPING 2-1/2" AND LARGER THAT IS SUSPENDED MORE THAN 12" FROM POINT OF CONNECTION TO STRUCTURE SHALL BE BRACED IN TWO DIRECTIONS (90° OPPOSING) USING ROD OF SAME LOAD CHARACTERISTICS AS PRIMARY SUSPENSION ROD.
2	PIPING IN EQUIPMENT ROOMS THAT IS LESS THAN 2-1/2" DIAMETER SHALL BE TRANSVERSELY BRACED AT MAXIMUM 30'-0" ON CENTER. PIPING 16" OR LESS IN DIAMETER SHALL BE TRANSVERSELY BRACED AT MAXIMUM 40'-0" ON CENTER AND LONGITUDINALLY AT 80'-0" ON CENTER. PIPING LARGER THAN 16" DIAMETER SHALL BE TRANSVERSELY BRACED AT MAXIMUM 30'-0" ON CENTER AND LONGITUDINALLY AT 60'-0" ON CENTER. A TRANSVERSE BRACE SHALL ALSO BE PROVIDED WITHIN 10'-0" OR 15 PIPE DIAMETERS OF EACH CHANGE OF DIRECTION.
FINAL DOCUMENTATION	
PROVIDE A ONE YEAR WARRANTY FOR ALL SYSTEMS, MATERIAL AND LABOR INCLUDING TRANSPORTATION AND TRAVEL TIME.	
PROVIDE INSTRUCTION TO OWNER'S PERSONNEL FOR ALL SYSTEMS AND EQUIPMENT ON SITE. THIS INSTRUCTION SHALL BE FOR A MINIMUM OF TWO HOURS.	
CONTRACTOR SHALL PROVIDE A BOOK AT FINAL INVOICE WITH ALL WARRANTIES, INSTRUCTION	
ADA NOTES	
LIGHT SWITCHES, ELECTRICAL OUTLETS, AND OTHER ENVIRONMENTAL CONTROLS SHALL HAVE OPERABLE PARTS TO THE CONTROLS NO HIGHER THAN 48" AND NO LOWER THAN 15", A.F.F.	

PLUMBING GENERAL NOTES	
1	NOTES APPLY TO ALL PLUMBING SHEETS UON.
2	COORDINATE PIPE ROUTING AWAY FROM ELECTRICAL PANELS. DO NOT INSTALL PIPING OVER ELECTRICAL PANELS.
3	EXACT LOCATION OF ALL EQUIPMENT AND PIPING SHALL BE COORDINATED WITH OTHER TRADES. CEILING MOUNTED SPRINKLER, LIGHTING AND ELECTRICAL REQUIREMENTS TAKE PRECEDENCE OVER CEILING MOUNTED MECHANICAL REQUIREMENTS.
4	ALL WORK SHALL CONFORM TO THAT 2012 INTERNATIONAL PLUMBING CODE W/LATEST STATE AMENDMENTS AND ALL APPLICABLE LOCAL CODES.
5	CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL WORK WITH THAT OF OTHER TRADES, HVAC, STRUCTURAL, ETC. SEE ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR BUILDING DETAILS AND DIMENSIONS. THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, LICENSES, DOCUMENTS AND SERVICES RELATED TO THE INSTALLATION OF THE WORK.
6	PROVIDE ALL MATERIALS FOR A COMPLETE INSTALLATION, IN ALL RESPECTS READY FOR INTENDED USE, AND IN STRICT ACCORDANCE WITH STATE AND LOCAL CODES. GET THE NAMES OF AUTHORITIES HAVING JURISDICTION (AHJ), AND MANUFACTURER'S RECOMMENDATIONS. OBTAIN AND PAY FOR ALL PERMITS REQUIRED BY THIS WORK.
7	REFER TO SPECIFICATIONS AND PLANS FOR ACCEPTABLE MANUFACTURERS AND MODELS OF PLUMBING FIXTURES AND EQUIPMENT, AND PROPER APPLICATIONS OF SAME.
9	CUTTING OF ROOF AND FLASHING OF PIPE CURBS, SANITARY VENT THROUGH ROOF, ETC., SHALL BE COORDINATED WITH AND PERFORMED BY THE ROOFING CONTRACTOR, AT THIS CONTRACTOR'S EXPENSE, TO MAINTAIN THE ROOF WARRANTY.
10	CONTRACTOR SHALL VISIT SITE PRIOR TO SUBMITTING BID AND FIELD VERIFY EXISTING CONDITIONS TO ENSURE THAT THE WORK REPRESENTED ON THESE DRAWINGS AND IN THESE SPECIFICATIONS CAN BE INSTALLED AS INDICATED. CONTRACTOR SHALL TAKE ALL INTERFERENCE INTO CONSIDERATION, PROVIDE ALL NECESSARY OFFSETS TO SUIT FIELD CONDITIONS AS REQUIRED.
11	CONTRACTOR SHALL COORDINATE ALL SANITARY SEWER, STORM DRAIN, FIRE AND DOMESTIC WATER LINES AND NATURAL GAS LINES WITH CIVIL DRAWINGS. SEE CIVIL DRAWINGS FOR CONTINUATION OF ALL UTILITY LINES.
12	DO NOT SCALE FLOOR PLANS FOR EXACT HORIZONTAL LOCATION OF PIPE ROUTING.
13	INFORMATION AND COMPONENTS SHOWN ON RISER DIAGRAMS OR DETAILS, BUT NOT SHOWN ON PLANS, AND VICE-VERSA, SHALL BE PROVIDED AS IF EXPRESSLY REQUIRED BY BOTH.
14	ALL DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL ARRANGEMENTS OR GEOMETRIC RELATIONSHIPS OF EQUIPMENT AND SERVICES. THEY ARE NOT INTENDED TO SPECIFY OR SHOW EVERY OFFSET, FITTING, OR COMPONENT. CONTRACTOR SHALL NOT SCALE DRAWINGS. EQUIPMENT SCHEDULES SHALL TAKE PRECEDENCE OVER CONFLICTING DRAWING INFORMATION. DRAWINGS SPECIFIC TO THIS DISCIPLINE DO NOT LIMIT THE RESPONSIBILITY OF WORK REQUIRED BY CONTRACT DOCUMENTS. REFER TO ARCHITECTURAL, STRUCTURAL, ELECTRICAL, AND OTHER DRAWINGS FOR COMPLETE INFORMATION.
15	PROVIDE FIRE SEAL WHERE PIPES PENETRATE FIRE RATED ASSEMBLY.
16	DRAWINGS ARE DIAGRAMMATIC ONLY AND REPRESENT THE GENERAL SCOPE OF THE WORK. REVIEW THE GENERAL NOTES AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY THE ARCHITECT OR OWNER'S CONSTRUCTION MANAGER OF ANY CONFLICTS OR DISCREPANCIES.
17	PLANS AND SPECIFICATIONS GOVERN WHERE THEY EXCEED CODE REQUIREMENTS.
18	PROVIDE TO THE ARCHITECT OR OWNER'S CONSTRUCTION MANAGER A COPY OF INSPECTION REPORTS AND APPROVAL CERTIFICATES FROM LOCAL AND STATE INSPECTIONS.
19	ALL WORK IS TO CONFORM TO THE LATEST EDITIONS OF THE AR. STATE PLUMBING CODE, AR. STATE GAS CODE, NFPA AND ALL LOCAL ORDINANCES.
21	MAKE ALL UTILITY CONNECTIONS AND INSTALLATIONS IN FULL ACCORDANCE WITH ALL UTILITY REGULATIONS. PROVIDE ALL ADDITIONAL APPURTENANCES AS REQUIRED BY THE UTILITY COMPANY. THE COMPLETED INSTALLATION SHALL BE IN ACCORDANCE WITH ALL APPLICABLE INDUSTRY STANDARDS OF GOOD PRACTICE AND SAFETY, AND THE MANUFACTURER'S STRICTEST RECOMMENDATIONS FOR EQUIPMENT AND PRODUCT APPLICATION AND INSTALLATION.
22	ALL SEWER PIPING BELOW SLAB TO BE 2" DIAMETER MINIMUM.
23	NO STRUCTURAL MEMBERS MAY BE CUT OR MODIFIED WITHOUT THE WRITTEN PERMISSION OF THE STRUCTURAL ENGINEER.
25	PROVIDE CLEANOUTS IN ALL SANITARY, STORM DRAINAGE & OVERFLOW LINES, WHETHER SHOWN OR NOT, AT INTERVALS NOT TO EXCEED 50 FEET, AT EACH DIRECTION 45 DEGREES AND GREATER, AND ON ALL VERTICAL RISERS AT A HEIGHT OF 30' A.F.F. AT THE BASE OF EACH STACK.
26	INSULATE ALL CONDENSATE LINES INSIDE BUILDING AS PER INSTALLATION REQUIREMENTS FOR COLD WATER LINE, IN SPECIFICATIONS.
27	SLOPE ALL SANITARY AND STORM LINES ARE 1/4" PER FOOT FOR PIPES LESS THAN 3" IN DIAMETER, AND NOT LESS THAN 1/8" PER FOOT FOR PIPES 3" AND LARGER. VERIFY INVERTS WITH SITE DRAWINGS AND COORDINATE INSTALLATION TO ASSURE PROPER FLOW.
28	SLEEVE AND SEAL ALL PIPE PENETRATIONS THRU RATED WALLS AND FLOORS. PIPE SLEEVES THROUGH FLOORS SHALL TERMINATE A MINIMUM OF 2" ABOVE FINISHED FLOOR. PLASTIC PIPING SHALL NOT BE USED TO PENETRATE FIRE RATED CONSTRUCTION.
30	ALL VENTS THROUGH ROOF SHALL BE PROVIDED WITH #6 LEAD FLASHING OR ELASTOMERIC FLASHING SYSTEM TO MAINTAIN ROOF WARRANTY.
32	PROVIDE A CONSTRUCTION RECORD SET OF "AS-BUILT" DOCUMENTS TO THE ARCHITECT OR OWNER'S CONSTRUCTION MANAGER REFLECTING ANY VARIANCES OF INSTALLED PIPING LOCATIONS OR EQUIPMENT CONTRARY TO THE CONSTRUCTION DOCUMENTS.
34	INSTALL VTR'S, EXHAUST FANS, AND FLUES A MINIMUM 5' FROM PARAPET OR OUTSIDE WALL AND 10'-0" MINIMUM FROM EQUIPMENT WITH OUTSIDE AIR INTAKE. VALVES SHALL BE LINE SIZE UNLESS OTHERWISE NOTED.
35	CLEAN FAUCET AERATORS AND PIPE STRAINERS PRIOR TO TURNING BUILDING OVER TO THE OWNER.
37	PIPING IS SHOWN IN ITS GENERAL LOCATION (UNLESS DIMENSIONED). EXACT LOCATION SHALL BE DETERMINED BY JOB CONDITIONS. CONTRACTOR SHALL COORDINATE THE INSTALLATION OF THEIR WORK WITH THAT OF OTHER TRADES & ARRANGE PIPING TO CLEAR STRUCTURAL MEMBERS & DUCTWORK. IF THE PLUMBING CONTRACTOR INSTALLS HIS WORK PRIOR TO COORDINATING WITH ALL OTHER TRADES OR AS TO CAUSE ANY INTERFERENCE WITH WORK OF OTHER TRADES, THEY SHALL MAKE THE NECESSARY CHANGES TO THE WORK OR CORRECT THE CONDITION WITHOUT EXTRA CHARGE. CONTRACTOR SHALL VERIFY LOCATIONS OF SEWER, WATER, GAS & ANY OTHER UTILITY CONNECTIONS FROM APPROVED SITE PLANS PRIOR TO BID. REROUTING UTILITIES FROM THAT SHOWN ON PLANS AT CONTRACTOR'S RISK. THE PLUMBING CONTRACTOR TO FURNISH ALL REQUIRED MATERIAL TO PROVIDE FOR THE PROPER INSTALLATION OF ALL PLUMBING EQUIPMENT. ANY OF THE CONFLICTS OR DISCREPANCIES REGARDING WHAT IS REQUIRED AS TO WHAT IS INDICATED ON PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO BID & PRIOR TO CONSTRUCTION SO THIS CAN BE CLARIFIED. IF DISCREPANCIES ARE NOT BROUGHT TO THE ARCHITECT'S ATTENTION PRIOR TO FINAL BIDS, THEN THE PLUMBING CONTRACTOR ACCEPTS THE DRAWINGS AS SUFFICIENT & CHANGES DURING CONSTRUCTION WILL NOT BE CONSIDERED. IF INSTALLED DRAWINGS TO BE REVISED OR FORMAL ENGINEER'S APPROVAL OF THE PLUMBING CONTRACTOR SHALL PAY ALL COSTS INVOLVED IN DRAWING REVISIONS AND/OR ENGINEER'S DOCUMENTED CORRESPONDENCE GENERATION.
38	PROVIDE PRESSURE REDUCERS IN WATER SUPPLY LINES TO KEEP PRESSURE BELOW 70 PSI AT ALL OUTLETS. MINIMUM PRESSURE ACCEPTABLE AT WATER OUTLETS IS 15 PSI AT DIRECT SUPPLY FLUSH VALVES, AND 8 PSI AT ALL OTHER OUTLETS.
39	PROVIDE WATER HAMMER ARRESTORS IN BRANCH WATER LINES AS REQUIRED BY MANUFACTURE. GOOD PRACTICE OR MINIMUM OF ONE ARRESTOR FOR EACH FIXTURE OR BANK OF FIXTURES. AIR CHAMBERS SHALL NOT BE USED.
40	PROVIDE STOP VALVES AT EVERY FIXTURE ON BOTH HOT AND COLD WATER SUPPLY LINES. VALVES, ESCUTCHEONS, FITTINGS, ETC. SHALL BE CHROMIUM PLATED WHERE PIPING IS EXPOSED.
41	EACH FIXTURE OR GROUP OF FIXTURES SHALL BE PROVIDED WITH A SHUT OFF VALVE IN THE CEILING SPACE. PROVIDE AN ACCESS PANEL IN SOLID CEILINGS.

ABBREVIATIONS			
Ø	ROUND	ID	INDIRECT
A	AIR	IET	INLINE EXPANSION TANK
AB	ABOVE BASE	INL	INSULATION
ABV	ABOVE	INT	INTERIOR
AC	AIR CONDITIONING	INV	INVERT
ACOUS	ACOUSTICAL	INWG	INCHES WATER GAUGE
AD	AREA DRAIN	JST SPC	JOIST SPACE
ADD	ADDITIONAL	JT	JOINT
ADDL	ADDITIONAL	LAB	LABORATORY
AFF	ABOVE FINISHED FLOOR	LAB	LABORATORY
AG	ABOVE GROUND	LB	POUND
AG	ABOVE GROUND	LB/HR	POUNDS PER HOUR
ALT	ALTERNATE	LAT	LEAVING AIR TEMPERATURE
AP	ACCESS PANEL	LF	LINEAL FOOT
APPROX	APPROXIMATE	LOC	LOCATION
ARCH	ARCHITECT/ARCHITECTURAL	LP	LOW PRESSURE
AV	ACID RESISTANT VENT	LPG	LIQUEFIED PETROLEUM GAS
AW	ACID RESISTANT WASTE	LRF	LIQUID REFRIGERANT
AUTO	AUTOMATIC	LS	LAWN SPRINKLER
BFF	BELOW FINISHED FLOOR	LVR	LOUVER
BLDG	BUILDING	LWT	LEAVING WATER TEMPERATURE
BLW	BELOW	M/A	MIXED AIR
BM	BEAM	MAN	MANUAL
BO	BY OTHER	MATL	MATERIAL
BOT	BOTTOM	MAV	MANUAL AIR VENT
BSMT	BASEMENT	MAX	MAXIMUM
BTU	BRITISH THERMAL UNITS	MBD	MOTORIZED BYPASS DAMPER
BTUH	BRITISH THERMAL UNITS PER HOUR	MBH	ONE THOUSAND BTU PER HOUR
BTWN	BETWEEN	MCB	ONE THOUSAND CUBIC FEET
CAP	CAPACITY	MCW	MAKE-UP COLD WATER
CB	CATCH BASIN	MCD	MOTORIZED DAMPER
CCW	COUNTER CLOCKWISE	MECH	MECHANICAL
CFCV	CONSTANT FLOW CONTROL VALVE	MFR	MANUFACTURER
CFM	CUBIC FEET PER MINUTE	MH	MISCELLANEOUS
CHW	CIRCULATING HOT WATER	MIN	MINIMUM
CI	CAST IRON	MISC	MISCELLANEOUS
CLG	CEILING	MTR	MOTOR
CLG	COOLING	MU/A	MAKE-UP AIR
CO	CLEAN OUT	NM	NOISE CRITERIA
COL	COLUMN	NC	NORMALLY CLOSED
COMB	COMBINATION	NIC	NOT IN CONTRACT
CONC	CONCRETE	NO	NUMBER
COND	CONDENSATE	NO	NORMALLY OPEN
CONF	CONFERENCE	NOM	NOMINAL
CONN	CONNECT	NTS	NOT TO SCALE
CONST	CONSTRUCTION	O	OXYGEN
CONT	CONTINUE/CONTINUATION	O/A	OUTSIDE AIR
CONTR	CONTRACT/CONTRACTOR	OC	ON CENTER
COP	CLEANOUT PLUG	OC	OVERFLOW
COORD	COORDINATE	OPNG	OPENING
COTG	CLEANOUT TO GRADE	ORD	OVERFLOW ROOF DRAIN
CTR	CENTER	PD	PRESSURE DROP
CUFT	CUBIC FEET	PV	POST INDICATOR VALVE
CV	CHECK VALVE	PLBG	PLUMBING
CW	COLD WATER	PR	PAIR
CW	CLOCKWISE	PREL	PRELIMINARY
D	DEGREE	PRESS	PRESSURE
DB	DRY BULB	PRM	PRIMARY
DCOTG	DOUBLE CLEANOUT TO GRADE	PRV	PRESSURE REDUCING VALVE
DET	DETAIL	PSI	POUNDS PER SQUARE INCH
DIA	DIAMETER	PSIG	POUNDS PER SQUARE INCH GAUGE
DIAG	DIAGONAL	PW	POTABLE WATER
DISCH	DISCHARGE	PWR	POWER
DJ	DIVISION	RA	RADIANT RISER
DN	DOWN	RCP	RADIANT CEILING PANEL
DMPR	DAMPEN	RD	ROOF DRAIN
DN	DOWN	REC	RECESSED
DWG	DRAWING	RED	REDUCER
DW	DISTILLED WATER	REFR	REFRIGERATION
EA	EACH	RH	RELATIVE HUMIDITY
EAT	ENTERING AIR TEMPERATURE	REOD	REQUIRED
EL	ELBOW	REV	REVERSE
ELEC	ELECTRICAL	RLA	RELIEF AIR
ELEV	ELEVATION	RM	ROOM
EP	EXPLOSION PROOF	RPM	REVOLUTIONS PER MINUTE
EQ	EQUAL	RW	RAIN WATER
EQUIP	EQUIPMENT	SF	SQUARE FOOT
EWC	ELECTRIC WATER COOLER	SHA	SUPPLY AIR
EWT	ENTERING WATER TEMPERATURE	SH	SANITARY
EA	EXHAUST AIR	SCHED	SCHEDULE
EAH	EXHAUST HOOD	SECT	SECTION
EXIST	EXISTING	SF	SQUARE FOOT
EXP	EXPANSION	SD	SMOKE DAMPER
EXPJT	EXPANSION JOINT	SHT	SHEET
EXT	EXTERIOR	SHT	SHEET
F	DEGREES FAHRENHEIT	SIM	SIMILAR
FCO	FLOOR CLEAN OUT	SLV	SLEEVE
FD	FLOOR DRAIN	SM	SURFACE MOUNT
FD	FIRE DAMPER	SP	STANDPIPE
FDV	FIRE DEPARTMENT VALVE	SP	STATIC PRESSURE
FES	FREESTANDING EXPANSION TANK	SPEC	SPECIFICATION
FHC	FIRE HOSE CABINET	SPS	STATIC PRESSURE STATION
FL	FLOOR	SQ	SQUARE
FLG	FLANGE	SR	SUCTION REFRIGERANT
FLL	FUEL OIL	SSD	SOIL SUBRAIN
FOW	FUEL OIL VENT	SS	STAINLESS STEEL
FOR	FUEL OIL RETURN	STD	STANDARD
FOS	FUEL OIL SUPPLY	STM	STEAM
FS	FEET PER MINUTE	STRUC	STRUCTURAL
FT	FOOT/FEET	SUSP	SUSPENDED
FTG	FOOTING	T	THERMOSTAT
FTR	FIN TUBE RADIATION	TCF	TEMPERATURE CONTROL PANEL
FUT	FUTURE	TD	TEMPERATURE DROP
GA	GAGE/GAUGE	TEFC	TOTALLY ENCLOSED FAN COOLED
GAL	GALLON	TEMP	TEMPERATURE
GALV	GALVANIZED	TYP	TYPICAL
GC	GENERAL CONTRACTOR	UNON	UNLESS OTHERWISE NOTED
GEN	GENERATOR	UG	UNDERGROUND
GENL	GENERAL	VACUUM	VACUUM
GPH	GALLONS PER MINUTE	V	VENT
GR	GRADE	VAV	VARIABLE AIR VOLUME
GW	GREASE WASTE	VENT	VENTILATION
HB	HOSE BIB	VOL	VOLUME
HD	HEAD	VTR	VENT THROUGH ROOF
HDR	HORIZONTAL	W	WASTE
HP	HORSE POWER	WAGD	WASTE ANESTHETIC GAS DISPOSAL
HP	HIGH PRESSURE	WB	WET BULB
HTG	HEATING	WCO	WALL CLEAN OUT
HTR	HEATER	WTR	WALL HYDRANT
HW	HOT WATER	YCO	YARD CLEANOUT
HYD	HYDRANT	2YCO	2-WAY YARD CLEANOUT

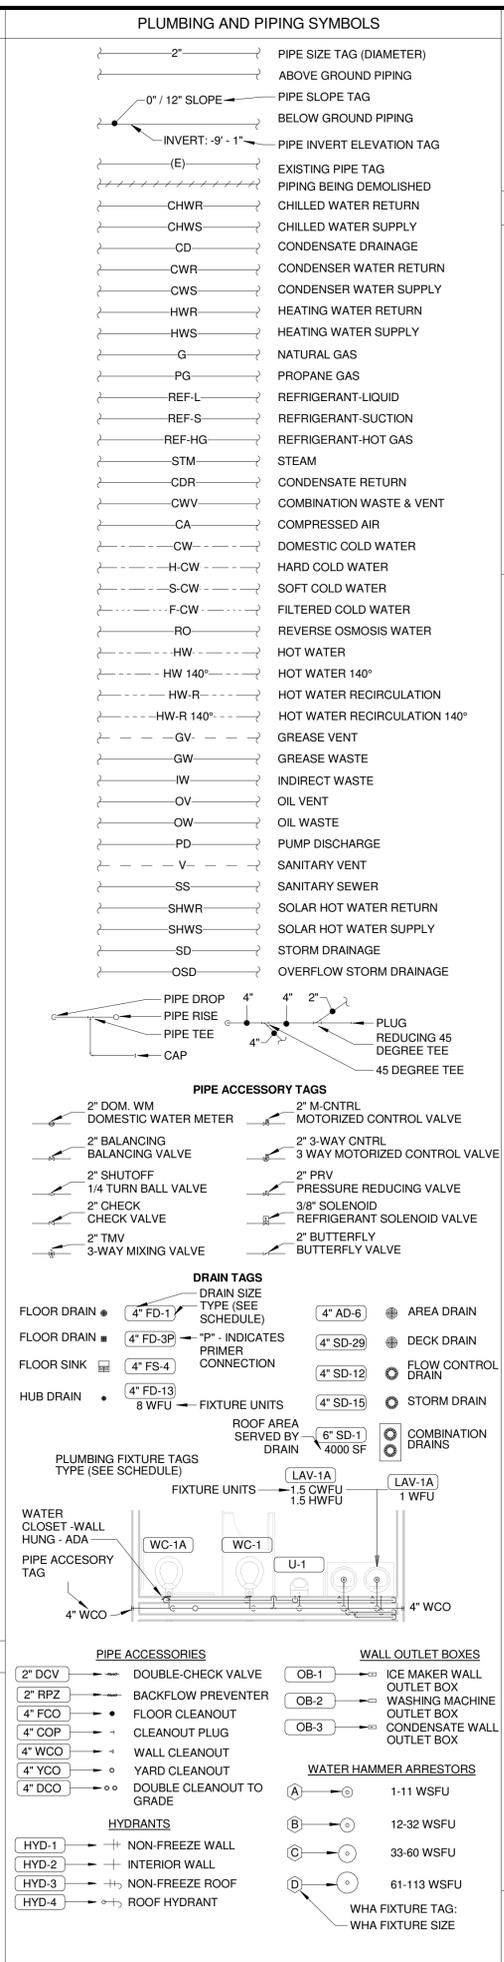

GENERAL PLUMBING SYMBOLS

- REVISION NUMBER SHOWN ON PLANS
- POINT WHERE NEW CONNECTS TO EXISTING
- NUMBER OF DETAIL ON SHEET
- NUMBER OF SHEET WHERE DETAIL APPEARS
- KEYNOTE
- PROPANE GAS
- CONTINUATION SYMBOL
- PIPE
- OFFICE ROOM NAME AND NUMBER
- ITEM TO BE DEMOLISHED
- AREA NOT IN CONTRACT

* NOTE *


ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER DRAWINGS IN THIS SET. THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THIS SET OF DRAWINGS.

Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045


SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE 09/11/25
JOB NO. 25089
REVISIONS


P0.1
PLUMBING LEGEND AND NOTES

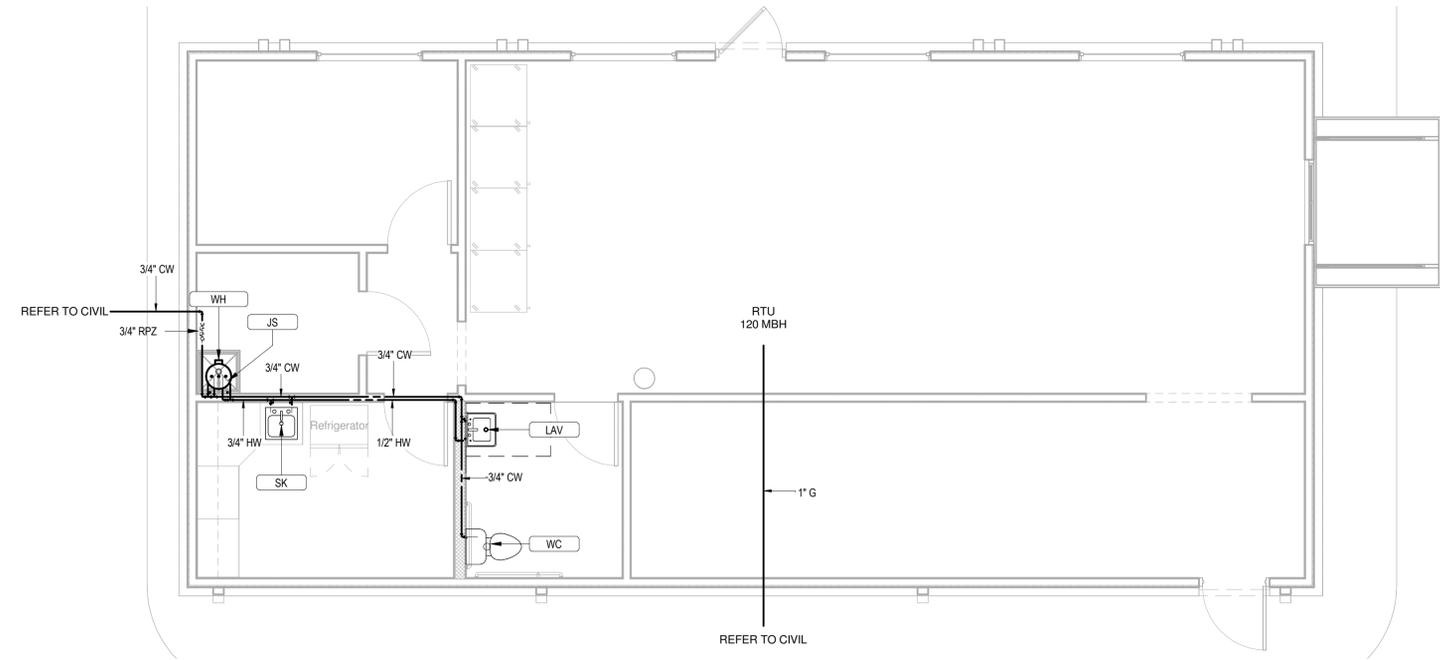

1 SUPPLY PLAN
1/4" = 1'-0"

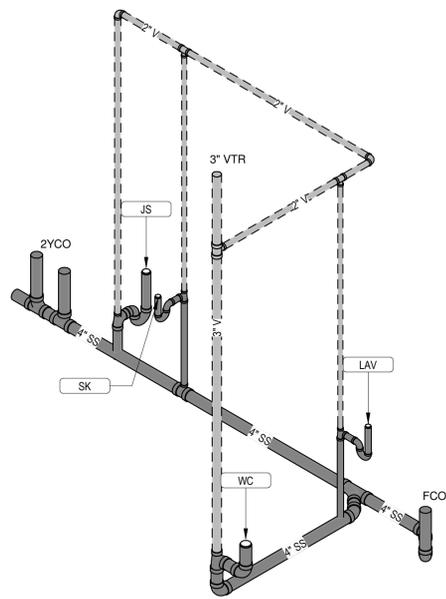

3 RISER DIAGRAM
P1.0

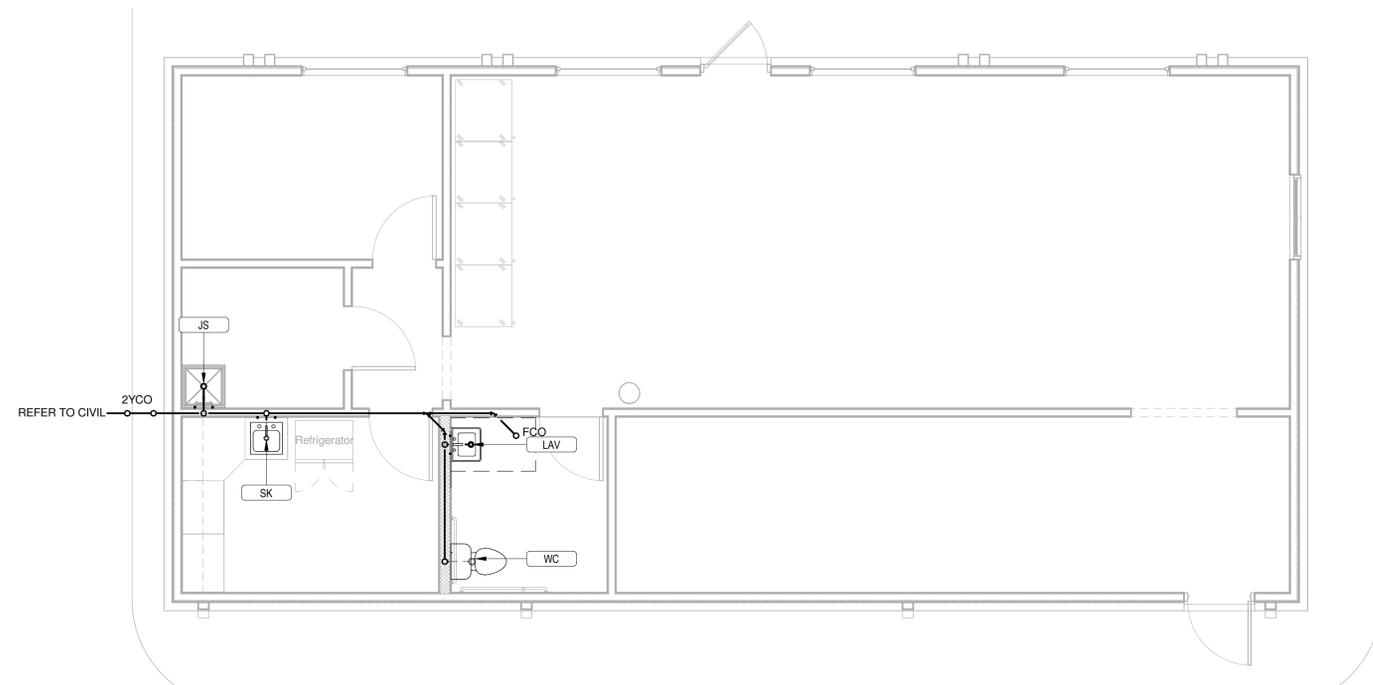

2 WASTE PLAN
1/4" = 1'-0"


Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE 09/11/25
JOB NO. 25089
REVISIONS

P1.0
PLUMBING SUPPLY PLANS

THIS DRAWING IS PROVIDED AS AN INSTRUMENT OF SERVICE TO THE ARCHITECT AND CONTRACTOR FOR THE PROJECT AND SHALL BE THE PROPERTY OF THE ARCHITECT. NO PART OF THIS DRAWING SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. ALL PERMITS AND APPROVALS ARE THE RESPONSIBILITY OF THE ARCHITECT AND CONTRACTOR. THE ARCHITECT'S LIABILITY IS LIMITED TO THE PROFESSIONAL SERVICES PROVIDED BY THE ARCHITECT.

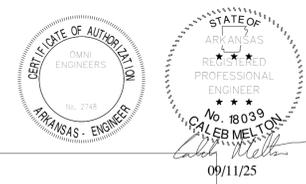


Burris Architecture
 820 Tiger Blvd., Suite 4, Bentonville, Ar 72712
 479-319-6045


SMOKE
 730 E MAIN ST
 FARMINGTON, AR

DATE: 09/11/25
 JOB NO: 25089
 REVISIONS:


P2.0
 PLUMBING SCHEDULE AND DETAILS

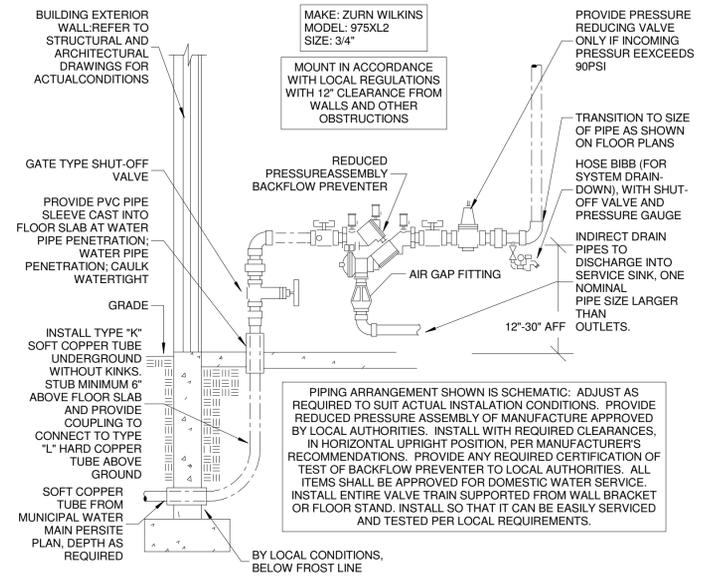


5 DOMESTIC WATER SERVICE ENTRY
 P2.0 N.T.S.

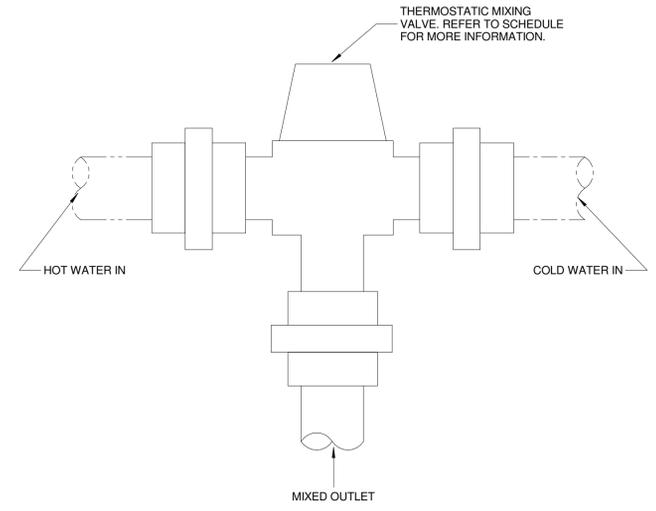


2 THERMOSTATIC MIXING VALVE
 P2.0 N.T.S.

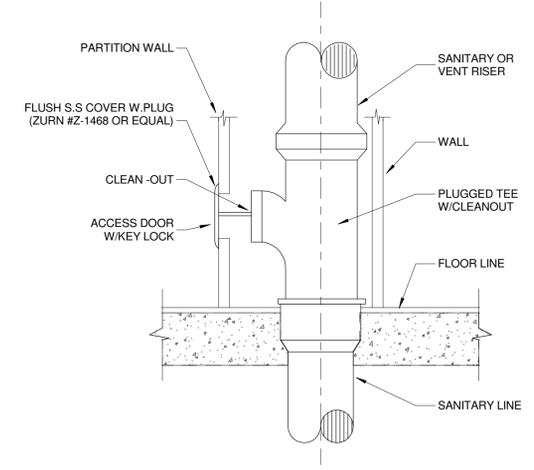

1 WALL AND STACK CLEANOUT
 P2.0 N.T.S.

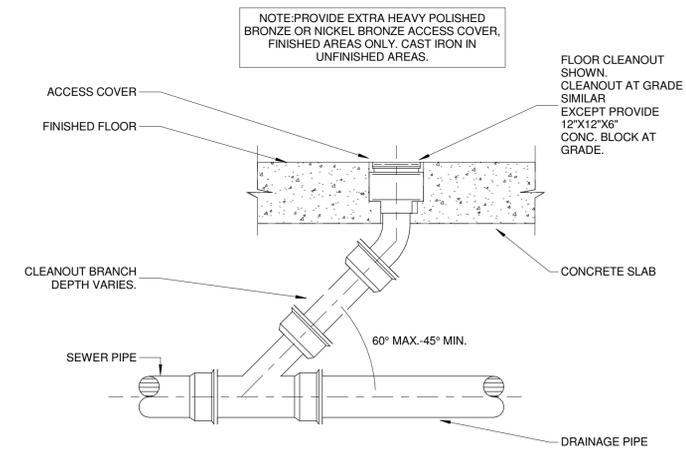

4 FLOOR CLEANOUT TO GRADE
 P2.0 N.T.S.

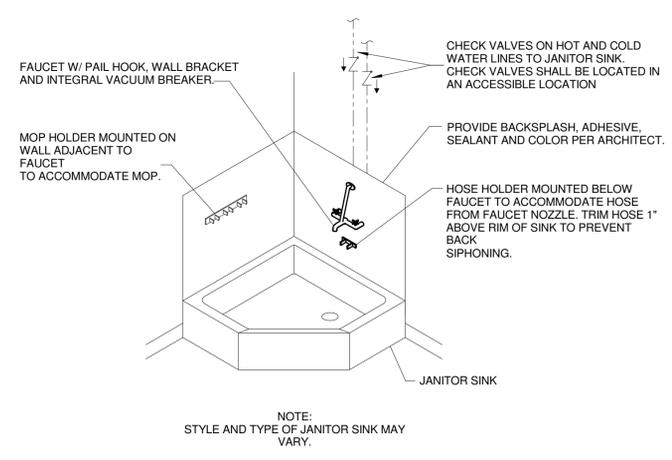

3 CORNER ANGLED JANITOR SINK
 P2.0 N.T.S.

PLUMBING FIXTURE SCHEDULE

ID	DESCRIPTION	MANUFACTURER	MODEL	MATERIAL DESCRIPTION	WASTE PIPE SIZE	VENT PIPE SIZE	COLD WATER PIPE SIZE	HOT WATER PIPE SIZE	SPECIFICATION	NOTES
SK	HAND SINK	ELKAY	ECTRU30179RT	STAINLESS STEEL	2"	1-1/2"	1/2"	1/2"	UNDER MOUNT LAVATORY, SINGLE HOLE FAUCET. DECK-MOUNTED MANUAL KITCHEN FAUCET BLACK, WITH VANDAL RESISTANT SPRAY, EXTERNAL ASSE 1070 COMPLIANT THERMOSTATIC MIXING VALVE, GRID DRAIN, LOOSE KEY ANGLE STOPS AND SUPPLIES INSULATE WATER AND WASTE WITH ADA INSULATION KIT	B, E / 1
JS	JANITOR SINK	FIAT	MSB24	---	3"	2"	3/4"	3/4"	SERVICE BASIN WITH CAP ON TWO SIDES, WITH CHROME PLATED 3" DRAIN AND CAST IRON TRAP. FAUCET SHALL INCLUDE PAIL HOOK AND ATMOSPHERIC VACUUM BREAKER SPOUT. FURNISH 5'-0" LENGTH OF 5-PLY GARDEN HOSE AND FITTINGS. PROVIDE WITH MOP HANGER.	D / 3
LAV	LAVATORY	NAMEEKS	CERRA STYLE	WHITE VITREOUS CHINA	2"	1-1/2"	1/2"	1/2"	WALL MOUNT LAVATORY, SINGLE HOLE FAUCET. DECK-MOUNTED MANUAL FAUCET BLACK, WITH VANDAL RESISTANT SPRAY. EXTERNAL ASSE 1070 COMPLIANT THERMOSTATIC MIXING VALVE. GRID DRAIN. LOOSE KEY ANGLE STOPS AND SUPPLIES INSULATE WATER AND WASTE WITH ADA INSULATION KIT. MOUNT AT ADA COMPLIANT HEIGHT.	B, C, E / 2
WC	WATER CLOSET - FLOOR MOUNT - FLUSH TANK	AMERICAN STANDARD	CADET PRO	WHITE VITREOUS CHINA	4"	2"	3/4"	---	ELONGATED FLOOR MOUNTED TANK TYPE WATER CLOSET, WITH CHURCH 295CT ELONGATED OPEN FRONT SEAT. INSTALL AT STANDARD NON-ADA HEIGHT OR ADA HEIGHT AS REQUIRED.	A, C / 3

NOTES:
 A. CONTRACTOR TO COORDINATE WITH FIXTURE SUPPLIER FOR LEFT/RIGHT HAND FLUSH LEVER TO COMPLY WITH ADA REQUIREMENTS.
 B. PROVIDE TRUE-BRO LAV GUARD 2 E-Z-SERIES PIPING COVERS FOR ALL EXPOSED PIPING.
 C. FIXTURE TO BE WHITE.
 D. LOCATE MOP HANGER BRACKET NEAR SINK. COORDINATE FINAL LOCATION WITH OWNER.
 E. PROVIDE WATTS SERIES USG-B MIXING VALVE OR EQUAL. SET FOR 105° DISCHARGE.

MOUNTING TYPES:
 1 COUNTERTOP
 2 WALL
 3 FLOOR
 4 UNDERMOUNT
 5 ROUGH-IN

SPECIALTY FIXTURE SCHEDULE

ID	FIXTURE	MANUFACTURER	MODEL	DESCRIPTION	NOTES
TMV	TEMPERATURE MIXING VALVE	WATTS	USG-B	+/-3°F UP TO 120°F, WITH BUILT-IN CHECK VALVES, BRASS BODY AND COPPER THERMOSTAT.	---
TP	TRAP PRIMER	SIoux CHIEF	695	BRONZE PRIMER VALVE WITH REMOVABLE OPERATING PARTS, INTEGRAL VACUUM BREAKER AND GASKETED ACCESS COVER.	---
VAL	VALVES	NIBCO	FP-600-A	FULL PORT BRASS BALL VALVE WITH PLASTIC JACKET TYPE HANDLE.	---

NOTES:
 A. SIZE PER MANUFACTURE'S RECOMMENDATION

WATER HEATER SCHEDULE

ID	MANUFACTURER	MODEL	HEATING INPUT	GALLONS	UNIT WEIGHT	VOLT/ PHASE	NOTES
WH	A.O. SMITH	DEL-6	3 KW	6	42	240/1	A-G, b

NOTES:
 A. ROUTE CONDENSATE TO BUILDING EXTERIOR AND TERMINATE IN AN APPROVED LOCATION
 B. PROVIDE WALL-MOUNTED PLATFORM INSTALLED ABOVE SERVICE SINK.
 C. PROVIDE EXPANSION TANK ET SIZED PER MANUFACTURER'S RECOMMENDATION
 D. SCHEDULE KW IS FOR SINGLE ELEMENT
 E. NOT USED
 F. NOTES ARE COMPREHENSIVE, SOME NOTES MAY NOT BE USED ON ALL PROJECTS.
 G. T&P DISCHARGE ROUTING WILL BE LOCATED AT SERVICE SINK

HOT WATER OUTLET TEMP (°F)
 a. 105°F
 b. 110°F
 c. 120°F
 d. 140°F

MOUNTING TYPES

PLUMBING SPECIFICATIONS

PLUMBING SPECIFICATIONS

DIVISION 15

15A: GENERAL

1.1 GENERAL REQUIREMENTS

-REQUIREMENTS UNDER DIVISION ONE AND THE GENERAL AND SUPPLEMENTARY CONDITIONS OF THESE SPECIFICATIONS SHALL BE A PART OF THIS SECTION. THE CONTRACTOR SHALL BE WELL ACQUAINTED WITH ITS CONTENTS AS TO REQUIREMENTS THAT AFFECT THIS DIVISION OR SECTION. THE WORK REQUIRED UNDER THIS SECTION INCLUDES MATERIAL, EQUIPMENT, APPLIANCES, TRANSPORTATION, SERVICES, AND LABOR REQUIRED TO COMPLETE THE ENTIRE SYSTEM AS REQUIRED BY THE DRAWINGS AND SPECIFICATIONS.
-THE SPECIFICATIONS AND DRAWINGS FOR THE PROJECTS ARE COMPLEMENTARY, AND PORTIONS OF THE WORK DESCRIBED IN ONE, SHALL BE PROVIDED AS IF DESCRIBED IN BOTH IN THE EVENT OF DISCREPANCIES, NOTIFY THE ENGINEER AND/OR OWNER AND REQUEST CLARIFICATION PRIOR TO PROCEEDING WITH THE WORK INVOLVED.

1.2 INSPECTION OF SITE

-PRIOR TO SUBMITTING BID, VISIT THE SITE OF THE PROPOSED WORK AND BECOME FULLY INFORMED AS TO THE CONDITIONS UNDER WHICH THE WORK IS TO BE DONE. FAILURE TO DO SO WILL NOT BE CONSIDERED SUFFICIENT JUSTIFICATION TO REQUEST OR OBTAIN EXTRA COMPENSATION OVER AND ABOVE THE CONTRACT PRICE.

1.3 MATERIAL AND WORKMANSHIP

-PROVIDE NEW MATERIAL, EQUIPMENT, AND APPARATUS UNDER THIS CONTRACT UNLESS OTHERWISE STATED HEREIN, OF BEST QUALITY NORMALLY USED FOR THE PURPOSE IN GOOD COMMERCIAL PRACTICE, AND FREE FROM ANY DEFECTS. MODEL NUMBERS LISTED IN THE SPECIFICATIONS OR SHOWN ON THE DRAWINGS ARE NOT NECESSARILY INTENDED TO DESIGNATE THE REQUIRED TRIM. WRITTEN DESCRIPTIONS OF THE TRIM GOVERN MODEL NUMBERS.
-WORK PERFORMED UNDER THIS CONTRACT SHALL PROVIDE A NEAT AND "WORKMANLIKE" APPEARANCE WHEN COMPLETED. TO THE SATISFACTION OF THE ARCHITECT AND ENGINEER, WORKMANSHIP SHALL BE THE FINEST POSSIBLE BY EXPERIENCED MECHANICS. INSTALLATIONS SHALL COMPLY WITH APPLICABLE CODES AND LAWS.
-THE COMPLETE INSTALLATION SHALL FUNCTION AS DESIGNED AND INTENDED WITH RESPECT TO EFFICIENCY, CAPACITY, NOISE LEVEL, ETC. ABNORMAL NOISE CAUSED BY RATTLING EQUIPMENT, PIPING, AND SQUEAKS IN ROTATING COMPONENTS WILL NOT BE ACCEPTABLE IN GENERAL. MATERIALS AND EQUIPMENT SHALL BE OF COMMERCIAL SPECIFICATION GRADE IN QUALITY. LIGHT DUTY AND RESIDENTIAL TYPE EQUIPMENT WILL NOT BE ACCEPTED.
-REMOVE FROM THE PREMISES WASTE MATERIAL PRESENT AS A RESULT OF WORK, INCLUDING CARTONS, CRATING, PAPER, STICKERS, AND/OR EXCAVATION MATERIAL NOT USED IN BACKFILLING, ETC. CLEAN EQUIPMENT INSTALLED UNDER THIS CONTRACT TO PRESENT A NEAT AND CLEAN INSTALLATION AT THE TERMINATION OF THE WORK.
-REPAIR OR REPLACE PUBLIC AND PRIVATE PROPERTY DAMAGED AS A RESULT OF WORK PERFORMED UNDER THIS CONTRACT TO THE SATISFACTION OF AUTHORITIES AND REGULATIONS HAVING JURISDICTION.

1.4 COORDINATION

-COORDINATE WORK WITH THAT OF OTHER TRADES SO THAT THE VARIOUS COMPONENTS OF THE SYSTEMS WILL BE INSTALLED AT THE PROPER TIME, WILL FIT THE AVAILABLE SPACE, AND WILL ALLOW PROPER SERVICE ACCESS TO THOSE ITEMS REQUIRING MAINTENANCE. COMPONENTS WHICH ARE INSTALLED WITHOUT REGARD TO THE ABOVE SHALL BE RELOCATED AT NO ADDITIONAL COST TO THE OWNER.
-UNLESS OTHERWISE INDICATED, THE GENERAL CONTRACTOR WILL PROVIDE CHASES AND OPENINGS IN BUILDING CONSTRUCTION REQUIRED FOR INSTALLATION OF THE SYSTEMS SPECIFIED HEREIN. THE CONTRACTOR SHALL FURNISH THE GENERAL CONTRACTOR WITH INFORMATION WHERE CHASES AND OPENINGS ARE REQUIRED, KEEP INFORMED AS TO THE WORK OF OTHER TRADES ENGAGED IN THE CONSTRUCTION OF THE PROJECT, AND EXECUTE WORK IN A MANNER AS TO NOT INTERFERE WITH OR DELAY THE WORK OF OTHER TRADES.
-FIGURED DIMENSIONS SHALL BE TAKEN IN PREFERENCE TO SCALE DIMENSIONS. CONTRACTOR SHALL TAKE HIS OWN MEASUREMENTS AT THE BUILDING, AS VARIATIONS MAY OCCUR. CONTRACTOR WILL BE HELD RESPONSIBLE FOR ERRORS THAT COULD HAVE BEEN AVOIDED BY PROPER CHECKING AND INSPECTION.
-PROVIDE MATERIALS WITH TRIM THAT WILL PROPERLY FIT THE TYPES OF CEILING, WALL, OR FLOOR FINISHES ACTUALLY INSTALLED. MODEL NUMBERS LISTED IN THE SPECIFICATIONS OR SHOWN ON THE DRAWINGS ARE NOT INTENDED TO DESIGNATE THE REQUIRED TRIM.

1.5 ORDINANCES AND CODES

-WORK PERFORMED UNDER THIS CONTRACT SHALL, AT A MINIMUM, BE IN CONFORMANCE WITH APPLICABLE NATIONAL, STATE, AND LOCAL CODES HAVING JURISDICTION. EQUIPMENT FURNISHED AND ASSOCIATED INSTALLATION WORK PERFORMED UNDER THIS CONTRACT SHALL BE IN STRICT COMPLIANCE WITH CURRENT APPLICABLE CODES ADOPTED BY THE LOCAL A.H.J. INCLUDING ANY AMENDMENTS AND STANDARDS AS SET FORTH BY THE NATIONAL FIRE PROTECTION ASSOCIATION (NFA), UNDERWRITERS LABORATORIES (UL), OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA), AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME), AMERICAN SOCIETY OF HEATING, REFRIGERATION, AND AIR CONDITIONING ENGINEERS (ASHRAE), AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), AMERICAN SOCIETY OF TESTING MATERIALS (ASTM), AND OTHER NATIONAL STANDARDS AND CODES WHERE APPLICABLE. WHERE THE CONTRACT DOCUMENTS EXCEED THE REQUIREMENTS OF THEIR REFERENCED CODES, STANDARDS, ETC., THE CONTRACT DOCUMENTS SHALL TAKE PRECEDENCE.
-PROCURE AND PAY FOR PERMITS AND LICENSES REQUIRED FOR THE ACCOMPLISHMENT OF THE WORK HEREIN DESCRIBED. WHERE REQUIRED, OBTAIN, PAY FOR, AND FURNISH CERTIFICATES OF INSPECTION TO THE OWNER. THE CONTRACTOR WILL BE HELD RESPONSIBLE FOR VIOLATIONS OF THE LAW.

1.6 PROTECTION OF EQUIPMENT AND MATERIALS

-STORE AND PROTECT FROM DAMAGE EQUIPMENT AND MATERIALS DELIVERED TO JOB SITE. COVER WITH WATERPROOF, TEAR-RESISTANT, HEAVY TARP OR POLYETHYLENE PLASTIC AS REQUIRED TO PROTECT FROM PLASTER, DIRT, PAINT, WATER, OR PHYSICAL DAMAGE. EQUIPMENT AND MATERIAL THAT HAS BEEN DAMAGED BY CONSTRUCTION ACTIVITIES WILL BE REJECTED, AND CONTRACTOR IS OBLIGATED TO FURNISH NEW EQUIPMENT AND MATERIAL OF A LIKE KIND AS APPROVED BY OWNER.
-KEEP PREMISES CLEAN FROM FOREIGN MATERIAL CREATED DURING WORK PERFORMED UNDER THIS CONTRACT. PIPING, EQUIPMENT, ETC., SHALL HAVE A NEAT AND CLEAN APPEARANCE AT THE TERMINATION OF THE WORK.
-PLUG OR CAP OPEN ENDS OF PIPING SYSTEMS WHILE STORED OR INSTALLED DURING CONSTRUCTION WHEN NOT IN USE TO PREVENT THE ENTRANCE OF DEBRIS INTO THE SYSTEMS.

1.7 SUBSTITUTIONS

-THE BASE BID SHALL INCLUDE ONLY THE PRODUCTS FROM MANUFACTURERS SPECIFICALLY NAMED IN THE DRAWINGS AND SPECIFICATIONS. NO SUBSTITUTION WILL BE CONSIDERED PRIOR TO RECEIPT OF BIDS UNLESS WRITTEN REQUEST FOR APPROVAL TO BID HAS BEEN RECEIVED BY THE ENGINEER AT LEAST TEN CALENDAR DAYS PRIOR TO THE DATE FOR RECEIPT OF BIDS. EACH SUCH REQUEST SHALL INCLUDE THE NAME OF THE MATERIAL OR EQUIPMENT FOR WHICH IT IS TO BE SUBSTITUTED AND A COMPLETE DESCRIPTION OF THE PROPOSED SUBSTITUTE INCLUDING DRAWINGS, CUTS, PERFORMANCE AND TEST DATA AND OTHER INFORMATION NECESSARY FOR AN EVALUATION. A STATEMENT SETTING FORTH CHANGES IN OTHER MATERIALS, EQUIPMENT OR OTHER WORK THAT INCORPORATION OF THE SUBSTITUTE WOULD REQUIRE SHALL BE INCLUDED. THE BURDEN OF PROOF OF THE MERIT OF THE PROPOSED SUBSTITUTE IS UPON THE PROPOSER. THE ENGINEER'S DECISION OF APPROVAL OR DISAPPROVAL TO BID OF A PROPOSED SUBSTITUTION SHALL BE FINAL.
-THE TERMS "APPROVED", "APPROVED EQUAL", AND "EQUAL" REFER TO APPROVAL BY THE ENGINEER AS AN ACCEPTABLE ALTERNATE BID. NO SUBSTITUTIONS WILL BE CONSIDERED THAT ARE NOT BID AS AN ALTERNATE. NO MATERIAL SUBSTITUTIONS SHALL BE CONSIDERED FOR APPROVAL PRIOR TO AWARD OF CONTRACT.
-COORDINATE AND VERIFY WITH OTHER TRADES WHETHER OR NOT THE SUBSTITUTED EQUIPMENT CAN BE INSTALLED AS SHOWN ON THE CONSTRUCTION DRAWINGS WITHOUT MODIFICATION TO ASSOCIATED SYSTEMS OR ARCHITECTURAL OR ENGINEERING DESIGN. INCLUDE ADDITIONAL COSTS FOR ARCHITECTURAL AND ENGINEERING DESIGN FEES IN BID IF DRAWING MODIFICATIONS ARE REQUIRED BECAUSE OF SUBSTITUTED EQUIPMENT.

1.8 OPERATION AND MAINTENANCE INSTRUCTIONS

-COLLECT AND COMPLETE A COMPLETE BROCHURE OF FIXTURES, MATERIALS, AND EQUIPMENT FURNISHED AND INSTALLED ON THIS PROJECT. INCLUDE OPERATIONAL AND MAINTENANCE INSTRUCTIONS, MANUFACTURER'S CATALOG SHEETS, WIRING DIAGRAMS, PARTS LISTS, APPROVED SHOP DRAWINGS, AND DESCRIPTIVE LITERATURE FURNISHED BY THE MANUFACTURER. INCLUDE AN INSIDE COVER SHEET THAT LISTS THE PROJECT NAME, DATE, OWNER, ARCHITECT, ENGINEER, GENERAL CONTRACTOR, SUBCONTRACTOR, AND AN INDEX OF CONTENTS.
-SUBMIT COPIES OF LITERATURE BOUND IN APPROVED BINDERS TO THE ARCHITECT AND OWNER AT THE TERMINATION OF THE WORK. PAPER CLIPS, STAPLES, RUBBER BANDS, AND MAILING ENVELOPES ARE NOT CONSIDERED APPROVED BINDERS. FINAL APPROVAL OF PLUMBING SYSTEMS WILL BE WITHHELD UNTIL THIS EQUIPMENT BROCHURE IS DEEMED COMPLETE BY THE ARCHITECT, ENGINEER, AND OWNER.

1.9 SPARE PARTS

-FURNISH TO OWNER, WITH RECEIPT, THE SPARE PARTS TO INCLUDE FAUCET WASHERS AND O-RINGS, FLOWMETER REPAIR KITS, AND WATER CLOSET TANK REPAIR KITS FOR THE FIXTURES FURNISHED FOR THIS PROJECT.

1.10 WARRANTIES

-WARRANT EACH SYSTEM AND EACH ELEMENT THEREOF AGAINST ALL DEFECTS DUE TO FAULTY WORKMANSHIP, DESIGN, OR MATERIAL FOR A PERIOD OF 12 MONTHS FROM DATE OF SUBSTANTIAL COMPLETION, UNLESS SPECIFIC ITEMS ARE NOTED TO CARRY A LONGER WARRANTY IN THE CONSTRUCTION DOCUMENTS OR MANUFACTURER'S STANDARD WARRANTY EXCEEDS 12 MONTHS. REMEDY ALL DEFECTS, OCCURRING WITHIN THE WARRANTY PERIOD(S), AS STATED IN THE GENERAL CONDITIONS AND DIVISION 1.
-WARRANTIES SHALL INCLUDE LABOR AND MATERIAL. MAKE REPAIRS OR REPLACEMENTS WITHOUT ANY ADDITIONAL COSTS TO THE OWNER.
-PERFORM THE REMEDIAL WORK PROMPTLY, UPON WRITTEN NOTICE FROM THE ENGINEER OR OWNER.
-AT THE TIME OF SUBSTANTIAL COMPLETION, DELIVER TO THE OWNER ALL WARRANTIES, IN WRITING AND PROPERLY EXECUTED, INCLUDING TERM LIMITS FOR WARRANTIES EXTENDING BEYOND THE ONE YEAR PERIOD, EACH WARRANTY INSTRUMENT BEING ADDRESSED TO THE OWNER AND STATING THE COMMENCEMENT DATE AND TERM.

1.11 CUTTING AND PATCHING

-PERFORM CUTTING OF WALLS, FLOORS, CEILINGS, ETC. AS REQUIRED TO INSTALL WORK UNDER THIS SECTION. OBTAIN PERMISSION FROM THE ARCHITECT PRIOR TO CUTTING. DO NO CUT OR DISTURB STRUCTURAL MEMBERS WITHOUT PRIOR APPROVAL FROM THE ARCHITECT. CUT HOLES AS SMALL AS POSSIBLE. GENERAL CONTRACTOR SHALL PATCH WALLS, FLOORS, ETC. AS REQUIRED BY WORK UNDER THIS SECTION. PATCHING SHALL MATCH THE ORIGINAL MATERIAL AND CONSTRUCTION. REPAIR AND REFINISH AREAS DISTURBED BY WORK TO THE CONDITION OF ADJOINING SURFACES IN A MANNER SATISFACTORY TO THE ARCHITECT.

1.12 ROUGH-IN

-COORDINATE WITHOUT DELAY ROUGHING-IN WITH GENERAL CONSTRUCTION. CONCEAL PIPING AND CONDUIT ROUGH-IN EXCEPT IN UNFINISHED AREAS WHERE OTHERWISE SHOWN.

1.13 STRUCTURAL STEEL

-STRUCTURAL STEEL USED FOR PIPE SUPPORTS, EQUIPMENT SUPPORTS, ETC., SHALL BE NEW, CLEAN, AND CONFORM TO ASTM DESIGNATION A-36.
-SUPPORT PLUMBING AND MECHANICAL EQUIPMENT AND PIPING FROM THE BUILDING STRUCTURE. DO NOT SUPPORT PLUMBING EQUIPMENT FROM CEILINGS, OTHER MECHANICAL OR ELECTRICAL COMPONENTS, AND OTHER NON-STRUCTURAL ELEMENTS.

1.14 ACCESS DOORS

-PROVIDE ACCESS DOORS IN CEILINGS AND WALLS WHERE INDICATED OR REQUIRED FOR ACCESS TO CONCEALED VALVES AND EQUIPMENT INSTALLED UNDER THIS SECTION. PROVIDE CONCEALED HINGES, SCREWDRIWER-TYPE LOCK, ANCHOR STRAPS, MANUFACTURED BY MILCOR, ZURN, TITUS, OR EQUAL. OBTAIN ARCHITECT'S APPROVAL OF TYPE, SIZE, LOCATION, AND COLOR BEFORE ORDERING.

1.15 PENETRATIONS

-SEAL FLOOR, EXTERIOR WALL AND ROOF PENETRATIONS WATER AND WEATHER TIGHT WITH APPROPRIATE NON-SHRINK, NON-HARDENING COMMERCIAL CONSTRUCTION SEALANT. SEAL ROOF PENETRATIONS WITH FOUR POUND PER SQUARE FOOT LEAD FLASHING. PROVIDE A SLEEVE, AND SEAL NON-FIRE-RATED FLOOR AND WALL PENETRATIONS WITH FIBERGLASS PACKING AND SILICONE CAULK (FOR ACOUSTICAL INSULATION).
-COORDINATE FIRE RATING REQUIREMENTS AND LOCATIONS WITH THE ARCHITECT. SEAL PENETRATIONS OF FIRE-RATED ASSEMBLIES WITH 3M #CP-25 FIRE BARRIER CAULK (PROVIDE THICKNESS AND METHOD AS REQUIRED AND RECOMMENDED BY MANUFACTURER) TO MAINTAIN THE FIRE RESISTANCE RATING OF FIRE-RATED ASSEMBLIES.
-SEAL EXTERIOR WALL PENETRATIONS BELOW GRADE WITH CAST IRON WALL PIPES AND MODULAR MECHANICAL SLEEVE SEALS, MANUFACTURED BY THUNDERLINE/LINK SEAL, CALPICO, INC AND METRAFLEX.
-PROVIDE SLEEVES FOR HORIZONTAL PIPE PASSING THROUGH OR UNDER THE FOUNDATION. SLEEVES SHALL BE CAST IRON SOIL PIPE TWO NOMINAL PIPE SIZES LARGER THAT THE PIPE SERVED.
-PROVIDE SLEEVES FOR VERTICAL PIPE PASSING THROUGH SLAB ON GRADE. SLEEVES SHALL BE SCHEDULE 40 PVC PIPE, TWO NOMINAL PIPE SIZES LARGER THAN THE PIPE SERVED. SEAL WATER-TIGHT WITH SILICONE CAULK.

15B: HEATING, VENTILATION, AND AIR CONDITIONING

REFERENCE MECHANICAL SPECIFICATIONS.

15C: PLUMBING

1.1 MATERIALS

1.1.1 DOMESTIC WATER PIPING

-ABOVE AND BELOW GRADE WATER PIPING SHALL BE PEX TUBING CONFORMING TO ASTM F877 CROSS-LINKED POLYETHYLENE TUBING HOT AND COLD-WATER DISTRIBUTION SYSTEMS, ASTM F876 CROSS-LINKED POLYETHYLENE TUBE, ASTM F1807 FITTING AND ASTM F2159 FITTINGS, COMPLY WITH NSF STANDARD 14 AND 61. PEX TUBING SHALL BE WATTS WATERPEX CROSS-LINKED POLYETHYLENE OR EQUAL. ALL PEX TUBING BELOW GRADE SHALL BE SLEEVED WITH PVC PIPE.
-FITTINGS SHALL BE MECHANICAL CRIMP FITTINGS IN COMPLIANCE WITH ASTM F1807 AND F2159. PEX FITTINGS SHALL BE WATTS BRASS CRIMPING FITTINGS USING EITHER WATTS COPPER CRIMPING OR STAINLESS STEEL CINCHCLAMP OR EQUAL, INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
-ABOVE AND BELOW GRADE WATER PIPING SHALL BE TYPE "L" AND "M" HARD DRAWN SEAMLESS COPPER TUBING CONFORMING TO ASTM 888.
-COPPER UNIONS SHALL BE CAST-COPPER-ALLOY, HEXAGONAL-STOCK BODY, WITH BALL-AND-SOCKET, METAL-TO-METAL SEATING SURFACE AND SOLDER-JOINT. JOINING MATERIAL SHALL BE ASTM B813 WATER-FLUSHABLE, LEAD-FREE FLUX ALLOY SOLDER.

1.1.2 FILTERED WATER PIPING

-ABOVE AND BELOW GRADE FILTERED WATER PIPING SHALL BE CPVC TUBING CONFORMING TO ASTM D2846 AND CSA B137 CHLORINATED POLY (VINYL CHLORIDE) PLASTIC HOT AND COLD-WATER DISTRIBUTION SYSTEMS, ASTM D1784 RIGID AND CHLORINATED PVC COMPOUNDS, ASTM F493 SOLVENT CEMENTS, COMPLY WITH NSF STANDARD 14 AND 61. CPVC TUBING SHALL BE FLOWGUARD GOLD CPVC CTS OR EQUAL.
-FITTINGS SHALL BE SOCKET TYPE JOINTS IN COMPLIANCE WITH ASTM D2846 AND CSA B137. CPVC FITTINGS SHALL BE FLOWGUARD GOLD CPVC CTS FITTINGS OR EQUAL. JOINING MATERIAL SHALL BE ASTM F493 SOLVENT CEMENT, INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
-ABOVE AND BELOW GRADE FILTERED WATER PIPING SHALL BE TYPE "L" AND "M" HARD DRAWN SEAMLESS COPPER TUBING CONFORMING TO ASTM 888.
-COPPER UNIONS SHALL BE CAST-COPPER-ALLOY, HEXAGONAL-STOCK BODY, WITH BALL-AND-SOCKET, METAL-TO-METAL SEATING SURFACE AND SOLDER-JOINT. JOINING MATERIAL SHALL BE ASTM B813 WATER-FLUSHABLE, LEAD-FREE FLUX ALLOY SOLDER.

1.1.3 SOIL, WASTE, AND VENT PIPING

-ABOVE AND BELOW GRADE SOIL, WASTE, AND VENT PIPING SHALL BE PVC PLASTIC, SCHEDULE 40 DWV PIPE CONFORMING TO ASTM D2665 WITH PLAIN ENDS. CELLULAR (FOAM) CORE PVC NOT ALLOWED. INSTALL PER ASTM D2665 AND ASTM D2321.
-FITTINGS SHALL BE PVC SOCKET-TYPE DWV PIPE FITTINGS; ASTM D2665 MADE TO ASTM D3311 DRAIN, WASTE, AND VENT PARTS.
-ABOVE AND BELOW GRADE SOIL, WASTE, AND VENT PIPING SHALL BE HUB-AND-SPIGOT CAST-IRON SOIL PIPE AND FITTINGS CONFORMING TO ASTM A74 WITH ASTM C564 RUBBER GASKETS. INSTALL CAST-IRON SOIL PIPING ACCORDING TO CISPI'S "CAST IRON SOIL PIPE AND FITTINGS HANDBOOK" CHAPTER IV, "INSTALLATION OF CAST IRON SOIL PIPE AND FITTINGS".
-ABOVE GRADE SOIL, WASTE, AND VENT PIPING SHALL BE ALLOWED TO BE COPPER DRAINAGE TUBING CONFORMING TO ASTM 8306 AT PLUMBING CONTRACTOR'S OPTION.

1.1.4 INDIRECT AND CONDENSATE DRAIN LINES

-PROVIDE HARD DRAWN, TYPE "M" OR "L" COPPER PIPE FOR ALL CONDENSATE DRAIN PIPING FROM COOLER AND FREEZER EVAPORATORS, PROVIDE HEAT TRACE FOR ALL CONDENSATE DRAIN PIPING LOCATED IN FREEZERS, AND ROUTE TO FLOOR DRAIN IN BUILDING.
-PROVIDE PVC PIPE FOR ALL OTHER INDIRECT AND CONDENSATE DRAIN PIPING FROM HVAC, PLUMBING, AND BEVERAGE EQUIPMENT, AND ROUTE TO FLOOR DRAIN IN BUILDING.

1.1.5 GAS PIPING

-GAS PIPING SHALL BE SCHEDULE 40 BLACK CARBON STEEL CONFORMING TO ASTM A53. PIPING 2" AND SMALLER SHALL BE WELDED OR THREADED WITH MALLEABLE IRON FITTINGS. PIPING 2-1/2" AND LARGER SHALL BE WELDED WITH BUTT-WELDED FITTINGS.
-FITTINGS SHALL CONFORM TO ASME B16.3, MALLEABLE IRON OR ASTM A334, FORGED STEEL WELDED TYPE.
-PROVIDE SHUT-OFF VALVE, DIRT LEG, AND UNION AT EACH ROOFTOP UNIT. PAINT ALL GAS PIPING EXPOSED TO WEATHER WITH ONE COAT OF PRIMER, AND TWO COATS OF RUST-PROOF PAINT. COLOR SHALL MATCH BUILDING COLORS. COORDINATE WITH OWNER'S CONSTRUCTION MANAGER.
-PROVIDE TREATED WOOD BLOCKING 6X6X12, 8'-0" OC MAX WITH GALVANIZED PIPE STRAP, 1 1/4" ZINC COATED LAG SCREWS, AND RUBBER WALK PAD ADHERED TO ROOF.

1.1.6 FLASHING

-SHEET LEAD, 4 POUNDS PER SQUARE FOOT, MINIMUM.

1.2 INSULATION

1.2.1 DOMESTIC COLD WATER (WITHIN BUILDING)

-COPPER PIPING: 1/2" WALL ONE-PIECE FIBERGLASS COVERING HAVING A CONDUCTIVITY NOT EXCEEDING 0.27 WITH FIRE RESISTANT JACKET WITH SELF-SEALING LAP TO PROVIDE A CONTINUOUS VAPOR BARRIER BY CERTAINTED, OWENS-CORNING, OR ARMSTRONG. (SEE BELOW FOR PLUMBING FITTING INSULATION REQUIREMENTS.)
-PEX TUBING: NO INSULATION REQUIRED.
-EXCEPTION: FOR NON-RECIRCULATING HOT WATER SYSTEM, PROVIDE 1/2" WALL ONE-PIECE FIBERGLASS COVERING HAVING A CONDUCTIVITY NOT EXCEEDING 0.27 WITH FIRE RESISTANT JACKET WITH SELF-SEALING LAP TO PROVIDE A CONTINUOUS VAPOR BARRIER BY CERTAINTED, OWENS-CORNING, OR ARMSTRONG ON THE FIRST 8 FEET OF INLET PIPING AT WATER HEATER.
-CPVC TUBING: NO INSULATION REQUIRED.

1.2.2 DOMESTIC HOT WATER

-COPPER PIPING: 1/2" WALL ONE-PIECE FIBERGLASS COVERING HAVING A CONDUCTIVITY NOT EXCEEDING 0.27 WITH FIRE RESISTANT JACKET WITH SELF-SEALING LAP TO PROVIDE A CONTINUOUS VAPOR BARRIER BY CERTAINTED, OWENS-CORNING, OR ARMSTRONG. (SEE BELOW FOR PLUMBING FITTING INSULATION REQUIREMENTS.)
-PEX TUBING: 1/2" WALL ONE-PIECE FIBERGLASS COVERING HAVING A CONDUCTIVITY NOT EXCEEDING 0.27 WITH FIRE RESISTANT JACKET WITH SELF-SEALING LAP TO PROVIDE A CONTINUOUS VAPOR BARRIER BY CERTAINTED, OWENS-CORNING, OR ARMSTRONG. (SEE BELOW FOR PLUMBING FITTING INSULATION REQUIREMENTS.)
-FOR HOT WATER PIPING BEING SERVED BY SYSTEM WITH RECIRCULATING PUMP, PROVIDE 1" WALL ONE-PIECE FIBERGLASS COVERING HAVING A CONDUCTIVITY NOT EXCEEDING 0.27 WITH FIRE RESISTANT JACKET WITH SELF-SEALING LAP TO PROVIDE A CONTINUOUS VAPOR BARRIER BY CERTAINTED, OWENS-CORNING, OR ARMSTRONG. (SEE BELOW FOR PLUMBING FITTING INSULATION REQUIREMENTS.)

1.2.3.1 INDIRECT AND CONDENSATE DRAIN PIPING (WITHIN BUILDING)

-COPPER PIPING: PROVIDE 1" FLEXIBLE UNICELLULAR INSULATION BY ARMACELL.
-PVC PIPING: NO INSULATION REQUIRED.
-FOR PIPING AT HANGERS, PROVIDE 8" LONG SECTIONS OF HIGH DENSITY, HIGH TEMPERATURE CALCIUM SILICATE BY JOHNS-MANVILLE, FIBERGLASS BY KNAUF, OR 8" LONG STYROFOAM BILLETS BY DOW. INSULATION SHALL BE CONTINUOUS ALONG THE PIPE SURFACE, EXCEPT AT VALVES, UNIONS, AND WHERE PIPING IS EXPOSED AT FIXTURES.
-FOR HOT AND COLD-WATER PIPING EXPOSED, CONCEALED IN WALLS, AND/OR INSTALLED INSIDE MASONRY UNITS OF WALLS, COVER FITTINGS WITH ZESTON, KNAUF, OR EQUAL ONE-PIECE PVC PREMOLDED INSULATING COVERS, FITTING COVERS, JACKETS, AND ADHESIVES SHALL NOT EXCEED FLAME SPREAD RATING OF 25 AND SMOKE DEVELOPMENT RATING OF 50 PER ASTM E84. AT ALL ELBOWS AND TEES, FILL VOIDS BETWEEN COVERS AND PIPING WITH FIBERGLASS INSULATION AND TAPE JOINTS. INSTALL PIPE INSULATION IN COMPLIANCE WITH MANUFACTURER'S RECOMMENDATIONS. WHERE PREMOLDED INSULATING FITTINGS ARE NOT APPROVED BY LOCAL AUTHORITIES, MITER INSULATION AT FITTINGS.

1.2.4 PIPING INSTALLATION

-GENERAL: CLEAN PIPE THOROUGHLY PRIOR TO INSTALLATION. REAM ENDS OF PIPE TO REMOVE BURRS. CUT PIPE ACCURATELY TO MEASUREMENTS TAKEN ON THE JOB. INSTALL WITH ADEQUATE CLEARANCE FOR INSTALLATION OF COVERINGS WHERE REQUIRED. PIPE SHALL NOT BE SPRUNG OR BENT. NEATLY ALIGN PIPE. CONNECT IT SECURELY, AND SUPPORT IT FROM THE BUILDING, AND SUPPORT IT FROM THE BUILDING STRUCTURE WITH HANGERS AS SPECIFIED BELOW. PROVIDE CHROME-PLATED ESCUTCHEONS ON PIPES PASSING THROUGH CEILINGS, FLOORS, OR WALLS OF FINISHED SPACES. RUN PIPES FREELY THROUGH FLOOR AND WALL PENETRATIONS USING PIPE SLEEVES. DO NOT GROUT IN PLACE UNLESS REQUIRED FOR STRUCTURAL FIRE INTEGRITY. INSTALL PIPE CONCEALED IN FINISHED SPACES WHEREVER POSSIBLE. USE A DIELECTRIC UNION WHERE FERROUS AND COPPER PIPE CONNECT. DIELECTRIC UNION SHALL HAVE A ZINC STEEL BODY, A THREADED NYLON INSERT, AND INSULATION PRESSURE GASKET. NO FERROUS METAL-TO-COPPER CONNECTION MADE WITHOUT INSULATING UNIONS WILL BE ALLOWED.
-HANGERS & SUPPORTS: PIPE HANGERS SHALL BE AS DESCRIBED IN THE SPECIFICATIONS BY B-LINE OR EQUAL BY ANVIL, MICHIGAN, TRUSSCO, OR UNISTRUT. CONNECT HANGERS TO THE STRUCTURE WITH SIDE BEAM CONNECTORS AND ALL THREAD HANGER RODS. PROVIDE ENGINEERED SUPPORT STRUTS BETWEEN JOISTS AND OTHER STRUCTURAL MEMBERS AS REQUIRED TO PROVIDE A RIGID HANGING.
-DOMESTIC WATER: ARRANGE COLD, HOT, AND HOT WATER RECIRCULATION PIPING TO DRAIN AT THE LOWEST POINT IN EACH SYSTEM. INSTALL AT LEAST ONE PIPE UNION ADJACENT TO ALL SHUT-OFF VALVES. AT CONNECTION POINT OF EACH PIECE OF EQUIPMENT, AND ELSEWHERE IN THE SYSTEM WHERE REQUIRED TO ALLOW PROPER MAINTENANCE, PROVIDE UNIONS OF THE GROUND JOINT TYPE. MAKE ALLOWANCE FOR EXPANSION AND CONTRACTION WHERE REQUIRED BY THE INSTALLATION. WHERE WATER PIPING OCCURS IN EXTERIOR WALLS, HOLD PIPE AS CLOSE AS POSSIBLE TO THE INTERIOR FACE OF THE WALL AND INSTALL INSULATION BATT OR OTHER INSULATION (MINIMUM R-8) BETWEEN PIPING AND THE EXTERIOR WALL FACE.

1.3 EXTERIOR UTILITY CONNECTIONS

-TERMINATE DOMESTIC WATER, STORM, AND SEWER LINES AT A POINT APPROXIMATELY FIVE FEET FROM THE BUILDING WALL, OR AS SHOWN ON THE DRAWINGS. MAKE CONNECTION TO THE VARIOUS SERVICES PROVIDED BY OTHERS AND COORDINATE CONNECTION REQUIREMENTS WITH CIVIL ENGINEER. VERIFY THAT INSTALLATION WILL TIE INTO THE VARIOUS SERVICE PROVIDED BY OTHERS AT THE INDICATED INVERT ELEVATION POINT PRIOR TO INSTALLATION. IF THE INSTALLATION WILL NOT TIE INTO THE INDICATED INVERT ELEVATION POINT WHILE MAINTAINING PROPER FALL, NOTIFY THE ARCHITECT AND CIVIL ENGINEER SO THAT AN ALTERNATIVE MAY BE DETERMINED.
-PROVIDE SERVICE PIPING AND ACCESSORIES REQUIRED TO COMPLETE UTILITY CONNECTIONS THAT ARE NOT FURNISHED BY THE SERVING UTILITY.

1.4 TESTING AND INSPECTION

-UPON COMPLETION OF EACH PHASE OF THE INSTALLATION, TEST EACH SYSTEM IN CONFORMANCE WITH LOCAL CODE REQUIREMENTS AND AS NOTED BELOW. FURNISH LABOR AND EQUIPMENT REQUIRED TO TEST PLUMBING WORK INSTALLED UNDER THIS CONTRACT, AND ASSUME COSTS INVOLVED IN MAKING THE TESTS, AND REPAIRING AND/OR REPLACING DAMAGE RESULTING THEREFROM.
-NOTIFY THE ARCHITECT AND AUTHORITY HAVING JURISDICTION, THREE (3) WORKING DAYS PRIOR TO MAKING PLUMBING SYSTEM TESTS. LEAVE CONCEALED WORK UNCOVERED UNTIL THE REQUIRED TESTS HAVE BEEN COMPLETED, BUT IF NECESSARY DUE TO CONSTRUCTION PROCEDURE, TESTS ON PORTIONS OF THE WORK MAY BE MADE, AND WHEN SATISFACTORY, THE WORK MAY BE CONCEALED. TEST PIPING BEFORE INSULATION IS INSTALLED, AND BEFORE BACKFILL, PIPES, JOINTS, FLANGES, VALVE STEMS, ETC., SHALL BE LEAK TIGHT. REPAIR OR REPLACE SYSTEM DEFECTS WITH NEW MATERIALS. CAULKING OF DEFECTIVE JOINTS, CRACK OR HOLES WILL NOT BE PERMITTED. REPEAT TESTS AFTER DEFECTS HAVE BEEN ELIMINATED. MAKE TESTS IN THE PRESENCE OF THE ADMINISTRATIVE AUTHORITY AND/OR THE OWNER'S AUTHORIZED REPRESENTATIVE.
-WORK SHALL BE INSPECTED FOR COMPLIANCE WITH CODES, ORDINANCES, REGULATIONS, AND ADHERENCE TO CONTRACT DOCUMENTS. PLUMBING CONTRACTOR SHALL SUPPLY OWNER WITH SIGNED FORMS OR PROOF OF ACCEPTANCE BY THE LOCAL AUTHORITY BEFORE CONTINUING FROM ONE STAGE TO ANOTHER. FINAL APPROVAL SHALL BE OBTAINED BEFORE FINAL PAYMENT IS MADE ON THE CONTRACT.

1.5 GUARANTEE

-THE WORK TO BE PERFORMED UNDER THIS CONTRACT SHALL INCLUDE THE FURNISHING, INSTALLATION, AND CONNECTION OF PLUMBING SYSTEMS INDICATED ON THE DRAWINGS AND IN THE SPECIFICATIONS. BY SIGNING THE CONTRACT, THE PLUMBING CONTRACTOR ACKNOWLEDGES THAT HE HAS ACQUAINTED HIMSELF WITH THE SITE AND THE EXISTING CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED, AND THE DRAWINGS AND SPECIFICATIONS PERTAINING THERETO, AND HE INDICATES THAT HE WILL COMPLY WITH THE REQUIREMENTS AND INTENT OF PERTINENT DOCUMENTS IN THE PERFORMANCE OF THE WORK.



OMN ENGINEERS
PO BOX 2106
LOWELL, AR 72745
479-696-7873

Burris
Architecture
820 Tigner Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE	09/11/25
JOB NO.	25089
REVISIONS	

P3.0
PLUMBING SPECIFICATIONS

MECHANICAL SEISMIC NOTES	
1	DUCTWORK 2" IN DIAMETER AND LARGER, AND SUSPENDED MORE THAN 12" FROM POINT OF CONNECTION TO STRUCTURE TO TOP OF DUCT SHALL BE BRACED IN TWO DIRECTIONS (80° OPPOSING) USING ROD OR STRAP OF SAME LOAD CHARACTERISTICS AS PRIMARY SUSPENSION ROD OR STRAP.
2	RECTANGULAR DUCTWORK WITH A CROSS-SECTIONAL AREA OF 6 SQ. FT. AND LARGER, AND SUSPENDED MORE THAN 12" FROM POINT OF CONNECTION TO STRUCTURE TO TOP OF DUCT SHALL BE BRACED IN TWO DIRECTIONS (90° OPPOSING) USING ROD OR STRAP OF SAME LOAD CHARACTERISTICS AS PRIMARY SUSPENSION ROD OR STRAP.
3	DUCTWORK SHALL HAVE TRANSVERSE BRACING AT MAXIMUM 30'-0" ON CENTER AND WITHIN 48" OF CHANGE IN DIRECTION AND LONGITUDINAL BRACING AT MAXIMUM 60'-0" ON CENTER.
4	CEILING DIFFUSERS AND GRILLES SHALL BE SECURED TO A STRUCTURAL ELEMENT USING A 12 GAUGE CEILING SUSPENSION WIRE.

DEFINITIONS

INDICATED: THE TERM "INDICATED" REFERS TO GRAPHIC REPRESENTATIONS, NOTES, OR SCHEDULES ON THE DRAWINGS, OTHER PARAGRAPHS OR SCHEDULES IN THE SPECIFICATIONS, AND SIMILAR REQUIREMENTS IN THE CONTRACT DOCUMENTS. WHERE TERMS SUCH AS "SHOWN", "NOTED", "SCHEDULED", AND "SPECIFIED" ARE USED, IT IS TO HELP THE READER LOCATE THE REFERENCE, NO LIMITATION ON LOCATION IS INTENDED.

DIRECTED: TERMS SUCH AS "DIRECTED", "REQUESTED", "AUTHORIZED", "SELECTED", "APPROVED", "REQUIRED", AND "PERMITTED" MEAN "DIRECTED BY THE ENGINEER", "REQUESTED BY THE ENGINEER", AND SIMILAR PHRASES.

APPROVED: THE TERM "APPROVED", WHERE USED IN CONJUNCTION WITH THE ENGINEER'S ACTION ON THE CONTRACTOR'S SUBMITTALS, APPLICATIONS, AND REQUESTS, IS LIMITED TO THE ENGINEER'S DUTIES AND RESPONSIBILITIES AS STATED IN GENERAL AND SUPPLEMENTARY CONDITIONS.

FURNISH: THE TERM "FURNISH" IS USED TO MEAN "SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS."

INSTALL: THE TERM "INSTALL" IS USED TO DESCRIBE OPERATIONS AT PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTIONS, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS.

PROVIDE: THE TERM "PROVIDE" MEAN "TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE."

INSTALLER: AN "INSTALLER" IS THE CONTRACTOR OR AN ENTITY ENGAGED BY THE CONTRACTOR, EITHER AS AN EMPLOYEE, SUBCONTRACTOR, OR SUB-SUBCONTRACTOR, FOR PERFORMANCE OF A PARTICULAR CONSTRUCTION ACTIVITY, INCLUDING INSTALLATION, ERECTION, APPLICATION, AND SIMILAR OPERATIONS. INSTALLERS ARE REQUIRED TO BE EXPERIENCED IN THE OPERATIONS THEY ARE ENGAGED TO PERFORM.

MECHANICAL GENERAL NOTES	
1	NOTES APPLY TO ALL MECHANICAL SHEETS UNON.
2	COORDINATE THE INSTALLATION OF THE MECHANICAL SYSTEMS WITH OTHER TRADES TO ENSURE A NEAT AND ORDERLY INSTALLATION. INSTALL DUCTWORK AND PIPING AS TIGHT TO STRUCTURE AS POSSIBLE. COORDINATE WITH OTHER TRADES TO AVOID CONFLICTS. COORDINATE INSTALLATION OF DUCTWORK AND PIPING TO AVOID CONFLICTS WITH ELECTRICAL PANELS, LIGHTING FIXTURES, ETC. ANY MODIFICATIONS REQUIRED DUE TO LACK OF COORDINATION WILL BE THE RESPONSIBILITY OF THE CONTRACTOR AT NO EXTRA COST TO THE OWNER.
3	DURING INSTALLATION OF NEW WORK, AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN. REPAIR DAMAGE CAUSED DURING CONSTRUCTION AT NO EXTRA COST TO THE OWNER.
4	ALL MECHANICAL EQUIPMENT SHOWN ON THE MECHANICAL PLANS SHALL BE PROVIDED BY THE MECHANICAL CONTRACTOR UNLESS OTHERWISE NOTED.
5	NEW MECHANICAL EQUIPMENT, DUCTWORK AND PIPING ARE SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE. VERIFY THAT FINAL EQUIPMENT LOCATIONS MEET MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AND PROPER AIRFLOW CLEARANCE AROUND EQUIPMENT.
6	INSTALL DUCTWORK AND PIPING PARALLEL TO BUILDING COLUMN LINES UNLESS OTHERWISE SHOWN OR NOTED.
7	OVERHEAD HANGERS AND SUPPORTS FOR EQUIPMENT, DUCTWORK AND PIPING SHALL BE FASTENED TO BUILDING JOISTS OR BEAMS. DO NOT ATTACH HANGERS AND SUPPORTS TO THE ABOVE FLOOR SLAB OR ROOF.
8	COORDINATE LOCATION OF EQUIPMENT SUPPORTS WITH LOCATION OF EQUIPMENT ACCESS PANELS/DOORS TO ENABLE SERVICE OF EQUIPMENT.
9	SEAL PENETRATIONS THROUGH THE BUILDING COMPONENTS IN ACCORDANCE WITH THE CONTRACT SPECIFICATIONS. FIREPROOF PENETRATIONS THROUGH FIRE RATED COMPONENTS IN ACCORDANCE WITH U.L. REQUIREMENTS.
10	COORDINATE THE EXACT MOUNTING SIZE AND FRAME TYPE OF DIFFUSERS, REGISTERS AND GRILLES WITH THE SUPPLIER TO MEET THE CEILING, WALL AND DUCT INSTALLATION REQUIREMENTS.
11	ADJUST LOCATION OF CEILING DIFFUSERS, REGISTERS AND GRILLES AS REQUIRED TO ACCOMMODATE FINAL CEILING GRID AND LIGHTING LOCATIONS.
12	LOCATE AND SET THERMOSTATS AT LOCATIONS SHOWN ON PLANS. VERIFY EXACT LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION. INSTALL DEVICES WITH TOP OF DEVICE AT MAXIMUM 48" AFF TO MEET ADA REQUIREMENTS UNLESS NOTED OTHERWISE ON PLANS. INSTALL WIRING IN CONDUIT PROVIDED BY DIVISION 16.
13	COORDINATE THE LOCATION AND ELEVATION OF WALL-MOUNTED DEVICES WITH PRESENTATION BOARDS, DISPLAY CABINETS, SHELVES OR OTHER COMPONENTS SHOWN ON THE ARCHITECTURAL DRAWINGS THAT ARE TO BE INSTALLED UNDER OTHER DIVISIONS. CONTRACTOR WILL NOT BE REIMBURSED FOR RELOCATION OF WALL-MOUNTED DEVICES CAUSED BY A LACK OF COORDINATION.
14	DUCTWORK CROSSING FIRE RATED WALLS OR OTHER FIRE RATED ASSEMBLIES SHALL BE MINIMUM 26 GAUGE SHEET METAL.
15	PROVIDE FIRE OR FIRE/SMOKE DAMPERS, AS APPLICABLE, IN DUCTWORK AT CEILINGS AND WALLS AT LOCATIONS SHOWN ON THE PLANS. FIRE AND FIRE/SMOKE DAMPERS SHALL CONFORM TO NFPA AS APPLICABLE. COORDINATE SLEEVE LENGTH WITH REQUIREMENTS OF INSTALLED LOCATION.
16	PROVIDE WALL OR DUCT ACCESS PANELS OR DOORS FOR ACCESS TO FIRE AND FIRE/SMOKE DAMPERS. ACCESS PANEL OR DOOR SHALL BE MINIMUM SIZE OF 10" BY 10" AND SHALL BE INSTALLED WITHIN 12" OF DAMPER. PROVIDE A REMOVABLE DUCT SECTION WHERE DUCT SIZE IS TOO SMALL FOR A 10" BY 10" ACCESS DOOR.
17	PROVIDE A MANUAL BALANCING DAMPER IN EACH BRANCH DUCT TAKEOFF FROM MAIN SUPPLY, RETURN, OUTDOOR AND EXHAUST AIR DUCTS.
18	PROVIDE A PREFABRICATED 45 DEGREE, HIGH EFFICIENCY, RECTANGULAR/ROUND BRANCH DUCT TAKEOFF FITTING WITH MANUAL BALANCING DAMPER AND LOCKING QUADRANT FOR BRANCH DUCT CONNECTIONS AND TAKE-OFFS TO INDIVIDUAL DIFFUSERS, REGISTERS AND GRILLES.
19	BRANCH DUCTWORK TO AIR OUTLETS SHALL BE SAME SIZE AS OUTLET NECK SIZE UNLESS OTHERWISE NOTED.
20	RIGID DUCTWORK INSULATION: PROVIDE 3/4 LB DENSITY, 2" (R-5) THICK, INSULATION WRAP ON RIGID ROUND AND RECTANGULAR, CONCEALED, SUPPLY AND RETURN AIR DUCTS AND ON OUTSIDE AIR DUCTS. CONTRACTOR'S OPTION TO FURNISH AND INSTALL 1-1/2 LB DENSITY, 1-1/2" (R-5) THICK INTERNAL DUCT LINER ON RECTANGULAR SUPPLY AND RETURN AIR DUCTS IN LIEU OF DUCTWRAP. DUCT SIZES ON MECHANICAL PLANS INDICATE CLEAR INSIDE AIRFLOW DIMENSIONS. INCREASE SHEET METAL SIZES ACCORDINGLY.
21	CONTRACTOR'S OPTION TO SUBSTITUTE ROUND DUCT OF EQUAL FREE AREA FOR RECTANGULAR DUCT AND VICE VERSA. DIMENSIONS OF RECTANGULAR DUCT MAY BE ADJUSTED AS NECESSARY TO INSTALL DUCT IN AVAILABLE SPACE AS LONG AS FREE AREA IS MAINTAINED.
22	PROVIDE THERMAFLEX TYPE G-KM, M-KE, FLEXMASTER TYPE 8, OR APPROVED EQUAL FLEXIBLE DUCTWORK. FLEXIBLE DUCTWORK SHALL BE LISTED UNDER UL 181 AS CLASS 1 AIR DUCT AND BE PROVIDED WITH INTEGRAL R-5, 3/4 LB DENSITY FIBERGLASS INSULATION. FLEXIBLE DUCTWORK SHALL NOT EXCEED 5'-0" IN LENGTH AND SHALL BE INSTALLED AND SUPPORTED TO AVOID SHARP BENDS AND SAGGING.
23	FOR ALL EXPOSED DUCTWORK, PROVIDE DUCT THAT IS SUITABLE FOR PAINTING. ENSURE THAT ALL EXPOSED DUCTWORK IS PROPERLY PREPARED AND READY FOR PAINTING. COORDINATE COLOR WITH ARCHITECT.
24	PROVIDE A NEW SET OF AIR FILTERS IN UNITS PRIOR TO TESTING, ADJUSTING AND BALANCING AND BEFORE TURNING SYSTEM(S) OVER TO OWNER.
25	INSTALL EXPOSED PIPING AND DUCTWORK AS HIGH AS PRACTICAL IN ROOMS WITHOUT CEILINGS.
26	LOCATIONS OF PIPING, DUCTWORK AND EQUIPMENT AS INDICATED ON THE DRAWING, ARE APPROXIMATE AND SUBJECT TO MINOR ADJUSTMENTS IN THE FIELD. WORK SHALL BE COORDINATED WITH ALL OTHER TRADES TO AVOID INTERFERENCE IN THE FIELD.
27	REFER TO PLUMBING SERIES DRAWINGS FOR GAS AND A.C. CONDENSATE DRAIN PIPING.
28	ADJUST PIPING AND DUCTWORK SIZES TO PROPERLY CONNECT TO MECHANICAL EQUIPMENT.
29	LOCATE EQUIPMENT REQUIRING ACCESS 2'-0" MAXIMUM ABOVE CEILING.
30	ALL ROOF MOUNTED EQUIPMENT SHALL BE A MINIMUM 10'-0" FROM EDGE OF ROOF.
31	FINAL PRODUCT SHALL BE A COMPLETE AND FUNCTIONING SYSTEM, AND SHALL CONFORM TO ALL REQUIREMENTS OF APPLICABLE FEDERAL, STATE, AND LOCAL CODES, INCLUDING BUT NOT LIMITED TO THE INTERNATIONAL BUILDING CODE AND INTERNATIONAL MECHANICAL CODE.
32	IF HVAC CONTRACTOR DESIRES TO VALUE ENGINEER THE DUCT SYSTEM(S) DESIGN, THE HVAC CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO REVISE ALL AFFECTED CONSTRUCTION DOCUMENTS FOR RESUBMITTAL TO ALL APPROVING PARTIES. ANY DESIRE TO VALUE ENGINEER SHALL BE DOCUMENTED VIA A FORMAL R.F.I. DOCUMENT. HVAC CONTRACTOR TO COORDINATE PROPOSED CHANGES WITH ALL OTHER AFFECTED TRADES.

FINAL DOCUMENTATION

PROVIDE A ONE YEAR WARRANTY FOR ALL SYSTEMS, MATERIAL AND LABOR INCLUDING TRANSPORTATION AND TRAVEL TIME.

PROVIDE INSTRUCTION TO OWNER'S PERSONNEL FOR ALL SYSTEMS AND EQUIPMENT ON SITE. THIS INSTRUCTION SHALL BE FOR A MINIMUM OF TWO HOURS.

CONTRACTOR SHALL PROVIDE A BOOK AT FINAL INVOICE WITH ALL WARRANTIES, INSTRUCTION

ADA NOTES

LIGHT SWITCHES, ELECTRICAL OUTLETS, AND OTHER ENVIRONMENTAL CONTROLS SHALL HAVE OPERABLE PARTS TO THE CONTROLS NO HIGHER THAN 48" AND NO LOWER THAN 15", A.F.F.



ABBREVIATIONS

&	AND	ID	INDIRECT
Ø	ROUND	IN	INCH
A	AIR	INL	INLET
AB	ABOVE BASE	INSUL	INSULATION
AC	ACOVE	INT	INTERIOR
ACOUS	AIR CONDITIONING	INV	INVERT
ADD	ACUSTICAL	INWG	INCHES WATER GAUGE
ADD	AREA DRAIN	JST SPC	JOIST SPACE
ADD	ADDENDUM	JOINT	JOINT
ADDL	ADDITIONAL	LAB	LABORATORY
AF	ABOVE FINISHED FLOOR	LB	POUND
AFUE	ANNUAL FUEL UTILIZATION EFFICIENCY	LBHR	POUNDS PER HOUR
AG	ABOVE GROUND	LAT	LEAVING AIR TEMPERATURE
ALT	ALTERNATE	LF	LINEAL FOOT
ALUM	ALUMINUM	LOC	LOCATION
AP	ACCESS PANEL	LP	LOW PRESSURE
APPROX	APPROXIMATE	LPG	LIQUEFIED PETROLEUM GAS
ARCH	ARCHITECT/ARCHITECTURAL	LR	LIQUID REFRIGERANT
AV	ACID RESISTANT VENT	LVR	LAWN SPRINKLER
AW	ACID RESISTANT WASTE	LOUVER	LOUVER
AUTO	AUTOMATIC	LWT	LEAVING WATER TEMPERATURE
BLDG	BELOW FINISHED FLOOR	M/A	MIXED AIR
BLW	BELOW	MAN	MANUAL
BM	BEAM	MATL	MATERIAL
BO	BY OTHER	MAV	MANUAL AIR VENT
BOT	BOTTOM	MAX	MAXIMUM
BSMT	BASEMENT	MBD	MOTORIZED BYPASS DAMPER
BTU	BRITISH THERMAL UNITS	MBH	ONE THOUSAND BTU PER HOUR
BTUH	BRITISH THERMAL UNITS PER HOUR	MCF	ONE THOUSAND CUBIC FEET
BTWN	BETWEEN	MCW	MAKE-UP COLD WATER
CAP	CAPACITY	MD	MOTORIZED DAMPER
CB	CATCH BASIN	MECH	MECHANICAL
CCW	COUNTER CLOCKWISE	MFR	MANUFACTURER
CFCV	CONSTANT FLOW CONTROL VALVE	MH	MANHOLE
CFM	CUBIC FEET PER MINUTE	MIN	MINIMUM
CHW	CIRCULATING HOT WATER	MISC	MISCELLANEOUS
CI	CAST IRON	MTR	MOTOR
CLG	CEILING	MU/A	MAKE-UP/AIR
CLG	CEILING	NECK	NECK
CO	COOLING	NC	NOISE CRITERIA
CO	CLEAN OUT	NC	NORMALLY CLOSED
COL	COLUMN	NIC	NOT IN CONTRACT
COMB	COMBINATION	NO	NUMBER
CONC	CONCRETE	NO	NORMALLY OPEN
COND	CONDENSATE	NOM	NOMINAL
CONF	CONFERENCE	NTS	NOT TO SCALE
CONN	CONNECTION	O	OXYGEN
CONST	CONSTRUCTION	O/A	OUTSIDE AIR
CONT	CONTINUE/CONTINUATION	OC	ON CENTER
CONTR	CONTRACTOR/CONTRACTOR	OF	OVERFLOW
COORD	COORDINATE	OPNG	OPENING
CTR	CENTER	ORD	OVERFLOW ROOF DRAIN
CUFT	CUBIC FEET	PD	PRESSURE DROP
CV	CHECK VALVE	PIV	POST INDICATOR VALVE
CW	COLD WATER	PLBG	PLUMBING
OW	CLOCKWISE	PR	PAIR
D	DEGREE	PREL	PRELIMINARY
DB	DRY BULB	PRESS	PRESSURE
DET	DETAIL	PRIM	PRIMARY
DIA	DIAMETER	PRV	PRESSURE REDUCING VALVE
DIAG	DIAGONAL	PSI	POUNDS PER SQUARE INCH
DISCH	DISCHARGE	PSIG	POUNDS PER SQUARE INCH GAUGE
DIV	DIVISION	PW	POTABLE WATER
DI	DEIONIZED WATER	PWR	POWER
DMPR	DAMPER	R	DUCT RISER
DN	DOWN	R/A	RETURN AIR
DWG	DRAWING	RCP	RAISED CEILING PANEL
DW	DISTILLED WATER	RD	ROOF DRAIN
EA	EACH	REC	RECESSED
EAT	ENTERING AIR TEMPERATURE	RED	REDUCER
EL	ELBOW	REFR	REFRIGERATION
ELEC	ELECTRICAL	RH	RELATIVE HUMIDITY
ELEV	ELEVATION	REQD	REQUIRED
EP	EXPLOSION PROOF	REV	REVERSE
EQ	EQUAL	R/LA	RELIEF AIR
EQUIP	EQUIPMENT	RM	ROOM
EWC	ELECTRIC WATER COOLER	RPM	REVOLUTIONS PER MINUTE
EWIT	ENTERING WATER TEMPERATURE	RW	RAIN WATER
E/A	EXHAUST AIR	SF	SQUARE FOOT
EAH	EXHAUST HOOD	S/A	SUPPLY AIR
EXIST	EXISTING	SAN	SANITARY
EXP	EXPANSION	SCHED	SCHEDULE
EXPT	EXPANSION JOINT	SECT	SECTION
EXT	EXTERIOR	SF	SQUARE FOOT
F	DEGREES FAHRENHEIT	SD	SMOKE DAMPER
FCO	FLOOR CLEAN OUT	SHT	SHEET
FD	FLOOR DRAIN	SIM	SIMILAR
FD	FIRE DAMPER	SLV	SLEEVE
FDV	FIRE DEPARTMENT VALVE	SM	SURFACE MOUNT
FHC	FIRE HOSE CABINET	SP	STANDPIPE
FL	FLOOR	SP	STATIC PRESSURE
FLEX	FLEXIBLE	SPEC	SPECIFICATION
FLG	FLANGE	SPS	STATIC PRESSURE STATION
FO	FUEL OIL	SQ	SQUARE
FOV	FUEL OIL VENT	SR	SUCTION REFRIGERANT
FOR	FUEL OIL RETURN	SSD	SOIL SUBDRAIN
FOS	FUEL OIL SUPPLY	SS	STAINLESS STEEL
FPM	FEET PER MINUTE	STD	STANDARD
FRP	FIBERGLASS REINFORCED PIPE	STM	STEAM
FS	FULL SIZE	STRUCT	STRUCTURAL
FS	FLOOR SINK	SUCT	SUCTION
FT	FOOT/FEET	SUSP	SUSPENDED
FTG	FOOTING	T	THERMOSTAT
FTR	FIN TUBE RADIATION	TCP	TEMPERATURE CONTROL PANEL
FUT	FUTURE	TD	TEMPERATURE DROP
GA	GAGE/GAUGE	TDR	TRENCH DRAIN
GAL	GALLON	TEMP	TEMPERATURE
GALV	GALVANIZED	TYP	TYPICAL
GC	GENERAL CONTRACTOR	UFD	UNDER FLOOR DUCT
GEN	GENERATOR	UG	UNDERGROUND
GENL	GENERAL	UCN	UNLESS OTHERWISE NOTED
GPH	GALLONS PER MINUTE	VAC	VACUUM
GR	GRADE	V	VENT
GW	GREASE WASTE	VAV	VARIABLE AIR VOLUME
HB	HOSE BIB	VEL	VELOCITY
HD	HEAD	VENT	VENTILATION
HORZ	HORIZONTAL	VERT	VERTICAL
HP	HORSE POWER	VOL	VOLUME
HP	HIGH PRESSURE	VTR	VENT THROUGH ROOF
HTG	HEATING	W	WASTE
HTR	HEATER	WB	WET BULB
HW	HOT WATER	WCO	WALL CLEAN OUT
HYD	HYDRANT	WH	WALL HYDRANT


EQUIPMENT ABBREVIATIONS

AC	AIR CONDITIONING UNIT	FP	FIRE PUMP
ACC	AIR COOLED CONDENSER	GI	GREASE INTERCEPTOR
AFMS	AIR FLOW MEASURING STATION	GRV	GRAVITY ROOF VENTILATOR
AHU	AIR HANDLING UNIT	H	HUMIDIFIER
AS	AIR SEPARATOR	HWP	HEATING WATER PUMP
B	BOILER	HX	HEAT EXCHANGER
CF	CABINET FAN	HPU	HEAT PUMP UNIT
CF	CHEMICAL FEEDER	HRU	HEAT RECOVERY UNIT
CFP	CHEMICAL FEEDER PUMP	ILC	INLINE CENTRIFUGAL
CH	CHILLER	PF	PROPELLER FAN
CRU	CONDENSATE RETURN UNIT	PRV	POWER ROOF VENTILATOR
CT	COOLING TOWER	PWF	POWER WALL FAN
CU	AIR COOLING CONDENSING UNIT	RE	RETURN/EXHAUST FAN
CUH	CABINET UNIT HEATER	RTU	ROOFTOP UNIT
CWP	CONDENSER WATER PUMP	SA	SHOCK ABSORBER
CHWP	CHILLED WATER PUMP	SAT	SOUND ATTENUATOR
DBP	DOMESTIC WATER BOOSTER PUMP	SEP	SEWAGE EJECTOR PUMP
DC	DUCT MOUNTED COIL	SF	SUPPLY FAN
DCP	DOMESTIC WATER CIRCULATING PUMP	SP	SUMP PUMP
EF	EXHAUST FAN	UH	UNIT HEATER
EDC	ELECTRIC DUCT COIL	UTL	UTILITY SET
ET	EXPANSION TANK	UV	UNIT VENTILATOR
EWH	ELECTRIC WATER HEATER	WFMS	WATER FLOW MEASURING STATION
FCU	FAN COIL UNIT	WH	WATER HEATER

HVAC SYMBOLS

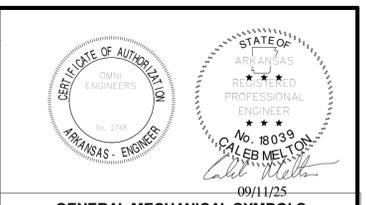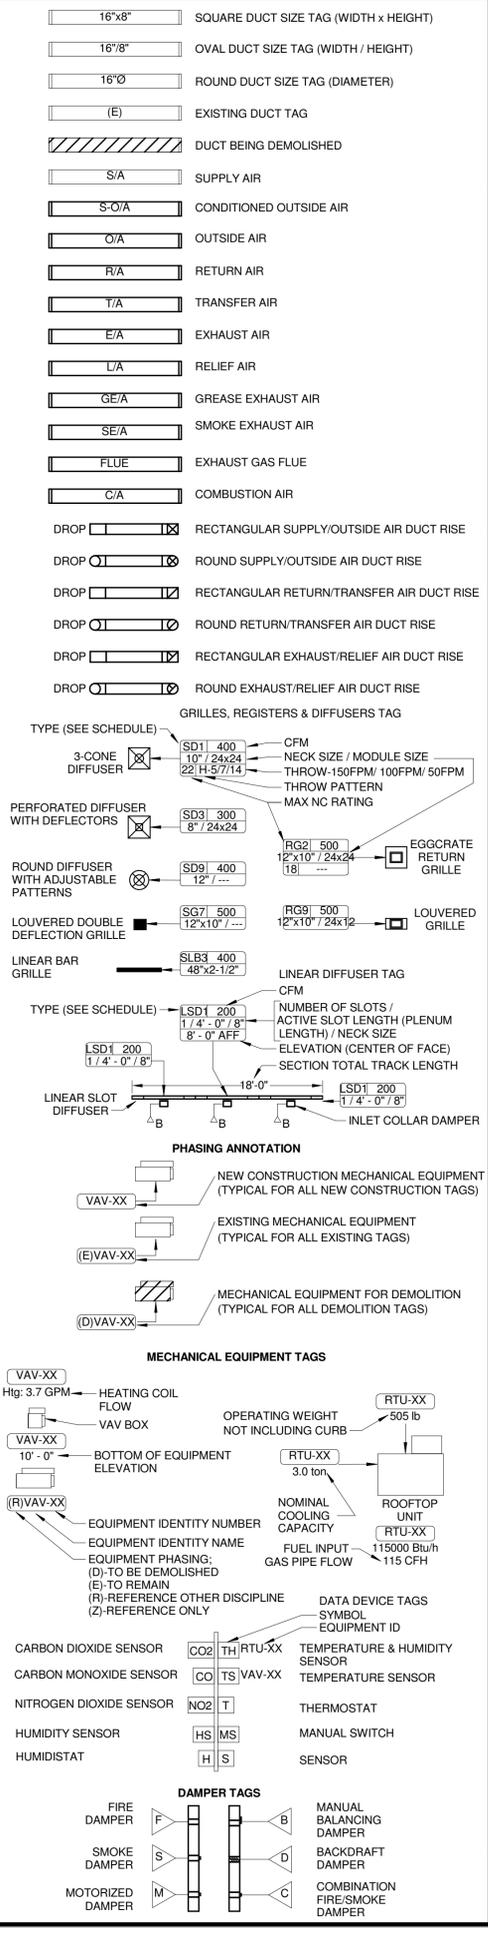

GENERAL MECHANICAL SYMBOLS

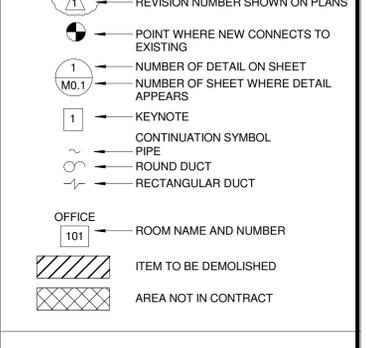

DATE	09/11/25
JOB NO.	25089
REVISIONS	
M.O.1	
MECHANICAL TITLE SHEET	

* NOTE *
ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER DRAWINGS IN THIS SET. THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THIS SET OF DRAWINGS.

EXHAUST FAN SCHEDULE												
ID	MANUFACTURER	MODEL	AIRFLOW	RPM	DRIVE TYPE	TOTAL STATIC PRESSURE	MOTOR POWER	INLET SONES	UNIT WEIGHT	VOLT	PHASE	NOTES
EF	GREENHECK	SP-B110	70	729	DIRECT	.375 IN-WG.	80W	1.5	12 LB	115 V	1	A-D,1,2,5-7


NOTES		ACCESSORIES:	
A.	DIVISION 16 CONTRACTOR TO PROVIDE DISCONNECT SWITCH.	1	PROVIDE BACKDRAFT DAMPER.
B.	NOT USED	2	PROVIDE MANUFACTURER'S ROOF JACK WITH ADAPTER.
C.	INTERLOCK FAN OPERATION WITH LIGHTING CONTROLS.	3	PROVIDE SPUN ALUMINUM VEN CAP. COOK MODEL "PR" WITH ROOF CURB.
D.	ROUTE EXHAUST TO ROOF AND MAINTAIN MINIMUM 10' CLEARANCE FROM ALL FRESH AIR INTAKES.	4	PROVIDE MANUFACTURER'S BRICK VENT.
		5	PROVIDE MANUFACTURER'S WHITE ALUMINUM GRILLE.
		6	PROVIDE BIRD SCREEN.
		7	PROVIDE ISOLATOR KIT.
		8	PROVIDE MANUFACTURER'S WALL CAP.
		9	PROVIDE GREASE COLLECTION CUP.
		10	PROVIDE THERMOSTAT, SET TO 80°F.

RTU SCHEDULE																		
ID	MANUFACTURER	MODEL	OUTSIDE AIR FLOW	TOTAL CFM	NOMINAL TONS	TOTAL STATIC PRESSURE	COOLING CAPACITY		HEAT		SEER2	REFRIGERANT TYPE	UNIT WEIGHT	ELECTRICAL				NOTES
							TOTAL	SENSIBLE	INPUT	OUTPUT				MCA	MOC	VOLT	PHASE	
RTU 1	GOODMAN	GPGM54810031	130	1325	4	0.5	46 MBH	32.6 MBH	100 MBH	81 MBH	15.2	R-32	400	35.8	50	240	1	A-J



NOTES	
A.	PROVIDE 2", 30% EFFICIENT PLEATED THROWAWAY FILTER WITH EACH UNIT.
B.	PROVIDE WITH CURB MOUNTED UNIT SCREENING
C.	NOT USED
D.	PROVIDE LOW AMBIANT KIT
E.	OUTDOOR AMBIANT DESIGN TEMPERATURE 95°F.
F.	SPECIFIED FAN ESP ACCOUNTS FOR DUCT LOSSES EXTERNAL TO UNIT.
G.	STARTERS FOR ALL MOTORS SHALL BE FURNISHED INTEGRAL WITH UNIT.
H.	PROVIDE FACTORY MOUNTED DISCONNECT AND SWITCH AND SINGLE POINT POWER CONNECTION.
I.	COORDINATE SIZE OF CONDUCTOR TERMINATION LUGS WITH CONDUCTOR SIZES SHOWN ON ELECTRICAL DRAWINGS.
J.	PROVIDE WITH 7 DAY A WEEK PROGRAMMABLE THERMOSTAT

GRILLES, REGISTERS, AND DIFFUSERS								
ID	MANUFACTURER	MODEL	MATERIAL	NOISE CRITERIA	PRESSURE TOTAL	INSTALLATION TYPE	SPECIFICATION	NOTES
RG1	PRICE	80	ALUMINUM	30 MAX	0.10 in-wg	GYP/SIDEWALL	1/2"x1/2"x1/2" EGGCRATE GRID	C,E-G
SD1	PRICE	ASCD	ALUMINUM	30 MAX	0.10 in-wg	GYP	24"x24" HIGH PERFORMANCE 3-CONE DIFFUSER	A-F

NOTES	
A.	NECK SIZE SHOWN ON DRAWINGS.
B.	BRANCH DUCT SIZE SHALL BE SAME AS NECK SIZE UNLESS OTHERWISE SHOWN ON DRAWINGS.
C.	BAKED ENAMEL FINISH, WHITE TO MATCH CEILING COLOR (IF DUCT MOUNTED, THEN PAINT SAME COLOR AS DUCTWORK).
D.	PROVIDE NECK ADAPTER FOR DUCT CONNECTION.
E.	FRAME TYPE TO MATCH CEILING CONSTRUCTION, COORDINATE WITH ARCHITECTURAL REFLECTED CEILING PLAN.
F.	ALUMINUM CONSTRUCTION.
G.	BLADES PARALLEL TO LONG DIMENSION.
H.	FACE SIZE VARIES WITH NECK SIZE.

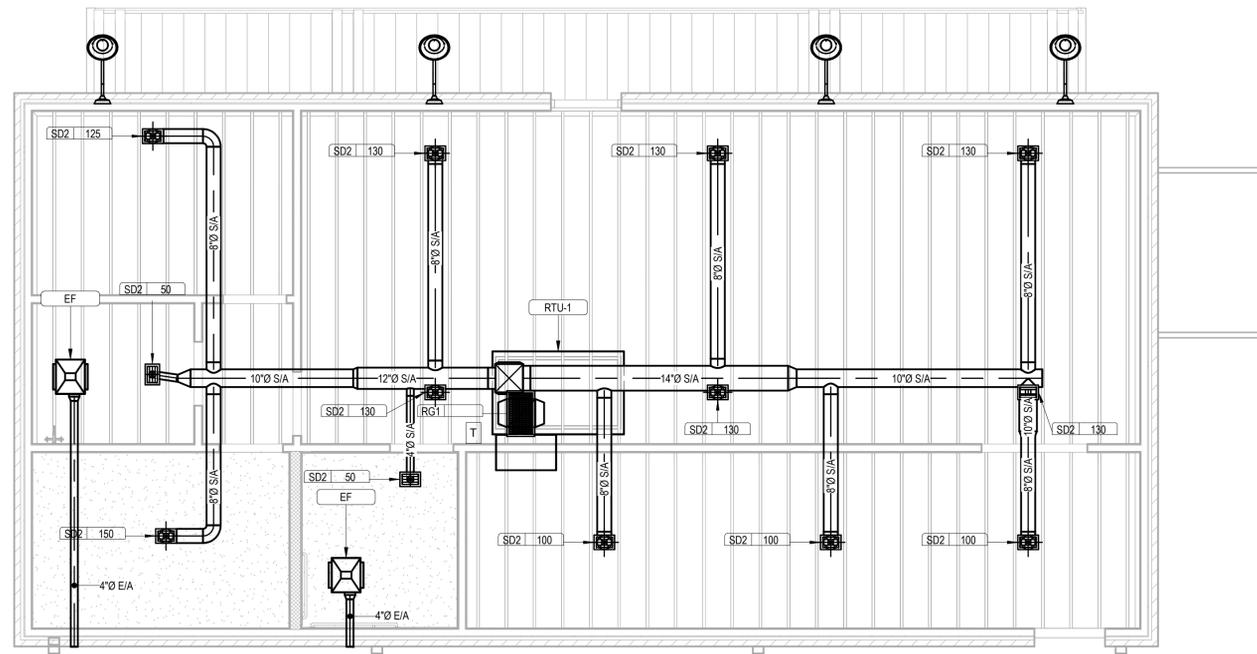

1 HVAC PLAN LEVEL 1
M1.0
1/4" = 1'-0"

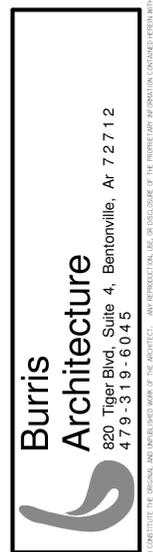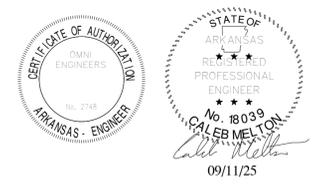

DATE 09/11/25
JOB NO. 25089
REVISIONS


M1.0
HVAC PLAN

THIS DRAWING IS PROVIDED AS AN INFORMATIONAL SERVICE BY THE ARCHITECT AND SHALL BE USED FOR INFORMATIONAL PURPOSES ONLY. THE ARCHITECT SHALL BE RESPONSIBLE FOR VERIFYING ALL INFORMATION SHOWN ON THIS DRAWING. ALL DRAWINGS REMAIN THE PROPERTY OF THE ARCHITECT AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT. PROJECT NO. 25089, DATE 09/11/25.




STATE OF ARKANSAS
 REGISTERED PROFESSIONAL ENGINEER
 No. 18039
 CALEB MELTON
 09/11/25


OMN ENGINEERS
 PO BOX 2106
 LOVELL, AR 72745
 479-696-7873

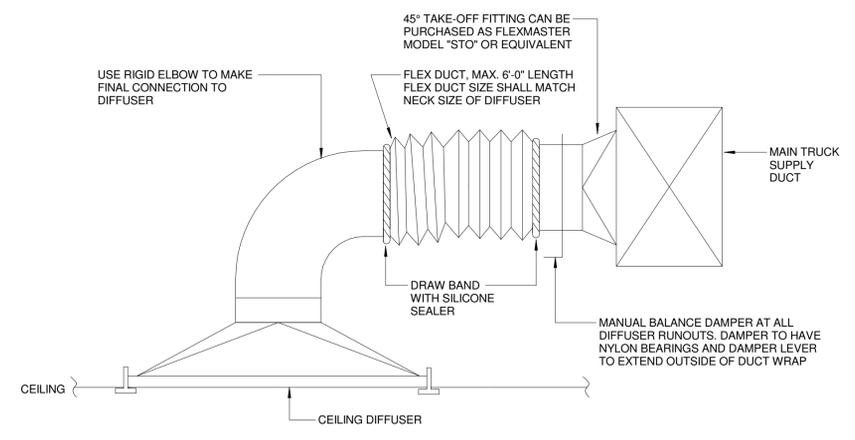


3 M2.0 DIFFUSER-TYPICAL CONNECTION
 SCALE: N.T.S.

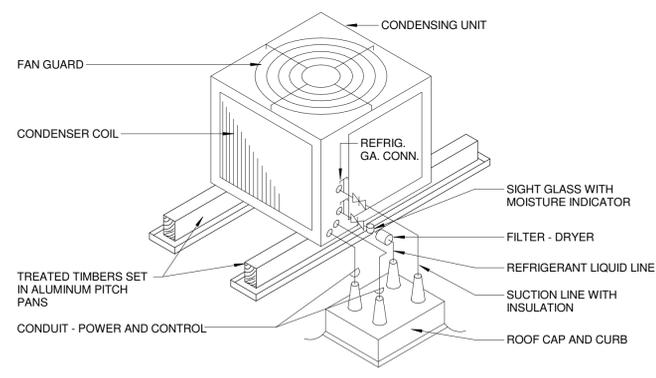


2 M2.0 Detail M-CU-Generic-Rooftop Mtd.
 SCALE: N.T.S.

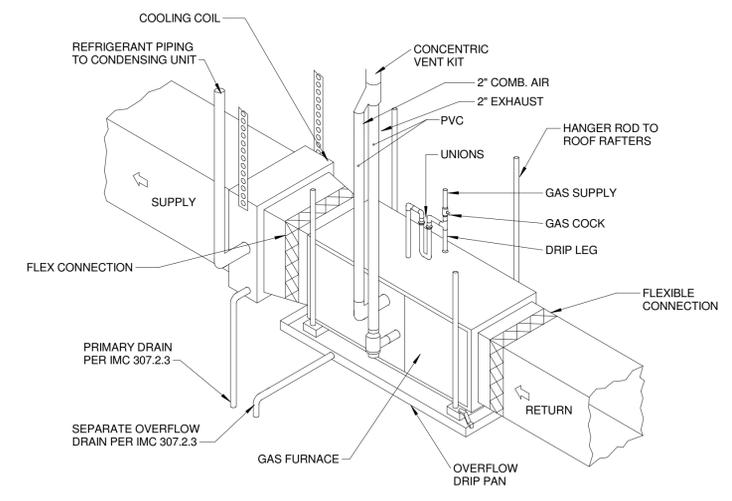

1 M2.0 AHU-HORIZONTAL-GAS CONCENTRIC FLUE KIT
 SCALE: N.T.S.

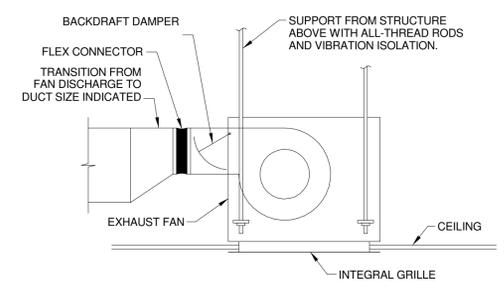


5 M2.0 Detail M-Exhaust Fan-Ceiling-Side Discharge
 N.T.S.

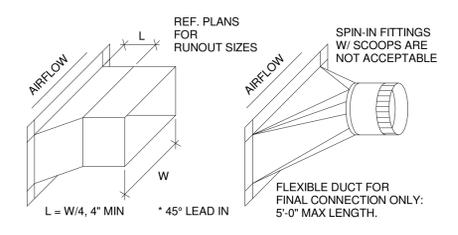

6 M2.0 BRANCH DUCT FITTING
 N.T.S.

- NOTES:
 1. REFER TO HVAC FLOOR PLANS FOR DUCT SIZES
 2. REFER TO SCHEDULES FOR GRILLES, REGISTERS, DIFFUSERS AND TERMINAL SIZES AND TYPES
 3. PROVIDE A MANUAL TYPE BALANCING DAMPER FOR EACH SUPPLY OUTLET AND RETURN INLET
 4. ALL DUCT RUNOUTS TO DIFFUSERS SHALL BE THE SAME SIZE AS DIFFUSER NECK SIZE, UNLESS OTHERWISE NOTED
 5. FLEX DUCT WILL NOT BE ALLOWED ON RETURN OR EXHAUST DUCTWORK SYSTEMS
 6. PROVIDE 12" AIR CUSHION AT THE END OF EACH SUPPLY MAIN AND BRANCH DUCT
 7. INDIVIDUAL BRANCH BALANCING DAMPERS NOT REQUIRED FOR SUPPLY OR EXHAUST REGISTERS

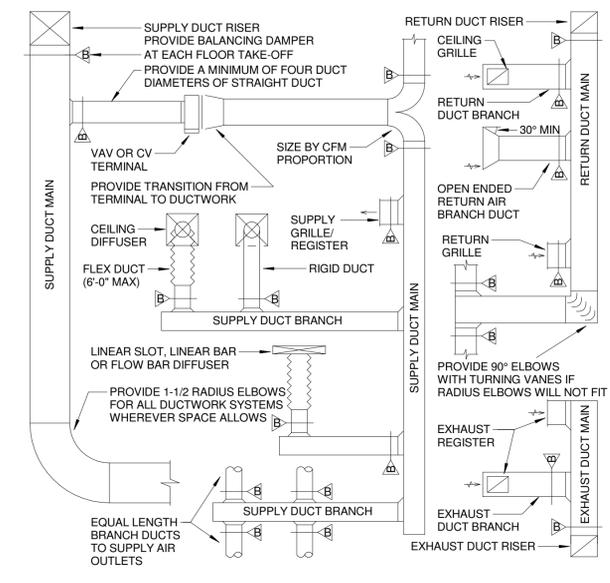

4 M2.0 DUCTWORK INSTALLATION DIAGRAM
 NO SCALE

Burris Architecture
 820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
 479-319-6045

SMOKE
 730 E MAIN ST
 FARMINGTON, AR

DATE: 09/11/25
 JOB NO: 25089
 REVISIONS:

M2.0
 MECHANICAL DETAILS

MECHANICAL SPECIFICATIONS

MECHANICAL SPECIFICATIONS

DIVISION 15

15A: GENERAL

1.1 GENERAL REQUIREMENTS

REQUIREMENTS UNDER DIVISION ONE AND THE GENERAL AND SUPPLEMENTARY CONDITIONS OF THESE SPECIFICATIONS SHALL BE A PART OF THIS SECTION. THE CONTRACTOR SHALL BECOME THOROUGHLY ACQUAINTED WITH ITS CONTENTS AS TO REQUIREMENTS THAT AFFECT THIS DIVISION OR SECTION. THE WORK REQUIRED UNDER THIS SECTION INCLUDES MATERIAL, EQUIPMENT, APPLIANCES, TRANSPORTATION, SERVICES, AND LABOR REQUIRED TO COMPLETE THE ENTIRE SYSTEM AS REQUIRED BY THE DRAWINGS AND SPECIFICATIONS.

THE SPECIFICATIONS AND DRAWINGS FOR THE PROJECTS ARE COMPLEMENTARY, AND PORTIONS OF THE WORK DESCRIBED IN ONE, SHALL BE PROVIDED AS IF DESCRIBED IN BOTH. IN THE EVENT OF DISCREPANCIES, NOTIFY THE ENGINEER AND/OR OWNER AND REQUEST CLARIFICATION PRIOR TO PROCEEDING WITH THE WORK INVOLVED.

1.2 INSPECTION OF SITE

PRIOR TO SUBMITTING BID, VISIT THE SITE OF THE PROPOSED WORK AND BECOME FULLY INFORMED AS TO THE CONDITIONS UNDER WHICH THE WORK IS TO BE DONE. FAILURE TO DO SO WILL NOT BE CONSIDERED SUFFICIENT JUSTIFICATION TO REQUEST OR OBTAIN EXTRA COMPENSATION OVER AND ABOVE THE CONTRACT PRICE.

1.3 MATERIAL AND WORKMANSHIP

WARRANT EACH SYSTEM AND EACH ELEMENT THEREOF AGAINST ALL DEFECTS DUE TO FAULTY WORKMANSHIP, DESIGN, OR MATERIAL FOR A PERIOD OF 12 MONTHS FROM DATE OF SUBSTANTIAL COMPLETION, UNLESS SPECIFIC ITEMS ARE NOTED TO CARRY A LONGER WARRANTY IN THE CONSTRUCTION DOCUMENTS OR MANUFACTURER'S STANDARD WARRANTY EXCEEDS 12 MONTHS. REMEDY ALL DEFECTS, OCCURRING WITHIN THE WARRANTY PERIOD(S), AS STATED IN THE GENERAL CONDITIONS AND DIVISION 1.

WARRANTIES SHALL INCLUDE LABOR AND MATERIAL. MAKE REPAIRS OR REPLACEMENTS WITHOUT ANY ADDITIONAL COSTS TO THE OWNER.

PERFORM THE REMEDIAL WORK PROMPTLY, UPON WRITTEN NOTICE FROM THE ENGINEER OR OWNER.

AT THE TIME OF SUBSTANTIAL COMPLETION, DELIVER TO THE OWNER ALL WARRANTIES, IN WRITING AND PROPERLY EXECUTED, INCLUDING TERM LIMITS FOR WARRANTIES EXTENDING BEYOND THE ONE YEAR PERIOD, EACH WARRANTY INSTRUMENT BEING ADDRESSED TO THE OWNER AND STATING THE COMMENCEMENT DATE AND TERM.

PERFORM CUTTING OF WALLS, FLOORS, CEILING, ETC. AS REQUIRED TO INSTALL WORK UNDER THIS SECTION. OBTAIN PERMISSION FROM THE ARCHITECT PRIOR TO CUTTING. DO NOT CUT OR DISTURB STRUCTURAL MEMBERS WITHOUT PRIOR APPROVAL FROM THE ARCHITECT. CUT HOLES AS SMALL AS POSSIBLE. GENERAL CONTRACTOR SHALL PATCH WALLS, FLOORS, ETC. AS REQUIRED BY WORK UNDER THIS SECTION. PATCHING SHALL MATCH THE ORIGINAL MATERIAL AND CONSTRUCTION. REPAIR AND REFINISH AREAS DISTURBED BY WORK TO THE CONDITION OF ADJOINING SURFACES IN A MANNER SATISFACTORY TO THE ARCHITECT.

PERFORM CUTTING OF WALLS, FLOORS, CEILING, ETC. AS REQUIRED TO INSTALL WORK UNDER THIS SECTION. OBTAIN PERMISSION FROM THE ARCHITECT PRIOR TO CUTTING. DO NOT CUT OR DISTURB STRUCTURAL MEMBERS WITHOUT PRIOR APPROVAL FROM THE ARCHITECT. CUT HOLES AS SMALL AS POSSIBLE. GENERAL CONTRACTOR SHALL PATCH WALLS, FLOORS, ETC. AS REQUIRED BY WORK UNDER THIS SECTION. PATCHING SHALL MATCH THE ORIGINAL MATERIAL AND CONSTRUCTION. REPAIR AND REFINISH AREAS DISTURBED BY WORK TO THE CONDITION OF ADJOINING SURFACES IN A MANNER SATISFACTORY TO THE ARCHITECT.

1.4 COORDINATION

COORDINATE WORK WITH THAT OF OTHER TRADES SO THAT THE VARIOUS COMPONENTS OF THE SYSTEMS WILL BE INSTALLED AT THE PROPER TIME, WILL FIT THE AVAILABLE SPACE, AND WILL ALLOW PROPER SERVICE ACCESS TO THOSE ITEMS REQUIRING MAINTENANCE. COMPONENTS WHICH ARE INSTALLED WITHOUT REGARD TO THE ABOVE SHALL BE RELOCATED AT NO ADDITIONAL COST TO THE OWNER.

UNLESS OTHERWISE INDICATED, THE GENERAL CONTRACTOR WILL PROVIDE CHASES AND OPENINGS IN BUILDING CONSTRUCTION REQUIRED FOR INSTALLATION OF THE SYSTEMS SPECIFIED HEREIN. THE CONTRACTOR SHALL FURNISH THE GENERAL CONTRACTOR WITH INFORMATION WHERE CHASES AND OPENINGS ARE REQUIRED. KEEP INFORMED AS TO THE WORK OF OTHER TRADES ENGAGED IN THE CONSTRUCTION OF THE PROJECT, AND EXECUTE WORK IN A MANNER AS TO NOT INTERFERE WITH OR DELAY THE WORK OF OTHER TRADES.

FIGURED DIMENSIONS SHALL BE TAKEN IN PREFERENCE TO SCALE DIMENSIONS. CONTRACTOR SHALL TAKE HIS OWN MEASUREMENTS AT THE BUILDING, AS VARIATIONS MAY OCCUR. CONTRACTOR WILL BE HELD RESPONSIBLE FOR ERRORS THAT COULD HAVE BEEN AVOIDED BY PROPER CHECKING AND INSPECTION.

PROVIDE MATERIALS WITH TRIM THAT WILL PROPERLY FIT THE TYPES OF CEILING, WALL, OR FLOOR FINISHES ACTUALLY INSTALLED. MODEL NUMBERS LISTED IN THE SPECIFICATIONS OR SHOWN ON THE DRAWINGS ARE NOT INTENDED TO DESIGNATE THE REQUIRED TRIM.

THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR DUCTWORK LAYOUT TO THE CONSTRUCTION MANAGER FOR OWNER APPROVAL PRIOR TO INSTALLATION.

1.5 ORDINANCES AND CODES

WORK PERFORMED UNDER THIS CONTRACT SHALL, AT A MINIMUM, BE IN CONFORMANCE WITH APPLICABLE NATIONAL, STATE, AND LOCAL CODES HAVING JURISDICTION. EQUIPMENT FURNISHED AND ASSOCIATED INSTALLATION WORK PERFORMED UNDER THIS CONTRACT SHALL BE IN STRICT COMPLIANCE WITH CURRENT APPLICABLE CODES ADOPTED BY THE LOCAL AHJ INCLUDING ANY AMENDMENTS AND STANDARDS AS SET FORTH BY THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), UNDERWRITERS LABORATORIES (UL), OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA), AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME), AMERICAN SOCIETY OF HEATING, REFRIGERATION, AND AIR CONDITIONING ENGINEERS (ASHRAE), AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), AMERICAN SOCIETY OF TESTING MATERIALS (ASTM), AND OTHER NATIONAL STANDARDS AND CODES WHERE APPLICABLE. WHERE THE CONTRACT DOCUMENTS EXCEED THE REQUIREMENTS OF THEIR REFERENCED CODES, STANDARDS, ETC., THE CONTRACT DOCUMENTS SHALL TAKE PRECEDENCE.

PROCURE AND PAY FOR PERMITS AND LICENSES REQUIRED FOR THE ACCOMPLISHMENT OF THE WORK HEREIN DESCRIBED. WHERE REQUIRED, OBTAIN, PAY FOR, AND FURNISH CERTIFICATES OF INSPECTION TO THE OWNER. THE CONTRACTOR WILL BE HELD RESPONSIBLE FOR VIOLATIONS OF THE LAW.

1.6 PROTECTION OF EQUIPMENT AND MATERIALS

STORE AND PROTECT FROM DAMAGE EQUIPMENT AND MATERIALS DELIVERED TO JOB SITE. COVER WITH WATERPROOF, TEAR-RESISTANT, HEAVY TARP OR POLYETHYLENE PLASTIC AS REQUIRED TO PROTECT FROM PLASTER, DIRT, PAINT, WATER, OR PHYSICAL DAMAGE. EQUIPMENT AND MATERIAL THAT HAS BEEN DAMAGED BY CONSTRUCTION ACTIVITIES WILL BE REJECTED, AND CONTRACTOR IS OBLIGATED TO FURNISH NEW EQUIPMENT AND MATERIAL OF A LIKE KIND AS APPROVED BY OWNER.

KEEP PREMISES CLEAN FROM FOREIGN MATERIAL CREATED DURING WORK PERFORMED UNDER THIS CONTRACT. PIPING, EQUIPMENT, ETC., SHALL HAVE A NEAT AND CLEAN APPEARANCE AT THE TERMINATION OF THE WORK.

PLUG OR CAP OPEN ENDS OF DUCTWORK AND PIPING SYSTEMS WHILE STORED OR INSTALLED DURING CONSTRUCTION WHEN NOT IN USE TO PREVENT THE ENTRANCE OF DEBRIS INTO THE SYSTEMS.

1.7 SUBSTITUTIONS

THE BASE BID SHALL INCLUDE ONLY THE PRODUCTS FROM MANUFACTURERS SPECIFICALLY NAMED IN THE DRAWINGS AND SPECIFICATIONS. NO SUBSTITUTION WILL BE CONSIDERED PRIOR TO RECEIPT OF BIDS UNLESS WRITTEN REQUEST FOR APPROVAL TO BID HAS BEEN RECEIVED BY THE ENGINEER AT LEAST TEN CALENDAR DAYS PRIOR TO THE DATE FOR RECEIPT OF BIDS. EACH SUCH REQUEST SHALL INCLUDE THE NAME OF THE MATERIAL OR EQUIPMENT FOR WHICH IT IS TO BE SUBSTITUTED AND A COMPLETE DESCRIPTION OF THE PROPOSED SUBSTITUTE INCLUDING DRAWINGS, CUTS, PERFORMANCE AND TEST DATA AND OTHER INFORMATION NECESSARY FOR AN EVALUATION. A STATEMENT SETTING FORTH CHANGES IN OTHER MATERIALS, EQUIPMENT OR OTHER WORK THAT INCORPORATION OF THE SUBSTITUTE WOULD REQUIRE SHALL BE INCLUDED. THE BURDEN OF PROOF OF THE MERIT OF THE PROPOSED SUBSTITUTE IS UPON THE PROPOSER. THE ENGINEER'S DECISION OF APPROVAL OR DISAPPROVAL TO BID OF A PROPOSED SUBSTITUTION SHALL BE FINAL.

THE TERMS "APPROVED", "APPROVED EQUAL", AND "EQUAL" REFER TO APPROVAL BY THE ENGINEER AS AN ACCEPTABLE ALTERNATE BID. NO SUBSTITUTIONS WILL BE CONSIDERED THAT ARE NOT BID AS AN ALTERNATE. NO MATERIAL SUBSTITUTIONS SHALL BE CONSIDERED FOR APPROVAL PRIOR TO AWARD OF CONTRACT.

COORDINATE AND VERIFY WITH OTHER TRADES WHETHER OR NOT THE SUBSTITUTED EQUIPMENT CAN BE INSTALLED AS SHOWN ON THE CONSTRUCTION DRAWINGS WITHOUT MODIFICATION TO ASSOCIATED SYSTEMS OR ARCHITECTURAL OR ENGINEERING DESIGN. INCLUDE ADDITIONAL COSTS FOR ARCHITECTURAL AND ENGINEERING DESIGN FEES IN BID IF DRAWING MODIFICATIONS ARE REQUIRED BECAUSE OF SUBSTITUTED EQUIPMENT.

1.8 OPERATION AND MAINTENANCE INSTRUCTIONS

COLLECT AND COMPILE A COMPLETE BROCHURE OF FIXTURES, MATERIALS, AND EQUIPMENT FURNISHED AND INSTALLED ON THIS PROJECT. INCLUDE OPERATIONAL AND MAINTENANCE INSTRUCTIONS, MANUFACTURER'S CATALOG SHEETS, WIRING DIAGRAMS, PARTS LISTS, APPROVED SHOP DRAWINGS, AND DESCRIPTIVE LITERATURE FURNISHED BY THE MANUFACTURER. INCLUDE AN INSIDE COVER SHEET THAT LISTS THE PROJECT NAME, DATE, OWNER, ARCHITECT, ENGINEER, GENERAL CONTRACTOR, SUBCONTRACTOR, AND AN INDEX OF CONTENTS.

SUBMIT COPIES OF LITERATURE BOUND IN APPROVED BINDERS TO THE ARCHITECT AND OWNER AT THE TERMINATION OF THE WORK. PAPER CLIPS, STAPLES, RUBBER BANDS, AND MAILING ENVELOPES ARE NOT CONSIDERED APPROVED BINDERS. FINAL APPROVAL OF MECHANICAL SYSTEMS WILL BE WITHHELD UNTIL THIS EQUIPMENT BROCHURE IS DEEMED COMPLETE BY THE ARCHITECT, ENGINEER, AND OWNER.

1.9 SPARE PARTS

FURNISH TO OWNER, WITH RECEIPT, THE FOLLOWING SPARE PARTS FOR THE EQUIPMENT FURNISHED FOR THIS PROJECT:

ONE SET OF SPARE FILTERS OF EACH TYPE REQUIRED FOR EACH UNIT. IN ADDITION TO THE SPARE SET OF FILTERS, INSTALL NEW FILTERS PRIOR TO TESTING, ADJUSTING, AND BALANCING WORK AND BEFORE TURNING SYSTEM OVER TO OWNER.

FURNISH ONE COMPLETE SET OF BELTS FOR EACH FAN.

FURNISH THREE OPERATING KEYS FOR EACH TYPE OF AIR OUTLET AND INLET THAT REQUIRES THEM.

1.10 WARRANTIES

WARRANT EACH SYSTEM AND EACH ELEMENT THEREOF AGAINST ALL DEFECTS DUE TO FAULTY WORKMANSHIP, DESIGN, OR MATERIAL FOR A PERIOD OF 12 MONTHS FROM DATE OF SUBSTANTIAL COMPLETION, UNLESS SPECIFIC ITEMS ARE NOTED TO CARRY A LONGER WARRANTY IN THE CONSTRUCTION DOCUMENTS OR MANUFACTURER'S STANDARD WARRANTY EXCEEDS 12 MONTHS. REMEDY ALL DEFECTS, OCCURRING WITHIN THE WARRANTY PERIOD(S), AS STATED IN THE GENERAL CONDITIONS AND DIVISION 1.

WARRANTIES SHALL INCLUDE LABOR AND MATERIAL. MAKE REPAIRS OR REPLACEMENTS WITHOUT ANY ADDITIONAL COSTS TO THE OWNER.

PERFORM THE REMEDIAL WORK PROMPTLY, UPON WRITTEN NOTICE FROM THE ENGINEER OR OWNER.

AT THE TIME OF SUBSTANTIAL COMPLETION, DELIVER TO THE OWNER ALL WARRANTIES, IN WRITING AND PROPERLY EXECUTED, INCLUDING TERM LIMITS FOR WARRANTIES EXTENDING BEYOND THE ONE YEAR PERIOD, EACH WARRANTY INSTRUMENT BEING ADDRESSED TO THE OWNER AND STATING THE COMMENCEMENT DATE AND TERM.

1.11 CUTTING AND PATCHING

PERFORM CUTTING OF WALLS, FLOORS, CEILING, ETC. AS REQUIRED TO INSTALL WORK UNDER THIS SECTION. OBTAIN PERMISSION FROM THE ARCHITECT PRIOR TO CUTTING. DO NOT CUT OR DISTURB STRUCTURAL MEMBERS WITHOUT PRIOR APPROVAL FROM THE ARCHITECT. CUT HOLES AS SMALL AS POSSIBLE. GENERAL CONTRACTOR SHALL PATCH WALLS, FLOORS, ETC. AS REQUIRED BY WORK UNDER THIS SECTION. PATCHING SHALL MATCH THE ORIGINAL MATERIAL AND CONSTRUCTION. REPAIR AND REFINISH AREAS DISTURBED BY WORK TO THE CONDITION OF ADJOINING SURFACES IN A MANNER SATISFACTORY TO THE ARCHITECT.

1.12 ROUGH-IN

COORDINATE WITHOUT DELAY ROUGHING-IN WITH GENERAL CONSTRUCTION. CONCEAL PIPING AND CONDUIT ROUGH-IN EXCEPT IN UNFINISHED AREAS WHERE OTHERWISE SHOWN.

1.13 STRUCTURAL STEEL

STRUCTURAL STEEL USED FOR PIPE SUPPORTS, EQUIPMENT SUPPORTS, ETC., SHALL BE NEW, CLEAN, AND CONFORM TO ASTM DESIGNATION A-36.

SUPPORT PLUMBING AND MECHANICAL EQUIPMENT AND PIPING FROM THE BUILDING STRUCTURE. DO NOT SUPPORT PLUMBING EQUIPMENT FROM CEILINGS, OTHER MECHANICAL OR ELECTRICAL COMPONENTS, AND OTHER NON-STRUCTURAL ELEMENTS.

1.14 ACCESS DOORS

PROVIDE ACCESS DOORS IN CEILING AND WALLS WHERE INDICATED OR REQUIRED FOR ACCESS TO CONCEALED VALVES AND EQUIPMENT INSTALLED UNDER THIS SECTION. PROVIDE CONCEALED HINGES, SCREWDRIVER-TYPE LOCK, ANCHOR STRAPS, MANUFACTURED BY MILCOR, ZURN, TITUS, OR EQUAL. OBTAIN ARCHITECT'S APPROVAL OF TYPE, SIZE, LOCATION, AND COLOR BEFORE ORDERING.

1.15 PENETRATIONS

SEAL FLOOR, EXTERIOR WALL AND ROOF PENETRATIONS WATER AND WEATHER TIGHT WITH APPROPRIATE NON-SHRINK, NON-HARDENING COMMERCIAL CONSTRUCTION SEALANT. SEAL ROOF PENETRATIONS WITH FOUR POUND PER SQUARE FOOT LEAD FLASHING. PROVIDE A SLEEVE, AND SEAL NON-FIRE-RATED FLOOR AND WALL PENETRATIONS WITH FIBERGLASS PACKING AND SILICONE CAULK (FOR ACOUSTICAL INSULATION).

COORDINATE FIRE RATING REQUIREMENTS AND LOCATIONS WITH THE ARCHITECT. SEAL PENETRATIONS OF FIRE-RATED ASSEMBLIES WITH 3M #GP-25 FIRE BARRIER CAULK (PROVIDE THICKNESS AND METHOD AS REQUIRED AND RECOMMENDED BY MANUFACTURER) TO MAINTAIN THE FIRE RESISTANCE RATING OF FIRE-RATED ASSEMBLIES.

SEAL EXTERIOR WALL PENETRATIONS BELOW GRADE WITH CAST IRON WALL PIPES AND MODULAR MECHANICAL SLEEVE SEALS, MANUFACTURED BY THUNDERLINE/LINK SEAL, CALPICO, INC AND METRAFLEX.

PROVIDE SLEEVES FOR HORIZONTAL PIPE PASSING THROUGH OR UNDER THE FOUNDATION. SLEEVES SHALL BE CAST IRON SOIL PIPE TWO NOMINAL PIPE SIZES LARGER THAN THE PIPE SERVED.

PROVIDE SLEEVES FOR VERTICAL PIPE PASSING THROUGH SLAB ON GRADE. SLEEVES SHALL BE SCHEDULE 40 PVC PIPE, TWO NOMINAL PIPE SIZES LARGER THAN THE PIPE SERVED. SEAL WATER-TIGHT WITH SILICONE CAULK.

15B: HEATING, VENTILATION, AND AIR CONDITIONING

1.1 DUCTWORK

CONTRACTOR SHALL PROVIDE ANY DUCTWORK NECESSARY FOR A COMPLETE INSTALLATION OF HVAC SYSTEMS (INCLUDING EXHAUST SYSTEMS). ALL DUCTWORK IDENTIFICATION AND INSTALLATION TO ADHERE TO ASHRAE AND SMACNA STANDARDS AND ALL GOVERNING CODES.

DUCTWORK SHALL BE A MINIMUM 26 GAUGE GALVANIZED STEEL SHEET METAL DUCTWORK.

SUPPLY DUCTWORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS FOR A TWO-INCH POSITIVE PRESSURE RATING AND SEAL CLASS B.

RETURN DUCTWORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS FOR A ONE-INCH NEGATIVE PRESSURE RATING AND SEAL CLASS C.

EXHAUST DUCTWORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS FOR A ONE-INCH POSITIVE PRESSURE RATING AND SEAL CLASS C.

ROUND DUCT RUNS SHALL BE CONSTRUCTED OF METAL PIPE WITH EXTERNAL SLEEVE INSULATION.

DUCTWORK CONNECTIONS TO AIR DEVICES MUST BE MADE WITH HARDBOARD ELBOWS, COVERED WITH SLEEVE INSULATION. FLEX DUCT MUST NOT BE UTILIZED FOR A 90 DEGREE CONNECTION TO AN AIR DEVICE.

VOLUME/BALANCING DAMPERS SHALL BE PROVIDED IN ALL BRANCH DUCT TAKE-OFFS FROM THE MAIN TRUNKS, UNLESS NOTED OTHERWISE ON PLANS. LOCATE DAMPERS A MINIMUM OF 4'-0" AWAY FROM AIR DEVICES. A MAXIMUM OF 5'-0" OF FLEX DUCT MAY BE USED FOR FINAL CONNECTION OF AIR DEVICES.

FLEX DUCT MUST BE PROPERLY SUPPORTED WITH ONE INCH STRAPS AND CUT TO PROPER LENGTH TO PREVENT SAGGING.

FLEX DUCT SHALL BE OWENS-CORNING FOIL-BACK HIGH QUALITY UL APPROVED OR EQUAL. PLASTIC WRAPPED FLEX DUCT IS NOT ACCEPTABLE.

DUCTWORK SHALL BE CONNECTED TO FANS, FAN CASINGS, AND FAN PLENUMS BY MEANS OF FLEXIBLE CONNECTIONS.

MITERED ELBOWS 45 DEGREES AND GREATER SHALL HAVE SINGLE THICKNESS TURNING VANES OF SAME GAUGE AS DUCTWORK.

1.2 INSULATION

SUPPLY AND RETURN DUCTWORK INSIDE THE BUILDING SHALL BE INSULATED WITH 1.5" THICK ACOUSTICAL LINING WITH A MINIMUM R-VALUE OF 6 OR EXTERNALLY WRAPPED WITH 2" THICK GLASS FIBER DUCT WRAP.

SUPPLY AND RETURN DUCTWORK LOCATED OUTSIDE THE BUILDING SHALL BE INSULATED WITH 2" LINER WITH A MINIMUM R-VALUE OF 8 AND SEAL SEAMS WEATHER TIGHT.

DEDICATED OUTSIDE AIR SUPPLY AND RELIEF DUCTWORK INSIDE THE BUILDING SHALL BE INSULATED WITH 2" DUCT WRAP WITH A MINIMUM R-VALUE OF 6.

1.3 PIPING

REFER TO PLUMBING SPECIFICATIONS FOR GAS AND CONDENSATE PIPING SPECIFICATIONS.

1.4 FINAL TESTING AND ADJUSTMENTS

AIR BALANCE SHALL BE PERFORMED BY AN INDEPENDENT AIR BALANCE CONTRACTOR. BALANCE EACH SUPPLY, RETURN, OUTSIDE AIR DEVICE WITHIN 5% OF REQUIREMENTS AND FURNISH A REPORT TO THE CONSTRUCTION MANAGER. THE ENTIRE HVAC SYSTEM MUST BE FULLY OPERABLE, BALANCED, AND APPROVED BY OWNER'S REPRESENTATIVE ON THE DAY TENANT OPENS FOR BUSINESS.

ADJUST THERMOSTATS AND CONTROL DEVICES TO OPERATE AS INTENDED. ADJUST BURNERS, PUMPS, FANS, ETC. FOR PROPER AND EFFICIENT OPERATION. CERTIFY TO ARCHITECT THAT ADJUSTMENTS HAVE BEEN MADE AND THAT SYSTEM IS OPERATING SATISFACTORILY. CALIBRATE, SET AND ADJUST AUTOMATIC TEMPERATURE CONTROLS. CHECK PROPER SEQUENCING OF INTERLOCK SYSTEMS, AND OPERATION OF SAFETY CONTROLS.

VERIFY ECONOMIZER OPERATION PER MANUFACTURER PROCEDURE WHEN APPLICABLE.

1.5 AIR DEVICES

PROVIDE AIR DEVICES AS SCHEDULED ON THE DRAWINGS.

MAINTAIN NOISE LEVEL OF NC-30 OR LESS.

ALL AIR TERMINAL DEVICES SHALL BE INSTALLED AS SHOWN ON THE PLANS IN ORDER TO HANDLE THE DESIGNED AIR FLOW CAPACITIES WITH A MINIMUM AMOUNT OF NOISE AND STATIC PRESSURE.

PROVIDE AIR DEVICES WITH WHITE ENAMEL FINISH UNLESS NOTED OTHERWISE.

1.6 CONTROLS

COORDINATE LOCATIONS FOR THERMOSTATS AND SENSORS FOR ROUGH-IN.

SMOKE DETECTORS SHALL BE FACTORY INSTALLED AND SHALL DISABLE HVAC UNIT OPERATION UPON ACTIVATION.

1.7 ELECTRICAL WIRING

ALL PROVISIONS FOR LOW VOLTAGE WIRING SHALL BE PERFORMED BY THE CONTRACTOR UNLESS CODES OR LABOR SITUATIONS DO NOT PERMIT. IF THE CONTRACTOR CANNOT PERFORM LOW VOLTAGE WIRING, THE CONTRACTOR SHALL INFORM THE GENERAL CONTRACTOR, AS PART OF THE HVAC BID DOCUMENT, TO HAVE THE ELECTRICAL SUBCONTRACTOR INCLUDE THIS WORK IN THEIR BID.

ALL ELECTRICAL POWER WIRING TO INCLUDE FINAL CONNECTIONS SHALL BE PROVIDED BY THE GENERAL CONTRACTOR'S ELECTRICAL SUBCONTRACTOR.

1.8 REMODEL WORK

REMOVE ALL UNUSED EQUIPMENT, DUCTWORK, PIPING AND ASSOCIATED SUPPORTS. CAP DUCTWORK AND PIPING AT MAINS AND SEAL AIR AND WATER TIGHT.

PROVIDE ITEMS OF HVAC SYSTEMS MODIFICATION REQUIRED BECAUSE OF BUILDING REMODELING, AS NOTED ON THE DRAWINGS OR NECESSARY FOR PROPER OPERATION. MATCH EXISTING MATERIALS AND CONSTRUCTION TECHNIQUES WHEN MODIFYING EXISTING SYSTEMS UNLESS SPECIFIED OTHERWISE. COORDINATE ADDITIONAL REQUIREMENTS WITH GENERAL CONTRACTOR AND ARCHITECT.

SEAL AIRTIGHT EXISTING DUCTWORK REQUIRED TO BE ABANDONED IN PLACE OR NOT IN USE AT THE TERMINATION OF THE WORK.

CAP AND SEAL WEATHERTIGHT EXISTING ROOF CURBS AND ROOF OPENINGS TO BE ABANDONED IN PLACE AS A RESULT OF EQUIPMENT REMOVAL.

CLEAN AND REBALANCE EXISTING DUCTWORK, DIFFUSERS, REGISTERS, AND GRILLES INTENDED FOR REUSE AS REQUIRED OR AS INDICATED ON DRAWINGS.

CLEAN AND REFURBISH EXISTING HVAC EQUIPMENT INTENDED FOR REUSE AS REQUIRED FOR PROPER OPERATION INCLUDING REPLACEMENT OF FILTERS, BELTS, MOTORS, REMOTE CONTROLS, AND SAFETY INTERLOCKS.

COMPLY WITH THE SCHEDULE OF OPERATIONS AS OUTLINED IN THE ARCHITECTURAL PORTIONS OF THIS SPECIFICATION. BUILDING SHALL BE IN CONTINUOUS OPERATION. ACCOMPLISH WORK REQUIRING INTERRUPTION OF BUILDING OPERATION AT A TIME WHEN THE BUILDING IS NOT IN OPERATION, AND ONLY WITH WRITTEN APPROVAL OF BUILDING OWNER AND/OR TENANT. COORDINATE INTERRUPTION OF BUILDING OPERATION WITH THE OWNER AND/OR TENANT A MINIMUM OF SEVEN DAYS IN ADVANCE OF WORK.

1.9 CONTRACTOR RESPONSIBILITIES

AFTER COMPLETION OF THE WORK DESCRIBED IN THIS SPECIFICATION AND SHOWN ON THE DRAWINGS, THE CONTRACTOR SHALL THOROUGHLY CLEAN ALL EXPOSED EQUIPMENT, REMOVING ALL LABELS AND STICKERS NOT CONTAINING OPERATION INSTRUCTION. CONTRACTOR SHALL REMOVE CRATING DEBRIS, LEAVING THE INSTALLATION FINISHED AND READY FOR OPERATION, INCLUDING CLEAN FILTERS IN AIR HANDLING UNITS.



OMN ENGINEERS
PO BOX 2106
LOVELL, AR 72745
479-696-7873



DATE 09/11/25
JOB NO. 25089
REVISIONS



THIS DRAWING IS PROVIDED AS AN INFORMATIONAL SERVICE TO THE ARCHITECT AND IS NOT TO BE USED FOR CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF ALL INFORMATION PROVIDED HEREON. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND LICENSES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY APPROVALS FROM THE ARCHITECT AND OWNER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY APPROVALS FROM THE ARCHITECT AND OWNER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY APPROVALS FROM THE ARCHITECT AND OWNER.



- ### GENERAL LOW VOLTAGE NOTES
- PROVIDE 4" WIDE X 4" TALL X 3/4" FIRE RATED, PAINTED CDX PLYWOOD BACKBOARD WHERE SHOWN ON DRAWINGS OR AS REQUIRED FOR TELEPHONE, CATV, ALARM SYSTEM EQUIPMENT, ETC. COORDINATE EXACT LOCATIONS(S) WITH RESPONSIBLE CONTRACTOR(S).
 - PROVIDE ROUGH-IN OF ALL BACK BOXES, CONDUITS (WITH BUSHINGS AND PULL STRINGS) AND OTHER WIRE WAYS AS REQUIRED FOR LOW VOLTAGE SYSTEMS, COORDINATE ALL REQUIRED LOCATIONS WITH OWNER AND RESPONSIBLE CONTRACTOR(S).
 - PROVIDE (1) 1/2" CONDUIT, AND 4" SQUARE BOX WITH SINGLE GANG DEVICE RING FOR ALL THERMOSTAT LOCATIONS INDICATED ON THE MECHANICAL DRAWINGS. ROUTE CONDUIT FROM BOX TO ACCESSIBLE CEILING CAVITY. PROVIDE PLASTIC BUSHINGS ON EXPOSED CONDUIT ENDS. PROVIDE PULL STRING IN ALL EMPTY CONDUIT SYSTEMS. COORDINATE EXACT LOCATIONS AND MOUNTING HEIGHTS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.
 - REFER TO SITE UTILITIES PLAN AND COORDINATE ENTIRE INSTALLATION WITH CABLE TV SERVICE PROVIDER.
 - ALL CABLE USED IN UNDERGROUND APPLICATIONS SHALL BE RATED FOR WET LOCATIONS.
 - REFER TO SITE UTILITIES PLAN AND COORDINATE ENTIRE INSTALLATION WITH PHONE SERVICE PROVIDER.
 - PROVIDE ONE #6 COPPER INSULATED GROUND WIRE FROM THE ELECTRICAL SERVICE GROUND TO THE TELEPHONE EQUIPMENT BOARD. LEAVE 36" EXTRA WIRE AT FREE END.


- ### GENERAL POWER NOTES
- ALL RECEPTACLES INSTALLED IN RESTROOMS, OUTDOORS AREAS, AND KITCHENS SHALL HAVE GROUND-FAULT CIRCUIT INTERRUPTING PROTECTION AS REQUIRED BY THE NATIONAL ELECTRICAL CODE.
 - PROVIDE POWER TO MECHANICAL, PLUMBING, AND ALL OTHER EQUIPMENT AS REQUIRED FOR PROPER OPERATION, COORDINATION, AND VERIFY EACH PIECE OF EQUIPMENT'S POWER/CONTROL REQUIREMENTS PRIOR TO ORDERING RELATED ELECTRONIC EQUIPMENT. REFER TO RELATED MECHANICAL, PLUMBING, AND OTHER RELATED DOCUMENTS FOR EQUIPMENT LOCATIONS AND CLEARANCES.
 - ALL RECEPTACLES LOCATED IN AREAS REQUIRING GROUND-FAULT CIRCUIT INTERRUPTING PROTECTION PER NEC-210 SHALL CONSIST OF A GFCI PROTECTED DEVICE, EVEN IF NOT SPECIFICALLY INDICATED IN THE DRAWINGS. THE GROUND-FAULT CIRCUIT INTERRUPTER SHALL BE INSTALLED IN A READILY ACCESSIBLE LOCATION AS DEFINED IN THE NEC. ALL RECEPTACLES SUPPLIED THROUGH A GROUND-FAULT CIRCUIT INTERRUPTER SHALL BE MARKED "GFCI PROTECTED."

- ### GENERAL LIGHTING NOTES
- WHERE RECESSED LIGHTING FIXTURES ARE INDICATED IN A FIRE-RATED CEILING, PROVIDE A ONE HOUR RATED "TENT" FOR FIXTURE.
 - PROVIDE ALL MOUNTING AND SUPPORT HARDWARE FOR LIGHT FIXTURES TO MEET SPECIFIED MOUNTING HEIGHTS. REFER TO ARCHITECTURAL ELEVATIONS FOR EXACT MOUNTING HEIGHTS OF FIXTURES.
 - CONNECT "UN-SWITCHED" HOT CONDUCTOR FROM CIRCUIT SERVING AREA LIGHTING TO EACH EXIT SIGN, EMERGENCY LIGHT, AND ANY FIXTURE DESIGNATED AS NIGHT LIGHT SERVING THE AREA. REFER TO EMERGENCY WIRING DIAGRAM.
 - COORDINATE ALL DEVICES AND WALL-MOUNTED LIGHT FIXTURE LOCATIONS WITH THE ARCHITECTURAL WALL FINISHES AND ELEVATIONS. EXACT LOCATION OF DEVICES SHALL BE COORDINATED WITH THE ARCHITECT PRIOR TO ROUGH-IN.
 - ELECTRICAL CONTRACTOR SHALL VERIFY CHEVRON DIRECTIONS OF ALL EXIT SIGNS PRIOR TO ORDERING.
 - FOR BATTERY FED EMERGENCY LIGHTS: PROVIDE EMERGENCY BALLAST. SWITCH FIXTURE AS INDICATED ON PLANS.
 - COORDINATE AND PROVIDE DIMMER SWITCHES RATED FOR AND COMPATIBLE WITH INTENDED LIGHT FIXTURE(S) TO BE CONTROLLED. CIRCUITS CONTROLLED WITH LINE-VOLTAGE DIMMER SWITCHES SHALL NOT SHARE NEUTRAL CONDUCTORS.

- ### GENERAL ELECTRICAL NOTES
- DRAWINGS ARE DIAGRAMMATIC ONLY AND REPRESENT THE GENERAL SCOPE OF THE WORK. REVIEW ALL GENERAL NOTES, SPECIFICATIONS, AND PLANS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS.
 - SPECIAL ATTENTION SHALL BE GIVEN TO ALL RACEWAYS WITHIN FINISHED AREAS THAT ARE OPEN TO STRUCTURE. IN GENERAL, ALL RACEWAYS SHALL BE CONCEALED WITHIN WALLS, ABOVE CEILING, OR BELOW FLOOR SLABS, WHERE EXPOSED RACEWAYS ARE UNAVOIDABLE, THE BID SHALL INCLUDE ANY REASONABLE MEANS TO MINIMIZE IT. MAINTAIN A MINIMUM SPACING OF 1-1/2" FROM CONDUIT TO ROOF DECK, ATTACHMENT TO ROOF DECK OR JOIST WEBBINGS IS NOT ALLOWED. IN AREAS WHERE EXPOSED RACEWAYS ARE REQUIRED, INSTALL SYSTEMS SQUARE AND TIGHT TO STRUCTURE AND PAINT TO MATCH THE STRUCTURE PER ARCHITECT AND/OR OWNER SPECIFICATIONS. COORDINATE ALL EXPOSED RACEWAYS WITH ARCHITECT PRIOR TO CONSTRUCTION OF WALLS, ROOF DECK, AND FLOORS.
 - OPENINGS AROUND ELECTRICAL PENETRATIONS THROUGH FIRE-RESISTANT-RATED WALLS, PARTITIONS, FLOORS OR CEILINGS SHALL BE FIRESTOPPED USING APPROVED METHODS TO MAINTAIN THE FIRE RESISTANCE RATING. PROVIDE PENETRATION FIRE STOPPING WITH RATINGS DETERMINED PER ASTM E 8414 OR UL 1472. FIRE STOPPING SHALL NOT BE LESS THAN THE FIRE RESISTANCE RATING OF CONSTRUCTION PENETRATIONS.
 - FIELD MOUNTED DEVICES SUCH AS SWITCHES, MOTOR STARTERS, RECEPTACLES, ETC., ARE SHOWN IN THEIR APPROXIMATE LOCATION. SWITCH MOUNTING HEIGHT SHALL BE 48" ABOVE FINISHED FLOOR AND RECEPTACLE MOUNTING HEIGHT SHALL BE 18" ABOVE FINISHED FLOOR UNO. REFER TO THE TYPICAL MOUNTING HEIGHT DETAIL.
 - INSTALL EQUIPMENT IN A MANNER SO AS TO REMAIN ACCESSIBLE WITH REASONABLE MEANS BY THE OWNER FOLLOWING COMPLETION OF WORK. EQUIPMENT ABOVE CEILING SHALL BE INSTALLED SUCH THAT IT MAY BE SAFELY ACCESSED FROM A STANDARD STEP LADDER OR PERSONNEL LIFT WITHOUT REMOVING OR DAMAGING THE CEILING STRUCTURE.
 - COORDINATE ALL CEILING MOUNTED ELECTRICAL ITEMS WITH OTHER DISCIPLINES, WITH CEILING, AND STRUCTURE. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN.
 - FIELD VERIFY LOCATIONS OF EXISTING ELECTRICAL EQUIPMENT, INCLUDING POWER POLES, TELEPHONE PEDESTALS, OVERHEAD AND UNDERGROUND FEEDERS, METERS, PANELS, DEVICES, ETC. PROVIDE FOR COORDINATION WITH EXISTING EQUIPMENT.
 - ROOM NAMES/NUMBERS SHOWN IN PANELBOARD SCHEDULES ARE PER ARCHITECTURAL FLOOR PLANS. CONTRACTOR SHALL PROVIDE FINALIZED PANELBOARD SCHEDULES AT COMPLETION OF PROJECT WITH OWNER PROVIDED NAMES/NUMBERS.
 - CONDUCTORS FOR BRANCH CIRCUITS AS DEFINED IN ARTICLE 100, SHALL BE SIZED TO PREVENT A VOLTAGE DROP EXCEEDING 3% AT THE FARTHEST LOAD, AND WHERE THE MAXIMUM TOTAL VOLTAGE DROP ON BOTH FEEDERS AND BRANCH CIRCUITS TO THE FARTHEST LOAD DOES NOT EXCEED 5%.
 - ALL WORK IS TO BE PERFORMED IN STRICT COMPLIANCE WITH THE NATIONAL ELECTRICAL CODE, STATE LAW, AND OTHER REGULATIONS GOVERNING WORK OF THIS NATURE.
 - THE CONTRACTOR IS RESPONSIBLE FOR ALL WORK, MATERIAL, AND LABOR TO SATISFY A COMPLETE AND WORKING SYSTEM WHETHER SPECIFIED OR IMPLIED.
 - CONTRACTOR TO CONFIRM EXACT LOCATION OF EXISTING AND NEW EQUIPMENT.
 - THE CONTRACTOR SHALL FURNISH AND INSTALL ALL GROUNDING SYSTEMS (AS REQUIRED) IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.

- ### GENERAL ELECTRICAL NOTES (CONT.)
- ALL ELECTRIC MATERIALS AND EQUIPMENT FOR THE PROJECT SHALL BE NEW AND U.L. OR EQUALLY LISTED.
 - SUBMIT THE OWNER CERTIFICATES OF INSPECTIONS IN DUPLICATE FROM AN APPROVED INSPECTION AGENCY UPON COMPLETION.
 - THE CONTRACTOR SHALL SECURE ALL PERMITS OR APPLICATIONS AND PAY ANY AND ALL FEES AS REQUIRED.
 - THE CONTRACTOR SHALL FURNISH ALL INSTRUMENTS AND QUALIFIED PERSONNEL OR FIRM TO PERFORM ALL REQUIRED TESTS.
 - NO EQUIPMENT SHALL BE ENERGIZED UNTIL ALL TEST AND ADJUSTMENTS HAVE BEEN MADE. THREE COPIES OF ALL TEST RESULTS SHALL BE DELIVERED TO THE OWNER.
 - ALL ELECTRICAL WORK SHALL BE COORDINATED WITH THE MECHANICAL WORK AS CALLED FOR IN MECHANICAL SPECIFICATIONS AND PLANS.
 - JUNCTION BOXES LOCATED ABOVE GRID CEILINGS SHALL BE LOCATED NO GREATER THAN 4-FEET ABOVE THE CEILING IN A LOCATION ACCESSIBLE VIA A LADDER FROM THE ROOM BELOW.
 - ALL WIRING DEVICE COVERPLATES SHALL INDICATE PANELBOARD AND CIRCUIT SERVING THE DEVICE. UTILIZE CLEAR VINYL (BLACK LETTERING) IDENTIFICATION LABELS MANUFACTURED BY 3M COMPANY (OR APPROVED EQUIVALENT).
 - THE TYPE OF CONDUIT SHALL BE AS FOLLOWS FOR ALL FEEDERS AND DISTRIBUTION CIRCUITS UNLESS OTHERWISE SPECIFIED:
 APPLICATION - TYPE OF CONDUIT
 BURIED IN CONCRETE OR OUTDOORS - PVC WITH RIGID GALVANIZED STEEL ELBOWS
 SERVICE ENTRANCE - GALVANIZED RIGID STEEL OR SERVICE UTILITY SPECIFICATIONS.
 - SEISMIC PROTECTION FOR ELECTRICAL SYSTEMS MUST MEET MINIMUM REQUIREMENTS OF ALL APPLICABLE CODES FOR BUILDINGS CLASSIFIED SEISMIC USE GROUP AND SEISMIC DESIGN CATEGORY. ANY REQUIREMENTS FOR SEISMIC PROTECTION MEASURES TO BE APPLIED SHALL BE INSTALLED IN STRICT ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE, AND/OR FEDERAL CODES AND WITH MANUFACTURER'S REQUIREMENTS, THE MOST STRINGENT SHALL APPLY.
 THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE TYPE AND LOCATION OF SEISMIC RESTRAINTS REQUIRED FOR THE VARIOUS SYSTEM'S ELEMENTS CONTAINED IN THE CONSTRUCTION, IF REQUIRED BY LOCAL, STATE, FEDERAL CODES AND/OR THE AUTHORITY HAVING JURISDICTION (AHJ). THE CONTRACTOR SHALL SUBMIT DESCRIPTIVE CATALOG DATA OF SEISMIC RESTRAINTS, SHOP DRAWINGS SHOWING THE TYPES, LOCATIONS AND INSTALLATION DETAILS OF SEISMIC RESTRAINTS AND CALCULATIONS SHOWING THAT THE SEISMIC RESTRAINTS MEET THE SEISMIC REQUIREMENTS TO THE LOCAL AHJ FOR REVIEW AND APPROVAL. CALCULATIONS SHALL BE SIGNED AND SEALED BY A REGISTERED PROFESSIONAL ENGINEER, LICENSED IN THE STATE OF THE PROJECT LOCATION AND EMPLOYED BY THE MANUFACTURER OF THE SEISMIC RESTRAINT PRODUCTS.
 - PROVIDE A MINIMUM OF (3) SPARE 1" CONDUITS FROM RECESSED PANELBOARD TO ACCESSIBLE CEILING SPACE.
 - UNLESS NOTED OTHERWISE, PROVIDE MINIMUM #8 AWG CONDUCTORS IN 1" CONDUIT(S) FOR ALL UNDERGROUND SITE POWER AND LIGHTING CIRCUITS. INCREASE CONDUCTOR AND RELATED CONDUIT SIZE AS NOTED OR OTHERWISE REQUIRED TO LIMIT VOLTAGE DROP TO LESS THAN 5% FOR THE ENTIRE LENGTH OF THE SYSTEM.
 - UNDERGROUND UTILITIES/FEEDERS/BRANCH CIRCUITS/ETC. SHALL NOT BE ROUTED THROUGH OR WITHIN 25 FEET OF ANY AREAS DEDICATED FOR FUTURE BUILDING ADDITION.

- ### ELECTRICAL SYMBOLS AND LEGEND
- 2' x 4' LIGHTING FIXTURE
 - 2' x 2' LIGHTING FIXTURE
 - 1' x 4' LIGHTING FIXTURE
 - STRIP LIGHTING FIXTURE
 - DOWNLIGHT
 - WALL MOUNTED LIGHTING FIXTURE
 - PENDANT LIGHTING FIXTURE
 - TRACK LIGHTING FIXTURE
 - EMERGENCY EGRESS FIXTURE
 - EXIT SIGN
 - SINGLE POLE SWITCH
 - THREE WAY SWITCH
 - FOUR WAY SWITCH
 - OCCUPANCY SENSOR
 - DIMMER SWITCH
 - OCCUPANCY SENSOR / DIMMER SWITCH
 - MOTOR RATED SWITCH
 - CEILING MOUNTED OCCUPANCY SENSOR
 - WALL MOUNTED OCCUPANCY SENSOR
 - DUPLEX RECEPTACLE
 - DUPLEX RECEPTACLE MOUNTED 8" ABOVE COUNTERTOP
 - DUPLEX RECEPTACLE WITH USB CHARGING PORT
 - QUADRUPLEX RECEPTACLE
 - SPECIAL RECEPTACLE: VERIFY NEMA TYPE WITH DRAWINGS / MANUFACTURER
 - RECEPTACLE WITH GFCI PROTECTION
 - SIMPLEX RECEPTACLE
 - CEILING MOUNTED RECEPTACLE
 - FLOOR BOX: HUBBELL 3SF8SS WITH 3SF8C COVER, ROUTE 1" TO NEAREST ACCESSIBLE CEILING SPACE. ON FLOORS WITH ACCESSIBLE SPACE BELOW, USE POKE-THROUGH FLOOR BOX: HUBBELL PT2X2 SERIES.
 - FLOOR BOX WITH DATA: LEGRAND WIREMOLD SERIES RFB4E-OG OR RFB6E-OG WITH EVOLUTION COVER. ROUTE (2) 1" FOR DATA FROM FLOOR BOX TO NEAREST ACCESSIBLE CEILING SPACE. ON FLOORS WITH ACCESSIBLE SPACE BELOW, USE POKE-THROUGH STYLE FLOOR BOX: LEGRAND 6AT SERIES.
 - TELEVISION: PROVIDE HUBBELL NSAV62M JUNCTION BOX (OR EQUAL) WITH 1/2" CONDUIT FOR POWER AND 1" CONDUIT WITH PULL STRINGS FOR A/V ROUTED TO ACCESSIBLE CEILING SPACE. PROVIDE CONNECTIONS FOR POWER, DATA, COAX, AND HDMI. MOUNT -60" AFF UNO. CONFIRM HEIGHT WITH ARCHITECT PRIOR TO ROUGH-IN.
 - ELECTRICAL PANEL
 - 4" x 4" JUNCTION BOX UNO
 - EQUIPMENT DISCONNECT: INTERIOR DISCONNECTS SHALL BE NEMA 1 TYPE. EXTERIOR DISCONNECTS SHALL BE NEMA 3R TYPE. SIZE AS INDICATED IN THE PLANS AND PER NAMEPLATE RATINGS.
 - PHONE/DATA: PROVIDE 4" x 4", 30-1/4 CUBIC INCH BOX WITH (2) 3/4" CONDUITS WITH PULL STRINGS. ROUTE TO ACCESSIBLE CEILING SPACE. PROVIDE SINGLE GANG MUD RING WITH BLANK COVER PLATE. PROVIDE PLASTIC BUSHINGS ON EXPOSED CONDUIT ENDS. WIRING BY OTHERS.
 - STROBE
 - HORN / STROBE
 - PULL STATION
 - SMOKE DETECTOR

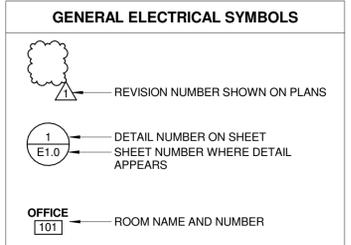

ABBREVIATIONS

1P	1 POLE (2P, 3P, 4P) PHASE	HP	HORSE POWER
A/AMP	AMPERE	HVAC	HEATING, VENTILATING, AND AIR CONDITIONING
AFF	ABOVE FINISHED FLOOR	IG	ISOLATED GROUND
AFG	ABOVE FINISHED GRADE	J-BOX	JUNCTION BOX
AFCI	ARC FAULT CIRCUIT INTERRUPTER	KVA	KILOVOLT-AMPERE
AHU	AIR HANDLING UNIT	KW	KILOWATT
ANN	ANNUNCIATOR	KWH	KILOWATT HOUR
ARCH	ARCHITECTURAL	LC	LIGHTING CONTACTOR
ATS	AUTOMATIC TRANSFER SWITCH	MCB	MAIN CIRCUIT BREAKER
A/V	AUDIO VISUAL	MLO	MAIN LUGS ONLY
AWG	AMERICA WIRE GAUGE	MTR	MOTOR
BMS	BUILDING MANAGEMENT SYSTEM	NEC	NATIONAL ELECTRICAL CODE
C	CONDUIT	NEMA	NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION
CATV	CABLE TELEVISION	NL	NOT IN CONTRACT
CB	CIRCUIT BREAKER	NLO	NEW LOCATION
CCTV	CLOSED CIRCUIT TELEVISION	NTS	NOT TO SCALE
CT	CURRENT TRANSFORMER	PC	PHOTO CELL
CU	COPPER	PF	POWER FACTOR
DWG	DRAWING	PNL	PANEL
EC	ELECTRICAL CONTRACTOR	PVC	POLYVINYL CHLORIDE CONDUIT
EF	EXHAUST FAN	R	RELOCATE
ELEC	ELECTRICAL	ROPT	RECEPTACLE
EM	EMERGENCY	REF	REFER
EMT	ELECTRICAL METALLIC TUBING	RTU	ROOFTOP UNIT
EWC	ELECTRIC WATER COOLER	EXISTING	EXISTING
EX	EXISTING	SF	SQUARE FEET
FA	FIRE ALARM	SPEC	SPECIFICATION
FAAP	FIRE ALARM ANNUNCIATOR PANEL	TC	TIME CLOCK
FACP	FIRE ALARM CONTROL PANEL	TV	TELEVISION
GC	GENERAL CONTRACTOR	TYP	TYPICAL
GFI	GROUND FAULT CIRCUIT INTERRUPTER	UC	UNDERCOUNTER
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	UG	UNDERGROUND
GND	GROUND	UH	UNIT HEATER
HP	HORSE POWER	UNO	UNLESS OTHERWISE NOTED
HVAC	HEATING, VENTILATING, AND AIR CONDITIONING	UTIL	UTILITY
		V	VOLT
		VA	VOLTS-AMPERE
		WH	WATER HEATER
		WP	WEATHERPROOF
		XFMR	TRANSFORMER

LIGHTING FIXTURE SCHEDULE

TYPE	MANUFACTURER	CATALOG SERIES	DESCRIPTION	LAMP	MOUNTING	VOLT	WATT
C	ENVISION LED	LED-MDJBX-4-15W-5CCT-WHR	5" DOWNLIGHT, ROUND	LED, 3500K	RECESSED	120 V	20 W
G	---	---	GOOSNECK WET	LED, 4000K	WALL	120 V	55 W
LI	---	---	LINEAR PENDANT 8"	LED, 3500K	SUSPENDED	120 V	58 W
S	ENVISION LED	LED-RST-4FT-3M40W-4CCT	LINEAR LED	LED, 3500K	SURFACE	120 V	60 W
T	---	---	LINEAR TAPE LIGHT	LED, 3500K	TRACK	120 V	8 W
V	INDESSA	444-2LED7-BLK-35K-24	VANITY, BLACK	LED, 3500K	WALL	120 V	16 W


- EC SHALL PROVIDE A SUBMITTAL PACKAGE INCLUDING CUTSHEETS FOR EACH FIXTURE.
- EC SHALL PROVIDE ALL ACCESSORIES FOR A COMPLETE ASSEMBLY INCLUDING MOUNTING HARDWARE.
- MOUNTING TYPE OF EACH FIXTURE SHALL BE COMPATIBLE WITH FIXTURE'S INSTALLATION SURFACE.
- ALL FINISHES SHALL BE COORDINATED WITH ARCHITECT AND DOCUMENTED ON SUBMITTALS.

Burris Architecture
 820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
 479-319-6045

SMOKE
 730 E MAIN ST
 FARMINGTON, AR

DATE 09/11/25
 JOB NO. 25089
 REVISIONS


E1.0
 ELECTRICAL LEGEND,
 LIGHTING FIXTURE
 SCHEDULE & NOTES

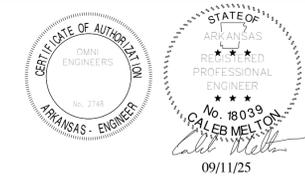


- GENERAL NOTES**
- COORDINATE EXACT MOUNTING HEIGHT OF EACH ABOVE-COUNTER RECEPTACLE WITH ARCHITECT AND OWNER PRIOR TO ROUGH-IN.
 - COORDINATE EXACT LOCATIONS OF RECEPTACLES AND DATA BOXES WITH OWNER AND FINAL FURNITURE LOCATIONS.
 - EXHAUST FANS SHALL BE CIRCUITED WITH LIGHTS UNLESS SHOWN OTHERWISE. REFER TO MECHANICAL PLANS FOR CONTROLS OF EXHAUST FANS.

RECPACLE FOR RGB LIGHTING SYSTEM. MOUNT AT 9' AFF. COORDINATE WITH LIGHTING INSTALLER FOR EXACT REQUIREMENTS PRIOR TO ROUGH IN.

RECPACLE FOR RGB LIGHTING SYSTEM. MOUNT AT 9' AFF. COORDINATE WITH LIGHTING INSTALLER FOR EXACT REQUIREMENTS PRIOR TO ROUGH IN.

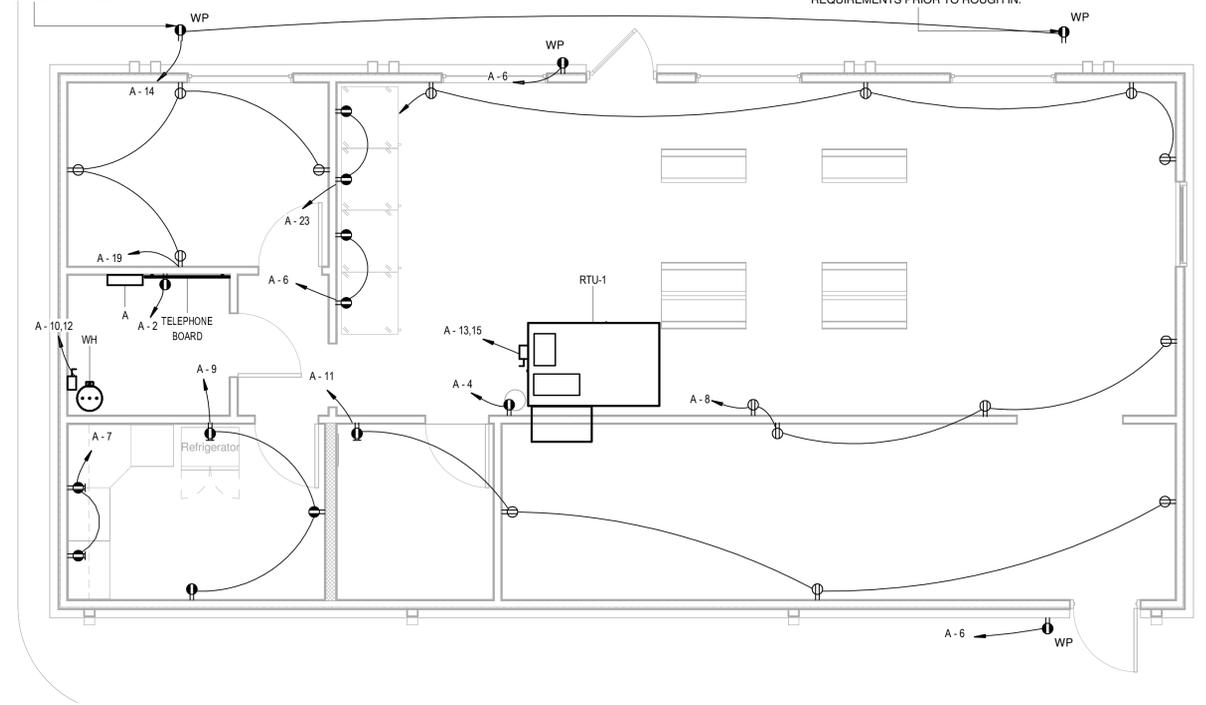

1 POWER PLAN LEVEL 1
E2.0 1/4" = 1'-0"

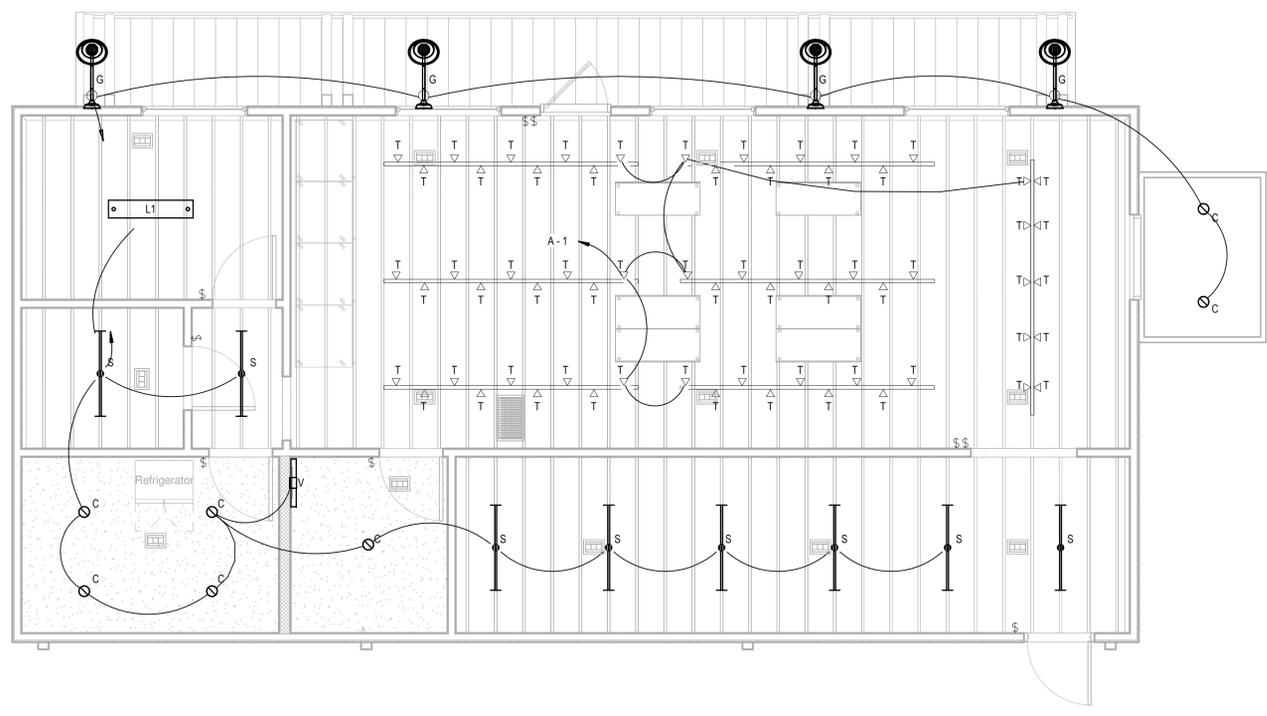

2 LIGHTING PLAN LEVEL 1
E2.0 1/4" = 1'-0"



Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE 09/11/25
JOB NO. 25089
REVISIONS

E2.0
LIGHTING AND POWER PLANS

THIS DRAWING IS THE PROPERTY OF BURRIS ARCHITECTURE AND SHALL REMAIN THE PROPERTY OF BURRIS ARCHITECTURE. NO PART OF THIS DRAWING IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF BURRIS ARCHITECTURE. ALL DRAWINGS ARE TO BE USED IN CONJUNCTION WITH THE CONTRACT DOCUMENTS. BURRIS ARCHITECTURE IS NOT RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED BY OTHER PROFESSIONALS. BURRIS ARCHITECTURE IS NOT PROVIDING ANY CONSULTING OR ENGINEERING SERVICES UNLESS SHOWN OTHERWISE ON THE DRAWINGS.

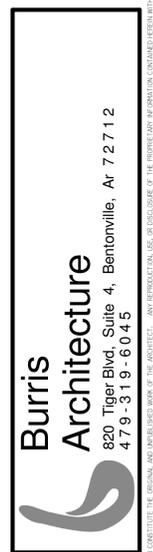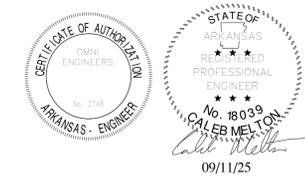

DATE 09/11/25
 JOB NO. 25089
 REVISIONS

E3.0
 ELECTRICAL RISER DIAGRAM

PANELBOARD: A

LOCATION: STORAGE 105
MOUNTING: SURFACE NEMA 1
MAIN DEVICE: MCB 200.0 A
BUS AMPS: 200A

VOLTAGE: 240/120 Single V. 1 ø 3 W.
A.I.C. RATING: FULLY
SPECIAL:

CKT	LOAD DESCRIPTION	WIRE	BKR	POLES	A	B	POLES	BKR	WIRE	LOAD DESCRIPTION	CKT	
1	Other	#12 20 A	1		57 VA	180 VA		1	20 A #12	RCPT	2	
3	LITES	#12 20 A	1			609 VA	800 VA	1	20 A #12	RCPT	4	
5	LITES	#12 20 A	1		289 VA	1600 VA		1	20 A #12	RCPT	6	
7	RCPT	#12 20 A	1			360 VA	720 VA	1	20 A #12	RCPT	8	
9	RCPT	#12 20 A	1		540 VA	2250 VA		1	20 A #12	RCPT	10	
11	RCPT	#12 20 A	1			720 VA	2250 VA	2	30 A #10	WATER HEATER	12	
13	RTU	#6 50 A	2		2600 VA	360 VA		1	20 A #12	RCPT	14	
15	RCPT	#12 20 A	1		720 VA	0 VA		1	20 A #12	RCPT	16	
17	RCPT	#12 20 A	1			720 VA	0 VA	1	20 A #12	SPARE	18	
19	RCPT	#12 20 A	1					1	20 A #12	SPARE	20	
21	SPACE	#12 --	1		0 VA			1	20 A #12	SPARE	22	
23	RCPT	#12 20 A	1			1600 VA	--	1	--	#12 SPACE	24	
25	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	26	
27	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	28	
29	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	30	
31	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	32	
33	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	34	
35	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	36	
37	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	38	
39	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	40	
41	SPACE	#12 --	1		--	--	--	1	--	#12 SPACE	42	
TOTAL LOAD:					8927 VA	10363 VA						
TOTAL AMPS:					74.4 A	86.4 A						

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS
Other	57 VA	100.00%	57 VA	TOTAL CONNECTED LOAD: 19290 VA TOTAL ESTIMATED DEMAND: 20804 VA TOTAL CONNECTED CURRENT: 80.4 A TOTAL ESTIMATED DEMAND CURRENT: 86.7 A
MTR	9700 VA	113.40%	11000 VA	
RCPT	8680 VA	100.00%	8680 VA	
LITES	893 VA	125.00%	1116 VA	

NOTES:

- #### PANELBOARD NOTES (#)
- TERMINATE GROUND ON ISOLATED GROUND BUS.
 - INSTALL LOCKING DEVICE FURNISHED WITH PANELBOARD (LOCK-OFF FOR MAINTENANCE).
 - INSTALL LOCKING DEVICE FURNISHED WITH PANELBOARD (LOCK-ON FOR CRITICAL LOAD).
 - GFI BREAKER FOR PERSONNEL PROTECTION (5MA).
 - GFI BREAKER FOR EQUIPMENT PROTECTION (30MA).
 - CONDUCTOR SIZE SHOWN IN PANEL SCHEDULE HAS BEEN INCREASED FOR VOLTAGE DROP. SIZE EQUIPMENT GROUND PROPORTIONALLY PER NEC.
 - REFER TO ONE-LINE DIAGRAM FOR AVAILABLE FAULT CURRENT INTERRUPT RATINGS.
 - REFER TO ONE LINE DIAGRAM FOR WIRE SIZES.
 - FACTOR WIRED TO LOAD.
 - THROUGH CONTROLLER. REFER TO LIGHTING CONTROLLER DETAIL.
 - ADD CIRCUIT BREAKER TO EXISTING PANEL.
 - 100% RATED CIRCUIT BREAKER.
 - MATCH AIC RATING OF SERVICING DEVICE.

EQUIPMENT LABEL

ALL SWITCHBOARDS AND PANELBOARDS SHALL HAVE A LABEL APPLIED TO WARN OF POTENTIAL ARC FLASH HAZARDS.

WARNING


ARC FLASH AND SHOCK HAZARD. APPROPRIATE PERSONAL PROTECTIVE EQUIPMENT (PPE) REQUIRED.

NOTES:


A. ALL SWITCHBOARDS AND PANELBOARD SHALL HAVE A COMMERCIALY PRODUCED PERMANENT APPLIED LABEL, SIMILAR TO THE ABOVE, TO WARN OF POTENTIAL ARC FLASH HAZARDS IN ACCORDANCE WITH NEC 110.16 AND NFPA 70E.

B. LABELING MAY BE COMPLETED BY EQUIPMENT MANUFACTURER, EQUIPMENT VENDOR/SUPPLIER, OR THE CONTRACTOR. THE CONTRACTOR SHALL VERIFY THAT ALL SWITCHBOARDS AND PANELBOARDS ARE PROPERLY LABELED IN THE FIELD.


- #### GENERAL NOTES
- THE ELECTRICAL CONTRACTOR SHALL VERIFY ALL SERVICE AND METERING REQUIREMENTS WITH THE UTILITY COMPANY PRIOR TO BID AND SHALL BE RESPONSIBLE FOR PROVIDING AND INSTALLING ALL MATERIAL AS REQUIRED BY THE SERVING UTILITY AS WELL AS COST INCURRED BY THE SERVING UTILITY.
 - ALL EQUIPMENT LISTED IN THE FAULT CURRENT SCHEDULE SHALL HAVE AN AIC RATING GREATER THAN OR EQUAL TO THE FAULT CURRENT SHOWN.
 - THE ELECTRICAL CONTRACTOR SHALL VERIFY THE FAULT CURRENT AT THE SECONDARY OF THE TRANSFORMER WITH THE UTILITY COMPANY AND ADJUST THE ELECTRICAL PANEL AIC RATINGS TO THE NEXT HIGHER STANDARD RATING.
 - ALUMINUM SERVICE CONDUCTORS ARE NOT RECOMMENDED AND SHOULD ONLY BE USED WHERE ABSOLUTELY NECESSARY OR REQUIRED BY THE OWNER. CONTRACTOR TO CONTACT THE ENGINEER FOR SIZING. WHERE ALUMINUM CONDUCTORS ARE USED, THE OWNER SHALL PROVIDE ANNUAL MAINTENANCE OF ALL TERMINATIONS TO ENSURE SECURE CONNECTIONS. ALUMINUM WERE WILL EXPAND AND CONTRACT AND OVER TIME MAY BECOME BRITTLE. THE OWNER SHALL ASSUME RESPONSIBILITY FOR USING ALUMINUM CONDUCTORS WITHOUT PROPER INSTALLATION, CARE AND MAINTENANCE.
 - COORDINATE ALL SERVING AND METERING DETAILS INCLUDING ANY RELOCATION OF EXISTING UTILITY LINES WITH THE POWER COMPANY.
 - CONTRACTOR TO CONFIRM EXACT LOCATION OF METERS WITH ELECTRIC UTILITY.
 - PAY ANY POWER COMPANY FEES CHARGED TO OWNER FOR SERVICE AND UTILITY LINE WORK ASSOCIATED WITH THIS PROJECT. THESE COSTS SHALL BE INCLUDED IN BIDS.
 - FURNISH AND INSTALL MATERIALS FOR A TEMPORARY CONSTRUCTION SERVICE AS REQUIRED.
 - FURNISH AND/OR INSTALL ALL REQUIRED MATERIAL AND LABOR IN COMPLIANCE WITH POWER COMPANY REQUIREMENTS TO PROVIDE A COMPLETE ELECTRICAL SERVICE, INCLUDING TRENCHING AND BACK FILLING, PRIMARY CONDUIT, CONCRETE TRANSFORMER PAD, SECONDARY CONDUITS AND CABLES, C. T. CABINET, METERING AND GROUNDING SYSTEM.

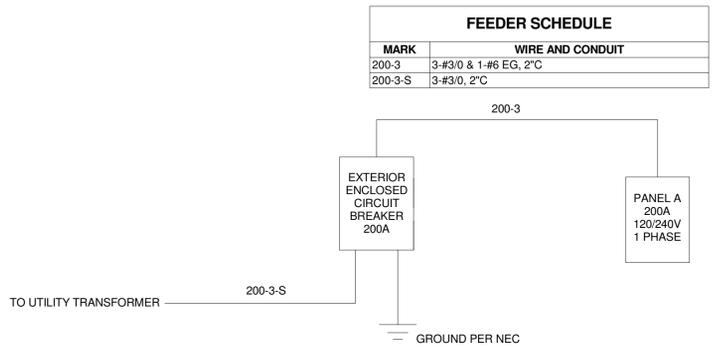


3
E3.0
RISER DIAGRAM - ELECTRICAL
1/8" = 1'-0"

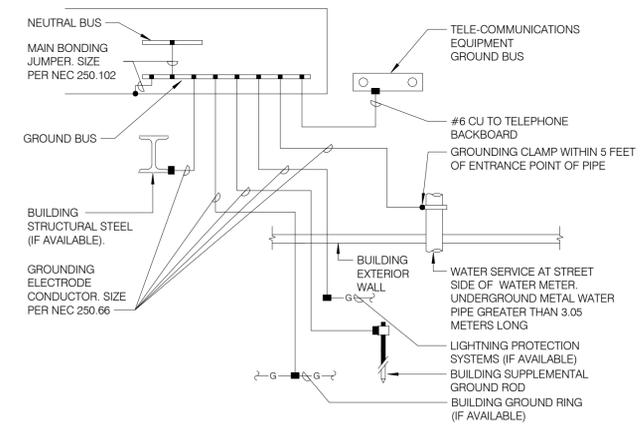

1
E3.0
TYPICAL GROUNDING DETAIL
1/2" = 1'-0"

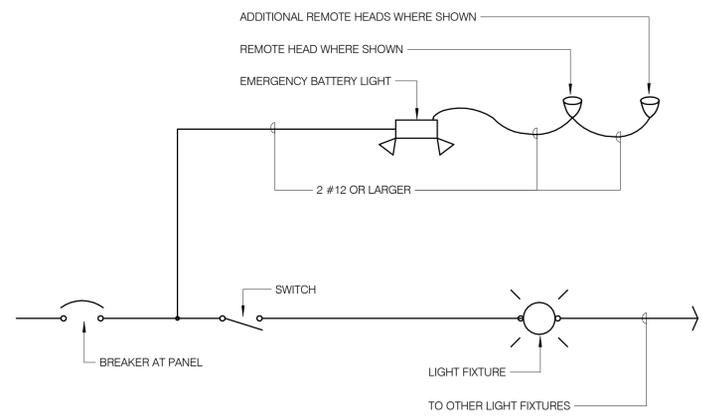


2
E3.0
EMERGENCY LIGHTING WIRING DIAGRAM
1/4" = 1'-0"

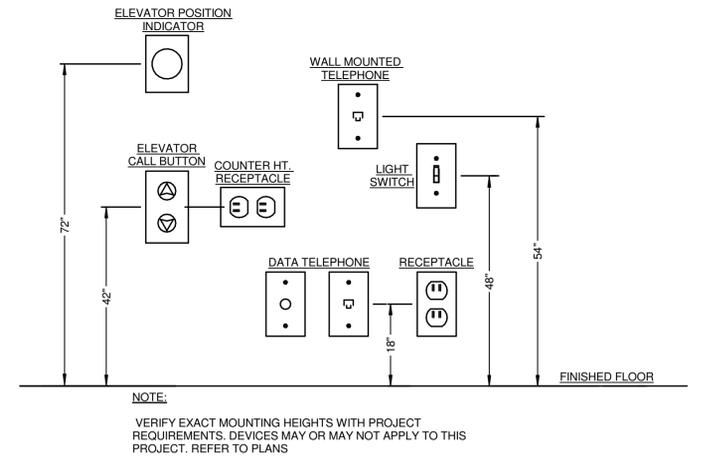

4
E3.0
MOUNTING HEIGHT DETAIL
NOT TO SCALE



OMNI ENGINEERS
PO BOX 2106
LOWELL, AR 72745
479-696-7873

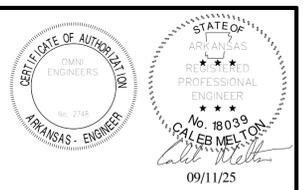

SECTION 26A GENERAL ELECTRICAL REQUIREMENTS

26A 1 GENERAL INSTRUCTIONS

26A 1-1 GENERAL REQUIREMENTS

REQUIREMENTS UNDER DIVISION 1 AND THE GENERAL AND SUPPLEMENTARY CONDITIONS OF THESE SPECIFICATIONS APPLY TO THIS SECTION AND DIVISION, WHERE THE REQUIREMENTS OF THIS SECTION AND DIVISION EXCEED THOSE OF DIVISION 1. THIS SECTION AND DIVISION TAKE PRECEDENCE. BECOME THOROUGHLY FAMILIAR WITH ALL THEIR CONTENTS AS TO REQUIREMENTS THAT AFFECT THIS DIVISION, SECTION OR BOTH. THE WORK REQUIRED UNDER THIS SECTION INCLUDES MATERIAL, EQUIPMENT, APPLIANCES, TRANSPORTATION, SERVICES, AND LABOR REQUIRED TO COMPLETE THE ENTIRE SYSTEM AS REQUIRED BY THE DRAWINGS AND SPECIFICATIONS, OR REASONABLY INFERRED TO BE NECESSARY TO FACILITATE EACH SYSTEM'S FUNCTIONING AS IMPLIED BY THE DESIGN AND THE EQUIPMENT SPECIFIED.

THE SPECIFICATIONS AND DRAWINGS FOR THE PROJECT ARE COMPLEMENTARY, AND PORTIONS OF THE WORK DESCRIBED IN ONE, SHALL BE PROVIDED AS IF DESCRIBED IN BOTH. IN THE EVENT OF DISCREPANCIES, NOTIFY THE ENGINEER AND REQUEST CLARIFICATION PRIOR TO PROCEEDING WITH THE WORK INVOLVED.

DRAWINGS ARE GRAPHIC REPRESENTATIONS OF THE WORK UPON WHICH THE CONTRACT IS BASED. THEY SHOW THE MATERIALS AND THEIR RELATIONSHIP TO ONE ANOTHER, INCLUDING SIZES, SHAPES, LOCATIONS, AND CONNECTIONS. THEY ALSO CONVEY THE SCOPE OF WORK, INDICATING THE INTENDED GENERAL ARRANGEMENT OF THE EQUIPMENT AND OTHER MATERIALS WITHOUT SHOWING ALL OF THE EXACT DETAILS AS TO ELEVATIONS, OFFSETS, CONTROL LINES, AND OTHER INSTALLATION REQUIREMENTS. USE THE DRAWINGS AS A GUIDE WHEN LAYING OUT THE WORK AND TO VERIFY THAT MATERIALS AND EQUIPMENT WILL FIT INTO THE DESIGNATED SPACES, AND WHICH, WHEN INSTALLED PER MANUFACTURERS' REQUIREMENTS, WILL ENSURE A COMPLETE, COORDINATED, SATISFACTORY AND PROPERLY OPERATING SYSTEM. DETERMINE EXACT LOCATIONS BY JOB MEASUREMENTS, BY CHECKING THE REQUIREMENTS OF OTHER TRADES, AND BY REVIEWING ALL CONTRACT DOCUMENTS. CORRECT ERRORS THAT COULD HAVE BEEN AVOIDED BY PROPER CHECKING AND INSPECTION, AT NO ADDITIONAL COST TO THE OWNER.

SPECIFICATIONS DEFINE THE QUALITATIVE REQUIREMENTS FOR PRODUCTS, MATERIALS, AND WORKMANSHIP UPON WHICH THE CONTRACT IS BASED.

26A 1-2 DEFINITIONS

WHenever used in these specifications or drawings, the following terms shall have the indicated meanings:

FURNISH: "TO SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLING, INSTALLING, AND SIMILAR OPERATIONS."

INSTALL: "TO PERFORM ALL OPERATIONS AT THE PROJECT SITE, INCLUDING, BUT NOT LIMITED TO, AND AS REQUIRED: UNLOADING, UNPACKING, ASSEMBLING, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, TESTING, COMMISSIONING, STARTING UP AND SIMILAR OPERATIONS, COMPLETE, AND READY FOR THE INTENDED USE."

PROVIDE: "TO FURNISH AND INSTALL COMPLETE, AND READY FOR THE INTENDED USE."

FURNISHED BY OWNER (OR OWNER-FURNISHED) OR FURNISHED BY OTHERS: "AN ITEM FURNISHED BY THE OWNER OR UNDER OTHER DIVISIONS OR CONTRACTS, AND INSTALLED UNDER THE REQUIREMENTS OF THIS DIVISION, COMPLETE, AND READY FOR THE INTENDED USE, INCLUDING ALL ITEMS AND SERVICES INCIDENTAL TO THE WORK NECESSARY FOR PROPER INSTALLATION AND OPERATION. INCLUDE THE INSTALLATION UNDER THE WARRANTY REQUIRED BY THIS DIVISION."

ENGINEER: WHERE REFERENCED IN THIS DIVISION, "ENGINEER" IS THE ENGINEER OF RECORD AND THE DESIGN PROFESSIONAL FOR THE WORK UNDER THIS DIVISION, AND IS A CONSULTANT TO, AND AN AUTHORIZED REPRESENTATIVE OF, THE ARCHITECT, AS DEFINED IN THE GENERAL AND/OR SUPPLEMENTARY CONDITIONS. WHEN USED IN THIS DIVISION, IT MEANS INCREASED INVOLVEMENT BY, AND OBLIGATIONS TO, THE ENGINEER, IN ADDITION TO INVOLVEMENT BY, AND OBLIGATIONS TO, THE ARCHITECT.

AHJ: THE LOCAL CODE AND/OR INSPECTION AGENCY (AUTHORITY) HAVING JURISDICTION OVER THE WORK.

NRTL: NATIONALLY RECOGNIZED TESTING LABORATORY, AS DEFINED AND LISTED BY OSHA IN 29 CFR 1910.7 (E.G., UL, ETL, CSA), AND ACCEPTABLE TO THE AHJ OVER THIS PROJECT.

THE TERMS "APPROVED EQUAL," "EQUIVALENT," OR "EQUAL" ARE USED SYNONYMOUSLY AND SHALL MEAN "ACCEPTED BY OR ACCEPTABLE TO THE ENGINEER AS EQUIVALENT TO THE ITEM OR MANUFACTURER SPECIFIED." THE TERM "APPROVED" SHALL MEAN LABELED, LISTED, CERTIFIED, OR ALL THREE, BY AN NRTL, AND ACCEPTABLE TO THE AHJ OVER THIS PROJECT.

26A 1-3 PRE-BID SITE VISIT

PRIOR TO SUBMITTING BID, VISIT THE SITE OF THE PROPOSED WORK AND BECOME FULLY INFORMED AS TO THE CONDITIONS UNDER WHICH THE WORK IS TO BE DONE. FAILURE TO DO SO WILL NOT BE CONSIDERED SUFFICIENT JUSTIFICATION TO REQUEST OR OBTAIN EXTRA COMPENSATION OVER AND ABOVE THE CONTRACT PRICE.

26A 1-4 MATERIAL AND WORKMANSHIP

PROVIDE ALL MATERIAL AND EQUIPMENT NEW AND IN FIRST CLASS CONDITION. PROVIDE MARKINGS OR A NAMEPLATE FOR ALL MATERIAL AND EQUIPMENT IDENTIFYING THE MANUFACTURER AND PROVIDING SUFFICIENT REFERENCE TO ESTABLISH QUALITY, SIZE AND CAPACITY. IN GENERAL, PROVIDE THE FOLLOWING QUALITY GRADE(S) FOR ALL MATERIALS AND EQUIPMENT:

COMMERCIAL SPECIFICATION GRADE
WORK PERFORMED UNDER THIS CONTRACT SHALL PROVIDE A NEAT AND "WORKMANLIKE" APPEARANCE WHEN COMPLETED, TO THE SATISFACTION OF THE ARCHITECT AND ENGINEER. WORKMANSHIP SHALL BE THE FINEST POSSIBLE BY EXPERIENCED MECHANICS OF THE PROPER TRADE.

THE COMPLETE INSTALLATION SHALL FUNCTION AS DESIGNED AND INTENDED WITH RESPECT TO EFFICIENCY, CAPACITY, NOISE LEVEL, ETC. ABNORMAL OR EXCESSIVE NOISE FROM EQUIPMENT, DEVICES OR OTHER SYSTEM COMPONENTS WILL NOT BE ACCEPTABLE.

REMOVE FROM THE PREMISES WASTE MATERIAL PRESENT AS A RESULT OF WORK. CLEAN EQUIPMENT INSTALLED UNDER THIS CONTRACT TO PRESENT A NEAT AND CLEAN INSTALLATION AT THE TERMINATION OF THE WORK.

REPAIR OR REPLACE PUBLIC AND PRIVATE PROPERTY DAMAGED AS A RESULT OF WORK PERFORMED UNDER THIS CONTRACT TO THE SATISFACTION OF AUTHORITIES AND REGULATIONS HAVING JURISDICTION.

26A 1-5 MANUFACTURERS

IN OTHER ARTICLES WHERE LISTS OF MANUFACTURERS ARE INTRODUCED, SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE PRODUCTS BY ONE OF THE MANUFACTURERS SPECIFIED.

WHERE A LIST IS PROVIDED, MANUFACTURERS LISTED ARE NOT IN ACCORDANCE WITH ANY RANKING OR PREFERENCE.

WHERE MANUFACTURERS ARE NOT LISTED, PROVIDE PRODUCTS SUBJECT TO COMPLIANCE WITH REQUIREMENTS FROM MANUFACTURERS THAT HAVE BEEN ACTIVELY INVOLVED IN MANUFACTURING THE SPECIFIED PRODUCT FOR NO LESS THAN 5 YEARS.

26A 1-6 COORDINATION

COORDINATE ALL WORK WITH OTHER DIVISIONS AND TRADES SO THAT THE VARIOUS COMPONENTS OF THE SYSTEMS WILL BE INSTALLED AT THE PROPER TIME, FIT THE AVAILABLE SPACE, AND WILL ALLOW PROPER SERVICE ACCESS TO THOSE ITEMS REQUIRING MAINTENANCE. REFER TO ALL OTHER DIVISION'S DRAWINGS, AND TO RELEVANT EQUIPMENT SUBMITTALS AND SHOP DRAWINGS TO DETERMINE THE EXTENT OF CLEAR SPACES. COMPONENTS WHICH ARE INSTALLED WITHOUT REGARD TO THE ABOVE SHALL BE RELOCATED AT NO ADDITIONAL COST TO THE OWNER.

UNLESS OTHERWISE INDICATED, THE GENERAL CONTRACTOR WILL PROVIDE CHASES AND OPENINGS IN BUILDING CONSTRUCTION REQUIRED FOR INSTALLATION OF THE SYSTEMS SPECIFIED HEREIN. CONTRACTOR SHALL FURNISH THE GENERAL CONTRACTOR WITH INFORMATION WHERE CHASES AND OPENINGS ARE REQUIRED. MAKE ALL OFFSETS REQUIRED TO CLEAR EQUIPMENT, BEAMS AND OTHER STRUCTURAL MEMBERS, AND TO FACILITATE CONCEALING SYSTEM COMPONENTS IN THE MANNER ANTICIPATED IN THE DESIGN. KEEP INFORMED AS TO THE WORK OF OTHER TRADES ENGAGED IN THE CONSTRUCTION OF THE PROJECT, AND EXECUTE WORK IN A MANNER AS TO NOT INTERFERE WITH OR DELAY THE WORK OF OTHER TRADES. FIGURED DIMENSIONS SHALL BE TAKEN IN PREFERENCE TO SCALE DIMENSIONS. CONTRACTOR SHALL TAKE HIS OWN MEASUREMENTS AT THE BUILDING, AS VARIATIONS MAY OCCUR. CONTRACTOR WILL BE HELD RESPONSIBLE FOR ERRORS THAT COULD HAVE BEEN AVOIDED BY PROPER CHECKING AND INSPECTION.

PROVIDE MATERIALS WITH TRIM THAT WILL PROPERLY FIT THE TYPES OF CEILING, WALL, OR FLOOR FINISHES ACTUALLY INSTALLED. MODEL NUMBERS LISTED IN THE CONSTRUCTION DOCUMENTS ARE NOT NECESSARILY INTENDED TO DESIGNATE THE REQUIRED TRIM.

26A 1-7 ORDINANCES, CODES, AND STANDARDS

WORK PERFORMED UNDER THIS CONTRACT SHALL, AT A MINIMUM, BE IN CONFORMANCE WITH APPLICABLE NATIONAL, STATE AND LOCAL CODES HAVING JURISDICTION. EQUIPMENT FURNISHED AND ASSOCIATED INSTALLATION WORK PERFORMED UNDER THIS CONTRACT SHALL BE IN STRICT COMPLIANCE WITH CURRENT APPLICABLE CODES ADOPTED BY THE LOCAL AHJ INCLUDING ANY AMENDMENTS AND STANDARDS AS SET FORTH BY THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), UNDERWRITERS LABORATORIES (UL), OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA), AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME), AMERICAN SOCIETY OF HEATING, REFRIGERATION, AND AIR CONDITIONING ENGINEERS (ASHRAE), AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), AMERICAN SOCIETY OF TESTING MATERIALS (ASTM) AND OTHER NATIONAL STANDARDS AND CODES WHERE APPLICABLE. ADDITIONALLY, COMPLY WITH RULES AND REGULATIONS OF PUBLIC UTILITIES AND MUNICIPAL DEPARTMENTS AFFECTED BY CONNECTION OF SERVICES. WHERE THE CONTRACT DOCUMENTS EXCEED THE REQUIREMENTS OF THE REFERENCED CODES, STANDARDS, ETC., THE CONTRACT DOCUMENTS SHALL TAKE PRECEDENCE.

PROMPTLY BRING ALL CONFLICTS OBSERVED BETWEEN CODES, ORDINANCES, RULES, REGULATIONS, REFERENCED STANDARDS, AND THESE DOCUMENTS TO THE ENGINEER'S ATTENTION FOR FINAL RESOLUTION. CONTRACTOR WILL BE HELD RESPONSIBLE FOR ANY VIOLATION OF THE LAW.

PROCURE AND PAY FOR PERMITS AND LICENSES REQUIRED FOR THE ACCOMPLISHMENT OF THE WORK HEREIN DESCRIBED. WHERE REQUIRED, OBTAIN, PAY FOR AND FURNISH CERTIFICATES OF INSPECTION TO OWNER. CONTRACTOR WILL BE HELD RESPONSIBLE FOR VIOLATIONS OF THE LAW.

26A 1-8 PROTECTION OF EQUIPMENT AND MATERIALS

STORE AND PROTECT FROM DAMAGE EQUIPMENT AND MATERIALS DELIVERED TO JOB SITE, IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS. FOR MATERIALS AND EQUIPMENT SUSCEPTIBLE TO CHANGING WEATHER CONDITIONS, DAMPNESS, OR TEMPERATURE VARIATIONS, STORE INSIDE IN CONDITIONED SPACES. FOR MATERIALS AND EQUIPMENT NOT SUSCEPTIBLE TO THESE CONDITIONS, COVER WITH WATERPROOF, TEAR-RESISTANT, HEAVY TARP OR POLYETHYLENE PLASTIC AS REQUIRED TO PROTECT FROM PLASTER, DIRT, PAINT, WATER, OR PHYSICAL DAMAGE. EQUIPMENT AND MATERIAL THAT HAS BEEN DAMAGED BY CONSTRUCTION ACTIVITIES WILL BE REJECTED, AND CONTRACTOR SHALL FURNISH NEW EQUIPMENT AND MATERIAL AS REQUIRED AT NO ADDITIONAL COST TO THE OWNER.

KEEP PREMISES BROOM CLEAN FROM FOREIGN MATERIAL CREATED DURING WORK PERFORMED UNDER THIS CONTRACT. PIPING, EQUIPMENT, ETC. SHALL HAVE A NEAT AND CLEAN APPEARANCE AT THE TERMINATION OF THE WORK.

PLUG OR CAP OPEN ENDS OF CONDUITS WHILE STORED AND INSTALLED DURING CONSTRUCTION WHEN NOT IN USE TO PREVENT THE ENTRANCE OF DEBRIS INTO THE SYSTEMS.

26A 1-9 SUBSTITUTIONS

INCLUDE IN THE BASE BID THE PRODUCTS SPECIFICALLY NAMED IN THESE SPECIFICATIONS OR IN THE DRAWINGS. SUBMIT, IN THE FORM OF ALTERNATES, WITH BID, PRODUCTS OF ANY OTHER MANUFACTURERS FOR SIMILAR USE. PROVIDED THE DIFFERENCES IN COST, IF ANY, ARE INCLUDED FOR EACH PROPOSED ALTERNATE.

NO SUBSTITUTIONS WILL BE CONSIDERED WITH RECEIPT OF BIDS, UNLESS THE ARCHITECT AND ENGINEER HAVE RECEIVED FROM THE BIDDER A WRITTEN REQUEST FOR APPROVAL. TO BID A SUBSTITUTION AT LEAST TEN CALENDAR DAYS PRIOR TO THE DATE FOR RECEIPT OF BIDS, AND HAVE APPROVED THE SUBSTITUTION REQUEST. INCLUDE, WITH EACH SUCH REQUEST, THE NAME OF THE MATERIAL OR EQUIPMENT FOR WHICH SUBSTITUTION IS BEING REQUESTED, AND A COMPLETE DESCRIPTION OF THE PROPOSED SUBSTITUTION, INCLUDING DRAWINGS, CUT SHEETS, PERFORMANCE AND TEST DATA, AND ALL OTHER INFORMATION NECESSARY FOR AN EVALUATION. INCLUDE ALSO A STATEMENT SETTING FORTH CHANGES IN OTHER MATERIALS, EQUIPMENT OR OTHER WORK THAT WOULD BE REQUIRED TO INCORPORATE THE SUBSTITUTION. THE BURDEN OF PROOF OF THE MERIT OF THE PROPOSED SUBSTITUTE IS UPON THE PROPOSER. THE PROPOSER OF ANY SUBSTITUTIONS SHALL COMPENSATE THE ENGINEER AT A RATE OF \$150.00 PER HOUR FOR TIME SPENT EVALUATING PROPOSED SUBSTITUTIONS AND OR THE SUBSEQUENT REVISIONS TO THE DESIGN REQUIRED TO UTILIZE THE SUBSTITUTION.

THE ARCHITECT'S OR ENGINEER'S DECISION TO APPROVE OR DISAPPROVE A SUBSTITUTION IN A BID IS FINAL.

IF THE PROPOSED SUBSTITUTION IS APPROVED PRIOR TO RECEIPT OF BIDS, SUCH APPROVAL WILL BE STATED IN AN ADDENDUM. BIDDERS SHALL NOT RELY UPON APPROVALS MADE IN ANY OTHER MANNER, INCLUDING VERBAL.

NO SUBSTITUTIONS WILL BE CONSIDERED AFTER RECEIPT OF BIDS AND BEFORE AWARD OF THE CONTRACT.

NO SUBSTITUTIONS WILL BE CONSIDERED AFTER THE CONTRACT IS AWARDED UNLESS SPECIFICALLY PROVIDED IN THE CONTRACT DOCUMENTS.

26A 1-10 SUBMITTALS

ASSEMBLE AND SUBMIT TO THE ARCHITECT, FOR ENGINEER'S REVIEW, MANUFACTURERS' PRODUCT LITERATURE FOR MATERIAL AND EQUIPMENT TO BE FURNISHED, INSTALLED, OR BOTH, UNDER THIS DIVISION, INCLUDING SHOP DRAWINGS, MANUFACTURERS' PRODUCT DATA AND PERFORMANCE SHEETS, SAMPLES, AND OTHER SUBMITTALS REQUIRED BY THIS DIVISION. HIGHLIGHT, MARK, LIST OR INDICATE THE MATERIALS, PERFORMANCE CRITERIA AND ACCESSORIES THAT ARE BEING PROPOSED. PROVIDE THE NUMBER OF SUBMITTALS REQUIRED BY DIVISION 1; HOWEVER, AT A MINIMUM, SUBMIT TWO (2) SETS. BEFORE SUBMITTING, VERIFY THAT ALL MATERIALS AND EQUIPMENT SUBMITTED ARE MUTUALLY COMPATIBLE AND SUITABLE FOR THE INTENDED USE, FIT THE AVAILABLE SPACES, AND ALLOW AMPLE AND CODE-REQUIRED ROOM FOR ACCESS AND MAINTENANCE. SUBMITTALS SHALL CONTAIN THE FOLLOWING INFORMATION. SUBMITTALS NOT SO IDENTIFIED WILL BE RETURNED TO THE CONTRACTOR WITHOUT ACTION:

- A. THE PROJECT NAME.
- B. THE APPLICABLE SPECIFICATION SECTION AND PARAGRAPH.
- C. THE SUBMITTAL DATE.
- D. THE CONTRACTOR'S STAMP, WHICH SHALL CERTIFY THAT THE STAMPED DRAWINGS HAVE BEEN CHECKED BY THE CONTRACTOR, COMPLY WITH THE DRAWINGS AND SPECIFICATIONS, AND HAVE BEEN COORDINATED WITH OTHER TRADES.

SUBMITTALS AND SHOP DRAWINGS SHALL NOT CONTAIN OMNI ENGINEERS' FIRM NAME OR LOGO, NOR SHALL IT CONTAIN THE OMNI ENGINEERS' ENGINEERS' SEAL AND SIGNATURE. THEY SHALL NOT BE COPIES OF OMNI ENGINEERS' WORK PRODUCT.

TRANSMIT SUBMITTALS AS EARLY AS REQUIRED TO SUPPORT THE PROJECT SCHEDULE. ALLOW FOR TWO WEEKS ENGINEER REVIEW TIME, PLUS MAILING TIME, PLUS A DUPLICATION OF THIS TIME FOR RE-SUBMITTALS, IF REQUIRED. THE ENGINEER'S SUBMITTAL REVIEWS WILL NOT RELIEVE THE CONTRACTOR FROM RESPONSIBILITY FOR ERRORS IN DIMENSIONS, DETAILS, SIZE OF MEMBERS, OR QUANTITIES; OR FOR OMITTING COMPONENTS OR FITTINGS; OR FOR NOT COORDINATING ITEMS WITH ACTUAL BUILDING CONDITIONS.

REFER TO DIVISION 1 FOR ACCEPTANCE OF ELECTRONIC SUBMITTALS FOR THIS PROJECT. FOR ELECTRONIC SUBMITTALS, CONTRACTOR SHALL SUBMIT THE DOCUMENTS IN ACCORDANCE WITH THE PROCEDURES SPECIFIED IN DIVISION 1. CONTRACTOR SHALL NOTIFY THE ARCHITECT AND ENGINEER THAT THE SHOP DRAWINGS HAVE BEEN POSTED. IF ELECTRONIC SUBMITTAL PROCEDURES ARE NOT DEFINED IN DIVISION 1, CONTRACTOR SHALL INCLUDE THE WEBSITE, USER NAME AND PASSWORD INFORMATION NEEDED TO ACCESS THE SUBMITTALS. FOR SUBMITTALS SENT BY E-MAIL, CONTRACTOR SHALL COPY THE ARCHITECT AND ENGINEER'S DESIGNATED REPRESENTATIVES. CONTRACTOR SHALL ALLOW THE ENGINEER REVIEW TIME AS SPECIFIED ABOVE IN THE CONSTRUCTION SCHEDULE. CONTRACTOR SHALL SUBMIT ONLY THE DOCUMENTS REQUIRED TO PURCHASE THE MATERIALS AND/OR EQUIPMENT IN THE ELECTRONIC SUBMITTAL AND SHALL CLEARLY INDICATE THE MATERIALS, PERFORMANCE CRITERIA AND ACCESSORIES BEING PROPOSED. GENERAL PRODUCT CATALOG DATA NOT SPECIFICALLY NOTED TO BE PART OF THE SPECIFIED PRODUCT WILL BE REJECTED AND RETURNED WITHOUT REVIEW.

26A 1-11 ELECTRONIC DRAWING FILES

IN PREPARATION OF SHOP DRAWINGS OR RECORD DRAWINGS, CONTRACTOR MAY, AS AN OPTION, OBTAIN ELECTRONIC DRAWING FILES IN REVIT, AUTOCAD, OR DXF FORMAT FROM THE ENGINEER FOR A FEE OF \$200 FOR THE FIRST SHEET AND \$100 PER SHEET FOR EACH ADDITIONAL SHEET. CONTACT THE ARCHITECT FOR WRITTEN AUTHORIZATION; AND, CONTACT THE ENGINEER TO OBTAIN THE NECESSARY RELEASE AGREEMENT FORM AND TO INDICATE THE DESIRED SHIPPING METHOD AND DRAWING FORMAT. IN ADDITION TO PAYMENT, ARCHITECT'S WRITTEN AUTHORIZATION AND ENGINEER'S RELEASE AGREEMENT FORM MUST BE RECEIVED BEFORE ELECTRONIC DRAWING FILES WILL BE SENT.

26A 1-12 OPERATION AND MAINTENANCE MANUALS

SUBMIT TO THE ARCHITECT, FOR ENGINEER'S REVIEW, COPIES EACH OF OPERATIONS AND MAINTENANCE INSTRUCTION MANUALS, APPROPRIATELY BOUND INTO MANUAL FORM INCLUDING APPROVED COPIES OF THE FOLLOWING, REVISED IF NECESSARY TO SHOW SYSTEM AND EQUIPMENT AS ACTUALLY INSTALLED. PAPER CLIPS, STAPLES, RUBBER BANDS, AND MAILING ENVELOPES ARE NOT CONSIDERED APPROVED BINDERS. PROVIDE THE NUMBER OF SUBMITTALS REQUIRED BY DIVISION 1; HOWEVER, AT A MINIMUM, SUBMIT TWO (2) SETS, AND INCLUDE, AT A MINIMUM, THE FOLLOWING INFORMATION:

- A. COVER SHEET THAT LISTS THE PROJECT NAME, DATE, OWNER, ARCHITECT, CONSULTING ENGINEER, GENERAL CONTRACTOR, SUB-CONTRACTOR, AND AN INDEX OF CONTENTS.
- B. MANUFACTURERS' CATALOGS AND PRODUCT DATA SHEETS
- C. OPERATION AND MAINTENANCE INSTRUCTIONS
- D. PARTS LISTS
- E. APPROVED SHOP DRAWINGS
- F. TEST REPORTS AS DEFINED IN NETA ATS FOR THE SYSTEMS AND EQUIPMENT
- G. PAINTED COATINGS: MANUFACTURER'S STANDARD PAINTED COATING APPLIED ACCORDING TO MFMA-3.
- H. NAMES, ADDRESSES, TELEPHONE NUMBERS, AND E-MAIL ADDRESSES OF LOCAL CONTACTS FOR WARRANTY SERVICES AND SPARE PARTS.

SUBMIT MANUALS PRIOR TO REQUESTING THE FINAL PUNCH LIST AND BEFORE ANY REQUESTS FOR SUBSTANTIAL COMPLETION. FINAL APPROVAL OF THIS DIVISION'S SYSTEMS INSTALLED UNDER THIS CONTRACT WILL BE WITHHELD UNTIL THIS EQUIPMENT BROCHURE IS RECEIVED AND DEEMED COMPLETE BY THE ARCHITECT AND ENGINEER.

PROVIDE "AS-BUILT" DRAWINGS (SEE DIVISION 1 AND GENERAL CONDITIONS).

26A 1-13 TRAINING

AT A TIME MUTUALLY AGREED UPON BETWEEN THE OWNER AND CONTRACTOR, PROVIDE THE SERVICES OF A FACTORY TRAINED AND AUTHORIZED REPRESENTATIVE TO TRAIN OWNER'S DESIGNATED PERSONNEL ON THE OPERATION AND MAINTENANCE OF THE EQUIPMENT PROVIDED FOR THIS PROJECT.

PROVIDE TRAINING TO INCLUDE BUT NOT BE LIMITED TO AN OVERVIEW OF THE SYSTEM AND/OR EQUIPMENT AS IT RELATES TO THE FACILITY AS A WHOLE; OPERATION AND MAINTENANCE PROCEDURES AND SCHEDULES RELATED TO STARTUP AND SHUTDOWN, TROUBLESHOOTING, SERVICING, PREVENTIVE MAINTENANCE AND APPROPRIATE OPERATOR INTERVENTION; AND REVIEW OF DATA INCLUDED IN THE OPERATION AND MAINTENANCE MANUALS.

SUBMIT A CERTIFICATION LETTER TO THE ARCHITECT STATING THAT THE OWNER'S DESIGNATED REPRESENTATIVE HAS BEEN TRAINED AS SPECIFIED HEREIN. LETTER SHALL INCLUDE DATE, TIME, ATTENDEES AND SUBJECT OF TRAINING. THE CONTRACTOR AND THE OWNER'S REPRESENTATIVE SHALL SIGN THE CERTIFICATION LETTER INDICATING AGREEMENT THAT THE TRAINING HAS BEEN PROVIDED.

SCHEDULE TRAINING WITH OWNER WITH AT LEAST 7 DAYS ADVANCE NOTICE.

26A 1-14 WARRANTIES

WARRANT EACH SYSTEM AND EACH ELEMENT THEREOF AGAINST ALL DEFECTS DUE TO FAULTY WORKMANSHIP, DESIGN OR MATERIAL FOR A PERIOD OF 12 MONTHS FROM DATE OF SUBSTANTIAL COMPLETION, UNLESS SPECIFIC ITEMS ARE NOTED TO CARRY A LONGER WARRANTY IN THE CONSTRUCTION DOCUMENTS OR MANUFACTURER'S STANDARD WARRANTY EXCEEDS THIS DURATION. WARRANTIES SHALL INCLUDE LABOR AND MATERIAL, REMEDY ALL DEFECTS, OCCURRING WITHIN THE WARRANTY PERIOD(S), AS STATED IN THE GENERAL CONDITIONS AND DIVISION 1 WITHOUT ANY ADDITIONAL COSTS TO THE OWNER.

PERFORM ANY REQUIRED REMEDIAL WORK PROMPTLY, UPON WRITTEN NOTICE FROM THE ENGINEER OR OWNER.

AT THE TIME OF SUBSTANTIAL COMPLETION, DELIVER TO THE OWNER ALL WARRANTIES, IN WRITING AND PROPERLY EXECUTED, INCLUDING TERM LIMITS FOR WARRANTIES EXTENDING BEYOND THE REQUIRED PERIOD, EACH WARRANTY INSTRUMENT BEING ADDRESSED TO THE OWNER AND STATING THE COMMENCEMENT DATE AND TERM.

26A 2 ELECTRICAL WORK

26A 2-1 BUILDING OPERATION

COMPLY WITH THE SCHEDULE OF OPERATIONS AS OUTLINED IN THE ARCHITECTURAL PORTIONS OF THIS SPECIFICATION. BUILDING SHALL BE IN CONTINUOUS OPERATION, ACCOMPLISH WORK THAT REQUIRES INTERRUPTION OF BUILDING OPERATION AT A TIME WHEN THE BUILDING IS NOT IN OPERATION, AND ONLY WITH WRITTEN APPROVAL OF BUILDING OWNER AND/OR TENANT. COORDINATE INTERRUPTION OF BUILDING OPERATION WITH THE OWNER AND/OR TENANT A MINIMUM OF 7 DAYS IN ADVANCE OF WORK.

26A 2-2 EXCAVATION AND BACKFILLING

PERFORM EXCAVATION AND BACKFILL REQUIRED FOR INSTALLATION OF UNDERGROUND WORK UNDER THIS CONTRACT. TRENCHES SHALL BE OF SUFFICIENT WIDTH, CRIB OR BRACE TRENCHES TO PREVENT CAVE-IN OR SETTLEMENT. DO NOT EXCAVATE TRENCHES CLOSE TO COLUMNS AND WALLS OF BUILDING WITHOUT PRIOR CONSULTATION WITH THE ARCHITECT. USE PUMPING EQUIPMENT IF REQUIRED TO KEEP TRENCHES FREE OF WATER. BACKFILL TRENCHES IN MAXIMUM 6" LAYERS OF WELL-TAMPED DRY EARTH IN A MANNER TO PREVENT FUTURE SETTLEMENT.

EXCAVATION AS HEREIN SPECIFIED SHALL BE CLASSIFIED AS COMMON EXCAVATION. COMMON EXCAVATION SHALL COMPRISE THE SATISFACTORY REMOVAL AND DISPOSITION OF MATERIAL OF WHATEVER SUBSTANCES AND OF EVERY DESCRIPTION ENCOUNTERED, INCLUDING ROCK, IF ANY, WITHIN THE LIMITS OF THE WORK AS SPECIFIED AND SHOWN ON THE DRAWINGS. EXCAVATION SHALL BE PERFORMED TO THE LINES AND GRADES INDICATED ON THE DRAWINGS. EXCAVATED MATERIALS WHICH ARE CONSIDERED UNSUITABLE FOR BACKFILL, AND SURPLUS OF EXCAVATED MATERIAL WHICH IS NOT REQUIRED FOR BACKFILL, SHALL BE DISPOSED OF BY THE CONTRACTOR AT HIS OWN EXPENSE AND RESPONSIBILITY, AND TO THE SATISFACTION OF THE ARCHITECT.

26A 2-3 COINCIDENTAL DAMAGE

REPAIR ALL STREETS, SIDEWALKS, DRIVES, PAVING, WALLS, FINISHES, AND OTHER FACILITIES DAMAGED IN THE COURSE OF THIS WORK. REPAIR MATERIALS SHALL MATCH EXISTING CONSTRUCTION AND OR CONFORM TO ALL REQUIREMENTS IDENTIFIED IN OTHER DIVISIONS. ALL BACKFILLING AND REPAIRING SHALL MEET ALL REQUIREMENTS OF THE OWNER, CITY AND OTHERS HAVING JURISDICTION. REPAIR WORK SHALL BE THOROUGHLY FIRST CLASS.

26A 2-4 CUTTING AND PATCHING

FOLLOWING THE REQUIREMENTS IN DIVISION 1, CUT WALLS, FLOORS, CEILINGS, AND OTHER PORTIONS OF THE FACILITY AS REQUIRED TO PERFORM WORK UNDER THIS DIVISION. OBTAIN PERMISSION OF THE ARCHITECT, OWNER, OR BOTH, BEFORE DOING ANY CUTTING, CUT ALL HOLES AS SMALL AS POSSIBLE. PATCH WALLS, FLOORS, AND OTHER PORTIONS OF THE FACILITY AS REQUIRED BY WORK UNDER THIS DIVISION. ALL PATCHING SHALL BE THOROUGHLY FIRST CLASS AND SHALL MATCH THE ORIGINAL MATERIAL AND CONSTRUCTION, INCLUDING FIRE RATINGS IF APPLICABLE IN A MANNER SATISFACTORY TO THE ARCHITECT.

26A 2-5 ROUGH-IN

COORDINATE WITHOUT DELAY ALL ROUGHING-IN WITH OTHER DIVISIONS. CONCEAL ALL PIPING AND ROUGH-IN EXCEPT IN UNFINISHED AREAS AND WHERE OTHERWISE INDICATED IN THE CONSTRUCTION DOCUMENTS.

26A 2-6 SUPPORT SYSTEMS

STEEL SLOTTED SUPPORT SYSTEMS (SLOTTED CHANNEL): COMPLY WITH MFMA-3, FACTORY-FABRICATED COMPONENTS FOR FIELD ASSEMBLY, 12-GAUGE, 1-5/8-INCH BY 1-5/8-INCH; COOPER B-LINE, ERICO INTERNATIONAL CORPORATION, UNISTRUT, THOMAS & BETTS CORPORATION, UNISTRUT.

FINISHES:

- A. METALLIC COATINGS: HOT-DIP GALVANIZED AFTER FABRICATION AND APPLIED ACCORDING TO MFMA-3.
- B. NONMETALLIC COATINGS: MANUFACTURER'S STANDARD PVC, POLYURETHANE OR POLYESTER COATING APPLIED ACCORDING TO MFMA-3.
- C. PAINTED COATINGS: MANUFACTURER'S STANDARD PAINTED COATING APPLIED ACCORDING TO MFMA-3.
- D. STAINLESS STEEL: TYPE 304, PER ASTM A240.

ALUMINUM SLOTTED SUPPORT SYSTEMS (SLOTTED CHANNEL): COMPLY WITH MFMA-3, TYPE 6063-T6, PER ASTM B221; FACTORY-FABRICATED COMPONENTS FOR FIELD ASSEMBLY, 12-GAUGE, 1-5/8-INCH BY 1-5/8-INCH; COOPER B-LINE, ERICO INTERNATIONAL CORPORATION, UNISTRUT, THOMAS & BETTS CORPORATION, UNISTRUT.

FIELD FABRICATION:

- A. WHERE FIELD CUTTING OF STANDARD LENGTHS OF CHANNEL ARE REQUIRED, MAKE CUTS STRAIGHT AND PERPENDICULAR TO MANUFACTURED SURFACES.
- B. FOR FIELD-CUT OR DAMAGED SURFACES OF COATED CHANNELS, DRESS CUT ENDS, DAMAGED SURFACES, OR BOTH, WITH AN ABRASIVE MATERIAL (E.G., FILE, GRINDING STONE, OR SIMILAR) AND CLEANSER TO REMOVE OILS, RUST, SHARP EDGES AND SHARDS.
- C. FOR CHANNEL WITH A FACTORY-APPLIED COATING, RE-FINISH CUT EDGES WITH A COATING COMPATIBLE WITH THE FACTORY FINISH AND AS RECOMMENDED BY THE MANUFACTURER (E.G., MANUFACTURER'S TOUCH-UP PAINT OR ZINC-RICH COLD-GALVANIZING COMPOUND, AS APPLICABLE).

26A 2-7 PENETRATIONS

COORDINATE SLEEVE SELECTION AND APPLICATION WITH SELECTION AND APPLICATION OF FIRE-STOPPING SPECIFIED IN DIVISION 7 SECTION "THROUGH-PENETRATION FIRESTOP SYSTEMS."

ROOFS:

- A. COORDINATE ALL ROOF PENETRATIONS WITH ENGINEER, OWNER, AND AS APPLICABLE, THE ROOFING CONTRACTOR PROVIDING A ROOF WARRANTY.
- B. KEEP ALL RACEWAY PENETRATIONS WITHIN MECHANICAL EQUIPMENT CURBS WHEREVER POSSIBLE. COORDINATE WITH ALL OTHER APPLICABLE DIVISION'S WORK.
- C. FLASH AND COUNTERFLASH ALL OPENINGS THROUGH ROOF, AND/OR PROVIDE PRE-FABRICATED MOLDED SEALS COMPATIBLE WITH THE ROOF CONSTRUCTION INSTALLED, OR AS REQUIRED BY THE ENGINEER, OWNER, OR ROOFING CONTRACTOR. ALL ROOF PENETRATIONS SHALL BE LEAK-TIGHT AT THE TERMINATION OF THE WORK AND SHALL NOT VOID ANY NEW OR EXISTING ROOF WARRANTIES.

WALLS AND FLOORS:

SLEEVES FOR RACEWAYS AND CABLES

- A. STEEL PIPE SLEEVES: ASTM A 53A 53M, TYPE E, GRADE B, SCHEDULE 40, GALVANIZED STEEL, PLAIN ENDS AND DRIP RINGS.
- B. CAST-IRON PIPE SLEEVES: CAST OR FABRICATED "WALL PIPE," EQUIVALENT TO TUDILE-IRON PRESSURE PIPE, WITH PLAIN ENDS AND INTEGRAL WATERSTOP, UNLESS OTHERWISE INDICATED.

SLEEVES FOR RECTANGULAR OPENINGS: GALVANIZED SHEET STEEL WITH MINIMUM 0.138 INCH THICKNESS AND OF WIDTH AND LENGTH TO SUIT APPLICATION.

26A 2-8 FIRE-STOPPING THROUGH PENETRATIONS

FIRE-RESISTANT THROUGH PENETRATION SEALANTS: TWO-PART, FOAMED-IN-PLACE, SILICONE SEALANT FORMULATED FOR USE IN THROUGH-PENETRATION FIRE-STOPPING AROUND CABLES, RACEWAYS, AND CABLE TRAY PENETRATIONS THROUGH FIRE-RATED WALLS AND FLOORS. SEALANTS AND ACCESSORIES SHALL HAVE FIRE-RESISTANCE RATINGS INDICATED, AS ESTABLISHED BY TESTING IDENTICAL ASSEMBLIES IN ACCORDANCE WITH ASTM E 814, BY UNDERWRITERS LABORATORIES, INC., OR OTHER NRTL ACCEPTABLE TO AHJ.

ACCEPTABLE MANUFACTURERS:

- A. HILTI, INC.
- B. 3M CORP.
- C. RECTORSEAL
- D. SPECIFY TECHNOLOGY INC.
- E. UNITED STATES GYPSUM COMPANY.

SUBMITTALS

- A. SUBMIT PRODUCT DATA, MANUFACTURER'S SPECIFICATIONS AND TECHNICAL DATA FOR EACH MATERIAL INCLUDING THE COMPOSITION AND LIMITATIONS. DOCUMENTATION OF UL FIRESTOP SYSTEMS TO BE USED AND MANUFACTURER'S INSTALLATION INSTRUCTIONS TO COMPLY WITH DIVISION 1.
- B. MANUFACTURER'S ENGINEERING JUDGMENT IDENTIFICATION NUMBER AND DRAWING DETAILS WHEN NO UL SYSTEM IS AVAILABLE FOR AN APPLICATION. ENGINEERING JUDGMENT SHALL INCLUDE BOTH PROJECT NAME AND CONTRACTOR'S NAME WHO WILL INSTALL FIRESTOP SYSTEM AS DESCRIBED IN DRAWINGS.
- C. SUBMIT MATERIAL SAFETY DATA SHEETS PROVIDED WITH PRODUCT DELIVERED TO JOB-SITE.

26A 2-9 CONCRETE BASES

PROVIDE CONCRETE BASES (E.G., HOUSEKEEPING PADS) FOR EQUIPMENT WHERE INDICATED ON THE DRAWINGS AND AS SPECIFIED HEREIN. CONCRETE BASES SHALL HAVE CHAMFERED EDGES. SIZE OF BASE SHALL BE A MINIMUM OF 2 INCHES GREATER THAN THE FOOTPRINT OF THE EQUIPMENT THAT IT IS SUPPORTING.

CONSTRUCT EQUIPMENT BASES OF A MINIMUM 28-DAY, 4000-PSI CONCRETE CONFORMING TO AMERICAN CONCRETE INSTITUTE STANDARD BUILDING CODE FOR REINFORCED CONCRETE (ACI 318-99) AND THE LATEST APPLICABLE RECOMMENDATIONS OF THE ACI STANDARD PRACTICE MANUAL. CONCRETE SHALL BE COMPOSED OF CEMENT CONFORMING TO ASTM C 150 TYPE I, AGGREGATE CONFORMING TO ASTM C33, AND POTABLE WATER. EXPOSED EXTERIOR CONCRETE SHALL CONTAIN 5 TO 7 PERCENT AIR ENTRAINMENT.

UNLESS OTHERWISE SPECIFIED OR SHOWN ON THE STRUCTURAL DRAWINGS, REINFORCE EQUIPMENT BASES WITH NO. 4 REINFORCING BARS CONFORMING TO ASTM A 615 OR 6X6 - W2.9 X W2.9 WELDED WIRE MESH CONFORMING TO ASTM A185. PLACE REINFORCING BARS 24 INCHES ON CENTER WITH A MINIMUM OF TWO BARS EACH DIRECTION.

PROVIDE GALVANIZED ANCHOR BOLTS FOR EQUIPMENT PLACED ON CONCRETE BASES OR ON CONCRETE SLABS. ANCHOR BOLTS SIZE, NUMBER AND PLACEMENT SHALL BE AS RECOMMENDED BY THE MANUFACTURER OF THE EQUIPMENT.

CONCRETE EQUIPMENT BASES SHALL HAVE A MINIMUM HEIGHT OF 4 INCHES AND SHALL BE POURED-IN-PLACE.

26A 2-10 ACCESS DOORS

PROVIDE ACCESS DOORS IN CEILINGS AND WALLS, WHERE INDICATED OR REQUIRED FOR ACCESS OR MAINTENANCE TO CONCEALED EQUIPMENT INSTALLED UNDER THIS SECTION. PROVIDE CONCEALED HINGES, SCREWDRIVER-TYPE LOCK, AND ANCHOR STRAPS.

MANUFACTURED BY MLCOR, ZURN, TITUS, OR EQUAL. OBTAIN ARCHITECT'S APPROVAL OF TYPE, SIZE, LOCATION AND COLOR BEFORE ORDERING.

26A 2-11 EQUIPMENT FURNISHED BY OTHERS

PROVIDE NECESSARY EQUIPMENT AND ACCESSORIES THAT ARE NOT PROVIDED BY THE EQUIPMENT SUPPLIER OR OWNER TO COMPLETE INSTALLATION OF EQUIPMENT FURNISHED BY OTHERS, IN LOCATIONS AS INDICATED ON THE DRAWINGS, SPECIFIED HEREIN, OR BOTH. EQUIPMENT AND ACCESSORIES NOT PROVIDED BY THE EQUIPMENT SUPPLIER MAY INCLUDE SUCH ITEMS AS FLEXIBLE CORDS AND PLUGS, AS REQUIRED FOR PROPER OPERATION OF THE COMPLETE SYSTEM, IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.


BE RESPONSIBLE FOR CORRECT ROUGH-IN DIMENSIONS, AND VERIFY THEM WITH ENGINEER, OWNER'S REPRESENTATIVE, EQUIPMENT SUPPLIER, OR ALL THREE, PRIOR TO ROUGH-IN AND SERVICE INSTALLATIONS.

26A 2-12 CLEANING

IN ADDITION TO THE REQUIREMENTS OF DIVISION 1, REMOVE FROM THE PREMISES DIRT AND REFUSE RESULTING FROM THE PERFORMANCE OF THE ELECTRICAL WORK, AS REQUIRED, TO PREVENT ACCUMULATION. COOPERATE IN MAINTAINING REASONABLY CLEAN PREMISES AT ALL TIMES, IMMEDIATELY PRIOR TO FINAL INSPECTION. MAKE A FINAL CLEANUP OF DIRT AND REFUSE RESULTING FROM THE WORK. CLEAN ALL MATERIAL AND EQUIPMENT INSTALLED UNDER THIS DIVISION. REMOVE DIRT, DUST, PLASTER, STAINS AND FOREIGN MATTER FROM ALL SURFACES. TOUCH UP AND RESTORE ALL DAMAGED FINISHES TO THEIR ORIGINAL CONDITION.



OWN ENGINEERS
PO BOX 2106
LOWELL, AR 72745
479-696-7873



Burris Architecture
479 Tiger Blvd, Suite 4, Bentonville, Ar 72712
820-319-6045



SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE 09/11/25
JOB NO. 25089
REVISIONS

E4.1
ELECTRICAL SPECIFICATIONS

26A 2-15 SYSTEM START UP

PRIOR TO STARTING UP THE ELECTRICAL SYSTEMS:

- CHECK ALL COMPONENTS AND DEVICES.
- LUBRICATE ITEMS ACCORDINGLY.
- TIGHTEN SCREWS AND BOLTS FOR CONNECTORS AND TERMINALS ACCORDING TO MANUFACTURERS PUBLISHED TORQUE-TIGHTENING VALUES. IF MANUFACTURERS TORQUE VALUES ARE NOT INDICATED, USE THOSE SPECIFIED IN UL 488A AND UL 486B.
- ADJUST TAPS ON EACH TRANSFORMER FOR RATED SECONDARY VOLTAGE WHEN THE TRANSFORMER IS AT MINIMUM LOAD.
- CHECK AND ADJUST BONDING'S SERVICE ENTRANCE VOLTAGE, GROUNDING CONDITIONS, GROUNDING RESISTANCE, AND PROPER PHASING.
- REPLACE ALL BURNED OUT LAMPS AND LAMPS USED FOR TEMPORARY CONSTRUCTION LIGHTING IN PERMANENT LIGHT FIXTURES.
- AFTER ALL SYSTEMS HAVE BEEN INSPECTED AND ADJUSTED, CONFIRM ALL OPERATING FEATURES REQUIRED BY THE DRAWINGS AND SPECIFICATIONS AND MAKE FINAL ADJUSTMENTS AS NECESSARY.

26A 4 ALTERNATES

PROVIDE ALL WORK CONTEMPLATED UNDER THE DIFFERENT ALTERNATES TO INCLUDE LABOR, MATERIALS, EQUIPMENT AND SERVICES NECESSARY FOR AND INCIDENTAL TO THE COMPLETION OF WORK UNDER EACH PARTICULAR ALTERNATE. FURNISH SEPARATE BIDS FOR EACH ALTERNATE APPLICABLE TO CONTRACTOR'S PROPOSAL, STATING THE AMOUNT TO BE ADDED OR DEDUCTED FROM THE BASE BID IN CASE THE ALTERNATE IS ACCEPTED. COMPLY WITH APPLICABLE SECTIONS OF THE BASE SPECIFICATIONS FOR WORK REQUIRED BY THE ALTERNATE UNLESS OTHERWISE SPECIFIED. REFER TO THE ARCHITECTURAL PORTION OF THE SPECIFICATION.

END OF SECTION 26A

26B BASIC ELECTRICAL MATERIALS AND METHODS

26B 1 METHODS

26B 1-1 RACEWAYS

METALLIC CONDUIT AND TUBING:

- ELECTRICAL METALLIC TUBING AND FITTINGS (EMT): ANSI C80.3, UL 797. REDUCED WALL EMT IS NOT ALLOWED.
- FLEXIBLE METAL CONDUIT (FMC): ZINC COATED STEEL OR ALUMINUM, UL 1. REDUCED WALL FMC IS NOT ALLOWED.
- INTERMEDIATE METAL CONDUIT (IMC): HOT-DIP GALVANIZED RIGID STEEL CONDUIT: ANSI C80.6, UL 1242.
- LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC): FLEXIBLE STEEL CONDUIT WITH PVC JACKET: UL 380.
- RIGID METAL CONDUIT (RMC): HOT-DIP GALVANIZED RIGID STEEL CONDUIT (GRS): ANSI C80.1, UL 6.
- PLASTIC COATED IMC, RMC, AND FITTINGS: NEMA RN 1, UL LISTED.
- IMC AND RMC FITTINGS: NEMA FB 1; COMPATIBLE WITH CONDUIT TYPE AND MATERIAL, UL LISTED.

NON-METALLIC CONDUIT AND TUBING:

- RIGID NONMETALLIC CONDUIT (RNC): SCHEDULE 40 PVC, 90 DEG C RATED, NEMA TC-2, UL 651; FITTINGS: NEMA TC 3, TC 6, UL 514, COMPATIBLE WITH CONDUIT/TUBING TYPE AND MATERIAL, UL LISTED.
- ELECTRICAL NONMETALLIC TUBING (ENT): NEMA TC 13, UL LISTED.
- LIQUIDTIGHT FLEXIBLE NONMETALLIC CONDUIT (LFNC): UL 1660.
- ENT AND LFNC FITTINGS: COMPATIBLE WITH CONDUIT/TUBING TYPE AND MATERIAL, UL LISTED.

26B 1-2 RACEWAY INSTALLATION

ABOVE GROUND USE:

- INSTALL ALL CIRCUAR RACEWAYS CONCEALED ABOVE SUSPENDED CEILINGS OR CONCEALED IN WALLS OR FLOORS WHEREVER POSSIBLE EXCEPT WHERE OTHERWISE INDICATED.
- PROVIDE GRS FOR ALL CONDUITS RUN EXPOSED TO WEATHER, OR EXPOSED TO OTHER HAZARDOUS CONDITIONS.
- ALL OTHER RACEWAY MAY BE EMT WHERE APPROVED BY LOCAL CODE. USE COMPRESSION TYPE FITTINGS FOR EMT, WITH ALL FITTINGS UL LISTED FOR THE ENVIRONMENT IN WHICH THEY ARE USED.

UNDERGROUND USE:

- PROVIDE GRS INSTALLED BELOW GRADE WITH A CORROSION RESISTANT BONDED-PLASTIC OR APPROVED MASTIC COATING. THIS SHALL INCLUDE THE 90-DEGREE ELBOW BELOW GRADE AND THE ENTIRE VERTICAL TRANSITION TO ABOVE GRADE.
- RNC CONDUIT MAY BE USED UNDERGROUND WHERE PERMITTED BY LOCAL CODE AND WHERE NOT SPECIFICALLY RESTRICTED BY THE DOCUMENTS. WHEN USED, PROVIDE COATED GRS, AS SPECIFIED ABOVE, FOR ALL BENDS GREATER THAN 30 DEGREES, INCLUDING THE 90-DEGREE ELBOWS BELOW GRADE AND THE ENTIRE VERTICAL RISERS FOR TRANSITIONS FROM BELOW TO ABOVE GRADE OR ABOVE-SLAB.

EQUIPMENT CONNECTIONS:

- USE FMC FOR FINAL CONNECTION TO EACH MOTOR AND TRANSFORMER, AND TO ANY DEVICE THAT WOULD OTHERWISE TRANSMIT MOTION, VIBRATION, OR NOISE. USE EMT WHERE EXPOSED TO LIQUIDS, VAPORS OR SUNLIGHT, AND TO CONNECT TO KITCHEN AND FOOD SERVICE EQUIPMENT. PROVIDE ALL FMC AND LFMC WITH AN INSULATED BONDING CONDUCTOR.
- USE ONLY METAL RACEWAYS FOR ALL POWER WIRING FROM THE OUTPUT OF VARIABLE FREQUENCY DRIVES TO THEIR RESPECTIVE MOTORS. ALL FEEDERS TO VARIABLE FREQUENCY DRIVES (VFDs) SHALL BE IN EMT OR OTHER METALLIC CONDUIT. PVC OR FIBERGLASS IS NOT ALLOWED FOR FEEDERS TO VFDs.

GENERAL RACEWAY INSTALLATION REQUIREMENTS:

- INSTALL RACEWAYS PARALLEL AND PERPENDICULAR TO BUILDING LINES.
- INSTALL RACEWAYS TO REQUIREMENTS OF STRUCTURE AND TO REQUIREMENTS OF ALL OTHER WORK ON THE PROJECT; TO CLEAR ALL OPENINGS, DEPRESSIONS, PIPES, DUCTS, REINFORCING STEEL, AND OTHER IMMOVABLE OBSTACLES.
- INSTALL RACEWAYS SET IN FORMS FOR CONCRETE STRUCTURE IN SUCH A MANNER THAT INSTALLATION WILL NOT AFFECT THE STRENGTH OF THE STRUCTURE.
- EXCEPT WHERE APPROVED IN WRITING BY THE ENGINEER, INSTALL NO RACEWAY IN A SLAB-ON-GRADE. LOCATE RACEWAY IN GRANULAR FILL BELOW SLABS-ON-GRADE.
- INSTALL RACEWAYS CONTINUOUS BETWEEN CONNECTIONS TO OUTLETS, BOXES AND CABINETS WITH A MINIMUM POSSIBLE NUMBER OF BENDS AND NOT MORE THAN THE EQUIVALENT OF FOUR 90-DEGREE BENDS BETWEEN CONNECTIONS. USE MEANS THAT WILL SIMULTANEOUSLY DISCONNECT ALL UNDERGROUND CONDUCTORS AS THE ENGINEER IN ADVANCE. MAKE OTHER BENDS SMOOTH AND EVEN AND WITHOUT FLATTENING RACEWAY OR FLAKING GALVANIZING OR ENAMEL. RADI OF BENDS SHALL BE AS LONG AS POSSIBLE AND NEVER SHORTER THAN THE CORRESPONDING TRADE ELBOW.
- USE LONG RADIUS ELBOWS FOR ALL UNDERGROUND INSTALLATIONS, WHERE NECESSARY OR INDICATED.
- SECURELY FASTEN RACEWAYS IN PLACE WITH APPROVED STRAPS, HANGERS AND STEEL SUPPORTS AS REQUIRED. ATTACH RACEWAY SUPPORTS TO THE BUILDING STRUCTURE. HANG SINGLE RACEWAYS FOR FEEDERS WITH MALLEABLE SPLIT RING HANGERS WITH ROD AND TURNBUCKLE SUSPENSION FROM INSERTS SPACED NOT OVER 10 FEET APART IN CONSTRUCTION ABOVE. CLAMP GROUPS OF HORIZONTAL FEEDER RACEWAYS TO STEEL CHANNELS THAT ARE SUSPENDED FROM INSERTS SPACED NOT OVER 10 FEET APART IN CONSTRUCTION ABOVE. SECURELY CLAMP VERTICAL FEEDER RACEWAYS TO STRUCTURAL STEEL MEMBERS ATTACHED TO STRUCTURE. INSTALL CABLE CLAMPS FOR SUPPORT OF VERTICAL FEEDERS WHERE REQUIRED. ADD RACEWAY SUPPORTS WITHIN 12 INCHES OF ALL BENDS, ON BOTH SIDES OF THE BENDS. DO NOT SUPPORT RACEWAYS FROM SUSPENDED CEILING COMPONENTS.

- REAM RACEWAY ENDS, THOROUGHLY CLEAN RACEWAYS BEFORE INSTALLATION, AND KEEP CLEAN AFTER INSTALLATION. PLUG OR COVER OPENINGS AND BOXES AS REQUIRED TO KEEP RACEWAYS CLEAN DURING CONSTRUCTION AND FISH ALL RACEWAYS CLEAR OF OBSTRUCTIONS BEFORE PULLING CONDUCTORS. PROVIDE RACEWAYS OF AMPLI SIZE FOR PULLING OF WIRE AND NOT SMALLER THAN CODE REQUIREMENTS AND NOT LESS THAN 1/2-INCH IN SIZE, UNLESS INDICATED OTHERWISE ON DRAWINGS.
- PROTECT ALL RACEWAY INSTALLATIONS AGAINST DAMAGE DURING CONSTRUCTION. REPAIR ALL RACEWAYS DAMAGED OR MOVED OUT OF LINE AFTER ROUGHING-IN TO MEET ENGINEER'S APPROVAL WITHOUT ADDITIONAL COST TO THE OWNER.
- ALIGN AND INSTALL TRUE AND PLUMB ALL RACEWAY TERMINATIONS AT PANELBOARDS, SWITCHBOARDS, MOTOR CONTROL EQUIPMENT AND JUNCTION BOXES.
- INSTALL APPROVED EXPANSION/DEFLECTION FITTINGS WHERE RACEWAYS PASS THROUGH (IF EMBEDDED) OR ACROSS (IF EXPOSED) EXPANSION JOINTS. ALSO WHEN USING RNC OR RAC IN EXPOSED ENVIRONMENTS IN ACCORDANCE WITH THE NEC AND EXPANSION/CONTRACTION PROPERTIES OF RNC OR RAC.
- INSTALL A PULL WIRE IN EACH EMPTY RACEWAY THAT IS LEFT FOR INSTALLATION OF CONDUCTORS OR CABLES UNDER OTHER DIVISIONS OR CONTRACTS. USE POLYPROPYLENE OR MONOFLAMENT PLASTIC LINE WITH NOT LESS THAN 200-LB TENSILE STRENGTH. LEAVE AT LEAST 24 INCHES OF SLACK AT EACH END OF PULL WIRE.
- MAKE ALL JOINTS AND CONNECTIONS IN A MANNER THAT WILL ENSURE MECHANICAL STRENGTH AND ELECTRICAL CONTINUITY.
- RACEWAYS PENETRATING FREEZER AND COOLER WALLS:
 - EFFECTIVELY SEAL RACEWAYS, BY INSTALLING A CONDUIT FITTING AT THE BOUNDARY OF THE TWO SPACES, AND FILLING IT WITH AN APPROVED PLIABLE MATERIAL, AFTER CONDUCTORS OR CABLES HAVE BEEN INSTALLED AND TESTED, WHENEVER:
 - RACEWAYS PASS FROM NON-COOLED TO COOLED SPACES.
 - RACEWAYS TRANSITION FROM OUTSIDE A FACILITY OR ENCLOSURE TO INSIDE, WHETHER BURIED OR EXPOSED.

26B 1-3 BUSHINGS AND LOCKNUTS

RIGIDLY TERMINATE CONDUITS ENTERING SHEET METAL ENCLOSURES TO THE ENCLOSURE WITH A BUSHING AND LOCKNUT ON THE INSIDE AND A LOCKNUT OR AN APPROVED HUB ON THE OUTSIDE. CONDUIT SHALL ENTER THE ENCLOSURE SQUARELY. PROVIDE BUSHINGS AND LOCKNUTS MADE OF GALVANIZED MALLEABLE IRON WITH SHARP, CLEAN-CUT THREADS. WHERE EMT ENTERS A BOX, PROVIDE APPROVED EMT COMPRESSION CONNECTORS. USE INSULATED, GROUNDING, OR COMBINATION, BUSHINGS WHEREVER CONNECTION IS SUBJECT TO VIBRATION OR MOISTURE, WHEN REQUIRED BY NFPA 70, OR BOTH.

26B 1-4 CONDUCTORS AND CABLES

CONDUCTOR MATERIAL: ANNEALED (SOFT) COPPER COMPLYING WITH ICEA S-95-658/NEMA WC70;

CONDUCTOR INSULATION TYPES: 90-DEGREE C-RATED, TYPE THHN/THWN-2 OR XHHW-2 COMPLYING WITH ICEA S-95-658/NEMA WC70.

- SIZES OF CONDUCTORS AND CABLES INDICATED OR SPECIFIED ARE IN AMERICAN WIRE GAGE (AWG - BROWN AND SHARPE).
- ALL FEEDER AND BRANCH CIRCUIT CONDUCTORS NO. 8 AWG AND LARGER: STRANDED.
- ALL CONDUCTORS, NO. 10 AWG AND SMALLER: SOLID COPPER.
- ALL BRANCH CIRCUIT WIRING: NOT SMALLER THAN NO. 12 AWG. IF NO CONDUCTOR SIZE IS INDICATED ON THE DRAWINGS FOR A BRANCH CIRCUIT, PROVIDE CONDUCTORS AND CONDUIT SIZED PER NFPA 70 AND BASED ON THE INDICATED BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE (OCPD) RATING AND NUMBER OF POLES. WHERE NO CIRCUIT SIZE (I.E., CONDUCTORS AND OCPD) IS INDICATED ON THE DRAWINGS FOR A BRANCH CIRCUIT, PROVIDE THREE NO. 12 AWG CONDUCTORS, IN 1/2-INCH RACEWAY, AND A 20A CIRCUIT BREAKER.

CONTROL WIRING: STRANDED COPPER CONDUCTORS, 600V INSULATION, OF THE PROPER TYPE, SIZE AND NUMBER AS REQUIRED TO ACCOMPLISH SPECIFIED FUNCTION. MINIMUM SIZE: NO. 14 AWG, UNLESS NOTED OTHERWISE.

STRANDED FOR ALL FLEXIBLE CORDS AND CABLES, OR AS OTHERWISE INDICATED.

UNLESS INDICATED OTHERWISE, SPECIAL PURPOSE CONDUCTORS AND CABLES, SUCH AS LOW VOLTAGE CONTROL AND SHIELDED INSTRUMENT WIRING, SHALL BE AS RECOMMENDED BY THE SYSTEM EQUIPMENT MANUFACTURER.

TYPE MC CABLE: 600V, UNJACKETED; ANSI E119 AND E814, UL STANDARDS 44 OR 83 (AS APPLICABLE), AND 1569, NFPA 70 ARTICLE 330; ALUMINUM OR GALVANIZED STEEL INTERLOCKED ARMOR; THHN- OR XHHW-INSULATED CONDUCTORS; COLOR CODE: ICEA METHOD 1, WITH GREEN INSULATED GROUNDING CONDUCTOR

26B 1-5 INSTALLATION OF CONDUCTORS AND CABLES

INSTALL ALL WIRING IN APPROVED RACEWAY AND ENCLOSURES, EXCEPT WHERE SPECIFIED OR INDICATED, FOR LOW-VOLTAGE WIRING OR DIRECT BURIED CABLES; OR, WHERE TYPE MC CABLE IS INDICATED, SPECIFIED AS ACCEPTABLE, OR BOTH.

SUPPORT ALL CONDUCTORS AND CABLES IN VERTICAL INSTALLATIONS, AS REQUIRED BY NFPA 70, BY INSTALLING CABLE SUPPORTS OR PLUG-TYPE CONDUIT RISER SUPPORTS, OR WIRE-MESH SAFETY GRIPS.

INSTALL ALL CONDUCTORS AND CABLE IN RACEWAYS CONTINUOUS WITHOUT TAPS OR SPLICES. SPLICE OR TAP ONLY IN APPROVED BOXES AND ENCLOSURES WITH APPROVED SOLDERLESS CONNECTORS, OR CRIMP CONNECTORS AND TERMINAL BLOCKS FOR CONTROL WIRING, AND KEEP TO THE MINIMUM REQUIRED. INSULATE ALL SPLICES, TAPS, AND JOINTS AS REQUIRED BY CODES.

ALL MATERIALS USED TO TERMINATE, SPLICE OR TAP CONDUCTORS: DESIGNED FOR, PROPERLY SIZED FOR, AND UL LISTED FOR THE SPECIFIC APPLICATION AND CONDUCTORS INVOLVED, AND INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS, USING THE MANUFACTURER'S RECOMMENDED TOOLS.

WHERE WIRING IS INDICATED AS INSTALLED, BUT THE CONNECTION IS INDICATED "FUTURE" OR "BY OTHER DIVISION, TRADES, OR CONTRACTS", LEAVE A MINIMUM 3-FOOT "PIGTAIL" AT THE BOX, TAP THE ENDS OF THE CONDUCTORS, AND COVER THE BOX.

THE NUMBER OF CONDUCTORS IN A SPECIFIC RACEWAY "HOME RUN" IS TYPICALLY INDICATED WITH CROSS LINES (TICK MARKS) ON EACH "CIRCUIT RUN" ON THE DRAWINGS. IN GENERAL, THE DIRECTION OF BRANCH CIRCUIT "HOME RUN" ROUTING IS INDICATED ON THE DRAWINGS, COMPLETE WITH CIRCUIT NUMBERS AND PANELBOARD DESIGNATION. CONTINUE ALL SUCH "HOME RUN" WIRING TO THE DESIGNATED PANELBOARD, AS THOUGH "CIRCUIT RUNS" WERE INDICATED IN THEIR ENTIRETY.

MULTI-WIRE BRANCH CIRCUITS (I.E., SHARED NEUTRAL) SHALL BE PROVIDED WITH A MEANS THAT WILL SIMULTANEOUSLY DISCONNECT ALL UNDERGROUND CONDUCTORS AT THE POINT THE BRANCH CIRCUIT ORIGINATES. MULTI-POLE BREAKERS OR 3 SINGLE POLE BREAKERS WITH A HANDLE THE ARE TWO EXAMPLES.

WHEN MULTIPLE HOME RUNS ARE COMBINED INTO A SINGLE RACEWAY SUCH THAT THE NUMBER OF CONDUCTORS EXCEEDS FOUR, CONDUCTOR COUNT IS MADE UP OF ANY COMBINATION OF PHASE AND NEUTRAL CONDUCTORS, THE FOLLOWING RESTRICTIONS APPLY, WHICH ARE IN ADDITION TO THOSE IN NFPA 70:

NORMAL OR NON-ESSENTIAL CIRCUITS:

- MAXIMUM OF 16 CONDUCTORS IN A SINGLE RACEWAY. FOR UP TO EIGHT CONDUCTORS IN A RACEWAY, MINIMUM RACEWAY SIZE: 3/4-INCH. FOR GREATER THAN EIGHT CONDUCTORS, MINIMUM RACEWAY SIZE: 1-INCH. DO NOT INSTALL ANY OTHER TYPE OF CIRCUIT IN THIS RACEWAY.
- THE MINIMUM WIRE SIZE FOR ALL CONDUCTORS IN THIS RACEWAY: NO. 10 AWG.
- ONLY 15A AND 20A BRANCH CIRCUIT HOMERUNS MAY BE COMBINED INTO ONE RACEWAY.

ISOLATED GROUND (IG) CIRCUITS:

- THE ISOLATED GROUND CONDUCTOR OF EACH IG CIRCUIT SHALL BE CONTINUOUS (NO SPLICES) THE ENTIRE LENGTH OF THE CIRCUIT.
- IG CIRCUITS SHALL BE PROVIDED WITH DEDICATED NEUTRALS, EQUIPMENT GROUNDS, AND ISOLATED GROUNDS AND ROUTED IN SEPARATE CONDUITS FROM OTHER CIRCUITS.

GFCI CIRCUITS:

- DO NOT USE MULTI-CONDUCTOR CIRCUITS, WITH A SHARED NEUTRAL, FOR ANY GFCI CIRCUIT BREAKER OR RECEPTACLE CIRCUIT.
- FOR BRANCH CIRCUITS FED FROM GFCI CIRCUIT BREAKERS, LIMIT THE ONE-WAY CONDUCTOR LENGTH TO 100 FEET BETWEEN THE PANELBOARD AND THE MOST REMOTE RECEPTACLE OR LOAD ON THE GFCI CIRCUIT.

EMERGENCY POWER CIRCUITS - INCLUDES ALL CIRCUITS COVERED UNDER ARTICLES 700, 701 AND 702.

- MAXIMUM OF EIGHT CONDUCTORS IN A SINGLE RACEWAY. MINIMUM RACEWAY SIZE: 3/4-INCH. DO NOT INSTALL ANY OTHER TYPE OF CIRCUIT IN THIS RACEWAY.

PROPERLY IDENTIFY ALL TERMINAL BLOCKS AND WIRE TERMINALS FOR CONTROL WIRING WITH VINYL STICK-ON MARKERS OR EQUIVALENT. PROVIDE ENGINEER WITH A LIST OF PROPOSED IDENTIFYING NUMBERS FOR REVIEW PRIOR TO INSTALLING MARKERS.

PROVIDE AN EQUIPMENT-GROUNDING CONDUCTOR, OR BONDING JUMPER, AS APPLICABLE, IN ALL FEEDERS AND BRANCH CIRCUITS, SIZED IN ACCORDANCE WITH NFPA 70 TABLES 250.66 OR 250.122, AS APPLICABLE, UNLESS INDICATED AS LARGER ON THE DRAWINGS.

VOLTAGE DROP IN BRANCH CIRCUITS SHALL NOT EXCEED 3 PERCENT.

WIRING SHALL HAVE INSULATION OF THE PROPER COLOR TO MATCH COLOR CODE SYSTEM IN THE TABLE BELOW UNLESS THERE IS A COLOR SYSTEM CURRENTLY IN USE BY THE FACILITY, IN WHICH CASE THE COLORS ARE TO MATCH THE EXISTING SYSTEM. IN LARGER SIZES, WHERE PROPERLY COLORED INSULATION IS NOT AVAILABLE, USE VINYL PLASTIC ELECTRICAL TAPE OF THE APPROPRIATE COLOR AROUND EACH CONDUCTOR AT ALL TERMINATION POINTS, JUNCTION AND PULL BOXES.

240V AND UNDER - 208Y/120, 120/240, 120/208, 240D/120
PHASE A - BLACK, PHASE B - RED, PHASE C - BLUE, NEUTRAL - WHITE, EQUIPMENT GROUND GREEN, ISOLATED GROUND - GREEN W/YELLOW STRIPE.

480V AND 480Y/277V
PHASE A - BROWN, PHASE B - ORANGE, PHASE C - YELLOW, NEUTRAL - GRAY, EQUIPMENT GROUND - GREEN.

USE OF MC CABLE, MAY ONLY BE USED:

- IN LIEU OF FLEXIBLE CONDUIT AND WIRING FROM LIGHT FIXTURES IN ACCESSIBLE CEILINGS TO JUNCTION BOXES (ATTACHED TO BUILDING STRUCTURE) ABOVE THE CEILING. PROVIDE CABLE WHIPS OF SUFFICIENT LENGTHS TO ALLOW FOR RELOCATING EACH LIGHT FIXTURE WITHIN A 5-FOOT RADIUS OF ITS INSTALLED LOCATION, BUT NOT EXCEEDING 6 FEET IN UNSUPPORTED LENGTHS.
- FOR VERTICAL DROPS IN STUD WALLS.
- IN LIEU OF EMT, ONLY FOR 15A AND 20A BRANCH CIRCUITS (WITH UP TO FOUR (4) CONDUCTORS, NOT INCLUDING GROUND CONDUCTOR), AND ONLY IN DRY CONCEALED LOCATIONS ABOVE GRADE, EXCEPT WHERE SPECIFICALLY NOT PERMITTED BY NFPA 70.

DO NOT USE MC CABLE FOR THE FOLLOWING:

- HOMERUNS TO PANELBOARDS.
- WHERE EXPOSED TO VIEW.
- WHERE EXPOSED TO DAMAGE.
- HAZARDOUS LOCATIONS.
- WET LOCATIONS.
- WHEN RESTRICTED OTHERWISE ABOVE, AND WHEN SPECIFICALLY DISALLOWED BY THE LOCAL AHJ, LANDLORD, OR BOTH.
- CIRCUITS THAT CAN BE SUPPLIED BY AN EMERGENCY OR STANDBY POWER SOURCE.

26B 1-6 JUNCTION BOXES, PULL BOXES, CABINETS AND WIREWAYS

PROVIDE JUNCTION BOXES, PULL BOXES, CABINETS AND WIREWAYS WHEREVER NECESSARY FOR PROPER INSTALLATION OF VARIOUS ELECTRICAL SYSTEMS ACCORDING TO NFPA 70 AND WHERE INDICATED ON THE DRAWINGS. SIZE AS REQUIRED FOR THE SPECIFIC FUNCTION OR AS REQUIRED BY NFPA 70, WHICHEVER IS LARGER. CONSTRUCTION SHALL BE OF A NEMA DESIGN SUITABLE FOR THE ENVIRONMENT INSTALLED. JUNCTION BOXES INSTALLED BEHIND WALL CASES, AND IN OR ON OTHER DISPLAY FIXTURES, EXCEPT WHERE OTHERWISE SPECIFIED, SHALL BE 4-INCH SQUARE OR LARGER, WITH GALVANIZED COVERS.

26B 1-7 OUTLET BOXES

ALL OUTLETS INCLUDING LIGHT FIXTURE, SWITCH, RECEPTACLE, AND SIMILAR OUTLETS: NATIONAL ELECTRICAL, APPLETON, STEEL CITY, RACO, OR APPROVED EQUAL. GALVANIZED STEEL KNOCKOUT BOXES, SUITABLE IN DESIGN TO THE PURPOSE THEY SERVE AND THE SPACE THEY OCCUPY, SIZE AS REQUIRED FOR THE SPECIFIC FUNCTION OR AS REQUIRED BY NFPA 70, WHICHEVER IS LARGER. SET ALL OUTLET BOXES IN WALLS, COLUMNS, FLOORS, OR CEILINGS SO THEY ARE FLUSH WITH THE FINISHED SURFACE, ACCURATELY SET, AND RIGIDLY SECURED IN POSITION. PROVIDE PLASTER RINGS, EXTENSION RINGS, AND OR MASONRY FINISH AS REQUIRED FOR FLUSH MOUNTING. PROVIDE APPROVED CAST OUTLET BOXES, WITH HUBS AND WEATHERPROOF COVERS, IN ALL AREAS SUBJECT TO DAMP, WET, OR HARSH CONDITIONS.

26B 1-8 OUTLET LOCATIONS

COORDINATE LOCATIONS OF OUTLET BOXES. OUTLETS ARE ONLY APPROXIMATELY LOCATED ON THE SMALL SCALE DRAWINGS. USE GREAT CARE IN THE ACTUAL LOCATION BY CONSULTING THE VARIOUS LARGE SCALE DETAILED DRAWINGS USED BY OTHER DIVISION TRADES, AND BY SECURING DEFINITE LOCATIONS FROM THE ARCHITECT AND/OR ENGINEER.

26B 1-9 MOUNTING HEIGHTS

UNLESS NOTED OTHERWISE, INSTALL WIRING DEVICES AS INDICATED BELOW (NOTE: DIMENSIONS ARE TO THE CENTER OF THE OUTLET BOX UNLESS NOTED OTHERWISE):

RECEPTACLES:

- VERTICALLY ALIGNED WITH THE GROUND SLOT MOUNTED AT THE BOTTOM: 16 INCHES ABOVE FINISHED FLOOR.
- HORIZONTALLY ALIGNED, WITH NEUTRAL SLOT MOUNTED AT THE TOP: 16 INCHES ABOVE FINISHED FLOOR.
- FOR ABOVE COUNTERS: 6 INCHES ABOVE TOP OF COUNTER OR AS SPECIFIED BY OTHERS.
- MECHANICAL AND ELECTRICAL EQUIPMENT ROOMS AND JANITORS CLOSETS: 44 INCHES ABOVE FINISHED FLOOR, VERTICALLY ALIGNED.
- GARAGES: 24 INCHES ABOVE FINISHED FLOOR, VERTICALLY ALIGNED.
- WEATHERPROOF EXTERIOR RECEPTACLES: 24 INCHES ABOVE FINISHED GRADE OR OTHERWISE INDICATED ON DRAWINGS, VERTICALLY ALIGNED.
- GFCI RECEPTACLES: SAME AS GENERAL RECEPTACLES.
- ISOLATED GROUND RECEPTACLES: SAME AS GENERAL RECEPTACLES.
- SPD RECEPTACLES: SAME AS GENERAL RECEPTACLES.
- CLOCK RECEPTACLES: 84 INCHES ABOVE FINISHED FLOOR OR AS SPECIFIED BY OTHERS.
- CONCRETE BLOCK WALLS: DIMENSIONS ABOVE MAY BE ADJUSTED SLIGHTLY, AS REQUIRED TO COMPENSATE FOR VARIABLE JOINT DIMENSIONS, SUCH THAT BOTTOM OR TOP OF BOXES, AS APPLICABLE, ARE AT JOINT JOINTS.

SWITCHES:

- GENERAL: 46 INCHES ABOVE FINISHED FLOOR.
- ABOVE COUNTERS: SAME AS FOR RECEPTACLES.
- CONCRETE BLOCK WALLS: 40 INCHES ABOVE FINISHED FLOOR (DIMENSION MAY BE ADJUSTED SLIGHTLY, AS REQUIRED TO COMPENSATE FOR VARIABLE JOINT DIMENSIONS, SUCH THAT BOTTOM OF BOXES ARE AT BLOCK JOINTS).
- WALLS WITH WAINSCOT: 48 INCHES MINIMUM ABOVE WAINSCOTING, BUT NOT EXCEEDING 48 INCHES ABOVE FINISHED FLOOR.

TELEPHONE/DATA OUTLET BOXES:

- GENERAL: MATCH MOUNTING HEIGHT OF ADJACENT WIRING DEVICE LISTED ABOVE.
- WALL-MOUNTED TELEPHONE: 40 INCHES ABOVE FINISHED FLOOR.

FOR OTHER THAN WIRING DEVICES, REFER TO PARAGRAPHS, ARTICLES, SECTIONS, DIVISIONS, OR DRAWINGS TO OBTAIN MOUNTING HEIGHTS FOR SPECIFIC EQUIPMENT OR SYSTEMS.

26B 1-10 WIRING DEVICES

UNLESS NOTED OTHERWISE ON THE DRAWINGS WIRING DEVICES ARE 20A RATED DEVICES, WHERE 15A RATED DEVICES ARE INDICATED ON THE DRAWINGS OR REQUIRED FOR CIRCUIT RATING LIMITATIONS, PROVIDE WIRING DEVICES EQUIVALENT TO THOSE SPECIFIED FOR 20A, BUT RATED FOR 15A.

PROVIDE THE FOLLOWING WIRING DEVICES WHERE SHOWN ON DRAWINGS OR REQUIRED. MINOR CHANGES RELATIVE TO THE LOCATION OF ELECTRICAL EQUIPMENT MAY BE MADE TO COMPLY WITH STRUCTURAL AND BUILDING REQUIREMENTS AS DETERMINED IN THE COURSE OF CONSTRUCTION. PROVIDE ALL WIRING DEVICES OF THE SAME MANUFACTURER AND NOT MIXED ON THE PROJECT, TO THE MAXIMUM EXTENT POSSIBLE. PROVIDE COLOR OF TOGGLES AND RECEPTACLES AS REQUESTED BY THE ENGINEER:

DUPLIX CONVENIENCE RECEPTACLES: SPECIFICATION GRADE, NEMA 5-20R, 125V, 20A, GROUNDING TYPE, UL LISTED AND LABELED, NYLON FACE, SIDE AND BACK WIRED, SELF-GROUNDING, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

HOSPITAL GRADE STRAIGHT BLADE RECEPTACLES: NEMA 5-20R, 125V, 20A, GROUNDING TYPE, UL LISTED AND LABELED, NYLON FACE, SIDE AND BACK WIRED, SELF-GROUNDING, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

HOSPITAL GRADE STRAIGHT BLADE SAFETY TYPE, TAMPER-RESISTANT RECEPTACLES: NEMA 5-20R, 125V, 20A, GROUNDING TYPE, UL LISTED AND LABELED, NYLON FACE, SIDE AND BACK WIRED, SELF-GROUNDING, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

TWIST-LOCKING TYPE RECEPTACLES: NEMA L5-20R, 125V, 20A, GROUNDING TYPE, UL LISTED AND LABELED, NYLON FACE, SIDE AND BACK WIRED, SELF-GROUNDING, LEVITON 2310 OR APPROVED EQUIVALENT.

GROUND FAULT CIRCUIT INTERRUPTER TYPE RECEPTACLES: SPECIFICATION GRADE UL LISTED AND LABELED COMPLYING WITH UL 943, CLASS A AND NEMA WD-1-1, 10, 125V, 20A, TRIP AT 4-6MA WITHIN 0.25 SECOND, AND FEED-THRU TYPE WITH INTEGRAL HEAVY DUTY NEMA 5-20R RECEPTACLE ARRANGED TO PROTECT RECEPTACLES DOWNSTREAM ON THE SAME CIRCUIT, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

ISOLATED GROUND RECEPTACLES: SPECIFICATION GRADE NEMA 5-20R NEMA L5-20R, 125V, 20A, GROUNDING TYPE, UL LISTED AND LABELED, NYLON FACE, SIDE AND BACK WIRED, FURNISHED WITH A GREEN PIGTAIL CONNECTED TO THE GROUNDING CONTACT, AND GROUNDING CONTACTS ELECTRICALLY ISOLATED FROM THE MOUNTING STRAP, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

TVSS RECEPTACLES: SPECIFICATION GRADE FOR 125V (150V MAXIMUM CONTINUOUS OPERATING VOLTAGE) SERVICE: NEMA 5-20R, 125V, 20A, SELF-GROUNDING TYPE, RFI/EMI NOISE FILTERING, UL LISTED 1449 SECOND EDITION (1998) & 489; EQUIPPED WITH LED INDICATOR(S) AND AUDIBLE ALARM, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

SUPPRESSION MODULE SHALL PROTECT NORMAL AND COMMON MODES, WITH THE FOLLOWING MODE CHARACTERISTICS, AND BE SUITABLE FOR ANSII/IEEE C82.41-1991 A, B INSTALLATIONS:

- PEAK ENERGY 240 JOULES MINIMUM
- PEAK CURRENT 18.0MA MINIMUM
- UL 3000A TEST 400V MINIMUM
- RESPONSE TIME 5 NANO-SECONDS
- SPECIAL WARRANTY: MANUFACTURER AGREES TO REPAIR OR REPLACE TVSS RECEPTACLES, OR REPLACEABLE SURGE MODULES (IF REMOVABLE), THAT FAIL IN MATERIALS OR WORKMANSHIP WITHIN 5 YEARS FROM DATE OF SUBSTANTIAL COMPLETION.

SPECIAL PURPOSE RECEPTACLES: GROUNDING TYPE, UL LISTED WITH NEMA CONFIGURATIONS AS IMPLIED ON THE DRAWINGS, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

SWITCHES: SPECIFICATION GRADE, RATED FOR 120/277V, 20A, BACK AND SIDE WIRED, AND UL LISTED AND LABELED, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

PILOT LIGHT SWITCHES: 20A, 1-POLE, 2-POLE, 3-WAY SWITCH WITH RED NEON LIGHTED HANDLE. TOGGLE SHALL BE ILLUMINATED WHEN THE SWITCH IS IN THE "ON" POSITION, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

LIGHTED HANDLE SWITCHES: 20A, 1-POLE, 3-WAY SWITCH WITH CLEAR NEON LIGHTED HANDLE. TOGGLE SHALL BE ILLUMINATED WHEN THE SWITCH IS IN THE "OFF" POSITION, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

KEY OPERATED LIGHT SWITCHES: SAME AS STANDARD LIGHT SWITCHES EXCEPT TOGGLE HANDLE SHALL BE OPERATED BY A FACTORY PROVIDED KEY, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

SWITCHES FOR USE WITH MECHANICALLY-HELD, ELECTRICALLY-OPERATED LIGHTING CONTACTORS: SINGLE POLE, DOUBLE THROW, MOMENTARY, CENTER OFF SWITCH, RATED FOR 120/277V, AND UL LISTED AND LABELED, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

WALL BOX DIMMERS: SPECIFICATION GRADE SLIDER TYPE WALL BOX DIMMERS, UL LISTED AND LABELED, WITH RADIO FREQUENCY INTERFERENCE (RFI) FILTERS TO AVOID INTERFERENCE WITH ELECTRONIC EQUIPMENT, AND A MINIMUM WATTAGE AS INDICATED ON THE DRAWINGS OR AS REQUIRED FOR THE LOAD, MANUFACTURED BY LEVITON OR APPROVED EQUIVALENT.

DUAL VOLTAGE SWITCH RELAY: A NORMALLY-OPEN, ELECTRICALLY-HELD RELAY THAT ALLOWS A SINGLE-POLE SWITCH TO CONTROL LOADS OPERATING AT TWO DIFFERENT VOLTAGES (E.G., 120V AND 277V); LISTED TO UL STANDARD 916; INSTALLED IN A 2-GANG OUTLET BOX, WITH A VOLTAGE-SEPARATING BARRIER AND PLASTER RING MANUFACTURED BY LIGHTING CONTROLS AND DESIGNS (GR 2001 DV) OR APPROVED EQUIVALENT.

WALL SWITCH OCCUPANCY SENSORS: PASSIVE INFR



OMN ENGINEERS
PO BOX 2106
LOVELL, AR 72745
479-696-7873

26B 3-11 DISCONNECT (SAFETY) SWITCHES

DISCONNECT (SAFETY) SWITCHES: SQUARE D, SIEMENS, CUTLER HAMMER, OR GENERAL ELECTRIC FUSED OR NON-FUSED (AS INDICATED ON DRAWINGS OR REQUIRED) NEMA KST, HEAVY DUTY, EXTERNALLY OPERATED, VISIBLE-BLADE SAFETY SWITCHES; NEMA ENCLOSURE TYPE INDICATED ON THE DRAWINGS OR SUITABLE FOR THE ENVIRONMENT IN WHICH INSTALLED. BASED ON FUSIBLE SWITCH AND FUSE SIZES INDICATED, INCLUDE CLASS R, J, OR I FUSE PROVISIONS AS APPLICABLE.

WHERE INDICATED, PROVIDE FUSIBLE SWITCHES PERMANENTLY LABELED AS SUITABLE FOR USE AS SERVICE ENTRANCE EQUIPMENT, WITH INTEGRAL AND SEPARATE NEUTRAL AND GROUND ASSEMBLIES, SUITABLE FOR THE SIZES OF CONDUCTORS INDICATED. DO NOT DOUBLE-LUG ANY TERMINATIONS NOT SPECIFICALLY LISTED AS SUITABLE FOR MORE THAN ONE CONDUCTOR.

PROVIDE SWITCHES WHERE NOT FURNISHED WITH THE STARTING EQUIPMENT, AT ALL OTHER POINTS REQUIRED BY NFPA 70, AND WHERE INDICATED ON THE DRAWINGS.

26B 4 LIGHT FIXTURES, LAMPS AND BALLASTS

26B 4-1 LIGHT FIXTURE LOCATIONS

LIGHT FIXTURES SHOWN ON THE ELECTRICAL DRAWINGS REPRESENT GENERAL ARRANGEMENTS ONLY. REFER TO ARCHITECTURAL DRAWINGS FOR MORE EXACT LOCATIONS. COORDINATE LOCATION WITH ALL OTHER TRADES BEFORE INSTALLATION TO AVOID CONFLICTS. COORDINATE LIGHT FIXTURE LOCATIONS IN MECHANICAL ROOMS WITH FINAL INSTALLED PIPING AND DUCTWORK LAYOUTS.

26B 4-2 LIGHT FIXTURES

PROVIDE LIGHT FIXTURES AS SCHEDULED ON DRAWINGS, INCLUDING ALL LAMPS, ALL NECESSARY ACCESSORIES, MATERIAL AND LABOR TO SECURELY HANG, CLEAN, AND MAKE LIGHT FIXTURES COMPLETELY READY FOR USE. PROVIDE: ALL HANGERS, SUPPORTS, AND MISCELLANEOUS HARDWARE REQUIRED TO INSTALL LIGHT FIXTURES; PROPER TRIM TO FIT EACH CEILING CONDITION ACTUALLY ENCOUNTERED; ADDITIONAL TIE WIRES CONNECTED TO STRUCTURE TO CONFORM TO SEISMIC REQUIREMENTS WHERE REQUIRED BY THE APPLICABLE BUILDING CODE.

PACKAGING OF LIGHT FIXTURES WILL NOT BE ALLOWED. ONLY THOSE LUMINAIRES LISTED IN THE LIGHT FIXTURE SCHEDULE, OR APPROVED IN ACCORDANCE WITH SUBSTITUTIONS OF THESE SPECIFICATIONS, WILL BE ACCEPTED. WHERE THE LIGHT FIXTURE SCHEDULE INDICATES AN ALLOWANCE FOR A SPECIFIC LIGHT FIXTURE, THE PRICE IS A CONTRACTOR PRICE. INCLUDE ALL ADDITIONAL COSTS FOR FREIGHT, LAMPS, AND INSTALLATION OF LIGHT FIXTURE AND LAMPS.

INSTALL ALL LINEAR LIGHT FIXTURES LOCATED IN AREAS WITHOUT CEILINGS IMMEDIATELY BELOW THE ROOF-FRAMING MEMBERS, OR SUSPENDED FROM CHAIN HANGERS SUITABLE IN LENGTH TO PROVIDE THE INDICATED MOUNTING HEIGHT.

THROUGH WIRING OF RECESSED LIGHT FIXTURES, IN SUSPENDED CEILINGS, IS NOT PERMITTED. CONNECT EACH LIGHT FIXTURE BY A WHIP TO A JUNCTION BOX. PROVIDE CABLE WHIPS OF SUFFICIENT LENGTHS TO ALLOW FOR RELOCATING EACH LIGHT FIXTURE WITHIN A 5-FOOT RADIUS OF ITS INSTALLED LOCATION, BUT NOT EXCEEDING 6 FEET IN UNSUPPORTED LENGTHS.

26B 4-3 EMERGENCY LIGHTING UNITS AND EXIT SIGNS

DESCRIPTION: SELF-CONTAINED UNITS COMPLYING WITH UL 924.

BATTERY: SEALED, MAINTENANCE-FREE, LEAD-ACID TYPE. THE BATTERIES SHALL BE OF SUITABLE RATING AND CAPACITY TO SUPPLY AND MAINTAIN AT NOT LESS THAN 87 1/2 PERCENT OF THE NOMINAL BATTERY VOLTAGE FOR THE TOTAL LAMP LOAD ASSOCIATED WITH THE UNIT FOR A PERIOD OF AT LEAST 1 1/2 HOURS, OR THE UNIT EQUIPMENT SHALL SUPPLY AND MAINTAIN NOT LESS THAN 60 PERCENT OF THE INITIAL EMERGENCY ILLUMINATION FOR A PERIOD OF AT LEAST 1 1/2 HOURS.

CHARGER: FULLY AUTOMATIC, SOLID-STATE TYPE WITH SEALED TRANSFER RELAY.

OPERATION: RELAY AUTOMATICALLY TURNS LAMP ON WHEN POWER SUPPLY CIRCUIT VOLTAGE DROPS TO 80 PERCENT OF NOMINAL VOLTAGE OR BELOW. LAMP AUTOMATICALLY DISCONNECTS FROM BATTERY WHEN VOLTAGE APPROACHES DEEP-DISCHARGE LEVEL.

WHEN NORMAL VOLTAGE IS RESTORED, RELAY DISCONNECTS LAMPS FROM BATTERY, AND BATTERY IS AUTOMATICALLY RECHARGED AND FLOATED ON CHARGER. TEST PUSH BUTTON: PUSH-TO-TEST TYPE, IN UNIT HOUSING, SIMULATES LOSS OF NORMAL POWER AND DEMONSTRATES UNIT OPERABILITY.

LED INDICATOR LIGHT: INDICATES NORMAL POWER ON. NORMAL GLOW INDICATES TRICKLE CHARGE; BRIGHT GLOW INDICATES CHARGING AT END OF DISCHARGE CYCLE.

INTEGRAL TIME-DELAY RELAY: HOLDS UNIT ON FOR FIXED INTERVAL OF 15 MINUTES WHEN POWER IS RESTORED AFTER AN OUTAGE.

INTEGRAL SELF-TEST: FACTORY-INSTALLED ELECTRONIC DEVICE AUTOMATICALLY INITIATES CODE-REQUIRED TEST OF UNIT EMERGENCY OPERATION AT REQUIRED INTERVALS. TEST FAILURE IS ANNUNCIATED BY AN INTEGRAL AUDIBLE ALARM AND FLASHING RED LED.

26B 4-4 LAMPS

PROVIDE LAMPS AS INDICATED ON THE DRAWINGS FOR ALL LIGHT FIXTURES, OR, IF NOT INDICATED, AS RECOMMENDED BY THE LIGHT FIXTURE MANUFACTURER. IN ALL CASES, LAMPS SHALL BE COMPATIBLE WITH THE SPECIFIED LIGHT FIXTURE. ACCEPTABLE LAMP MANUFACTURERS: GENERAL ELECTRIC, OSRAM/SYLVANIA, PHILIPS, OR VENTURE.

ALL FLUORESCENT LAMPS SHALL BE MINIMUM OF 4100 DEGREES K, WITH A MINIMUM COLOR-RENDERING INDEX OF 80, UNLESS NOTED OR DIRECTED OTHERWISE.

INCANDESCENT LAMPS: TYPE AND WATTAGE AS SHOWN ON THE DRAWINGS; RATED 130V UNLESS OTHERWISE SCHEDULED OR SPECIFIED.

26B 5 MISCELLANEOUS ELECTRICAL

26B 5-1 WIRING OF EQUIPMENT

PROVIDE ALL RACEWAYS AND POWER WIRING FOR ALL APPLICABLE DIVISIONS EQUIPMENT REQUIRING ELECTRICAL CONNECTIONS, INCLUDING, BUT NOT LIMITED TO, PUMPS, WATER HEATERS, AND HVAC EQUIPMENT, AND ALL LINE-VOLTAGE CONTROL AND INTERLOCK WIRING NOT PROVIDED UNDER OTHER DIVISIONS. CONNECT PER MANUFACTURERS' WIRING DIAGRAMS. COORDINATE WITH APPLICABLE DIVISIONS FOR DISCONNECTS FURNISHED WITH EQUIPMENT, AND PROVIDE ALL DISCONNECT SWITCHES AS REQUIRED. AFTER INSTALLING WIRING, VERIFY THAT EACH MOTOR LOAD HAS THE CORRECT PHASE ROTATION.

VERIFY THE ACTUAL "MAXIMUM OVERCURRENT PROTECTION" (MOCP) DEVICE RATINGS AND "MINIMUM CIRCUIT AMPACITY" (MCA) CONDUCTOR SIZING FOR MECHANICAL EQUIPMENT FROM THE EQUIPMENT NAMEPLATE. BASE ELECTRICAL INSTALLATIONS ON ACTUAL REQUIRED AMPERAGES, WHICH MAY VARY SOMEWHAT FROM THE CONDUCTOR AND EQUIPMENT SIZES SHOWN ON THE DRAWINGS; HOWEVER, IN NO CASE, REDUCE THE SIZE OF CONDUCTORS INDICATED ON THE DRAWINGS WITHOUT AUTHORIZATION FROM THE ENGINEER. PROVIDE PROPERLY SIZED ELECTRICAL WIRING AND EQUIPMENT WITHOUT EXTRA COST TO THE OWNER. NOTIFY THE ENGINEER OF ALL CHANGES REQUIRED IN THE ELECTRICAL INSTALLATION DUE TO EQUIPMENT VARIANCES SO THAT THE EFFECTS ON FEEDERS, BRANCH CIRCUITS, PANELBOARDS, FUSES AND CIRCUIT BREAKERS CAN BE CHECKED PRIOR TO PURCHASING AND INSTALLATION. BE RESPONSIBLE FOR COORDINATING WITH APPLICABLE DIVISIONS TO VERIFY THE ACTUAL AMPACITIES AND CORRECT SIZES OF ALL CONDUCTORS AND OVERCURRENT PROTECTIVE DEVICES FOR ALL EQUIPMENT, AND CORRECT OVERLOAD HEATERS FOR ALL MOTORS, WHEN STARTERS ARE PROVIDED UNDER DIVISION 26.

26B 5-2 WIRING OF THERMOSTATS, TIME AND TEMPERATURE CONTROLS

PROVIDE ALL RACEWAYS, POWER WIRING, AND LINE-VOLTAGE CONTROL AND INTERLOCK WIRING NOT PROVIDED UNDER OTHER DIVISIONS, FOR ALL THERMOSTATS, TEMPERATURE CONTROL DEVICES, AND CONTROLS, INCLUDING, BUT NOT LIMITED TO, NIGHT STATS, WATER HEATER INTERLOCKS, TIME SWITCHES AND OVERRIDE TIMERS. SEE MECHANICAL DRAWINGS FOR LOCATIONS AND TEMPERATURE CONTROL DIAGRAM. LOW-VOLTAGE CONDUCTORS FOR THERMOSTATS AND TEMPERATURE CONTROL SYSTEM MAY BE RUN EXPOSED ABOVE FINISHED ACCESSIBLE CEILINGS, IF APPROVED AND LISTED FOR THIS PURPOSE, BUT SHALL BE INSTALLED IN CONDUIT WITHIN WALLS AND WHERE EXPOSED IN THE WORK AREAS.

26B 5-3 TELEPHONE SYSTEM PROVISIONS

PROVIDE INCOMING TELEPHONE SERVICE RACEWAYS AS INDICATED ON DRAWINGS OR AS REQUIRED BY THE SERVING TELEPHONE COMPANY. PROVIDE 3/4-INCH THICK PLYWOOD BOARD, FIRE-RETARDANT-TREATED AND STAMPED FRP, SECURELY ANCHORED TO THE WALL, AT THE LOCATION AND OF THE SIZE AS INDICATED ON THE DRAWINGS.

PROVIDE FLUSH MOUNTED TELEPHONE OUTLET BOXES WITH 3/4-INCH EMT STUB-UP CONCEALED TO ACCESSIBLE CEILING SPACE AT LOCATIONS AS INDICATED ON THE DRAWINGS.

26B 5-4 DATA SYSTEM PROVISIONS

PROVIDE FLUSH MOUNTED DATA OUTLET BOXES WITH 3/4-INCH CONDUIT STUB-UP CONCEALED TO ACCESSIBLE CEILING SPACE AT LOCATIONS AS INDICATED ON THE DRAWINGS.

26B 5-5 TIME SWITCHES

TIME SWITCHES: ELECTRONIC DIGITAL ASTRONOMICAL, TYPE AS INDICATED, WITH MANUAL BYPASS SWITCH, NEMA ENCLOSURE SUITABLE FOR THE ENVIRONMENT INSTALLED; NUMBER AND TYPES OF CONTACTS, SEQUENCE, AND VOLTAGE AS INDICATED ON THE DRAWINGS, OR AS REQUIRED, BASED ON THE TIME SWITCH FUNCTION AND THE NUMBER OF BRANCH CIRCUITS OR CONTACTORS CONTROLLED. PROVIDE WIRING TO PHOTOCELLS, CONTACTORS, RELAYS OR OTHER CONTROL POINTS AS REQUIRED. MANUFACTURERS: INTERMATIC, PARAGON OR TORK.

26B 5-6 PHOTO CONTROL

THE PHOTO CONTROL SHALL:

- A. PROVIDE AUTOMATIC SWITCHING FOR LIGHTING LOADS USING A THERMAL DESIGN WITH BUILT-IN DELAY TO ENSURE THAT THE CONTROLLED LIGHTING DOES NOT SWITCH OFF DUE TO AMBIENT LIGHT OR LIGHTNING STRIKING THE PHOTOCELL.
- B. HAVE A RATING BASED ON UL TESTING AT 50% POWER FACTOR FOR BALLAST LOADS, BE UL LISTED, AND MEET ALL APPLICABLE AGENCY REQUIREMENTS.
- C. BE STEM-MOUNTING TYPE WITH ALL NECESSARY MOUNTING HARDWARE AND INSTRUCTIONS; HAVE A HOUSING CONSTRUCTED OF HIGH IMPACT POLY-CARBONATE. PHOTO CONTROL COMPONENTS CONSISTING OF A METAL FILM RESISTOR, DUAL TEMPERATURE COMPENSATING BI METAL BLADES, SNAP ACTION CONTACT BLADES, CHEMICALLY TREATED/POLYMER ENCAPSULATED CADMIUM SULFIDE PHOTOCELL AND SILVER ALLOY CONTACTS TO ENSURE RELIABLE 5 YEAR MANUFACTURER WARRANTED OPERATION. PHOTO CONTROL SHALL BE 100% FACTORY TESTED FOR FUNCTION WITHIN MANUFACTURER'S SPECIFIED LIGHT LEVELS.
- D. BE FROM THE SAME MANUFACTURER OF AND TOTALLY COMPATIBLE WITH THE TIME SWITCHES SPECIFIED ABOVE.

22,000A AT 240V MAXIMUM

ENCLOSURES: NEMA RATED FOR ENVIRONMENT INSTALLED IN OR AS INDICATED ON THE DRAWINGS.

COIL VOLTAGE: 120V AC OR AS INDICATED ON THE DRAWINGS.

MECHANICALLY-HELD TYPE, CONTROL INTERFACE SHALL BE 2-WIRE INPUT MODULE WITH 3-WIRE OUTPUT OR AS INDICATED ON THE DRAWINGS; SQUARE D CLASS 8903 LX OR EQUIVALENT OF GENERAL ELECTRIC, SIEMENS, CUTLER HAMMER OR ASCO.

26B 5-9 MISCELLANEOUS EQUIPMENT AND CONNECTIONS

PROVIDE ALL WIRING AND CONNECTIONS TO EQUIPMENT FURNISHED BY OTHERS, INCLUDING, BUT NOT LIMITED TO, BAKERY EQUIPMENT, DELI EQUIPMENT, MEAT ROOM EQUIPMENT, KITCHEN EQUIPMENT, CHECKSTAND AND SCANNERS, EXHAUST HOOD FIRE EXTINGUISHING SYSTEM, ETC.

INSTALL SCAN SYSTEM ELECTRONIC COMMUNICATION CABLE IN UNDERFLOOR DUCT (CABLE PROVIDED BY OTHERS).

PROVIDE ALL RACEWAYS, WIRING AND RELATED CONNECTIONS OF DEVICES TO ENERGY MANAGEMENT SYSTEM THAT ARE NOT THE RESPONSIBILITY OF DIVISION 23.

ALL WIRING AND CONNECTIONS OF EXIT DOOR ALARMS.

END OF SECTION 26B

Burris Architecture
820 Tiger Blvd, Suite 4, Bentonville, Ar 72712
479-319-6045

SMOKE
730 E MAIN ST
FARMINGTON, AR

DATE	09/11/25
JOB NO.	25089
REVISIONS	

E4.2
ELECTRICAL SPECIFICATIONS

THIS DRAWING IS PROVIDED AS AN INFORMATIONAL SERVICE ONLY. IT IS NOT TO BE USED FOR CONSTRUCTION. THE USER ASSUMES ALL LIABILITY FOR THE PROPER USE OF THIS INFORMATION. THE INFORMATION IS PROVIDED AS IS WITHOUT WARRANTY OF ANY KIND, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO THE WARRANTIES OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE AND NONINFRINGEMENT. IN NO EVENT SHALL THE ENGINEER BE LIABLE FOR ANY DAMAGES OR OTHER LIABILITY, WHETHER IN CONTRACT, TORT OR OTHERWISE, ARISING FROM, OUT OF OR IN CONNECTION WITH THIS INFORMATION.