

Comfort Systems USA (Arkansas), Inc.
P.O. Box 16620
Little Rock, AR 72231
Phone 501-834-3320
Fax 501-834-5416

Date: 07/14/2026
Return Request: 08/11/2026
Project: Highlands Building at Pinnacle Hills
Supplier: Comfort Systems USA
Manufacturer: Various
Submittal: Canvas Connector and Turning Vanes
Submittal Number: 23 33 00 -01
Drawing # and Installation: Mechanical

ARCHITECT

Crafton Tull
Fayetteville, Ar

ENGINEER

IMEG

GENERAL CONTRACTOR

Clark Contractors
Rogers, Ar

MECHANICAL SUBCONTRACTOR

Comfort Systems USA (Arkansas), Inc.
116 Commercial Ave.
Lowell, AR 72745
(479) 770.8992

NOTES:

--

CSUSA PROJECT NO.
26-5034

jzuber@comfortar.com



Knight & Wilson, Inc.

"Sheet Metal Contractors"

676 East E.H. Crump Blvd. Memphis TN 38126

901-274-6978

SUBMITTAL

EQUIPMENT:

FLEXIBLE CANVAS CONNECTOR

SPEC SECTION:

23 33 00

PROJECT:

HIGHLANDS BLDG. - PINNACLE HILLS

LOCATION:

ROGERS, AR

CONTRACTOR:

COMFORT SYSTEMS USA

WE PROPOSE TO USE "**DURODYNE**" **NEOPRENE "30oz."**
FLEXIBLE DUCT CANVAS CONNECTOR PER THE ATTACHED
SUBMITTAL WHICH WILL MEET THE CRITERIA AS LISTED IN
THE SPECIFICATIONS.

CONTACT:

MICHAEL COAD, K&W - PROJECT MGR.

DATE:

6/29/2026

SUBMITTAL RECORD

JOB _____
 LOCATION _____
 SUBMITTED TO _____
 SUBMITTAL PREPARED BY _____
 APPROVED BY _____
 DATE _____



Submittal Form


FDC

Flexible Duct Connector

DESCRIPTION

All air duct installations for heating, cooling or ventilation are attached to mechanical equipment containing a fan or blower. Vibrations, noises and rattles resulting from operation of the fan or blower are transmitted into the metal ducts which carry the noises throughout the system.

In order to isolate the vibration and noises to the source, an air - tight flexible joint, consisting of a fabric which is attached to sheet metal on both side, must be inserted between the equipment and the ductwork. This vibration isolator is called a "Flexible Duct Connector".



Fabric Comparisons	Excelon®	Neoprene (Specification Grade)	Durolon	Teflon
UL Classified Listing #	R4462	R4462	UL Certified NFPA 701	n/a
Continuous Temp. Range	-40°F. to 180°F.	-40°F. to 200°F.	-40°F. to 250°F.	-150°F. to 500°F.
Color	Black	Black	White	Grey Outside/Beige Inside
Commercial Grade Weight	22 oz.	30 oz.	26 oz.	16.5 oz.
Residential Grade Weight	17 oz.	30 oz.	26 oz.	16.5 oz.
Abrasion Resistance ¹	15,000 cycles	600 cycles	500 cycles	1,000 cycles
Leakage Resistance ²	350	595	250	650
Tear Strength ³	100 lbs. / 100 lbs.	12 lbs. / 12 lbs.	12 lbs. / 12 lbs.	50 lbs. / 30 lbs.
Tensile Strength ⁴	240 lbs. / 220 lbs.	500 lbs. / 450 lbs.	225 lbs. / 300 lbs.	400 lbs. / 300 lbs.
Base Fabric	Woven Nylon/Polyester Blend	Woven Fiberglass	Woven Fiberglass	Fiberglass/Satin Weave
Coating	Vinyl	Neoprene	Hypalon	Teflon
Features	• Excellent water resistance • Excellent tear strength • Excellent all purpose fabric • Unaffected by mildew	• Extremely resistant to alkalis & gasoline • Excellent on systems exposed to toxic fumes • Good general purpose fabric • Unaffected by mildew	• Excellent ozone & weathering resistance • Best overall acid resistance • Recommended for rooftop applications • Unaffected by mildew	• High temperature resistant • High corrosion resistance • Excellent chemical resistance
Metal-Fab® Grip Loc	MBX333 (#10159)	MFN333 (#10003)	MFD333 (#10002)	MCT333 (#10278)
Super Metal-Fab® Grip Loc	MB6X363 (#10160) MB12X3123 (#10252)	MF6N363 (#10012) MFN12N3123 (#10251)	MF6D363 (#10011)	MC6T363 (#10069)
TDC/TDF Grip Loc	MBX444 (#10210) MBX464 (#10214) MBX484 (#10280) MBX4104 (#10286)	MFN444 (#10211) MFN464 (#10246) MFN484 (#10281) MFN4124 (#10254)	MFD444 (#10237) MFD464 (#10245)	MCT444 (#10279) MCT4104 (#10287)

Please see individual submittals for each fabric/configuration for flame/smoke test results (ASTM E84 rating & NFPA 701).
 Excelon and Neoprene are available in 1000 foot rolls (Metal-Fab) and 800 foot rolls (TDC/TDF).

All Metal-Fab, Super Metal-Fab and TDC/TDF Flexible Duct Connectors are manufactured with 24 gauge galvanized steel.
 Duro Dyne meets or exceeds the SMACNA steel requirements for flexible duct connector.
 Other materials are available upon request.


Notes:

1. Abrasion resistance as per Federal Test Standard 191 Method #5306 using CS 17 wheel with 250 Gram load.
2. Leakage resistance as per Federal Test Standard 191 Method #5512. Results in P.S.I.
 (To convert inches of water multiply P.S.I. x 27.176.)
3. Tear strength in tongue pounds as per Federal Test Standard 191 Method #5134.1 (warp/fill).
4. Tensile strength in grab pounds as per Federal Test Standard 191 Method #5100 (warp/fill).
5. Standard Excelon is not LA city approved. Use Excelon-LA when LA city approval is necessary.
 (See Specification Form Excelon-LA - 203)

All Duro Dyne Flexible Duct Connector Products are suitable for pressures of -10 to +15 wg. Duro Dyne's standard 'single fold' metal to fabric grip has been tested by an independent testing laboratory to withstand a negative pressure of -10" WC and a positive pressure of +17.25" WC with no tearing or visible separation.

SUGGESTED SPECIFICATION**Vibration Isolating Flexible Duct Connector For Heating, Cooling & Exhaust Supplies & Returns.**

At the inlet and discharge of all air handling equipment(unless otherwise noted) furnish and install vibration isolators. Vibration isolators shall be a coated woven fabric named _____ and shall be "Underwriters Laboratories Classified". Vibration isolators shall have a tear strength of not less than _____, and a continuous temperature range of _____. Vibration isolators shall be preassembled metal to exposed fabric to metal. Fabric and metal shall be joined by means of a double lock seam. Vibration isolators shall be code _____ (called Flexible Duct Connectors) as manufactured by Duro Dyne Corporation, Bay Shore, N.Y.

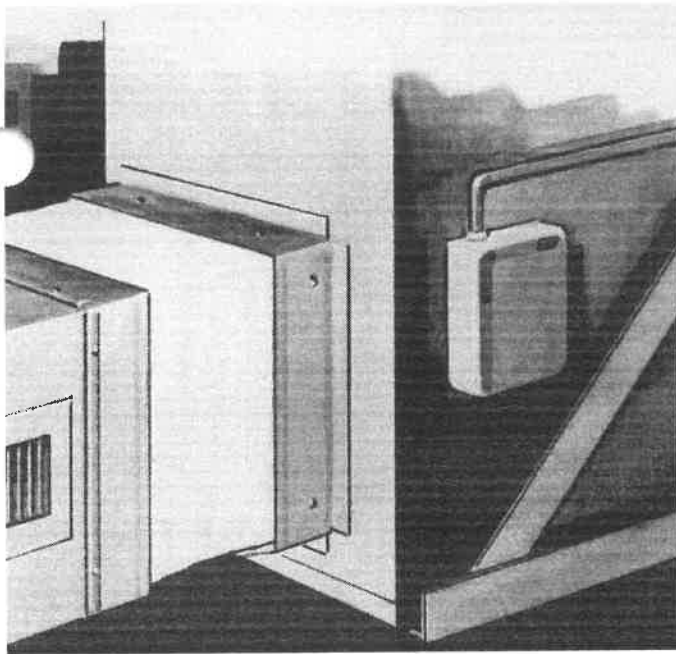

Specifications

All Listed Duro Dyne Flexible Duct Connector Fabrics are designed to meet the following specifications:

1. MIL-C-20696B Para. 4.4.3. (Oil Resistance).
2. MIL-C-20696B Para. 4.4.4. (Hydro Carbon Resistance).
3. NFPA701 Tests for Flame Propagation of Fabrics and film (except Teflon).
4. California State Fire Marshal Approved.
5. Los Angeles City Approved. (*See note below)
6. Denver City Approved.

All Duro Dyne Flexible Duct Connectors utilize galvanized steel meeting ASTM-A-525 G 60 or better.

Duro Dyne Flexible Duct Connectors are also available with 300 series stainless steel or 3003 aluminum upon request.

****Note** - Standard Excelon is not LA city approved. Use Excelon-LA when LA city approval is necessary. (See Submittal Form for Excelon-LA)

CHEMICAL RESISTANCE

(X = Extremely Resistant)

(NR = Not Recommended)

(O = No Data Available)

Chemical	Excelon	Neoprene	Durulon	Teflon	Chemical	Excelon	Neoprene	Durulon	Teflon
Acetic Acid	NR	X	X	X	Hydrofluoric Acid (100%)	NR	X	X	X
Aluminum Chloride	X	X	X	X	Hydrogen Peroxide	X	NR	X	NR
Aluminum Sulfate	X	X	X	X	Hydrogen Sulfide	X	X	X	X
Ammonia (Anhyd)	X	X	X	X	Lactic Acid	NR	X	X	X
Ammonium Hydroxide	X	X	X	X	Linseed Oil	NR	X	X	O
Ammonium Sulfate	X	X	X	X	Magnesium Chloride	NR	X	X	X
Barium Sulfide	X	X	X	X	Maleic Acid	X	NR	X	O
Black Sulfate Liquor	X	X	X	X	Methyl Alcohol	NR	X	X	X
Boric Acid	X	X	X	X	Methyl Cellosolve	NR	X	X	O
Butyl Alcohol	NR	X	X	X	Mineral Oil	X	X	X	X
Cadmium Plating Solution	X	NR	NR	O	Naptha	NR	NR	NR	X
Calcium Chloride	X	X	X	X	Nickel Chloride	X	X	X	X
Calcium Hypochlorite	X	NR	X	X	Nickel Sulfate	X	X	X	X
Chlorine Water	X	NR	NR	O	Nitric Acid (40%)	X	NR	X	X
Chromic Acid	X	NR	X	X	Oleic Acid	X	NR	NR	X
Chromium Plating Solution	X	O	O	O	Oleum	NR	NR	X	X
Citric Acid	X	X	X	X	Oxalic Acid	X	X	X	X
Copper Chloride	X	X	X	X	Phosphoric Acid (85%)	NR	X	X	X
Copper Sulfate	X	X	X	X	Pickling Solution	X	NR	X	O
Cottonseed Oil	X	X	X	O	Potassium Chloride	X	X	X	O
Diacetone Alcohol	NR	X	X	O	Potassium Cyanide	X	X	X	X
Disodium Phosphate	X	NR	NR	O	Potassium Dichromate	X	X	X	X
Ethyl Alcohol	NR	X	X	X	Potassium Hydroxide (40%)	X	X	X	X
Ethylene Glycol	NR	X	X	X	Potassium Sulfate	X	X	X	X
Ferric Chloride	X	X	X	X	Propyl Alcohol	NR	X	X	O
Ferric Sulfate	X	X	X	X	Sodium Chloride	X	X	X	X
Fluoroboric Acid	X	X	X	O	Sodium Hydroxide (40%)	NR	X	X	X
Formaldehyde (40%)	X	X	X	X	Sodium Hypochlorite	NR	NR	X	X
Formic Acid	X	X	X	X	Steam	NR	X	NR	X
Glucose	X	X	X	X	Sulfur Dioxide (Liquid)	NR	X	X	X
Glycerine	NR	X	X	X	Sulfuric Acid (50%)	X	NR	X	X
Heptane	NR	X	X	X	Sulfuric Acid (over 50%)	NR	NR	X	X
Hexane	NR	X	X	X	Tannic Acid	X	X	X	X
Hydrobromic Acid (40%)	NR	X	X	X	Vinegar	X	X	X	X
Hydrochloric Acid (conc)	NR	X	X	X					

Duro Dyne National Corporate Headquarters, Bay Shore, NY

631-249-9000 • Fax: 631-249-8346

Duro Dyne Midwest • Duro Dyne West • Duro Dyne Canada

www.durodyne.com • E-mail: durodyne@durodyne.com



©2021 Duro Dyne Corporation

5/24/2022

BO010403



Knight & Wilson, Inc.

"Sheet Metal Contractors"

676 East E.H. Crump Blvd. Memphis TN 38126
901-274-6978

SUBMITTAL

EQUIPMENT:

DOUBLE WALL TURNING VANE

SPEC SECTION:

23 33 00

PROJECT:

HIGHLANDS BLDG. - PINNACLE HILLS

LOCATION:

ROGERS, AR

CONTRACTOR:

COMFORT SYSTEMS USA

NOTE:

WE PROPOSE TO PROVIDE MACHINE FABRICATED HOLLOW **DOUBLE WALL VANE** WELDED TO RAIL PER THE ATTACHED SUBMITTAL. WE WILL USE 2" FOR DUCTS LESS THAN 36" AND OR 4" RADIUS VANES FOR DUCTS OVER 36". THESE VANES ARE MACHINE FABRICATED AND WELDED TO THE VANE RAIL AND THEN INCORPORATED WITHIN OUR DUCTWORK ELBOWS. ALL VANES PER SMACNA CONSTRUCTION. VANES TO BE USED IN DUCT VELOCITIES OF 1500fpm OR LESS

CONTACT:
DATE:

MICHAEL COAD, K&W - PROJECT MGR.
6/29/2026



KNIGHT & WILSON, INC.

www.knightwilson.com

676 E. H. CRUMP BLVD.


MEMPHIS, TENNESSEE 38126

(901) 274-6978

PRODUCT

DOUBLE WALL TURNING VANE

SPECIFICATION

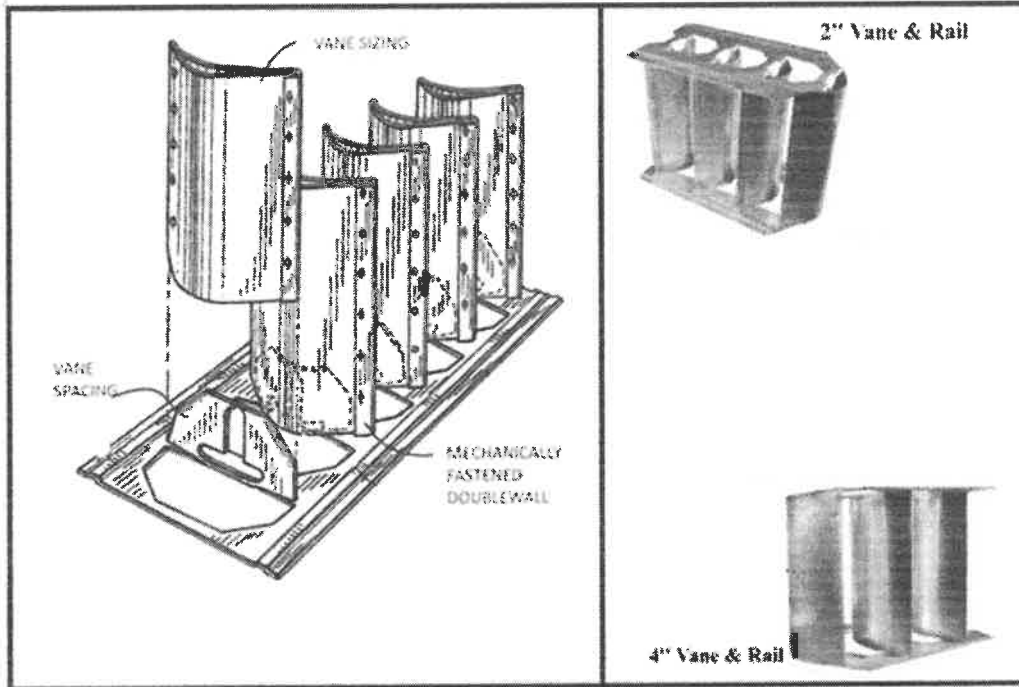

SIZE	GUAGE	SPACING	DUCT SIZE
2"	26ga - Galv	2.375"	12"-35" High
4"	24ga - Galv	3.50"	36"+ High

THESE VANES ARE MACHINE FABRICATED AND WELDED TO THE VANE RAIL AND THEN INCORPORATED WITHIN OUR DUCTWORK ELBOWS. ALL VANES PER SMACNA DUCT CONSTRUCTION STANDARDS.