


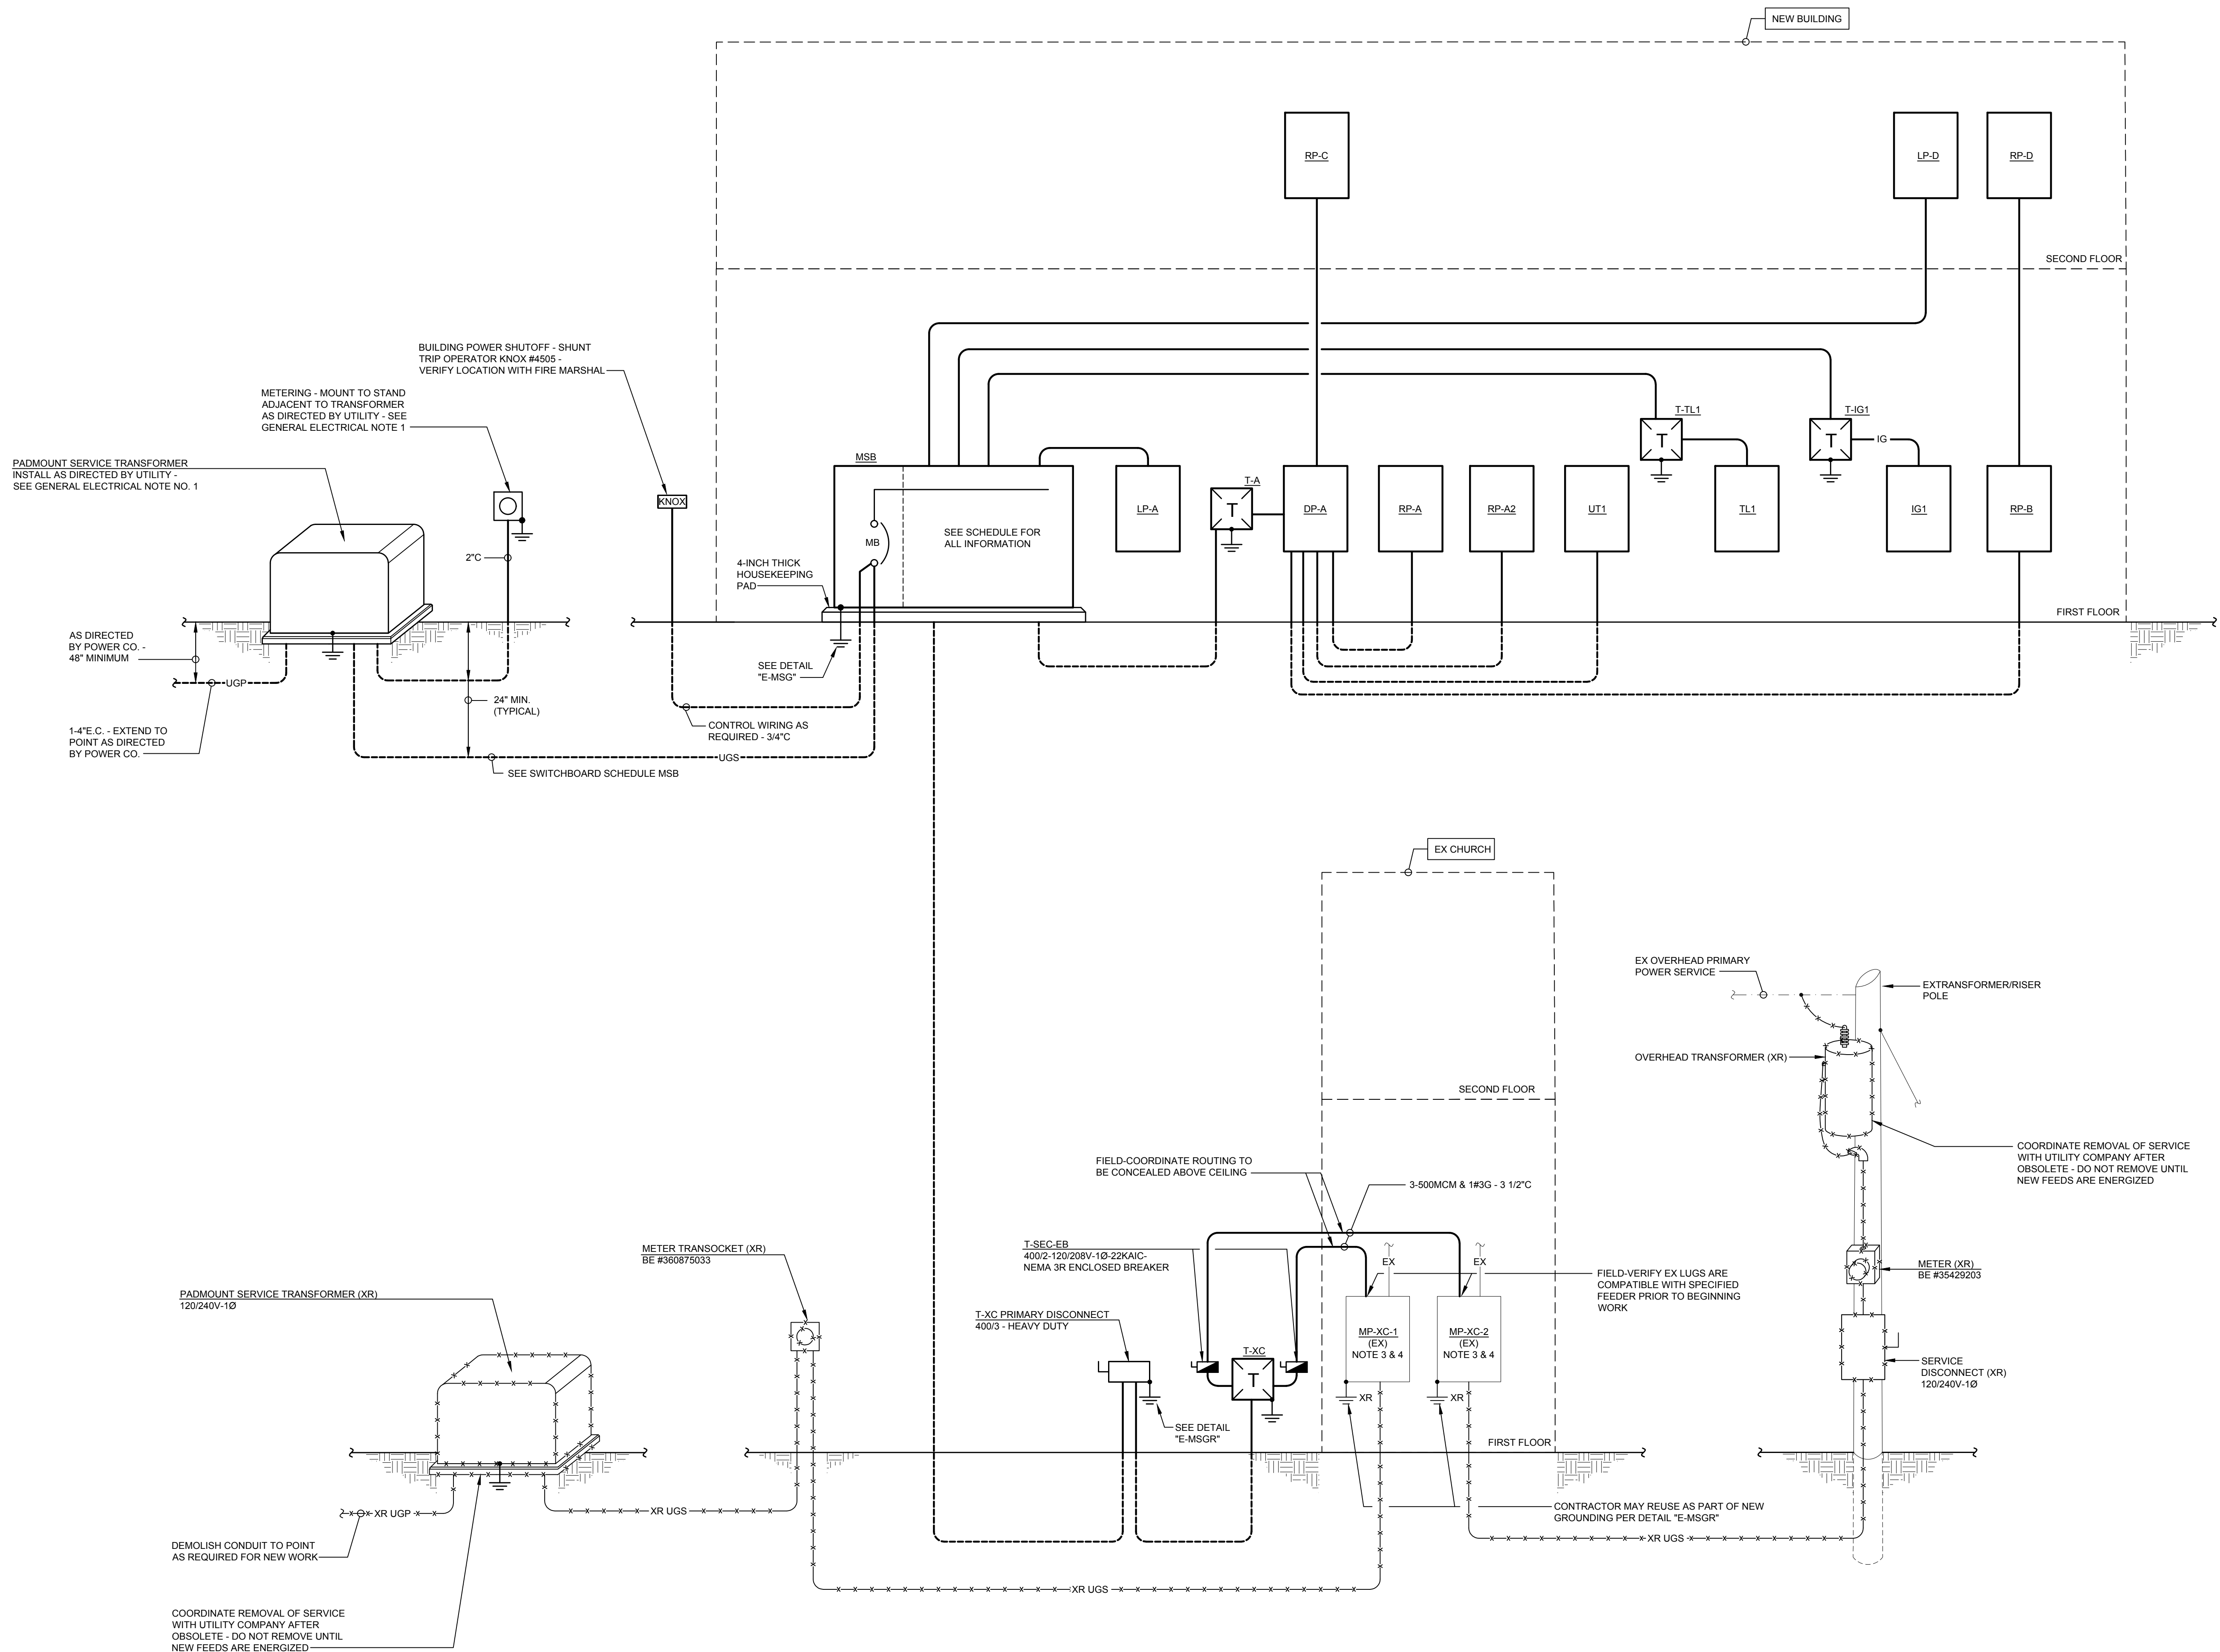

SINGLE LINE DIAGRAM

SCALE : NONE

DIAGRAM NOTES

- REFER TO PANELBOARD AND TRANSFORMER SCHEDULES FOR ALL APPLICABLE FEEDER SIZES, BREAKER RATINGS, BUS RATINGS, TRANSFORMER RATINGS, ETC. NOT SHOWN ON THIS DIAGRAM.
- NEUTRAL-GROUND BONDS SHALL ONLY BE MADE AT THE FOLLOWING LOCATIONS:
A. MAIN BREAKER AT MSB.
B. SECONDARY SIDE OF ALL TRANSFORMERS.
- CONTRACTOR SHALL CONFIRM ALL EXISTING 2-POLE ELECTRICAL, HVAC, PLUMBING, ETC. EQUIPMENT AT EXISTING CHURCH IS DUAL-RATED FOR USE AT 208 VOLT PRIOR TO BEGINNING WORK.
- REMOVE EXISTING NEUTRAL GROUND BOND AT EXISTING SERVICE DISCONNECTS.



architecture
interior design



3117 2nd Avenue South Birmingham, AL 35233
p 205.870.3090
www.LIVEDesigngroup.com



8-12-2025

CALVARY CHURCH CALVARY CHURCH FACILITY ADDITION BENTONVILLE, AR

Revisions		
No.	Description	Date

Project Number
21010

Date
08/12/25

SINGLE LINE
DIAGRAM

E0.02



JACKSON,
RENFRO
& ASSOCIATES, INC.

ROBERT RENFRO, PE
bobr@jra.com
(205) 536-7114
(205) 536-2028
JRA 1000 NCS 224472
ELECTRICAL ENGINEERING & DESIGN
111 HUNTERDAYS CENTER PEWY • SUITE 100 • BIRMINGHAM, AL • 35242