




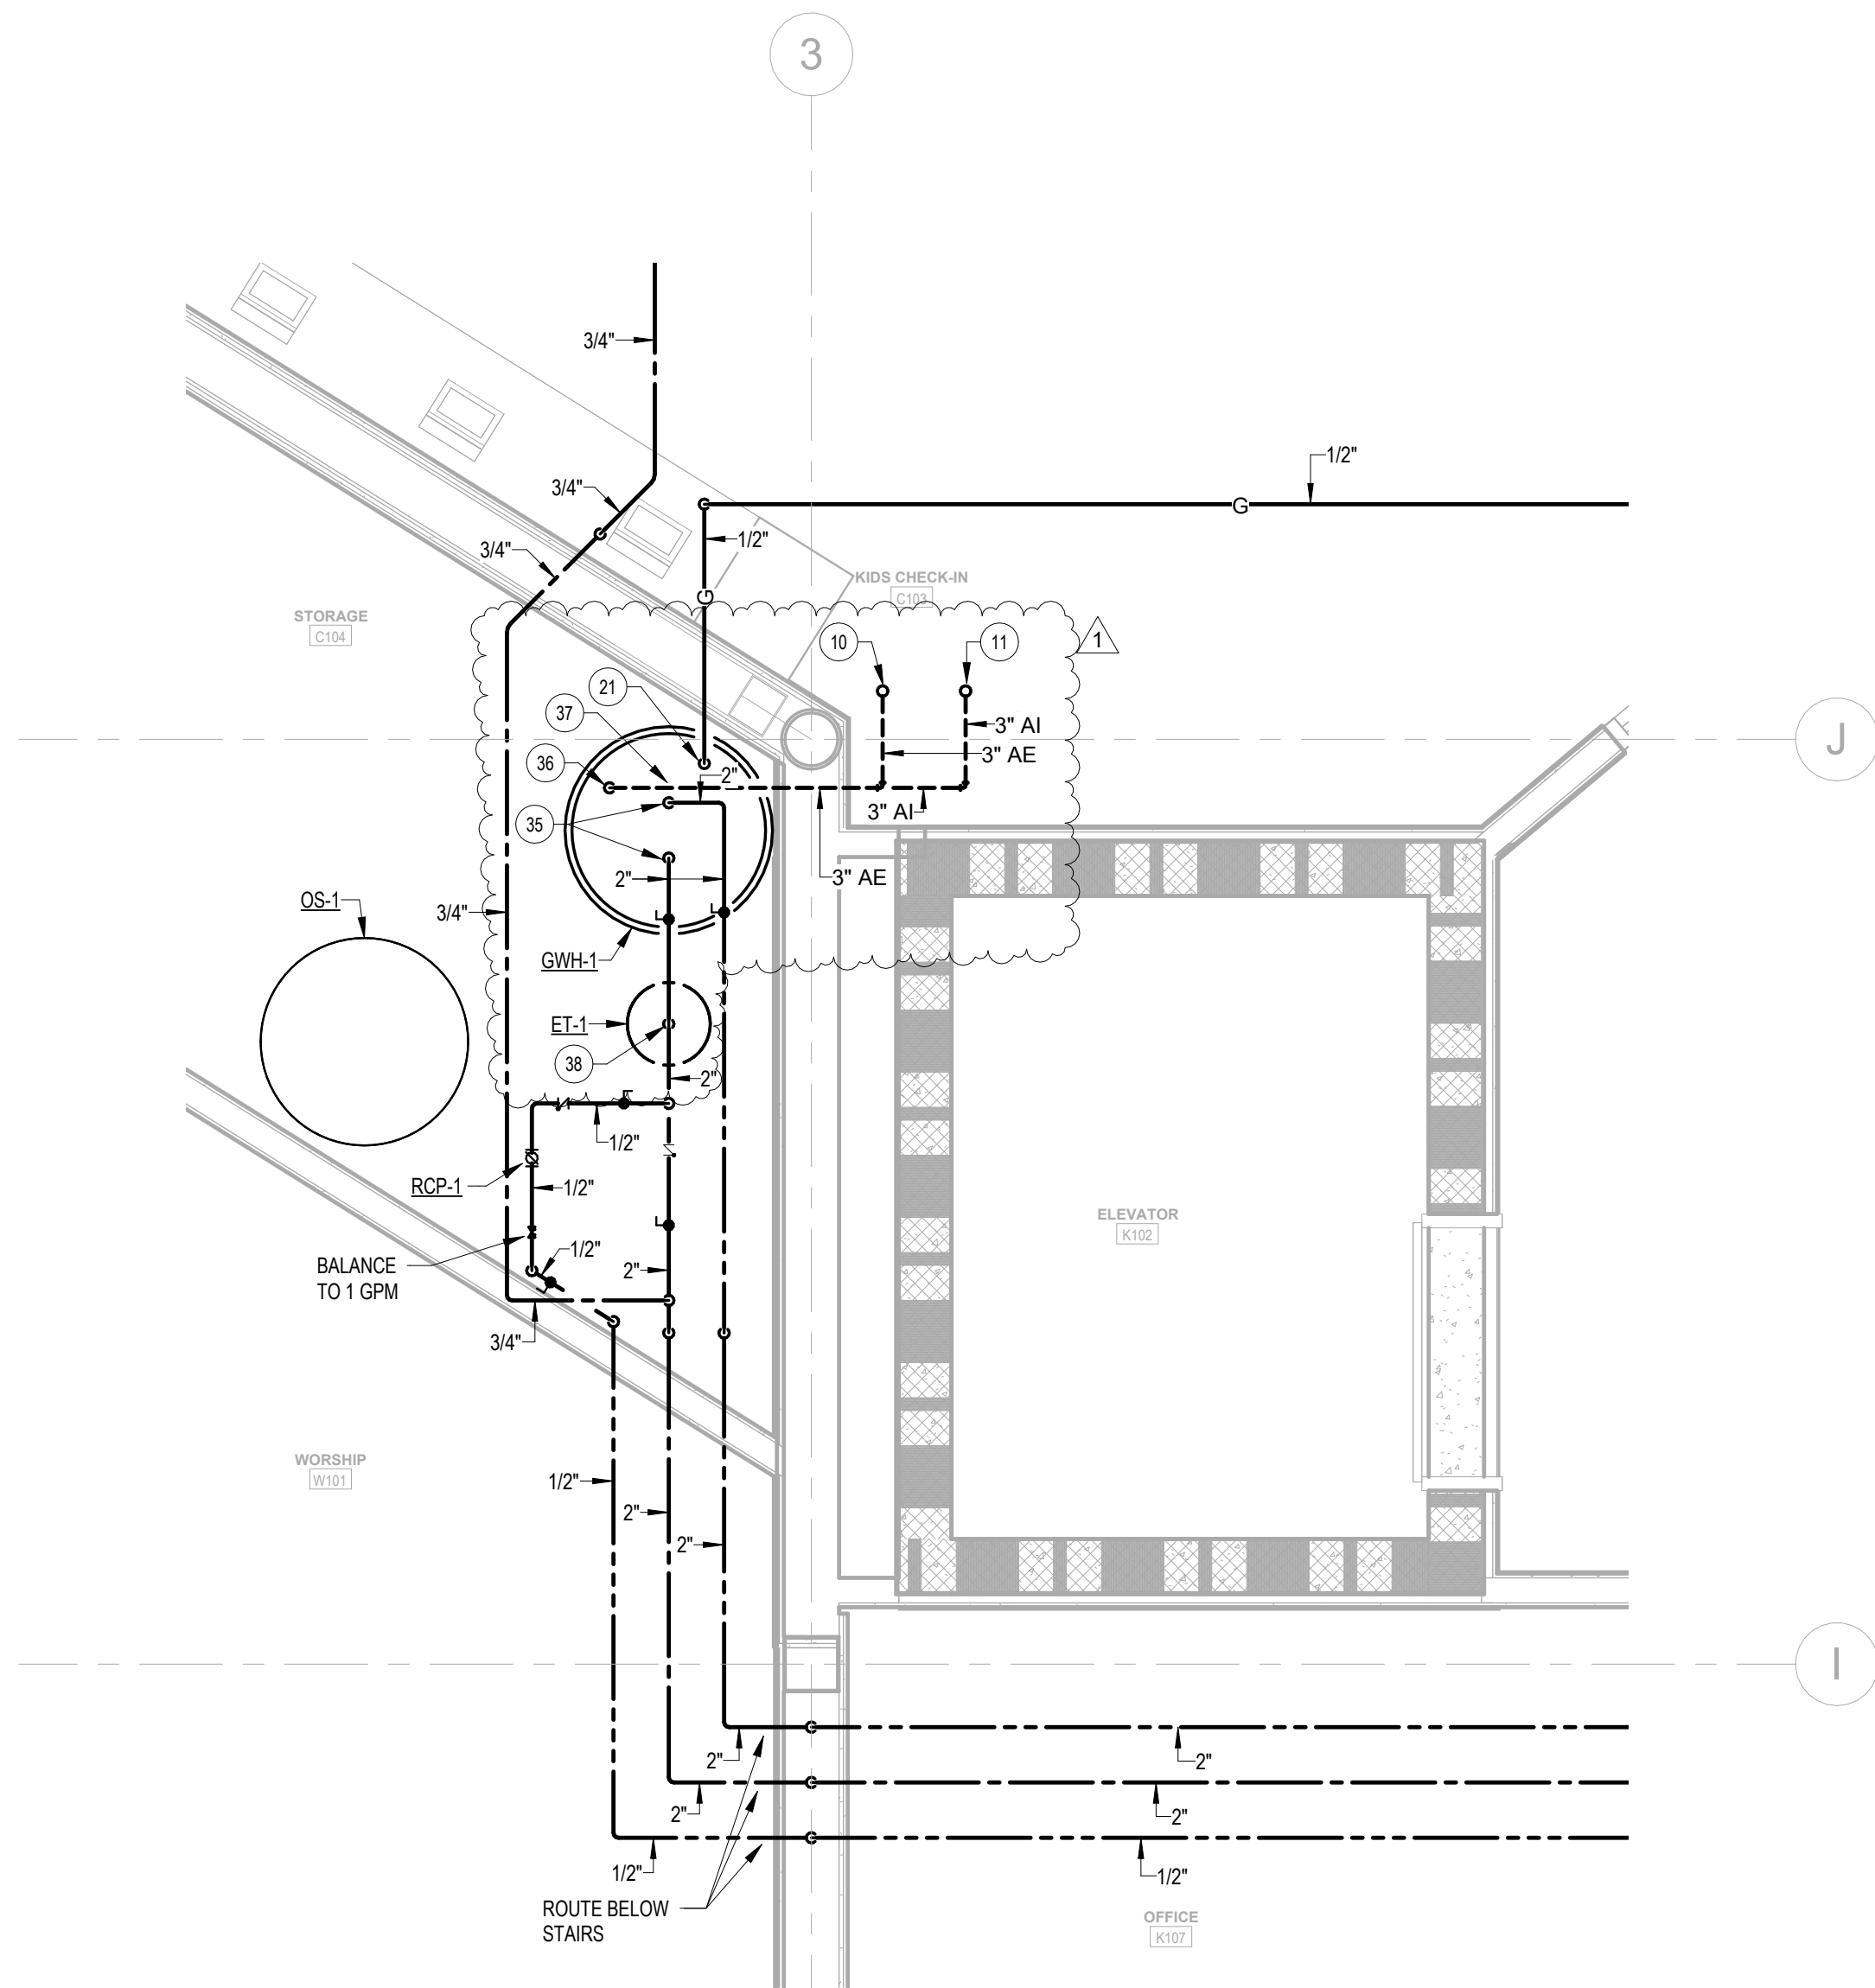

2 ENLARGED EAST SIDE STORAGE ROOM - PRESSURE
1/2" = 1'-0"

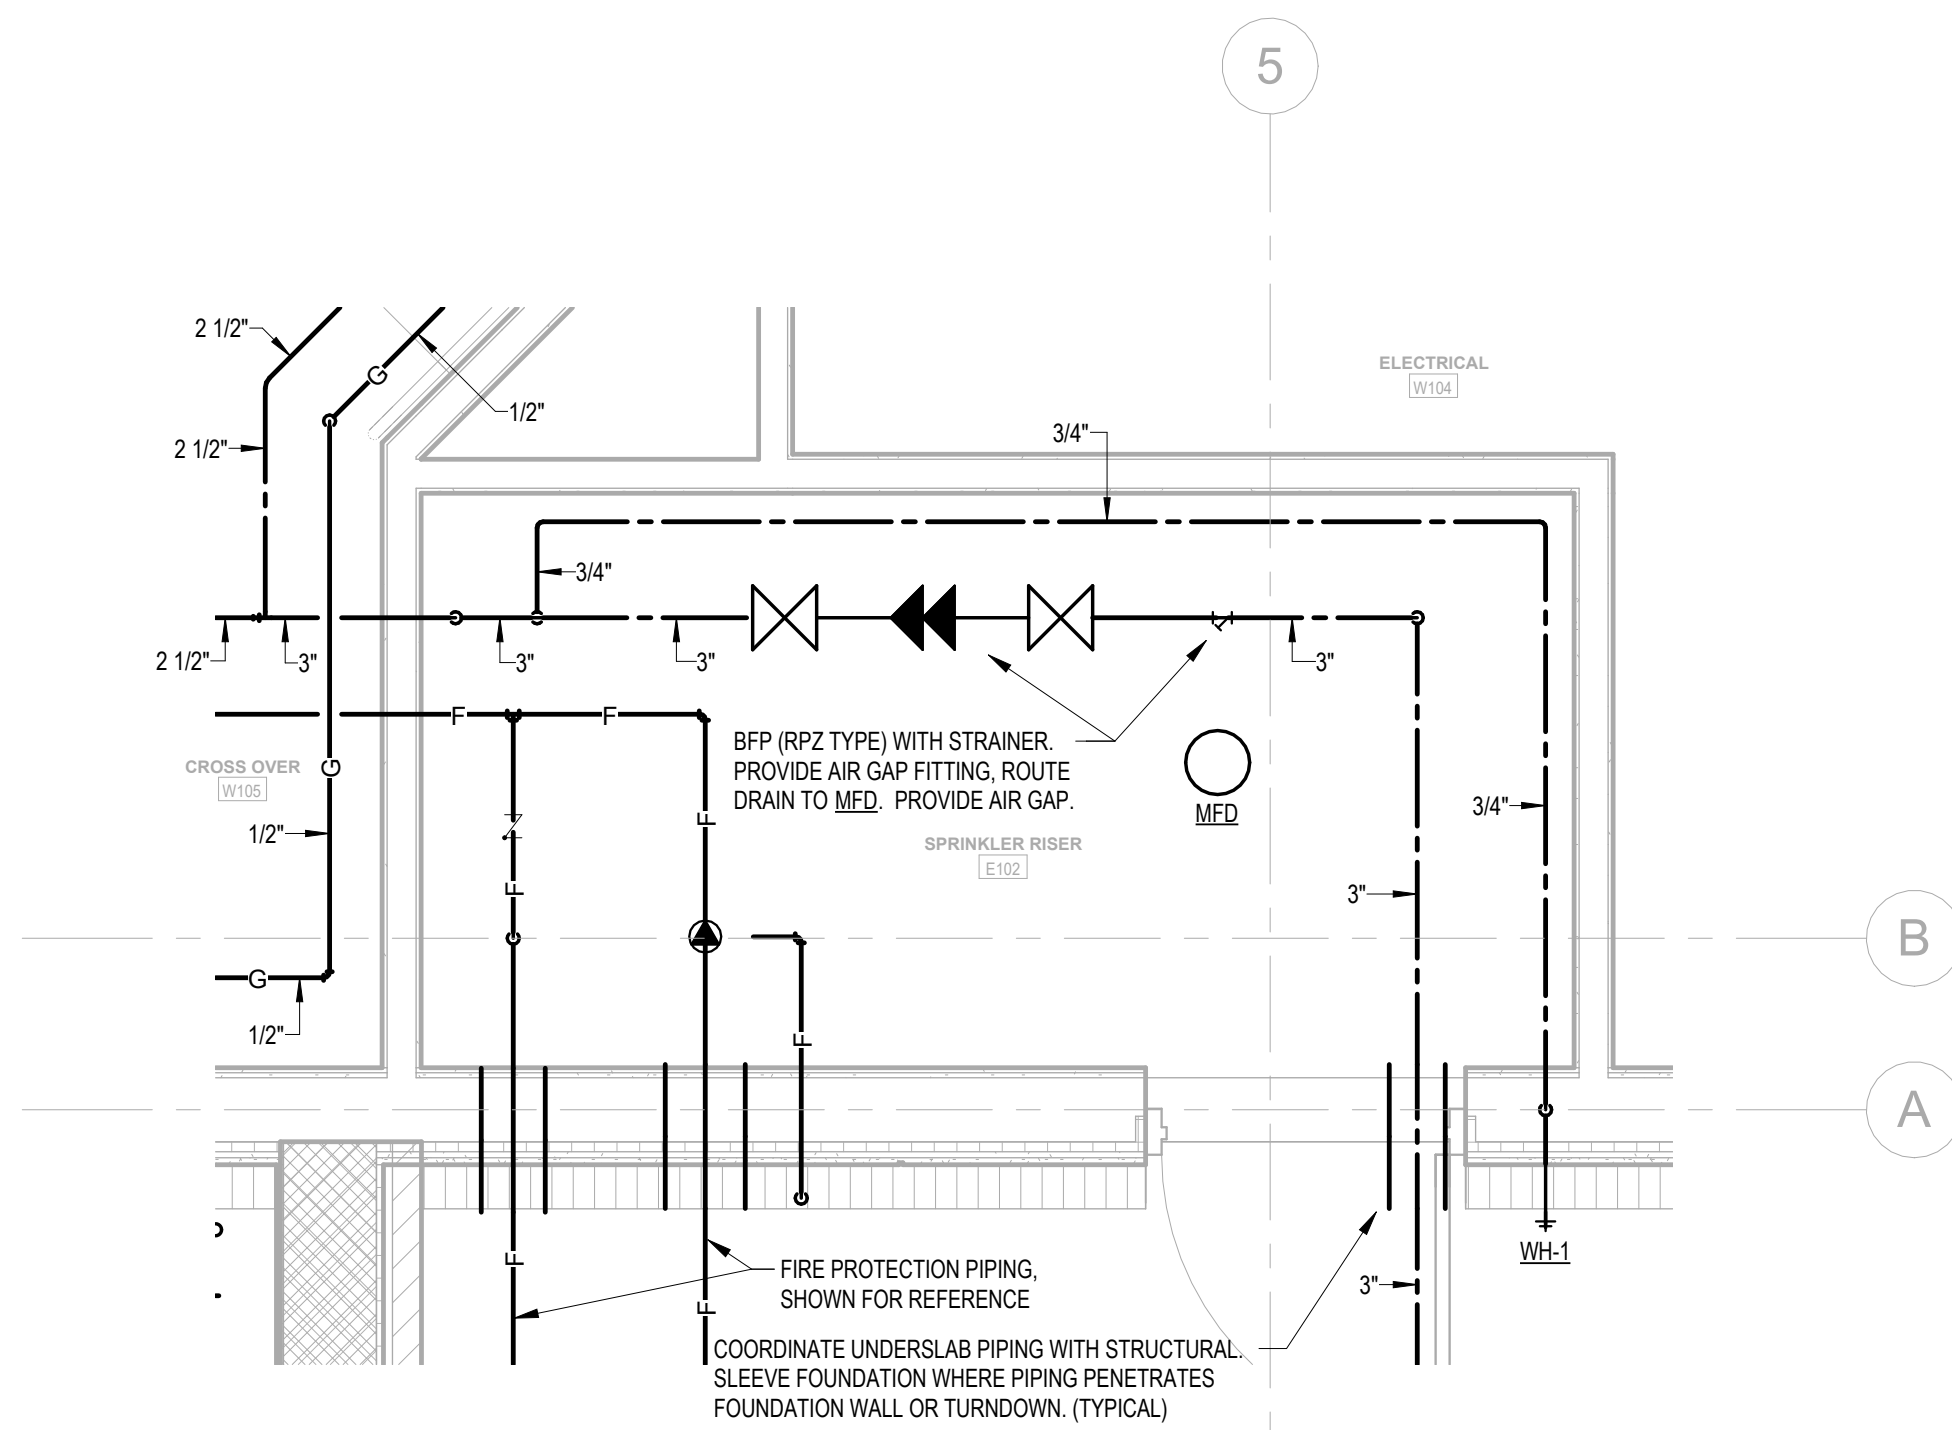

3 ENLARGED SPRINKLER RISER ROOM - PRESSURE
1/2" = 1'-0"

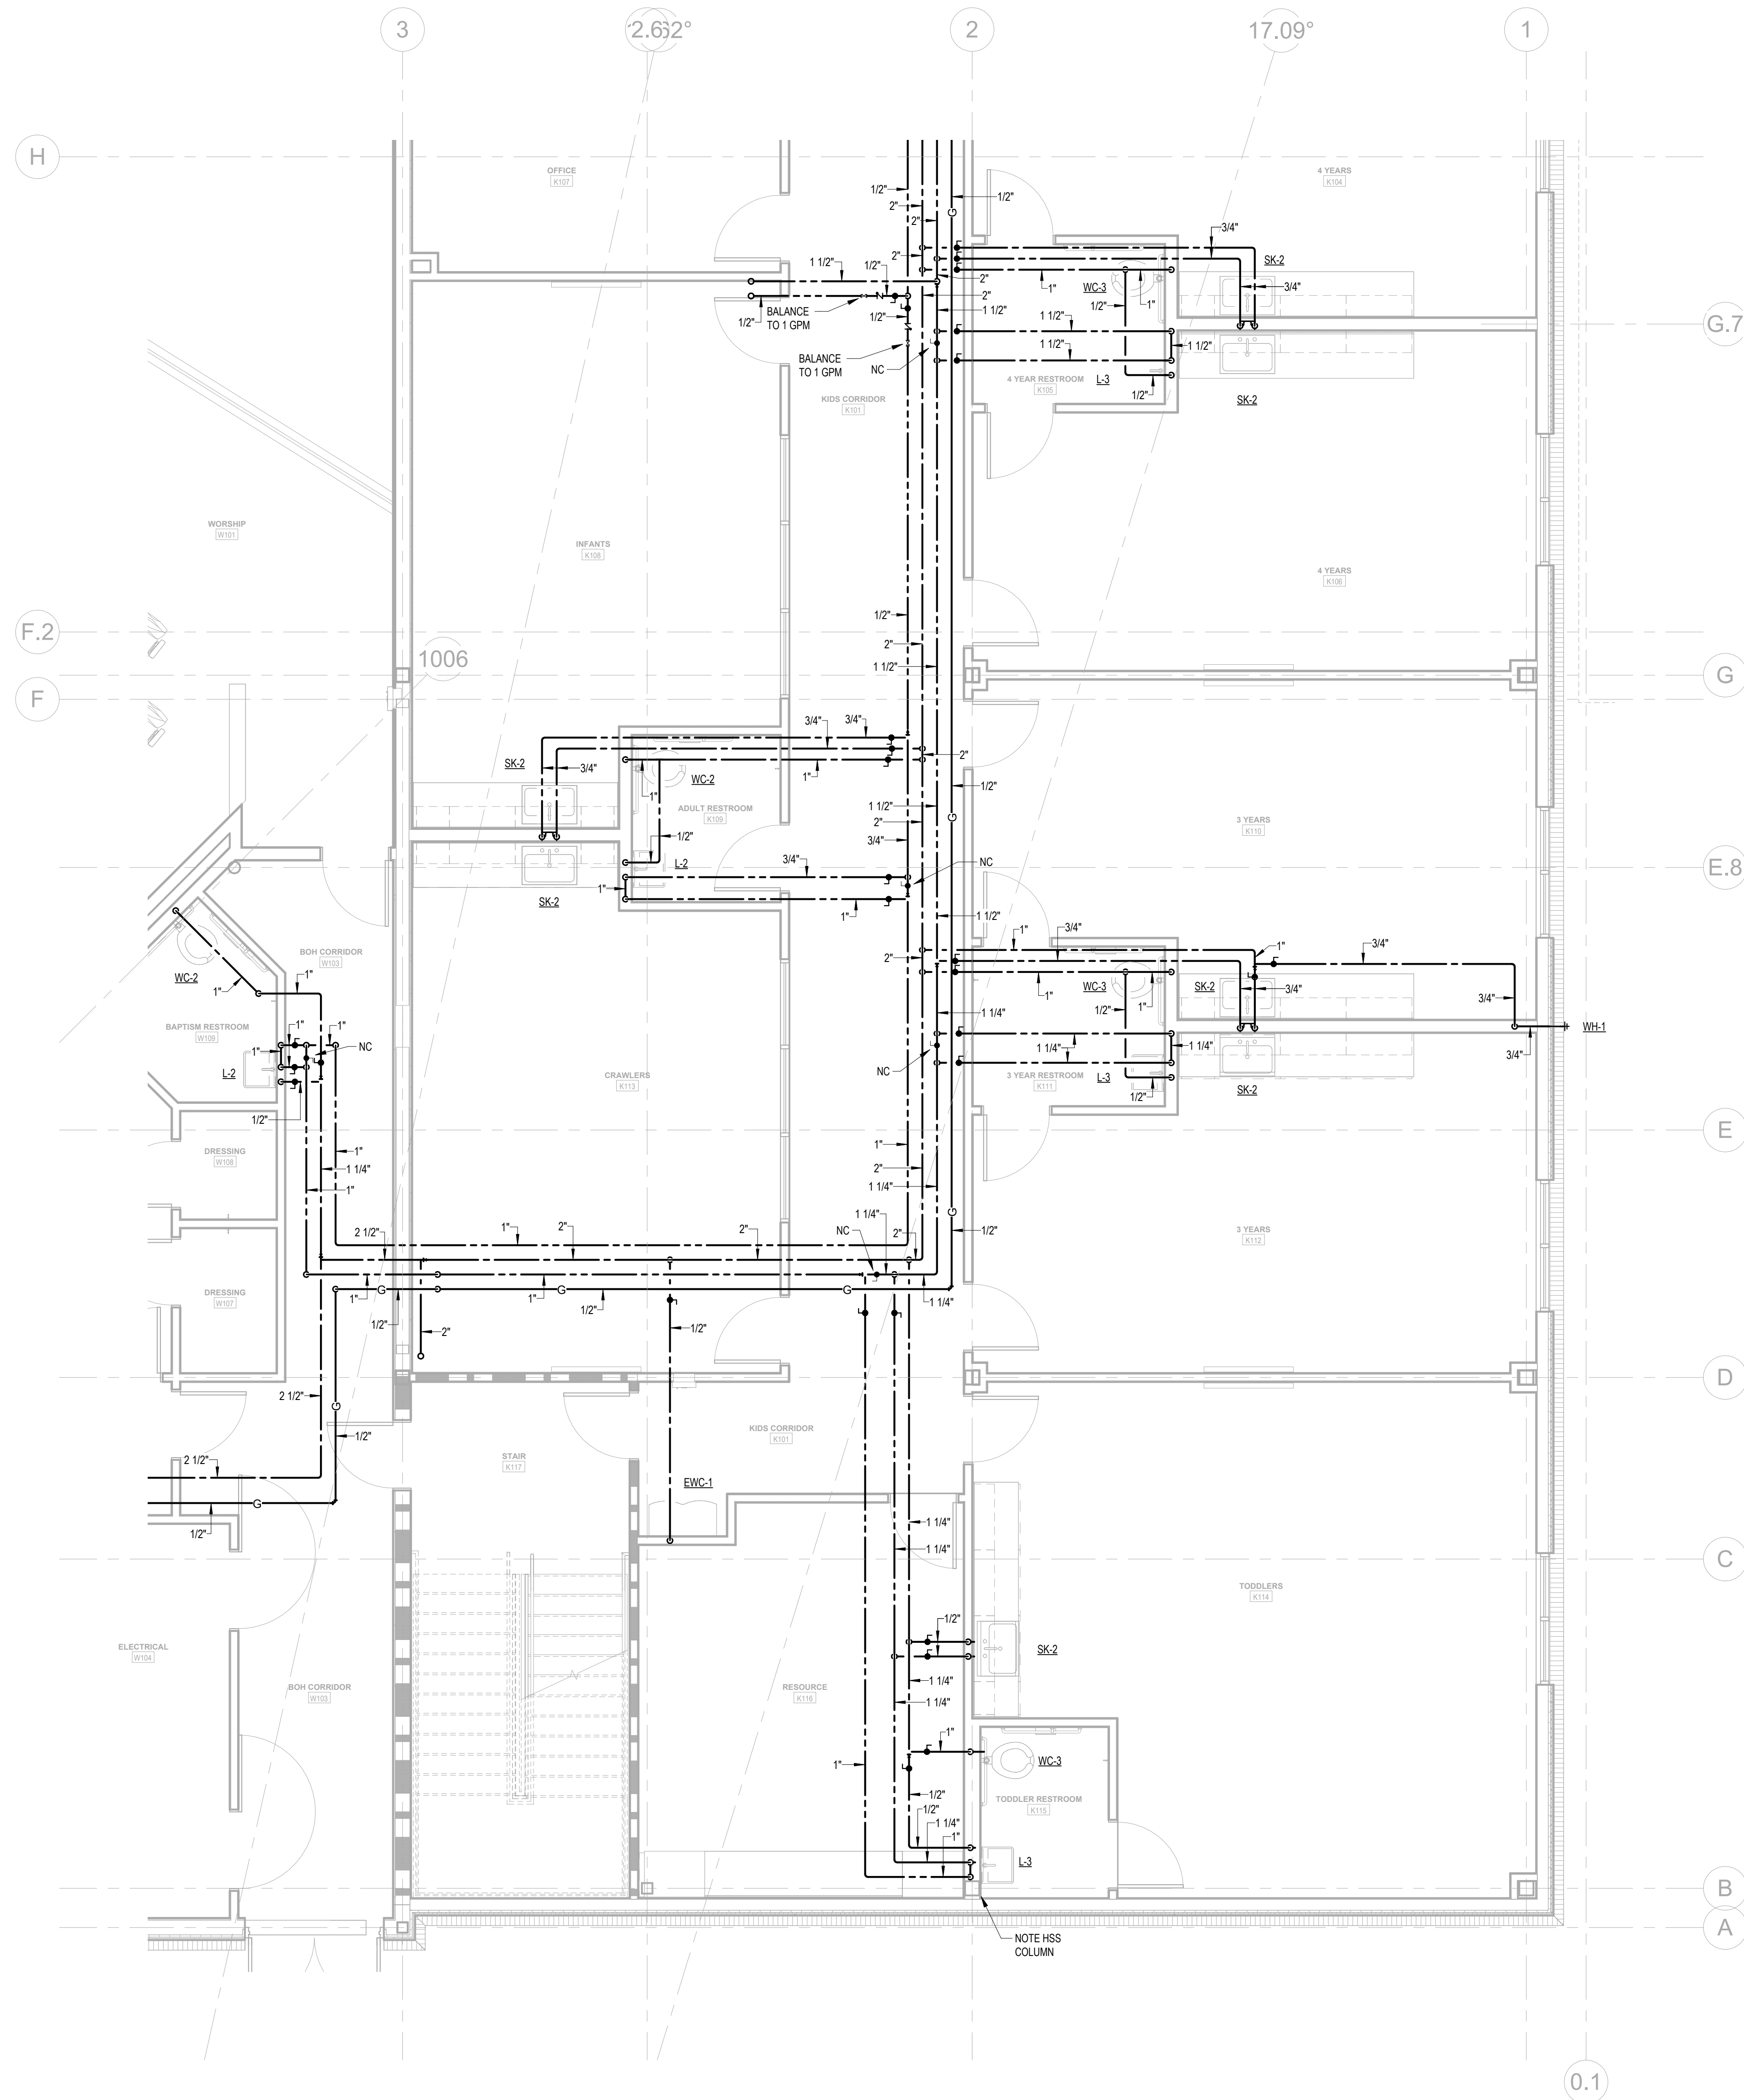

1 ENLARGED EAST SIDE PLAN - PRESSURE
1/4" = 1'-0"

KEYED NOTES	
10	3" AE UP
11	3" AI UP
21	DROP 1/2" NG TO EQUIPMENT
35	DROP 2" OW, 2" HW TO EQUIPMENT
36	DROP 3" AIR EXHAUST PIPE TO EQUIPMENT
37	DROP 3" AIR INTAKE PIPE TO EQUIPMENT
38	DROP 3/4" CW TO EQUIPMENT

BBG&S
BIRMINGHAM, AL
205.870.3090
www.LIVEdesigngroup.com
ARCHITECTURE
INTERIOR DESIGN



CALVARY CHURCH CALVARY CHURCH FACILITY ADDITION BENTONVILLE, AR

Revisions		
No.	Description	Date
1	Addendum 01	09/12/25

Project Number
21010

Date
08/12/25

PLUMBING
ENLARGED PLANS

P3.03