
## PLUMBING DEMO NOTES


PLANS ARE SCHEMATIC IN NATURE, LAYOUT IS BASED ON BEST AVAILABLE INFORMATION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND DIMENSIONS. BRING ANY DISCREPANCIES FROM THE DRAWINGS AND NOTES TO THE OWNER'S REPRESENTATIVE IMMEDIATELY. MINOR CHANGES IN THE SCOPE OF THE DEMOLITION WORK SHALL NOT JUSTIFY AN ADDITIONAL COST. CONTRACTOR SHALL CLEAN ALL EXISTING PLUMBING FIXTURES TO REMAIN OR BE REUSED IN AREA OF WORK TO LIKE-NEW CONDITION AND PROVIDE A LIST OF ANY DEFICIENCIES TO OWNER'S REPRESENTATIVE.

> DEMOLISH ALL DUCTWORK, PIPING AND EQUIPMENT SHOWN SHADED AND DASHED IN A DARK LINE WEIGHT.



Description

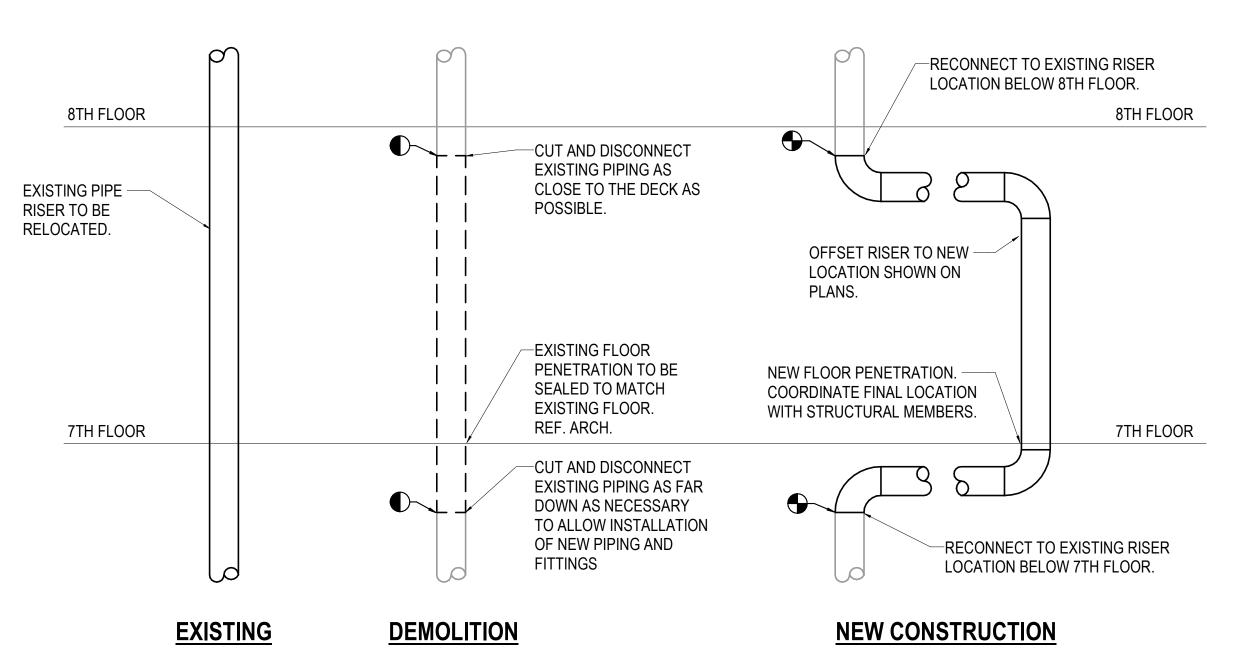

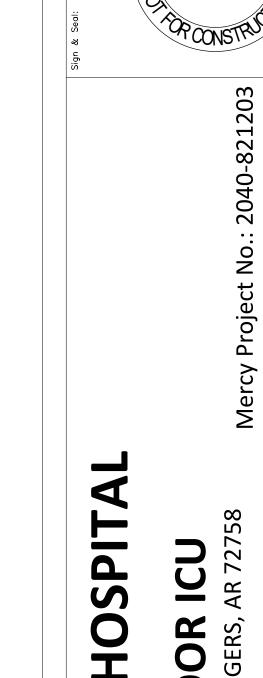




7TH FLOOR

PD1.1

**AREA B** 

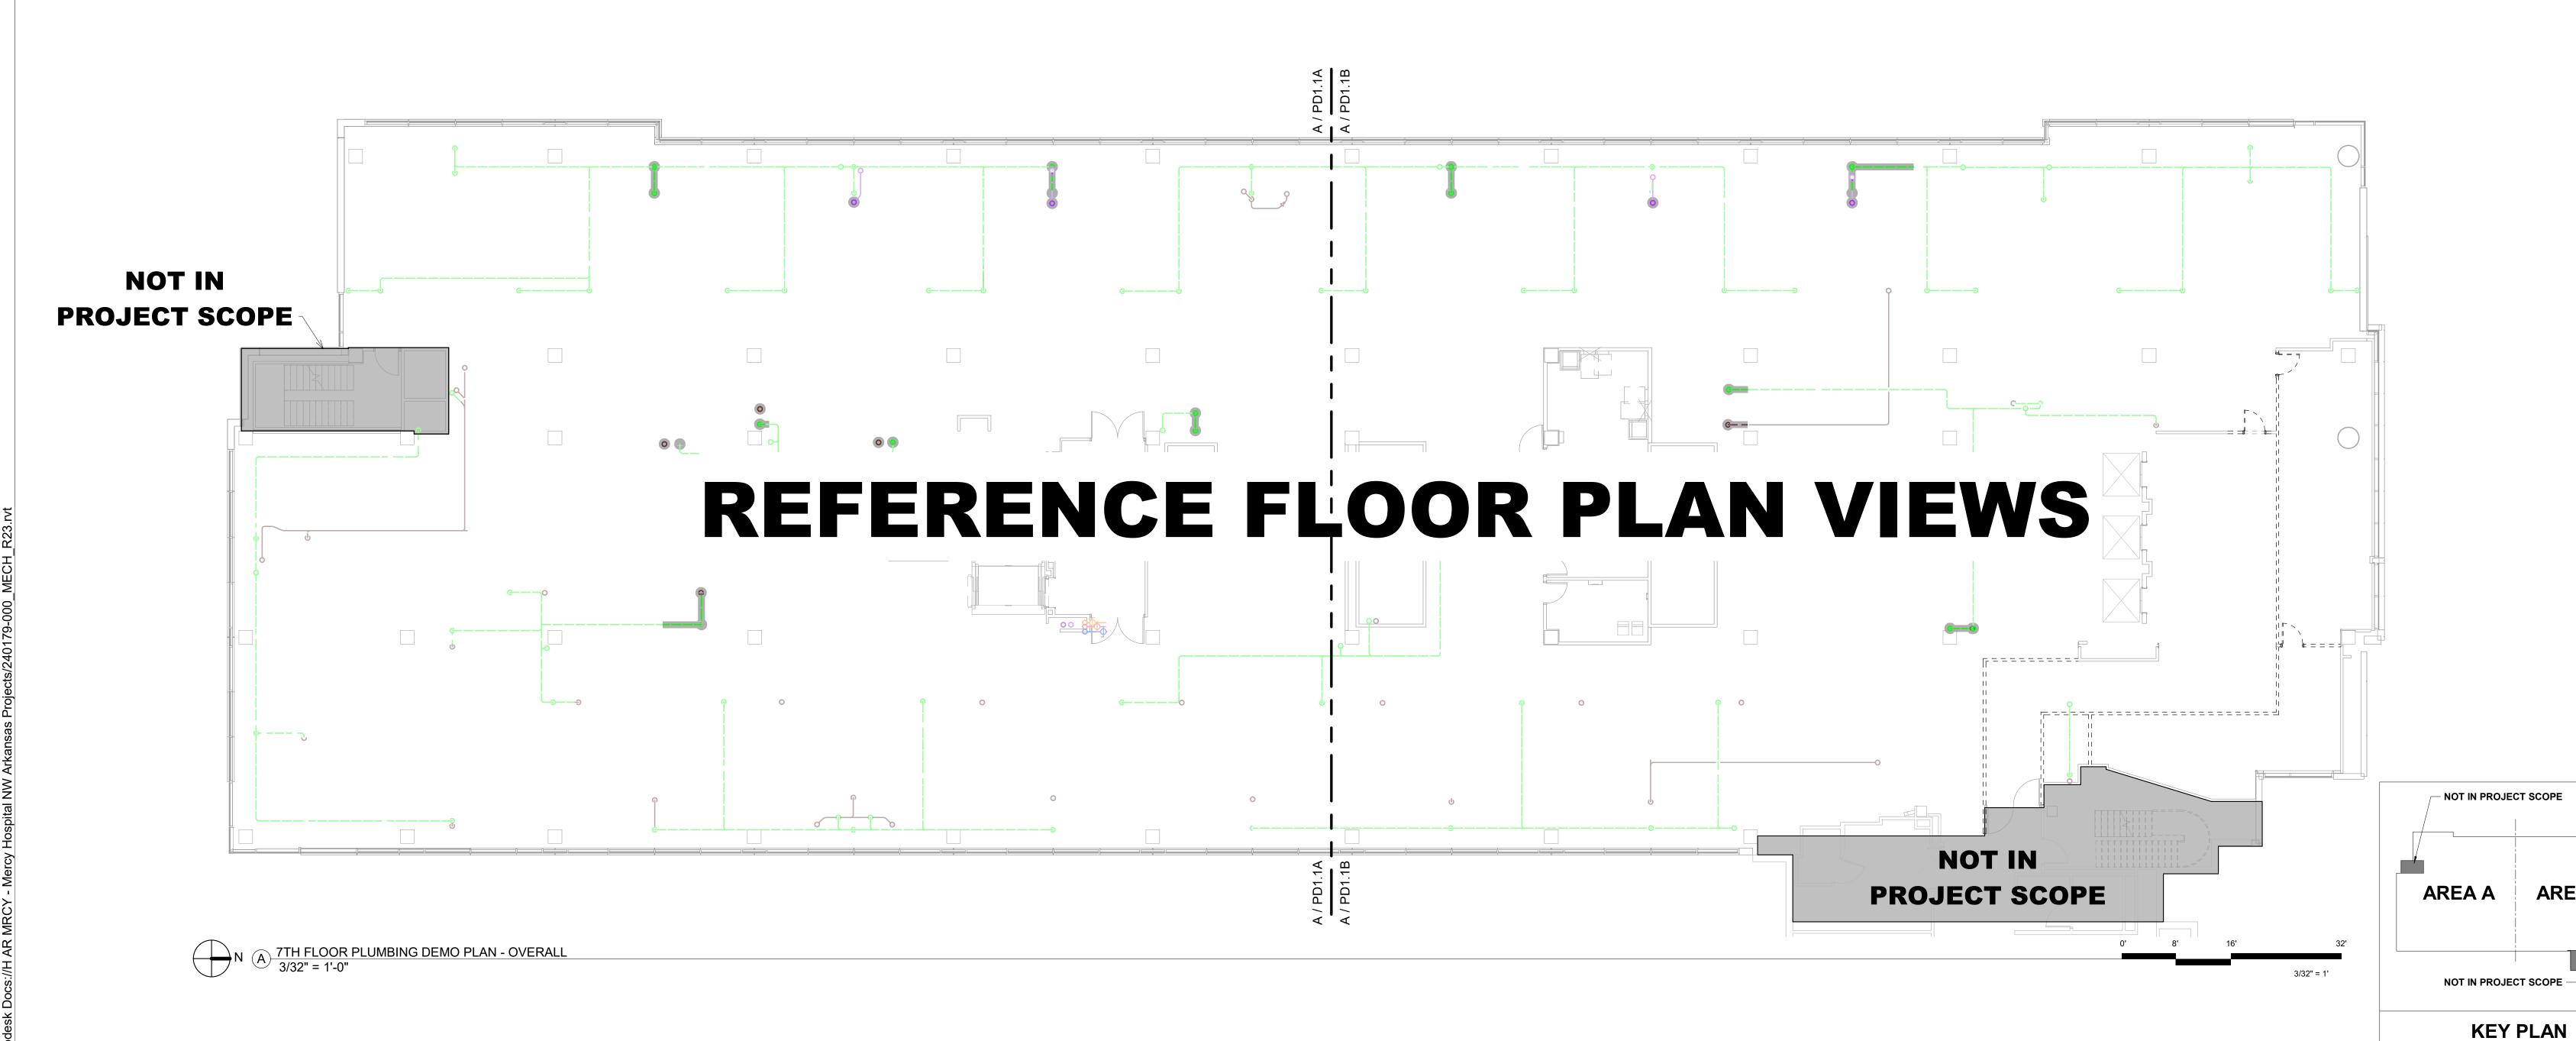


PLANS ARE SCHEMATIC IN NATURE, LAYOUT IS BASED ON BEST AVAILABLE INFORMATION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND DIMENSIONS. BRING ANY DISCREPANCIES FROM THE DRAWINGS AND NOTES TO THE OWNER'S


REPRESENTATIVE IMMEDIATELY. MINOR CHANGES IN THE SCOPE OF THE DEMOLITION WORK SHALL NOT JUSTIFY AN ADDITIONAL COST. CONTRACTOR SHALL CLEAN ALL EXISTING PLUMBING FIXTURES TO REMAIN OR BE REUSED IN AREA OF WORK TO LIKE-NEW CONDITION AND PROVIDE A LIST OF ANY DEFICIENCIES TO OWNER'S REPRESENTATIVE. DEMOLISH ALL DUCTWORK, PIPING AND EQUIPMENT SHOWN SHADED AND DASHED IN A DARK LINE WEIGHT.

# SHEET KEYNOTES

1 RELOCATE WASTE/VENT RISER TO WALL/CHASE

2 DEMO 8' RAINLEADER UP TO CEILING AND RELOCATE TO CHASE.

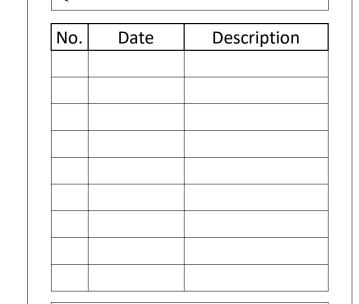



- NOT IN PROJECT SCOPE


NOT IN PROJECT SCOPE -

**KEY PLAN** 

**AREA A** 

AREA B

7TH FLOOR PD1.1A

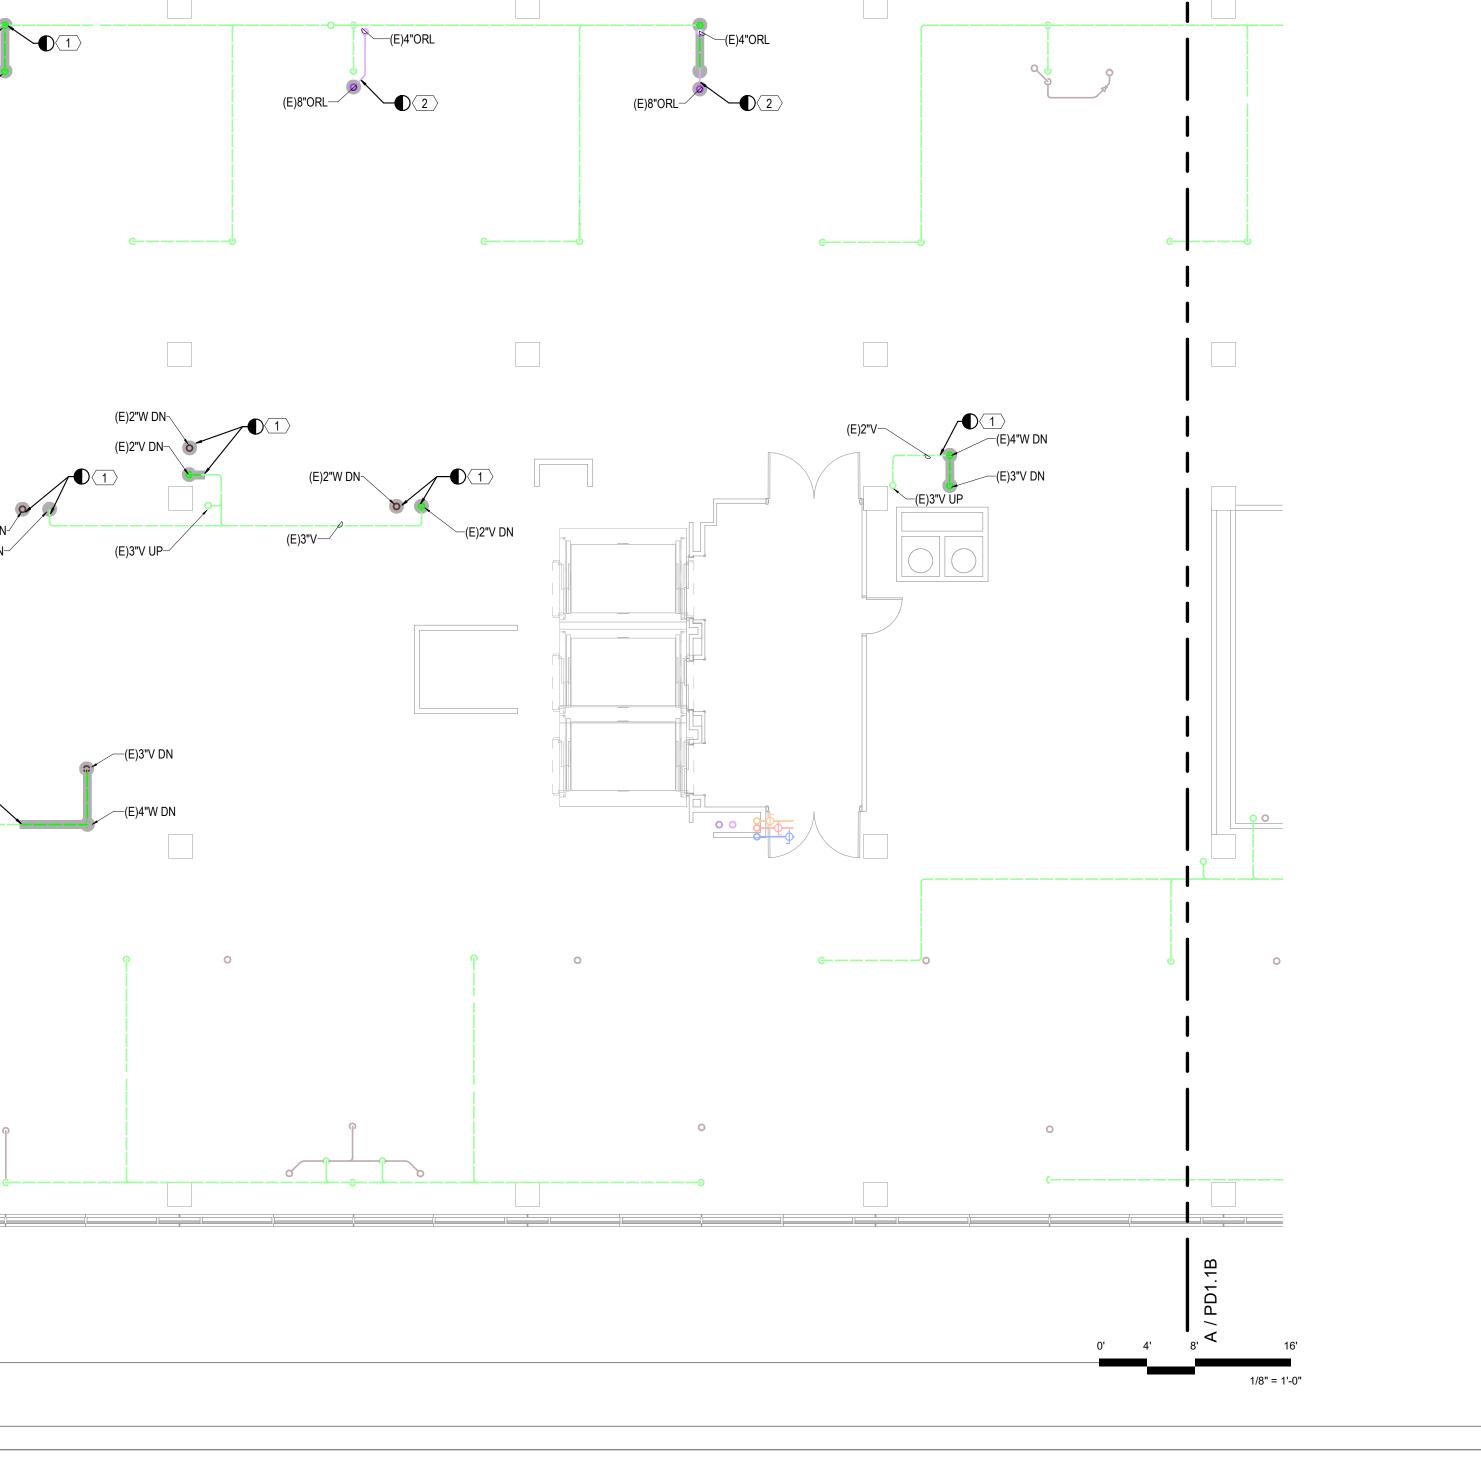

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

**NOT IN** 

PROJECT SCOPE

(E)2"V UP (E)2"W UP

(E)2"V DN (E)2"W DN

(E)2"V DN

(E)4"V UP

(E)4"W DN

N A 7TH FLOOR PLUMBIND DEMO PLAN - AREA A 1/8" = 1'-0"

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

**PLUMBING DEMO NOTES** . PLANS ARE SCHEMATIC IN NATURE, LAYOUT IS BASED ON BEST AVAILABLE INFORMATION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND

DIMENSIONS. BRING ANY DISCREPANCIES FROM THE DRAWINGS AND NOTES TO THE OWNER'S REPRESENTATIVE IMMEDIATELY. MINOR CHANGES IN THE SCOPE OF THE DEMOLITION WORK SHALL NOT JUSTIFY AN ADDITIONAL COST. CONTRACTOR SHALL CLEAN ALL EXISTING PLUMBING FIXTURES TO REMAIN OR BE REUSED IN AREA OF WORK TO LIKE-NEW CONDITION AND PROVIDE A LIST

OF ANY DEFICIENCIES TO OWNER'S REPRESENTATIVE. . DEMOLISH ALL DUCTWORK, PIPING AND EQUIPMENT SHOWN SHADED AND DASHED IN A DARK LINE WEIGHT.

## # SHEET KEYNOTES

- NOT IN PROJECT SCOPE

NOT IN PROJECT SCOPE


**KEY PLAN** 

AREA A

**AREA B** 


1 RELOCATE WASTE/VENT RISER TO WALL/CHASE 2 DEMO 8' RAINLEADER UP TO CEILING AND RELOCATE


Description



7TH FLOOR

**PD1.1B** 

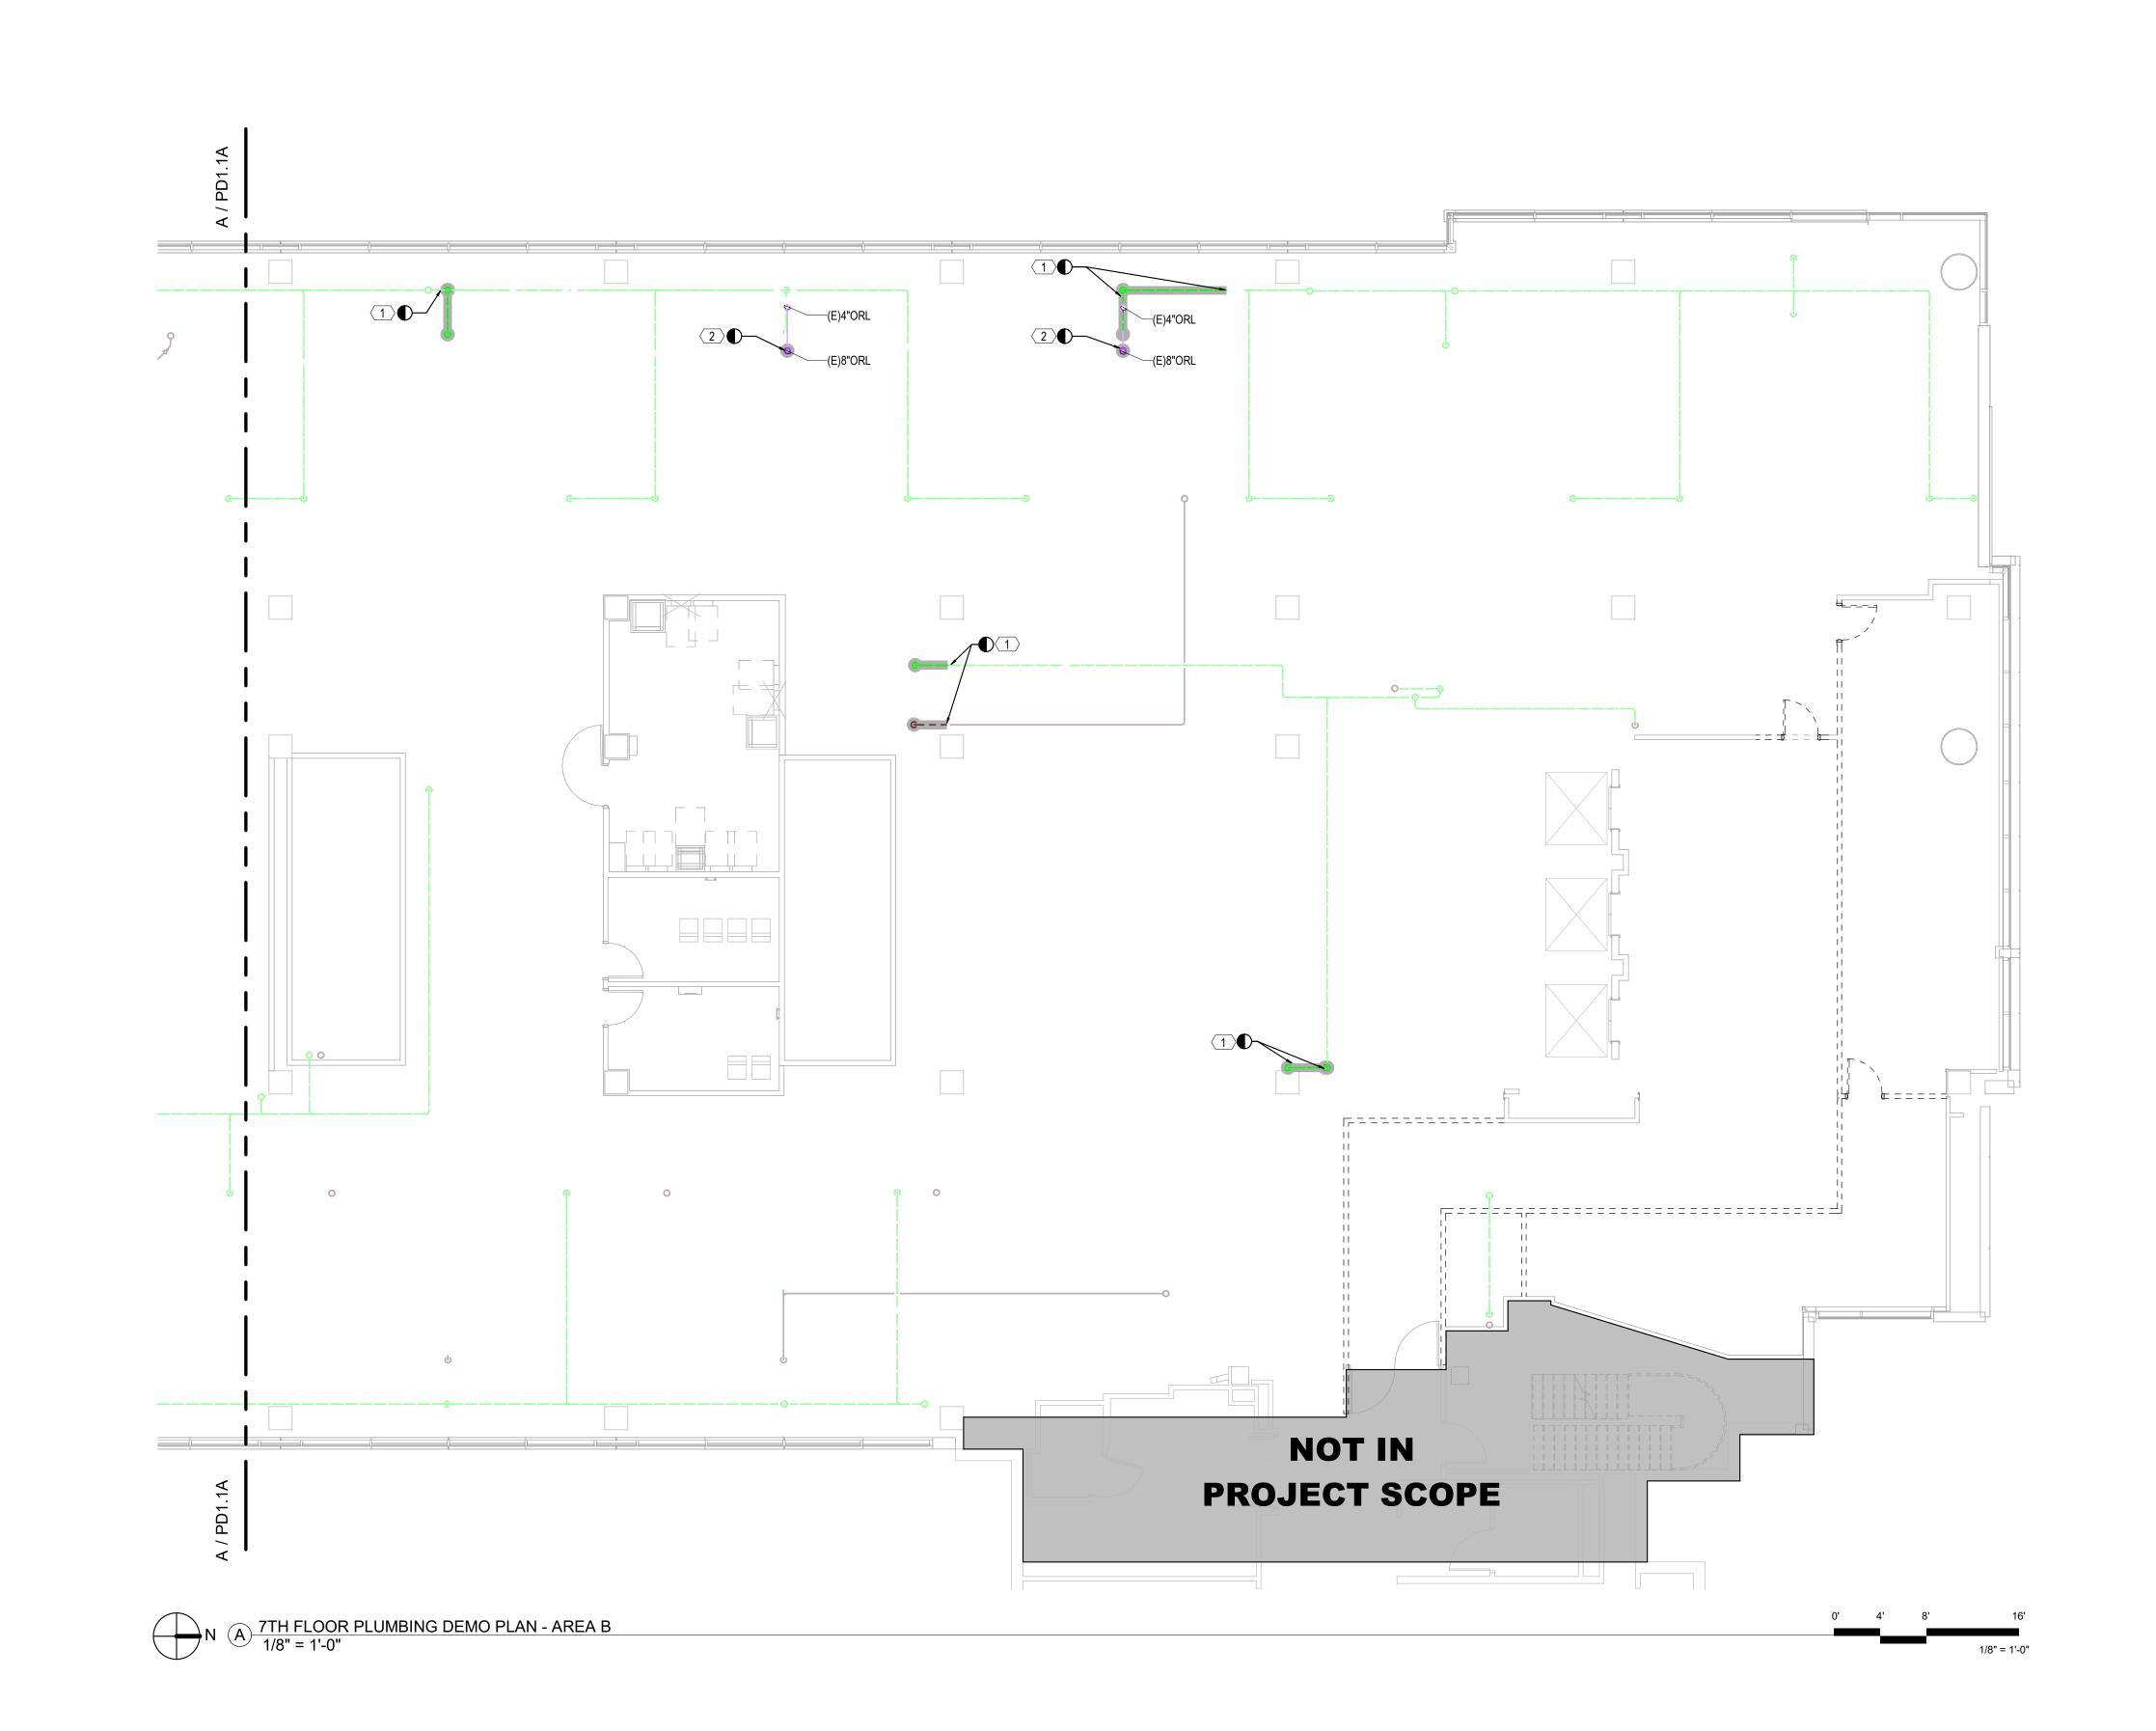

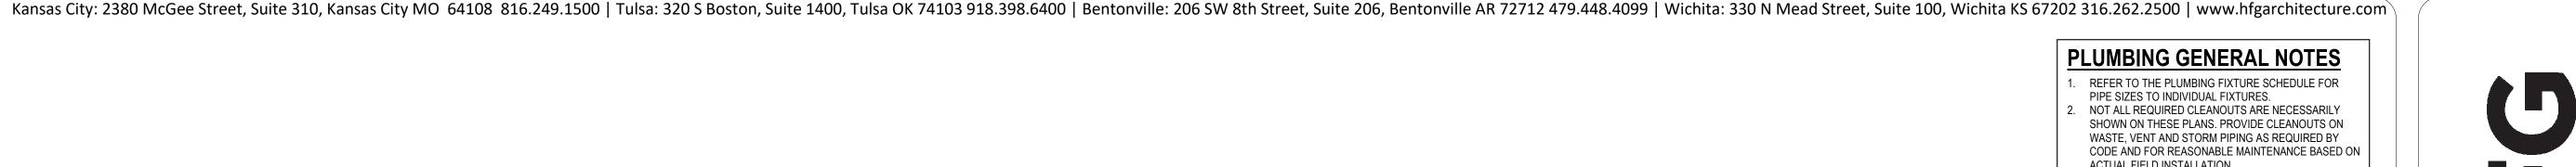


- ACTUAL FIELD INSTALLATION. . PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO
- BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF INSULATION. . AVOID ROUTING OVER ELECTRICAL ROOMS AND ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES. COORDINATE ROUTING WITH ELECTRICAL CONTRACTOR.
- . ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS PANELS IN HARD LID CEILINGS. . ACCESS PANELS SHALL BE 24x24, UNLESS NOTED OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE,

EXACT LOCATIONS SHALL BE COORDINATED WITH THE

- ARCHITECTURAL DRAWINGS AND EQUIPMENT LOCATIONS. PROVIDE RATED ACCESS PANELS WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR
- INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE. . PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT. . TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED
- AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE 10. VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES AND EQUIPMENT.

# SHEET KEYNOTES

Date Description






7TH FLOOR

P1.1

- NOT IN PROJECT SCOPE AREA A **AREA B** NOT IN PROJECT SCOPE **KEY PLAN** 

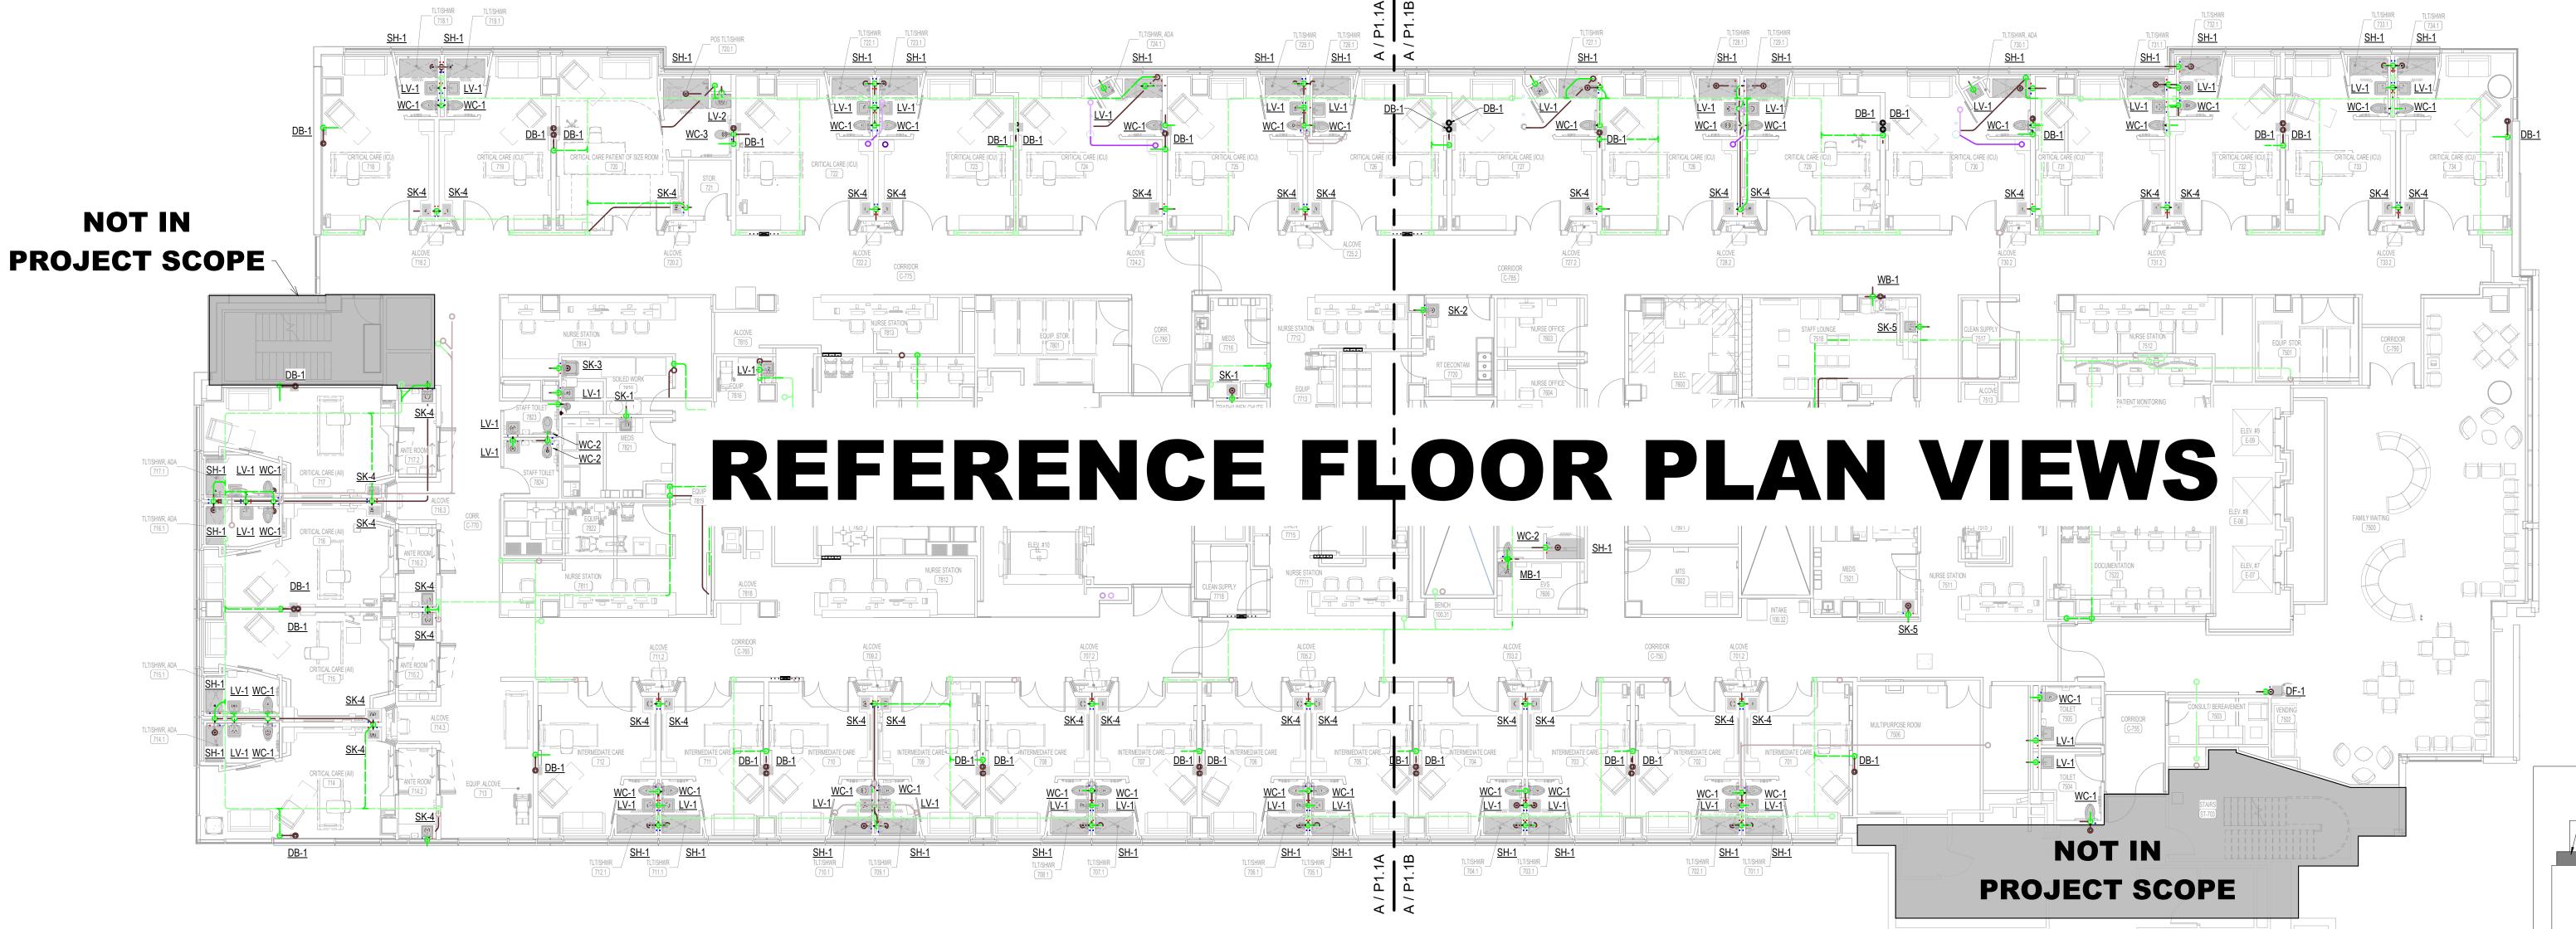

N A 7TH FLOOR PLUMBING PLAN - OVERALL - DRAIN, WASTE, & VENT 3/32" = 1'-0"

PIPE SIZES TO INDIVIDUAL FIXTURES.

ACTUAL FIELD INSTALLATION.

INSULATION.

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

REFER TO THE PLUMBING FIXTURE SCHEDULE FOR NOT ALL REQUIRED CLEANOUTS ARE NECESSARILY SHOWN ON THESE PLANS. PROVIDE CLEANOUTS ON WASTE, VENT AND STORM PIPING AS REQUIRED BY CODE AND FOR REASONABLE MAINTENANCE BASED ON PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF

AVOID ROUTING OVER ELECTRICAL ROOMS AND ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES. COORDINATE ROUTING WITH ELECTRICAL CONTRACTOR.

ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS PANELS IN HARD LID CEILINGS. ACCESS PANELS SHALL BE 24x24, UNLESS NOTED OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE, EXACT LOCATIONS SHALL BE COORDINATED WITH THE

ARCHITECTURAL DRAWINGS AND EQUIPMENT LOCATIONS. PROVIDE RATED ACCESS PANELS WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING

REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE. PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT. . TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE

10. VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES AND EQUIPMENT.

### # SHEET KEYNOTES

NOT IN PROJECT SCOPE

NOT IN PROJECT SCOPE


**KEY PLAN** 


AREA B

AREA A

- VENT PIPING DRAWN OFFSET TO SHOW PIPE SIZES. INSTALL INSIDE WALL/CHASE. CONNECT TO VENT/WASTE BELOW FLOOR, ROUTE NEW RISER WITHIN WALL/CHASE AND CONNECT TO
- EXISTING IN PLENUM SPACE. RELOCATED 8" OVERFLOW RAINLEADER TO CHASE. RECONNECT TO EXISTING 4" RAINLEADER IN PLENUM


Date Description








7TH FLOOR

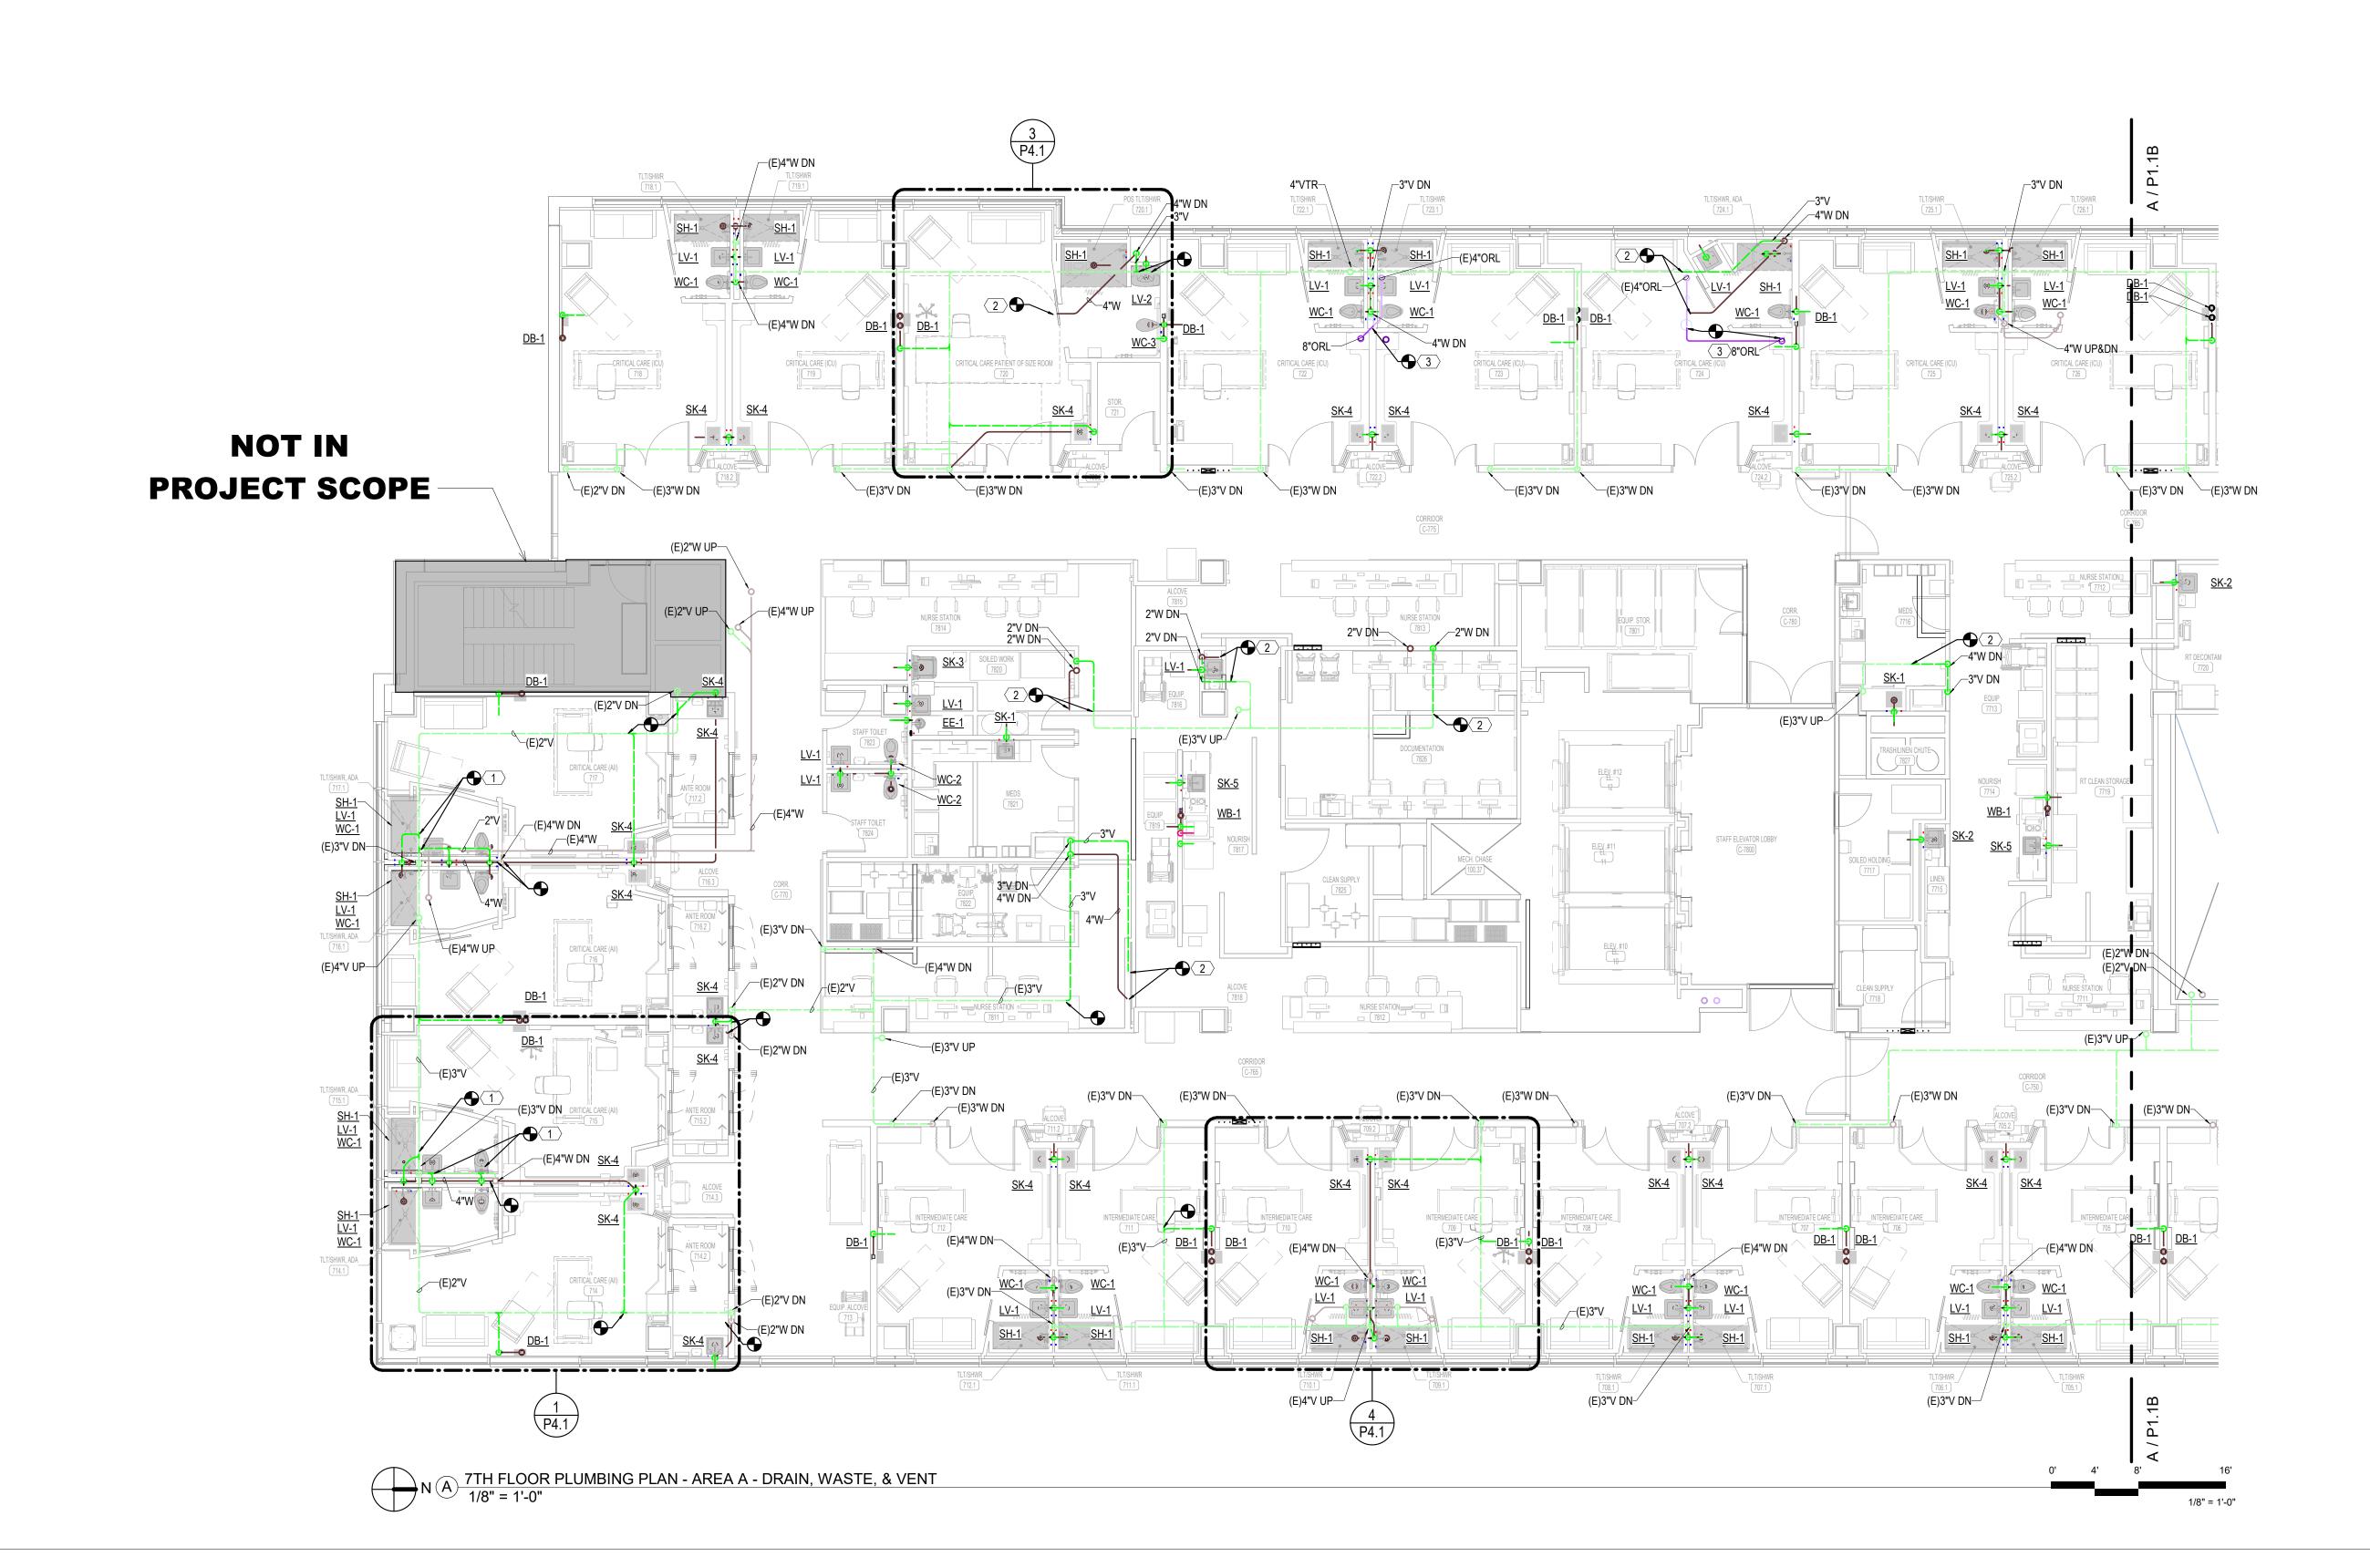

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

Date

Description





**7TH FLOOR** 

PLUMBING GENERAL NOTES

. REFER TO THE PLUMBING FIXTURE SCHEDULE FOR PIPE SIZES TO INDIVIDUAL FIXTURES. NOT ALL REQUIRED CLEANOUTS ARE NECESSARILY SHOWN ON THESE PLANS. PROVIDE CLEANOUTS ON WASTE, VENT AND STORM PIPING AS REQUIRED BY CODE AND FOR REASONABLE MAINTENANCE BASED ON ACTUAL FIELD INSTALLATION. PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO

BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF INSULATION. AVOID ROUTING OVER ELECTRICAL ROOMS AND ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES. COORDINATE ROUTING WITH ELECTRICAL

CONTRACTOR. ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS PANELS IN HARD LID CEILINGS.

ACCESS PANELS SHALL BE 24x24, UNLESS NOTED OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE, EXACT LOCATIONS SHALL BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS AND EQUIPMENT LOCATIONS. PROVIDE RATED ACCESS PANELS WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET

AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE. PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT.

TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE 10. VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL

FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES AND EQUIPMENT.

- NOT IN PROJECT SCOPE

**NOT IN PROJECT SCOPE** 


**KEY PLAN** 

**AREA B** 

AREA A

# SHEET KEYNOTES

CONNECT TO VENT/WASTE BELOW FLOOR, ROUTE NEW RISER WITHIN WALL/CHASE AND CONNECT TO EXISTING IN PLENUM SPACE. RELOCATED 8" OVERFLOW RAINLEADER TO CHASE. RECONNECT TO EXISTING 4" RAINLEADER IN PLENUM SPACE.

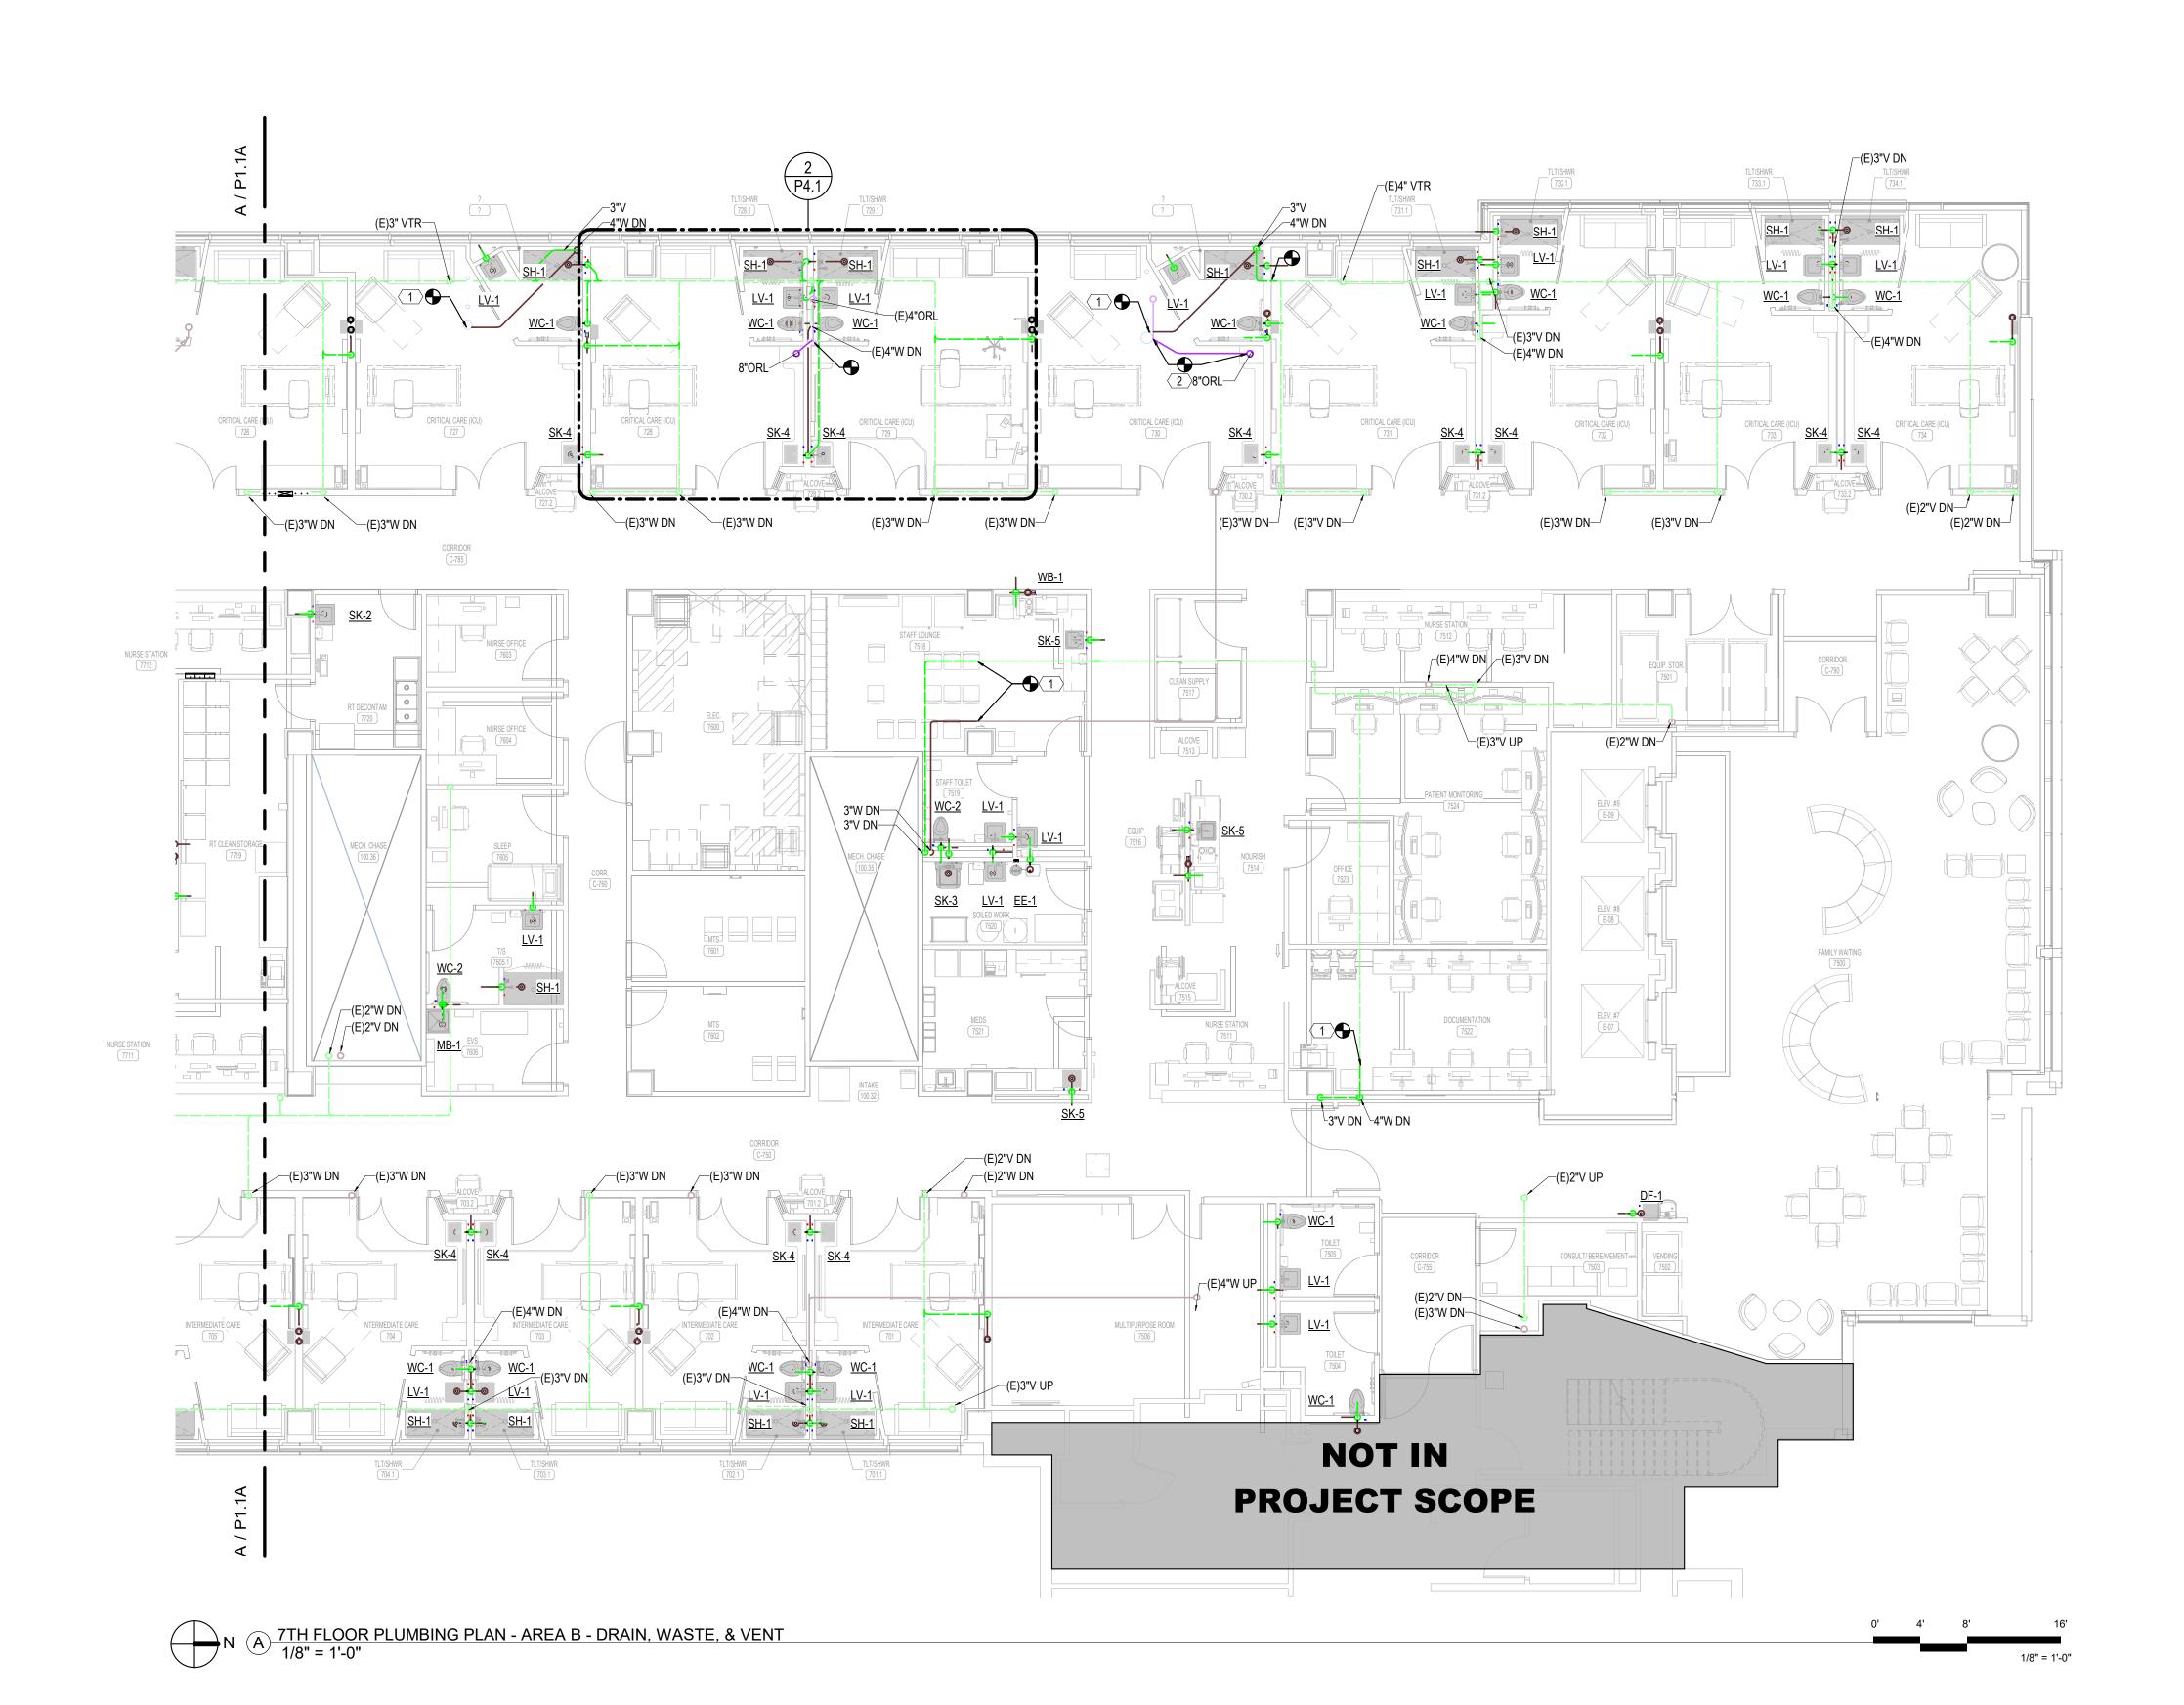




- REFER TO THE PLUMBING FIXTURE SCHEDULE FOR PIPE SIZES TO INDIVIDUAL FIXTURES. NOT ALL REQUIRED CLEANOUTS ARE NECESSARILY SHOWN ON THESE PLANS. PROVIDE CLEANOUTS ON
- WASTE, VENT AND STORM PIPING AS REQUIRED BY CODE AND FOR REASONABLE MAINTENANCE BASED ON ACTUAL FIELD INSTALLATION. PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO
- BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF INSULATION. AVOID ROUTING OVER ELECTRICAL ROOMS AND ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES. COORDINATE ROUTING WITH ELECTRICAL

CONTRACTOR.

- ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS PANELS IN HARD LID CEILINGS. ACCESS PANELS SHALL BE 24x24, UNLESS NOTED OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE, EXACT LOCATIONS SHALL BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS AND EQUIPMENT
- LOCATIONS. PROVIDE RATED ACCESS PANELS WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE.
- PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT. TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE
- 10. VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES AND EQUIPMENT.


Date Description



7TH FLOOR

P1.2

**KEY PLAN** 

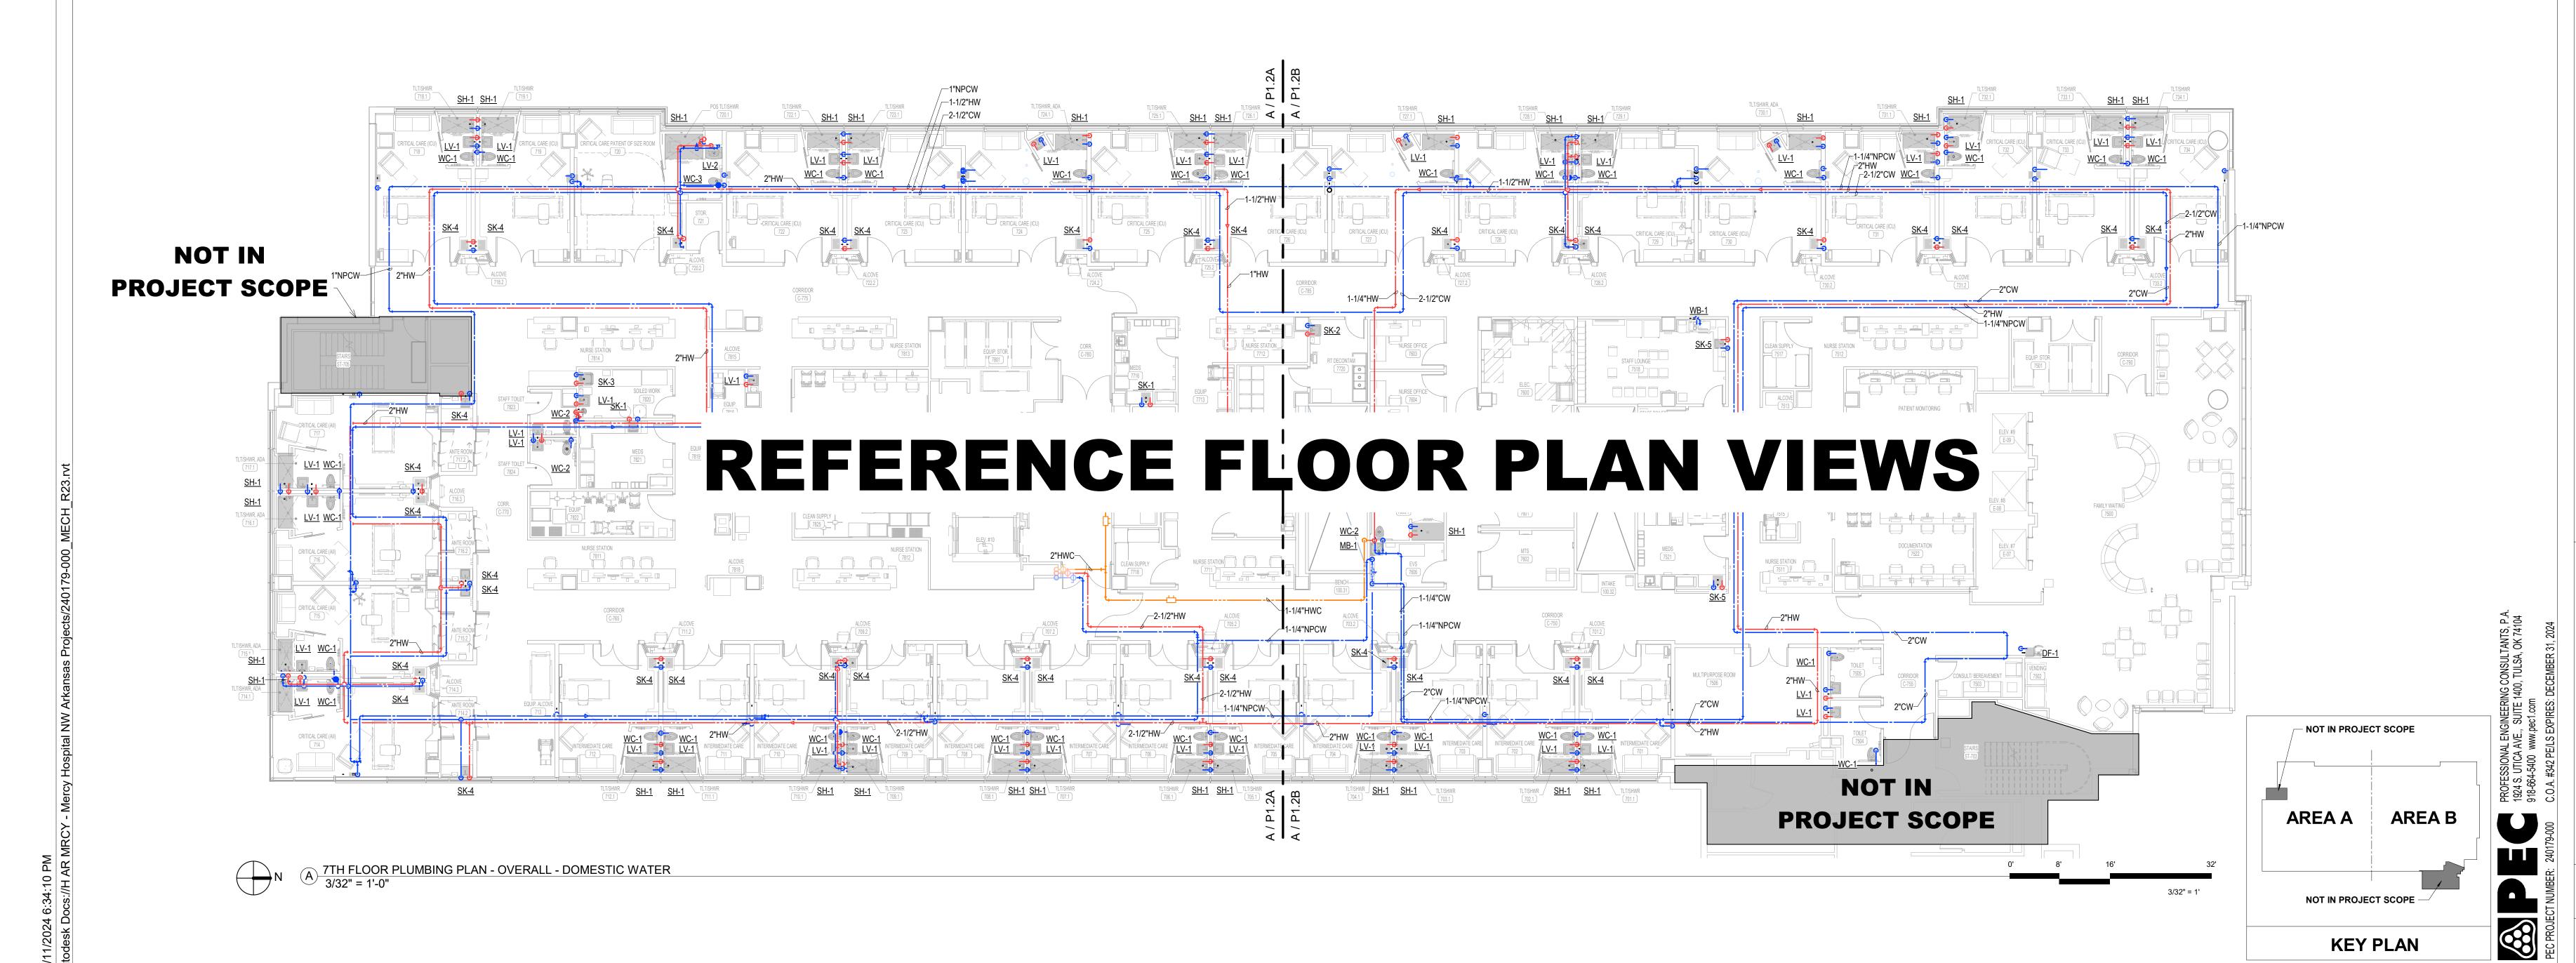

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

REFER TO THE PLUMBING FIXTURE SCHEDULE FOR PIPE SIZES TO INDIVIDUAL FIXTURES. NOT ALL REQUIRED CLEANOUTS ARE NECESSARILY SHOWN ON THESE PLANS. PROVIDE CLEANOUTS ON WASTE, VENT AND STORM PIPING AS REQUIRED BY CODE AND FOR REASONABLE MAINTENANCE BASED ON ACTUAL FIELD INSTALLATION. PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF AVOID ROUTING OVER ELECTRICAL ROOMS AND ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES. COORDINATE ROUTING WITH ELECTRICAL

CONTRACTOR. ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS PANELS IN HARD LID CEILINGS. ACCESS PANELS SHALL BE 24x24, UNLESS NOTED OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE, EXACT LOCATIONS SHALL BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS AND EQUIPMENT LOCATIONS. PROVIDE RATED ACCESS PANELS WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE.

PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT. TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE . VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES AND EQUIPMENT.

NOT IN PROJECT SCOPE


NOT IN PROJECT SCOPE

**KEY PLAN** 

AREA B


AREA A

Date Description



HOSPIT MERCY N
Building No.: 1388
ROGERS 7T
2710 RIFE MEDICAL I

7TH FLOOR

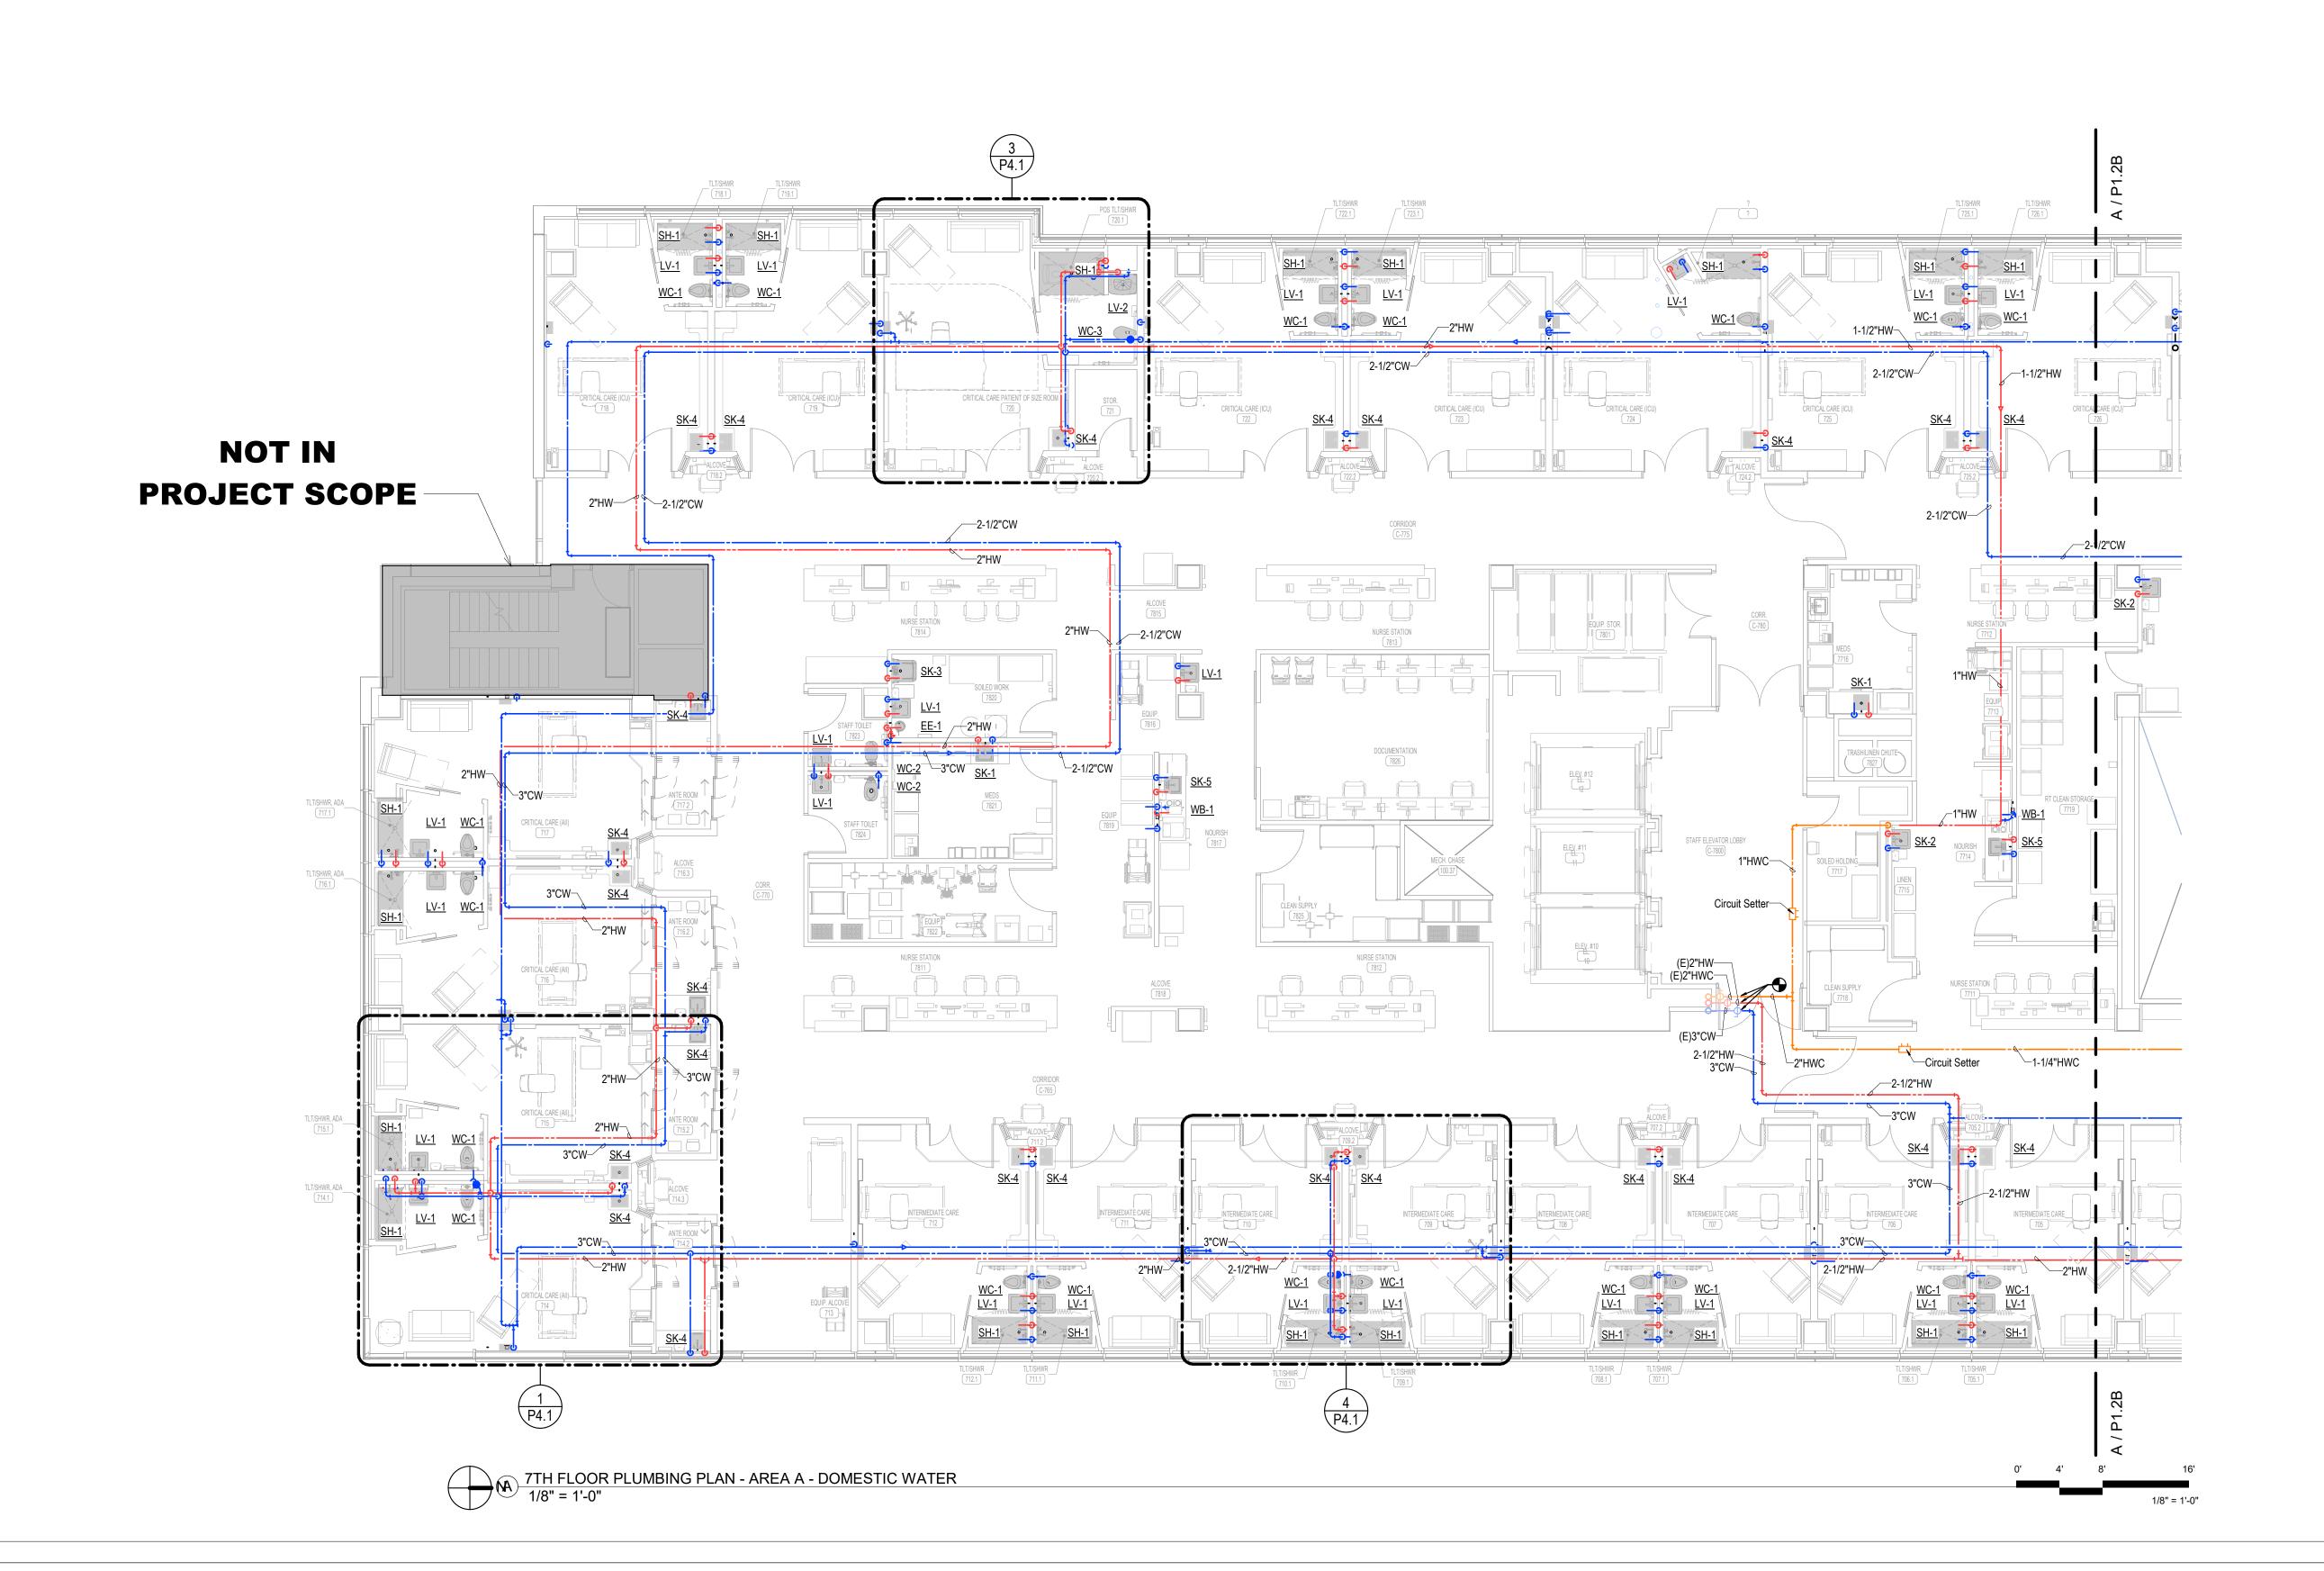

. REFER TO THE PLUMBING FIXTURE SCHEDULE FOR PIPE SIZES TO INDIVIDUAL FIXTURES. NOT ALL REQUIRED CLEANOUTS ARE NECESSARILY SHOWN ON THESE PLANS. PROVIDE CLEANOUTS ON

WASTE, VENT AND STORM PIPING AS REQUIRED BY CODE AND FOR REASONABLE MAINTENANCE BASED ON ACTUAL FIELD INSTALLATION. PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF INSULATION. AVOID ROUTING OVER ELECTRICAL ROOMS AND

ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES. COORDINATE ROUTING WITH ELECTRICAL CONTRACTOR. 5. ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS PANELS IN HARD LID CEILINGS. ACCESS PANELS SHALL BE 24x24, UNLESS NOTED

OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE, EXACT LOCATIONS SHALL BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS AND EQUIPMENT LOCATIONS. PROVIDE RATED ACCESS PANELS WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET

AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE. 8. PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT.

FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES

TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE 0. VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL

AND EQUIPMENT.

NOT IN PROJECT SCOPE


**NOT IN PROJECT SCOPE** 

**KEY PLAN** 

**AREA B** 

AREA A


No.	Date	Description







**7TH FLOOR** 

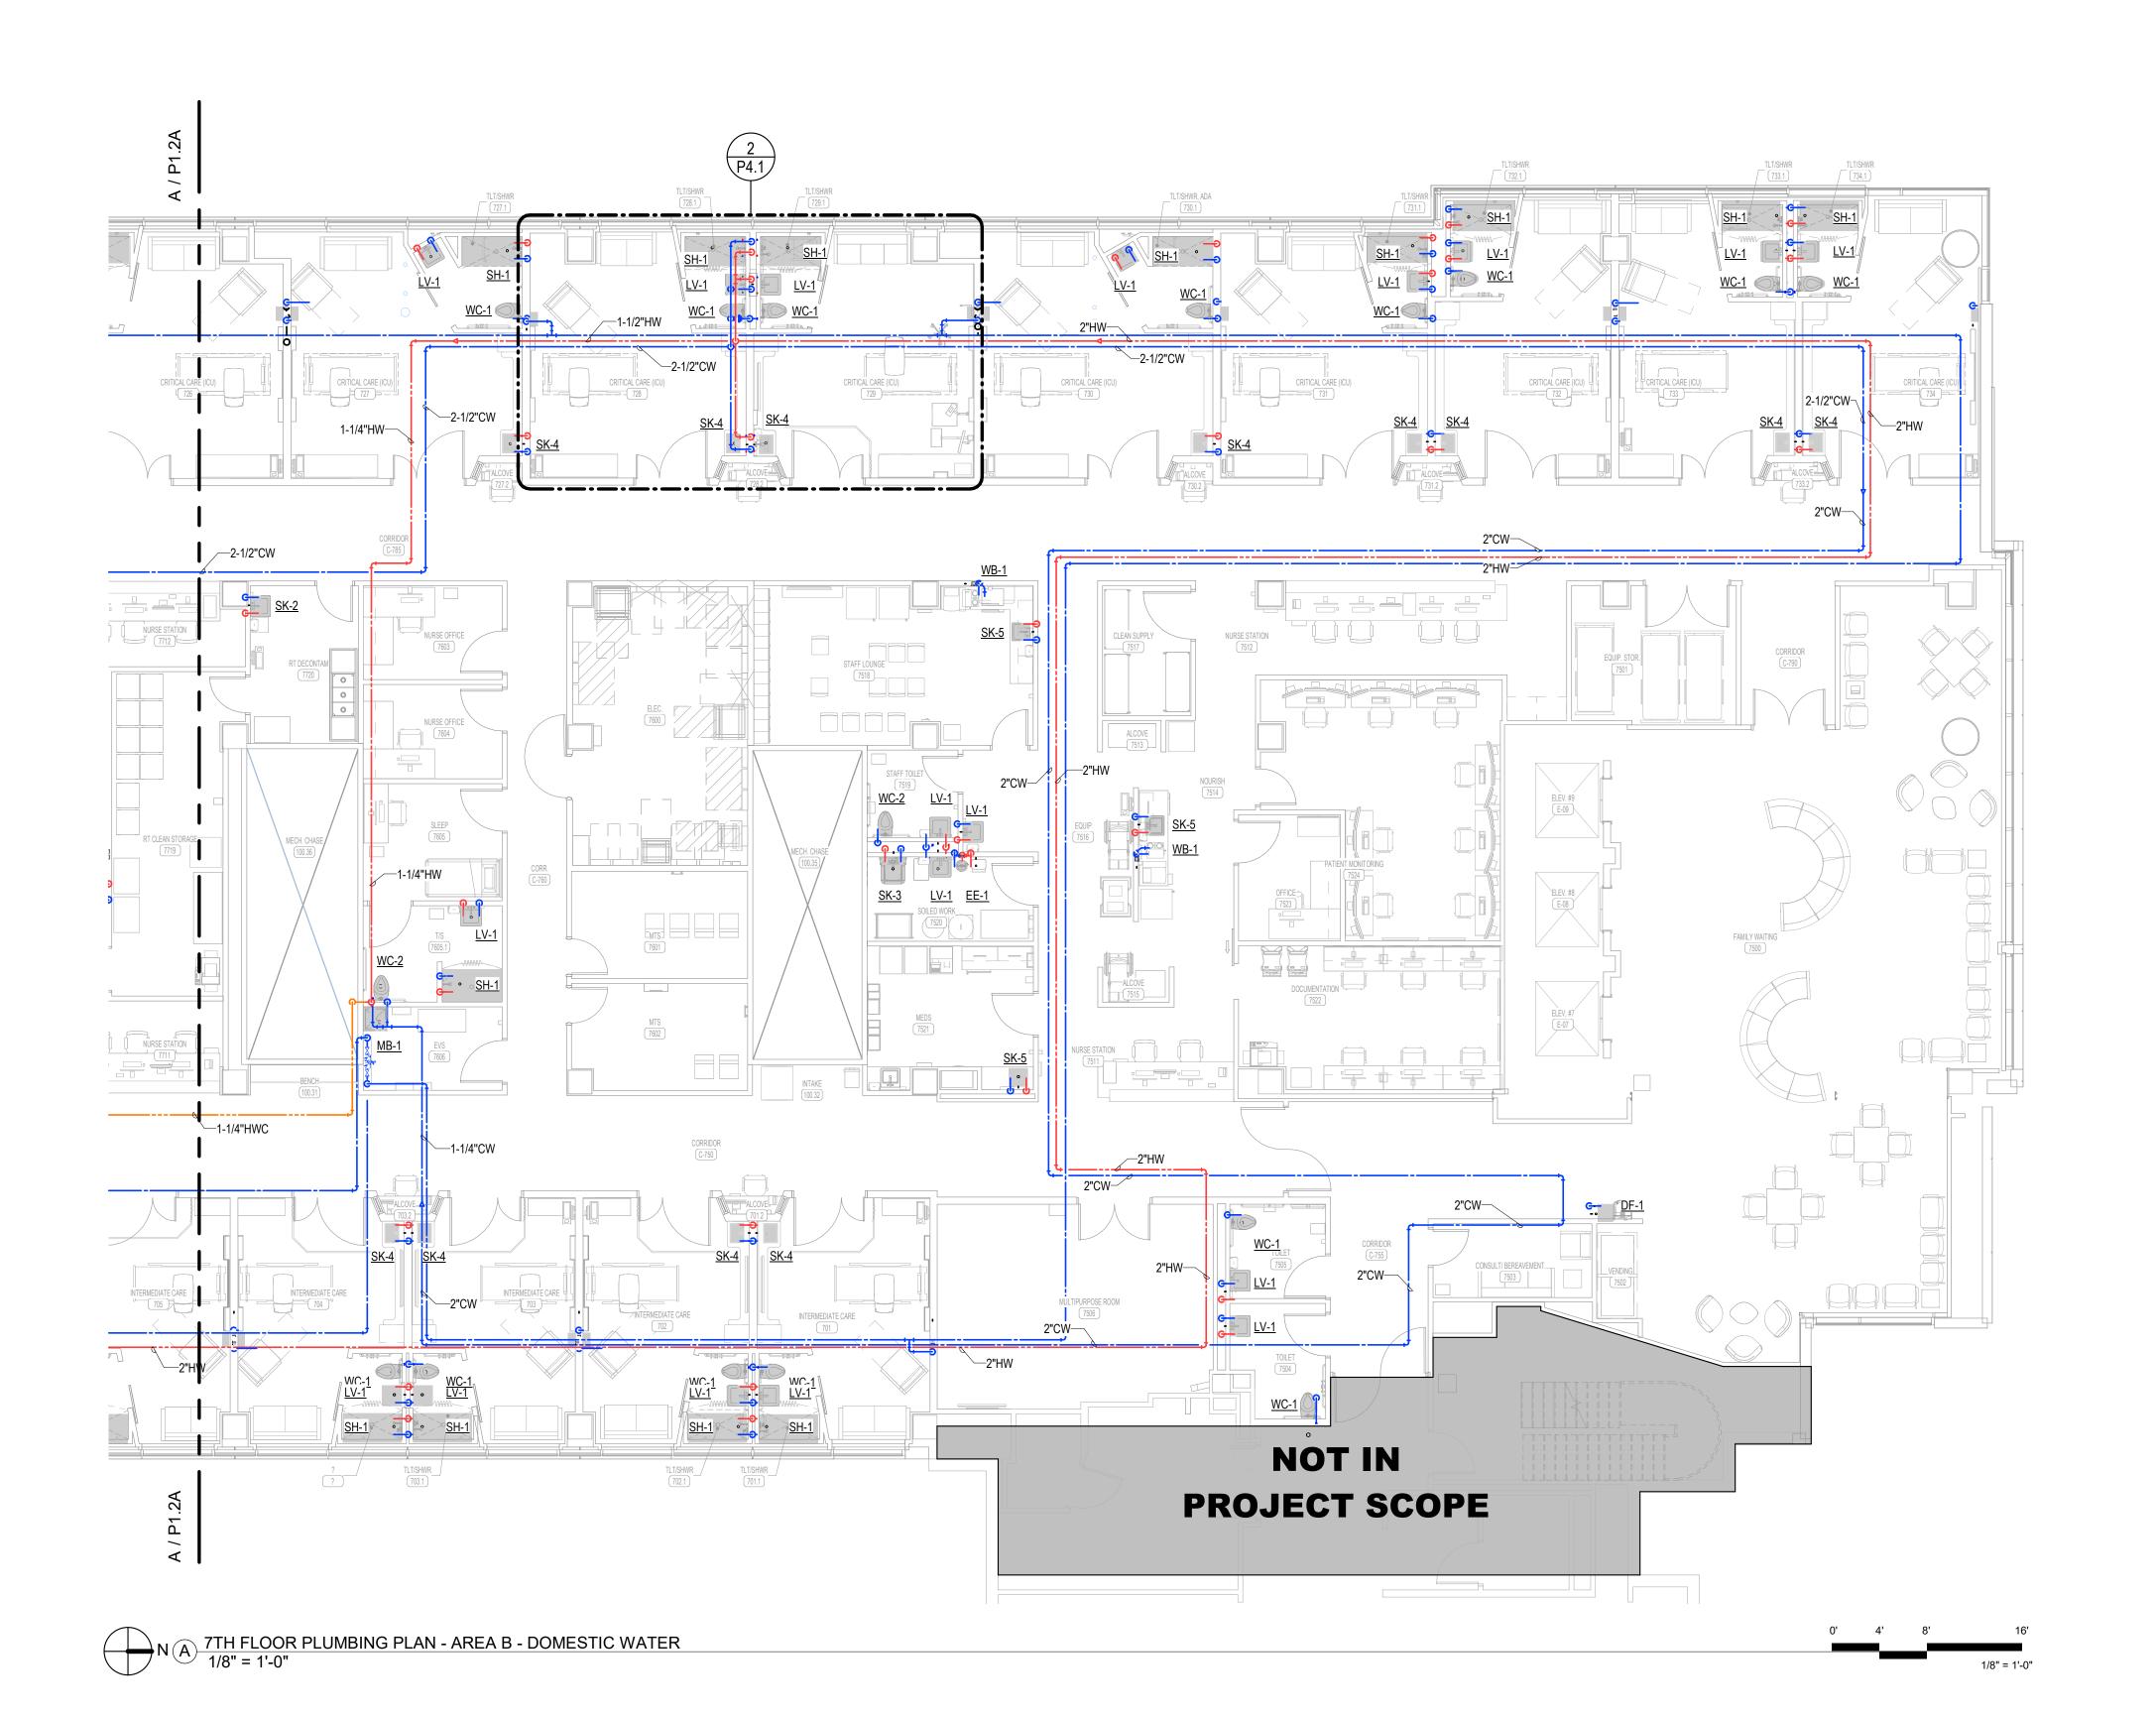

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville AR 72712 479.448.4099 | Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com



- PLANS ARE SCHEMATIC IN NATURE. LAYOUT IS BASED ON BEST AVAILABLE INFORMATION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND
- ALL CUTTING, PATCHING, AND DEMOLITION WORK SHALL BE CLOSELY COORDINATED WITH THE EXISTING CONDITIONS AND THE REQUIRED NEW WORK. G.C. SHALL PATCH AND FINISH PENETRATIONS OF EXISTING SURFACES TO MATCH ADJACENT SURFACES. FIELD VERIFY BEST ROUTING FOR NEW PIPING AND DUCTWORK. COORDINATE WITH EXISTING EQUIPMENT, PIPING, AND DUCTWORK. PIPING SHALL RISE AND DROP, JOG OR OFFSET AS REQUIRED TO AVOID
- FROM LACK OF COORDINATION SHALL BE MADE AT THE CONTRACTOR'S EXPENSE. REFER TO ARCHITECTURAL SPECIFICATIONS AND PLANS FOR PHASING OF DEMOLITION AND NEW WORK. ADJACENT AREAS ARE OCCUPIED AND CONTRACTOR SHALL WORK CLOSELY WITH OWNER TO SCHEDULE DEMOLITION AND CONSTRUCTION TO BE AS LEAST DISRUPTIVE AS POSSIBLE.

CONFLICTS. DUCTWORK SHALL TAKE PRECEDENCE OVER ALL PIPING, EXCEPT WHERE GRADE MUST BE MAINTAINED FOR DRAINAGE. ANY EXPENSES RISING

MED GAS GENERAL NOTES

Description






7TH FLOOR

**P2.1** 

**KEY PLAN** 

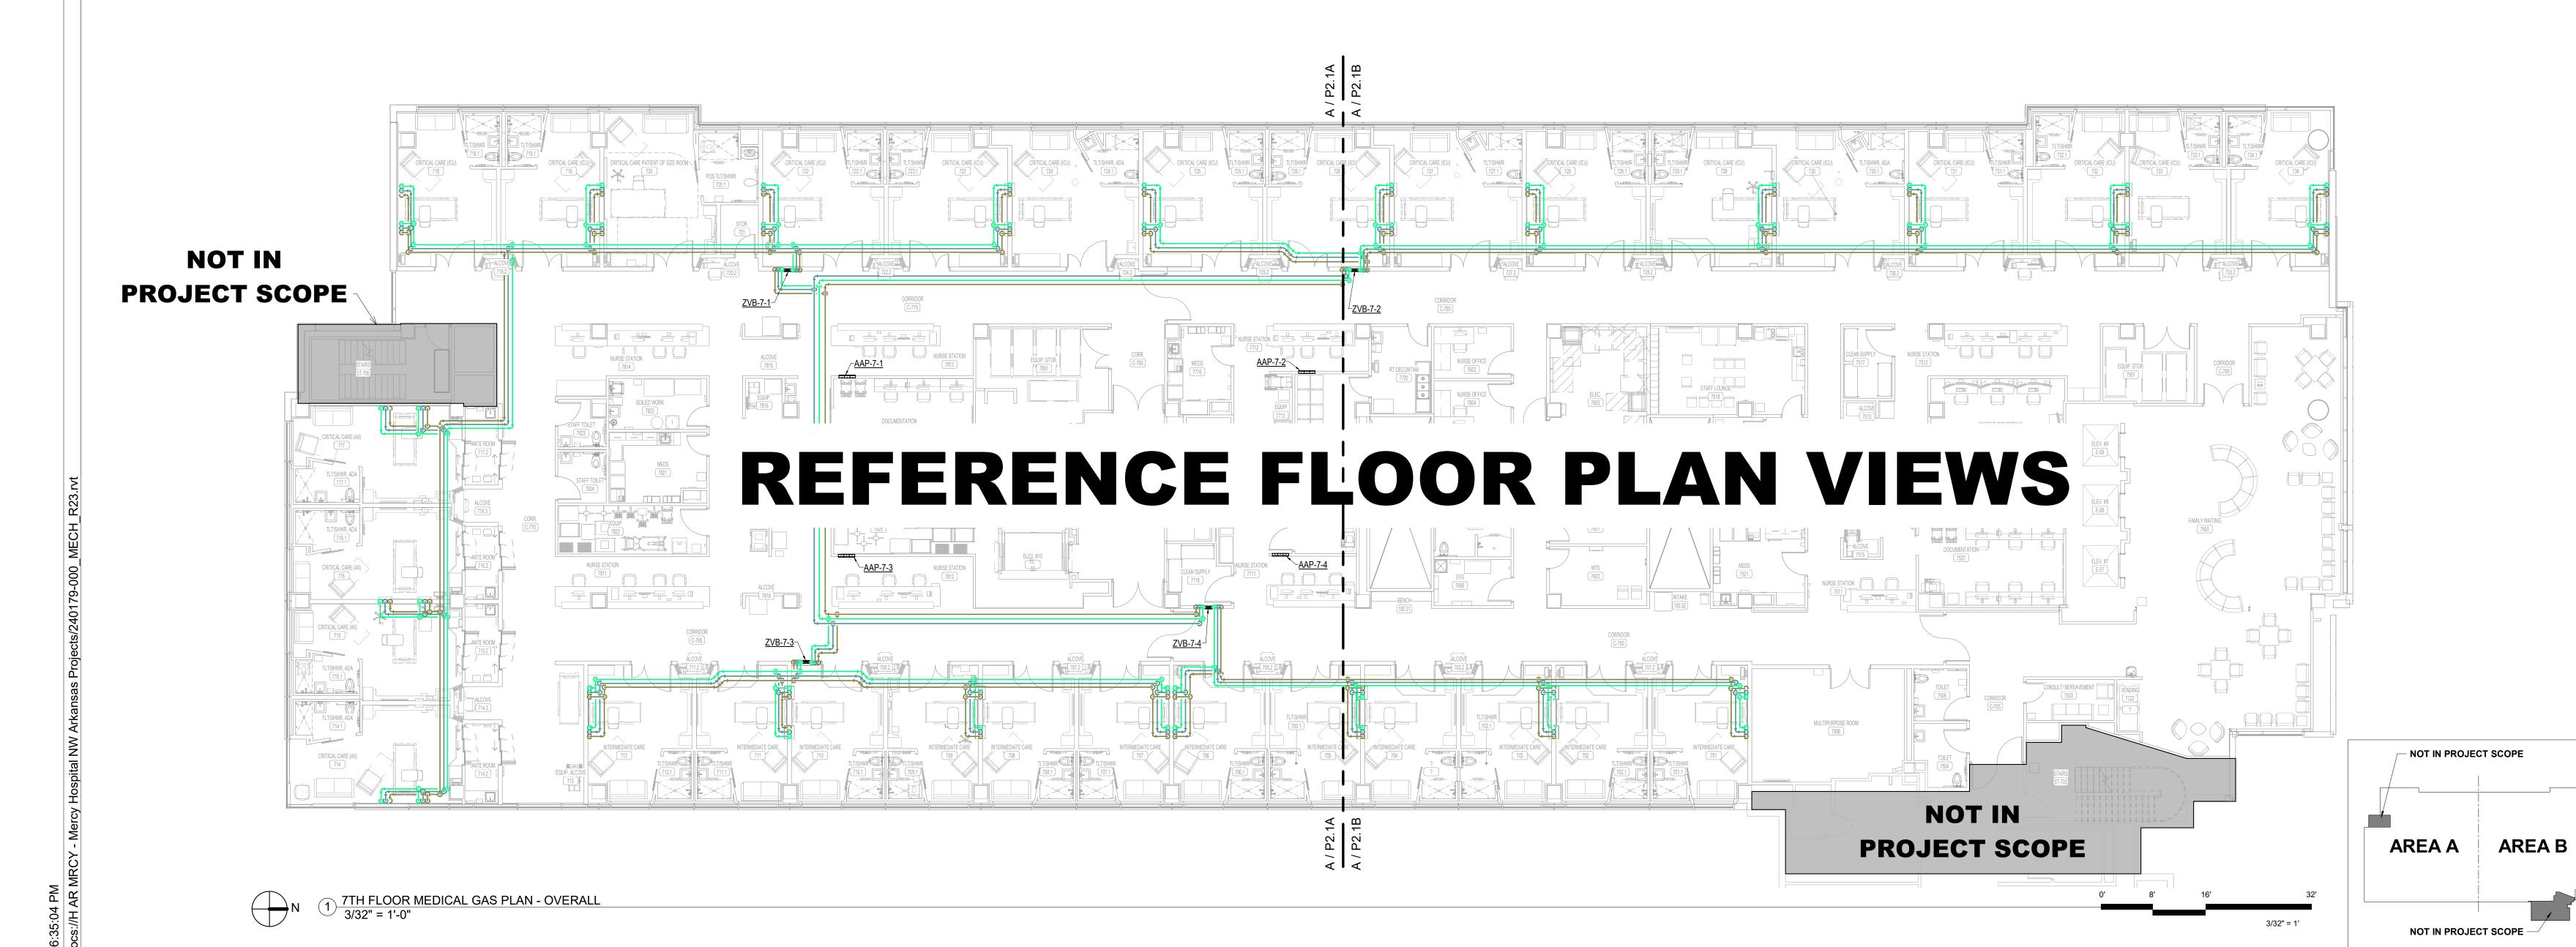

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

# SHEET KEYNOTES

1 REFER TO ARCHITECTURAL ELEVATIONS OF THE HEADWALL FOR LOCATIONS AND HEIGHTS OF MEDICAL GAS OUTLETS.

FROM LACK OF COORDINATION SHALL BE MADE AT THE

REFER TO ARCHITECTURAL SPECIFICATIONS AND PLANS FOR PHASING OF DEMOLITION AND NEW WORK. ADJACENT AREAS ARE OCCUPIED AND CONTRACTOR SHALL WORK CLOSELY WITH OWNER TO SCHEDULE DEMOLITION AND CONSTRUCTION TO BE AS LEAST

CONTRACTOR'S EXPENSE.

DISRUPTIVE AS POSSIBLE.

NOT IN PROJECT SCOPE


**KEY PLAN** 

AREA B

AREA A

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com

No. Date Description



e: 11/13/2024
As indicated

rcy Project No.: 2040-82

| Dote: 11/13/20 | Scole: | 11/13/20

M ADEA A


IEDICAL LANE, RODGERS, AR 727

MERCY NV
Building No.: 1388
ROGERS 7TH
2710 RIFE MEDICAL LAN
Sheet Nome:
7TH FLOOR MEDICAL



7TH FLOOR

P2.1A

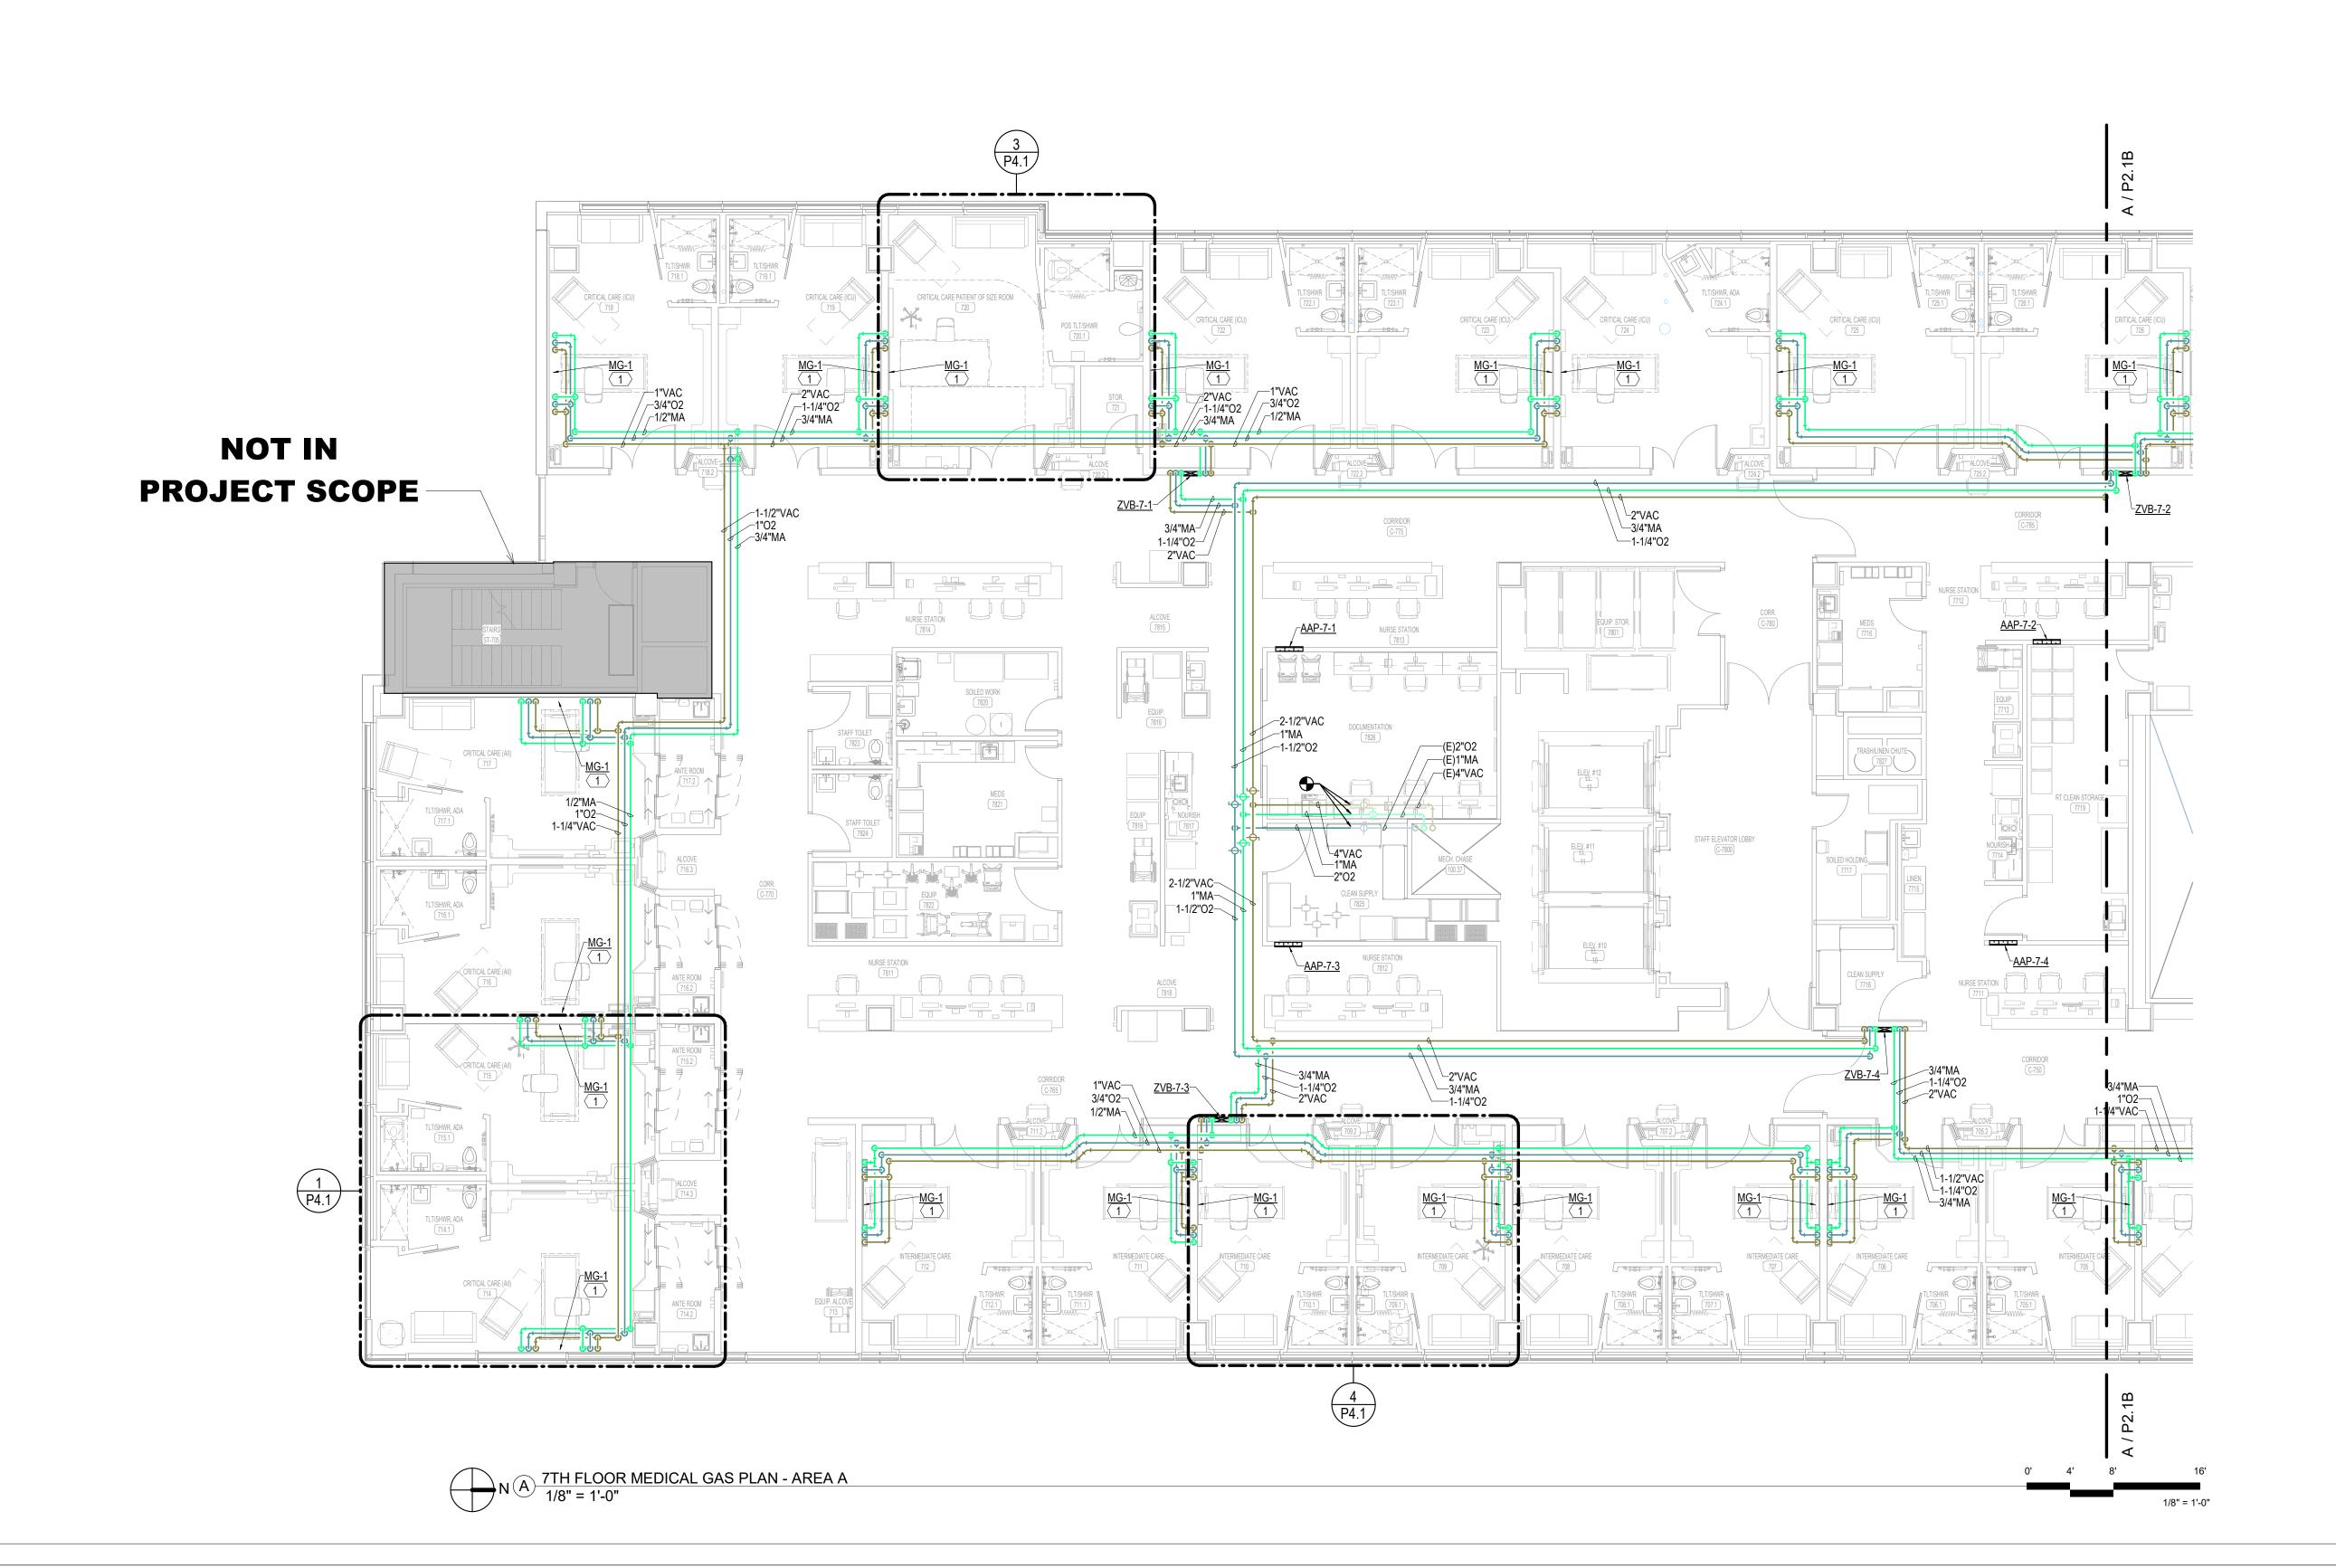


ALL CUTTING, PATCHING, AND DEMOLITION WORK
SHALL BE CLOSELY COORDINATED WITH THE EXISTING
CONDITIONS AND THE REQUIRED NEW WORK. G.C.
SHALL PATCH AND FINISH PENETRATIONS OF EXISTING
SURFACES TO MATCH ADJACENT SURFACES.
FIELD VERIFY BEST ROUTING FOR NEW PIPING AND
DUCTWORK. COORDINATE WITH EXISTING EQUIPMENT,
PIPING, AND DUCTWORK. PIPING SHALL RISE AND
DROP, JOG OR OFFSET AS REQUIRED TO AVOID
CONFLICTS. DUCTWORK SHALL TAKE PRECEDENCE
OVER ALL PIPING, EXCEPT WHERE GRADE MUST BE
MAINTAINED FOR DRAINAGE. ANY EXPENSES RISING
FROM LACK OF COORDINATION SHALL BE MADE AT THE
CONTRACTOR'S EXPENSE.

REFER TO ARCHITECTURAL SPECIFICATIONS AND PLANS FOR PHASING OF DEMOLITION AND NEW WORK. ADJACENT AREAS ARE OCCUPIED AND CONTRACTOR SHALL WORK CLOSELY WITH OWNER TO SCHEDULE DEMOLITION AND CONSTRUCTION TO BE AS LEAST DISRUPTIVE AS POSSIBLE.

# SHEET KEYNOTES

1 REFER TO ARCHITECTURAL ELEVATIONS OF THE HEADWALL FOR LOCATIONS AND HEIGHTS OF MEDICAL GAS OUTLETS.

No. Date Description



at 11/13/2024

As indicated

:y Project No.: 2040-82.

Mercy Pro

OICAL LANE, RODGERS, AR 7275

2710 RIFE MEDICAL LANE,

TH FLOOR MEDICAL GA

Bailting Builting Brief I

NOT IN PROJECT SCOPE

**NOT IN PROJECT SCOPE** 


**KEY PLAN** 

**AREA B** 

AREA A

7TH FLOOR

P2.1B

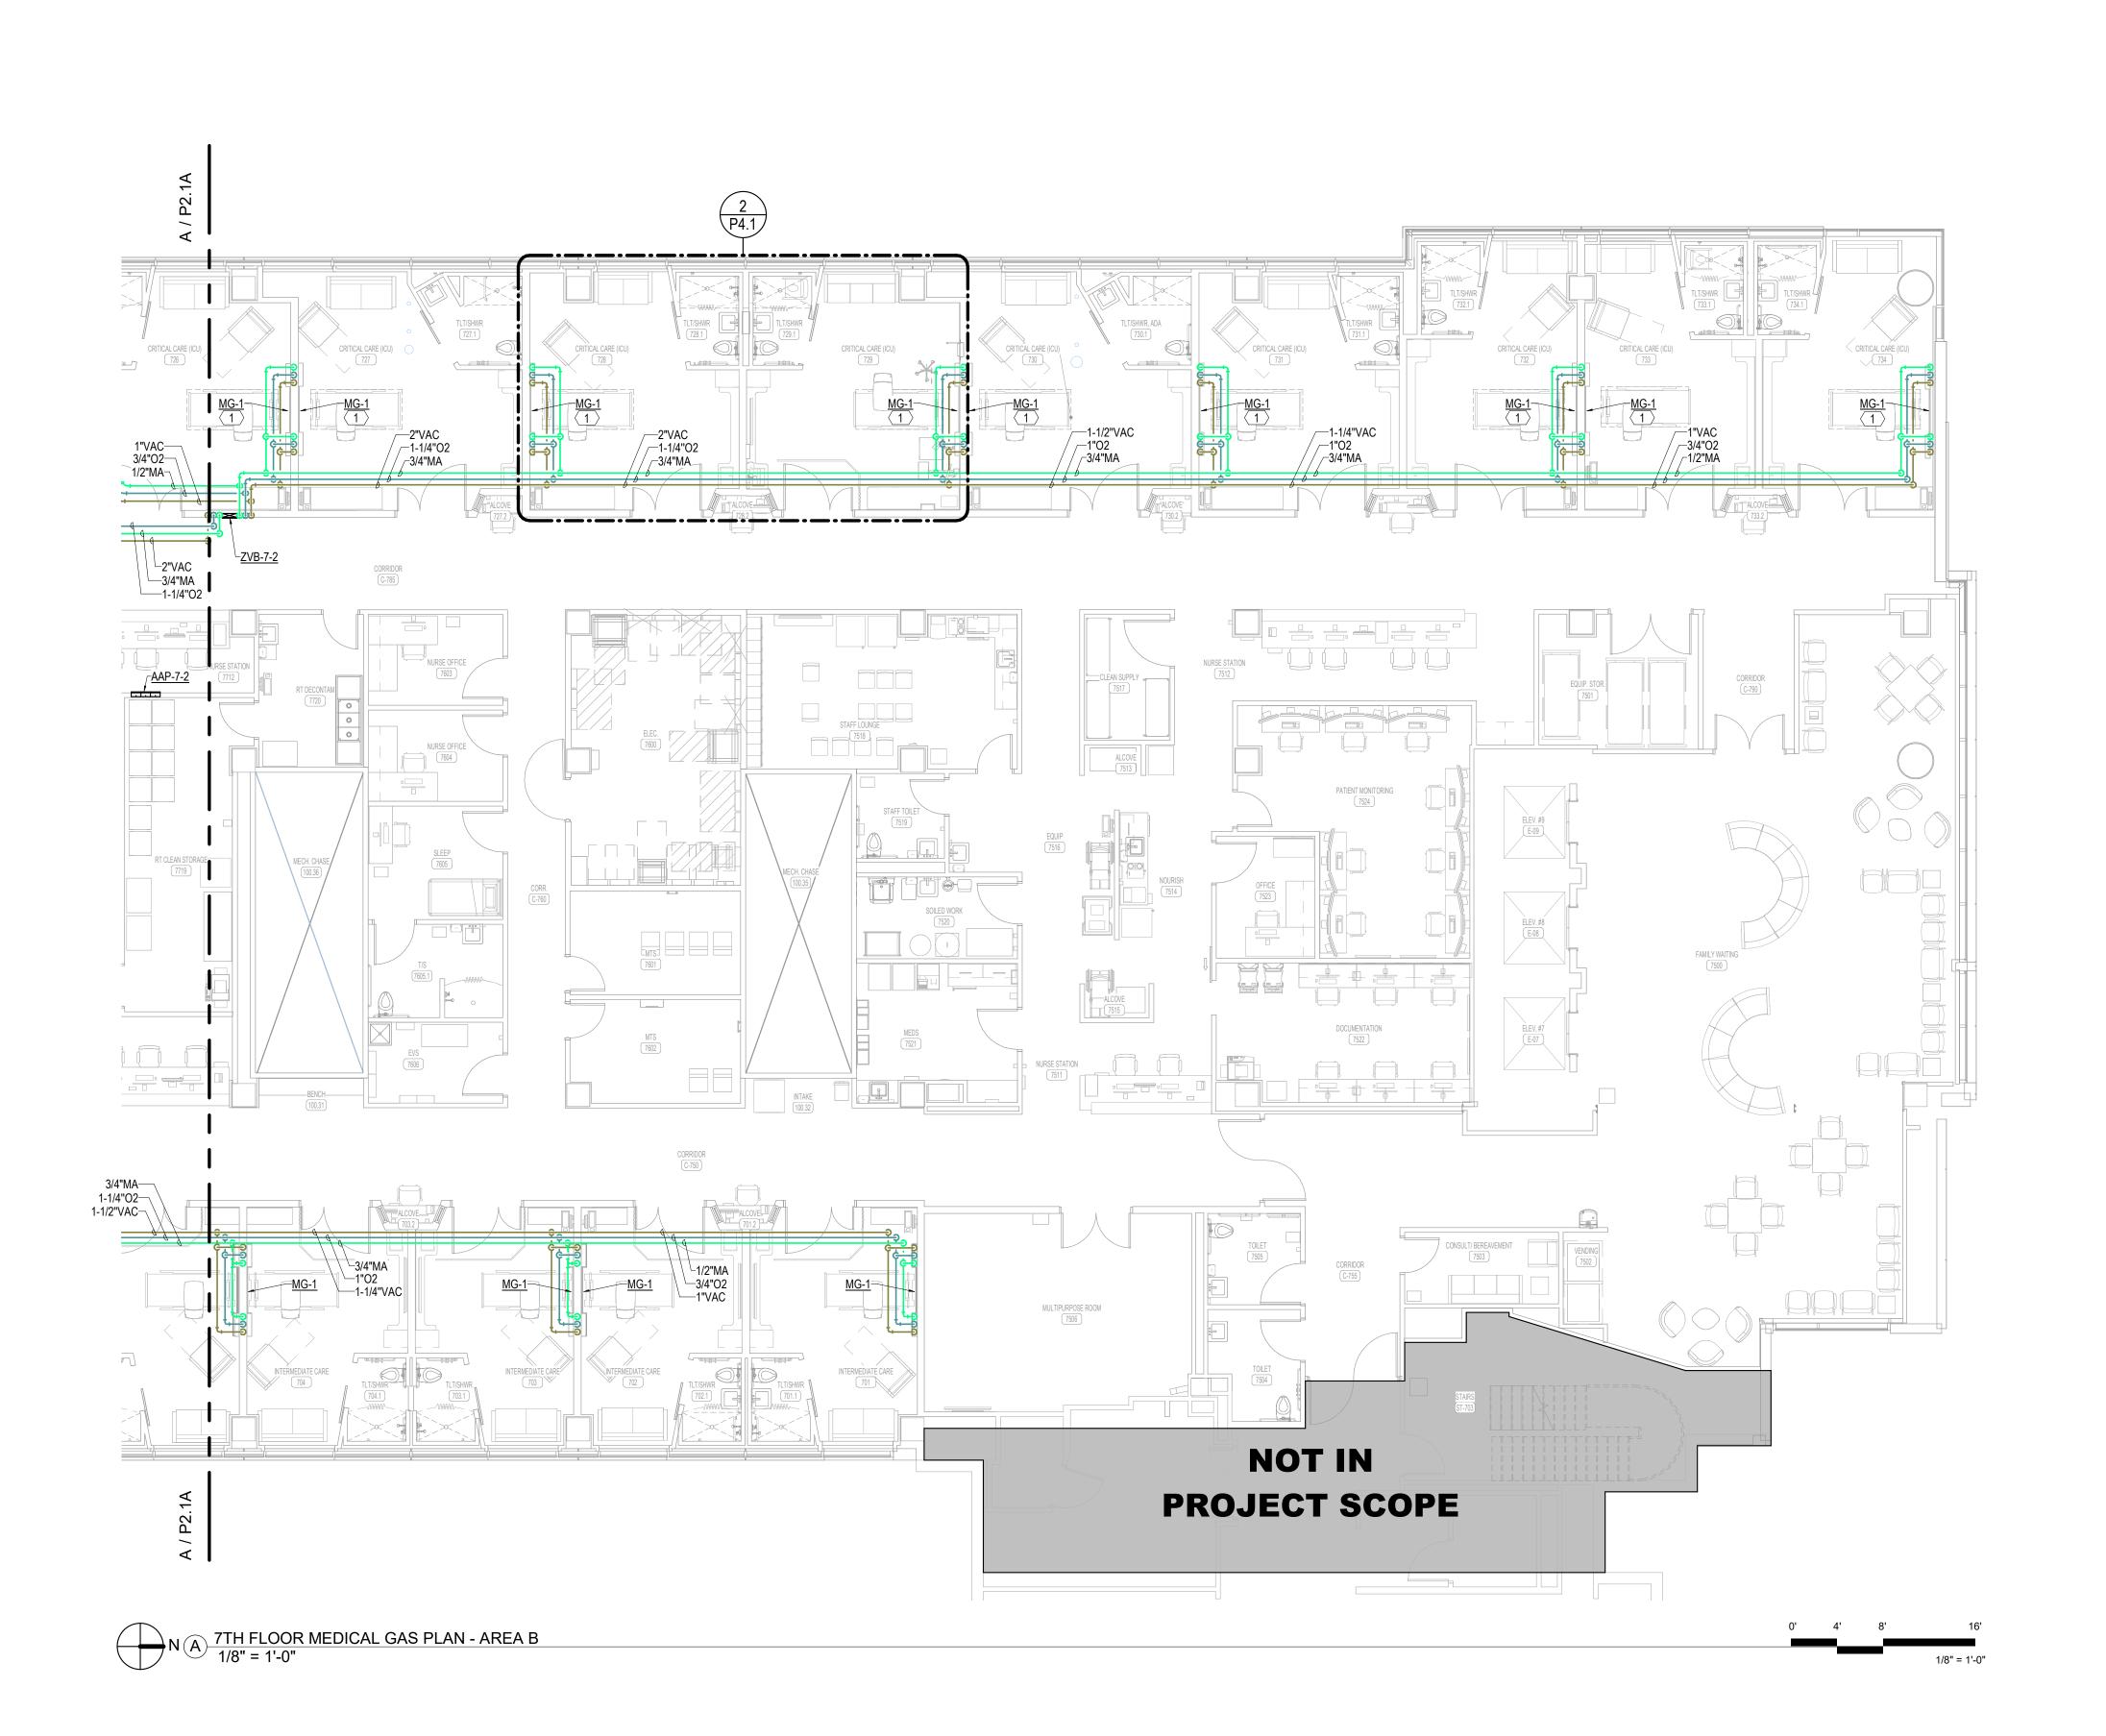

Kansas City: 2380 McGee Street, Suite 310, Kansas City MO 64108 816.249.1500 | Tulsa: 320 S Boston, Suite 1400, Tulsa OK 74103 918.398.6400 | Bentonville: 206 SW 8th Street, Suite 310, Wichita: 330 N Mead Street, Suite 100, Wichita KS 67202 316.262.2500 | www.hfgarchitecture.com


## PLUMBING GENERAL NOTES


- NOT ALL REQUIRED CLEANOUTS ARE NECESSARILY SHOWN ON THESE PLANS. PROVIDE CLEANOUTS ON WASTE, VENT AND STORM PIPING AS REQUIRED BY
  - CODE AND FOR REASONABLE MAINTENANCE BASED ON ACTUAL FIELD INSTALLATION. PIPING ON EXTERIOR WALLS OR PRE-CAST WALLS TO
- INSULATION. AVOID ROUTING OVER ELECTRICAL ROOMS AND COORDINATE ROUTING WITH ELECTRICAL
- CONTRACTOR. ALL VALVES SHALL BE INSTALLED ABOVE DROP-IN CEILINGS IN ACCESSIBLE LOCATIONS, OR WITH ACCESS
- ACCESS PANELS SHALL BE 24x24, UNLESS NOTED OTHERWISE. LOCATIONS SHOWN ARE APPROXIMATE, EXACT LOCATIONS SHALL BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS AND EQUIPMENT LOCATIONS. PROVIDE RATED ACCESS PANELS
- AT ALL FLOOR RECEPTORS. INSTALL IN ACCORDANCE 0. VERIFY AND REFER TO ARCHITECTURAL DIMENSIONAL FLOOR PLAN FOR EXACT LOCATIONS OF ALL FIXTURES

## # SHEET KEYNOTES

- 1 PROVIDE ISOLATION VALVE IN VERTICAL RISER FROM
- 2 REFER TO ARCHITECTURAL ELEVATIONS OF THE HEADWALL FOR LOCATIONS AND HEIGHTS OF MEDICAL GAS OUTLETS.


LOCATION AND HEIGHT OF DIALYSIS BOX.

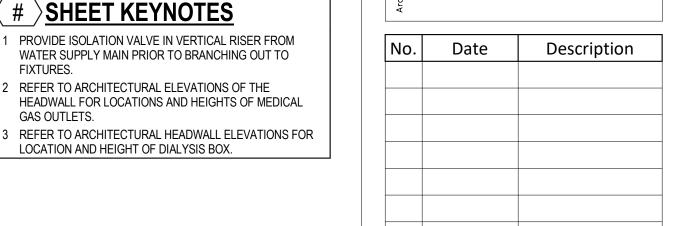



HOSPIT

MERCY N
Building No.: 1388
ROGERS 7T
2710 RIFE MEDICAL L

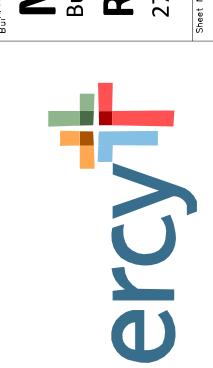

7TH FLOOR

P4.1

REFER TO THE PLUMBING FIXTURE SCHEDULE FOR

PIPE SIZES TO INDIVIDUAL FIXTURES.

BE ROUTED IN FRAMED WALL ON INTERIOR SIDE OF


ELECTRICAL PANELS; MAINTAIN N.E.C. CLEARANCES.


PANELS IN HARD LID CEILINGS.


WHEREVER REQUIRED BY APPLICABLE CODES. REFERENCE CEILING SPACE ALLOCATION DETAIL FOR INSTALLATION HEIGHTS OF PLUMBING PIPING. OFFSET AS NECESSARY TO AVOID OBSTRUCTIONS. PIPING REQUIRED TO BE SLOPED SHALL TAKE PRECENDENCE. PROVIDE ACCESSIBLE SHUT-OFF VALVES TO ALL APPLIANCES AND EQUIPMENT. TRAP PRIMERS OR TRAP GUARDS SHALL BE INSTALLED


AND EQUIPMENT.

WATER SUPPLY MAIN PRIOR TO BRANCHING OUT TO

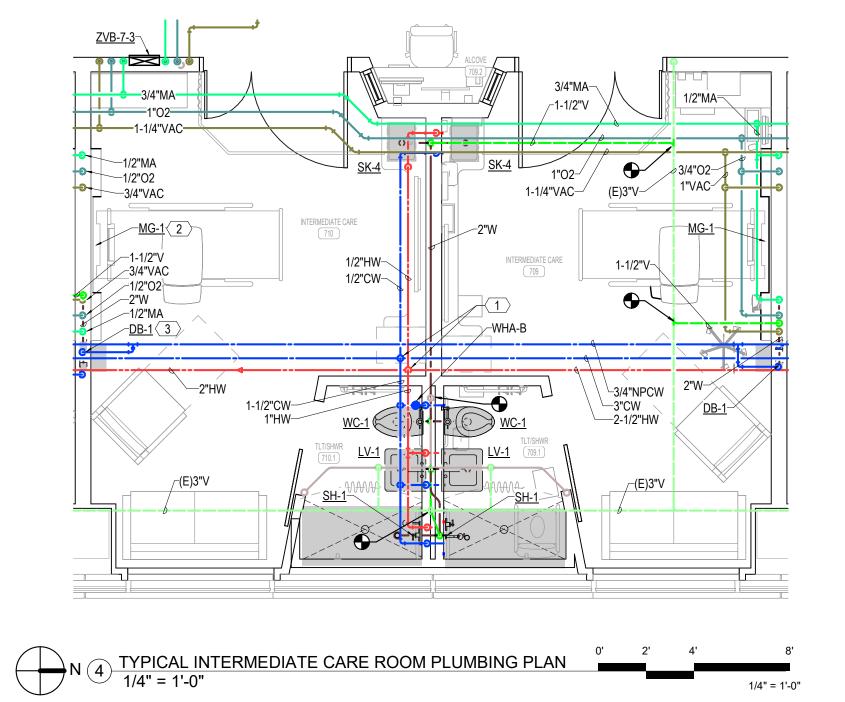


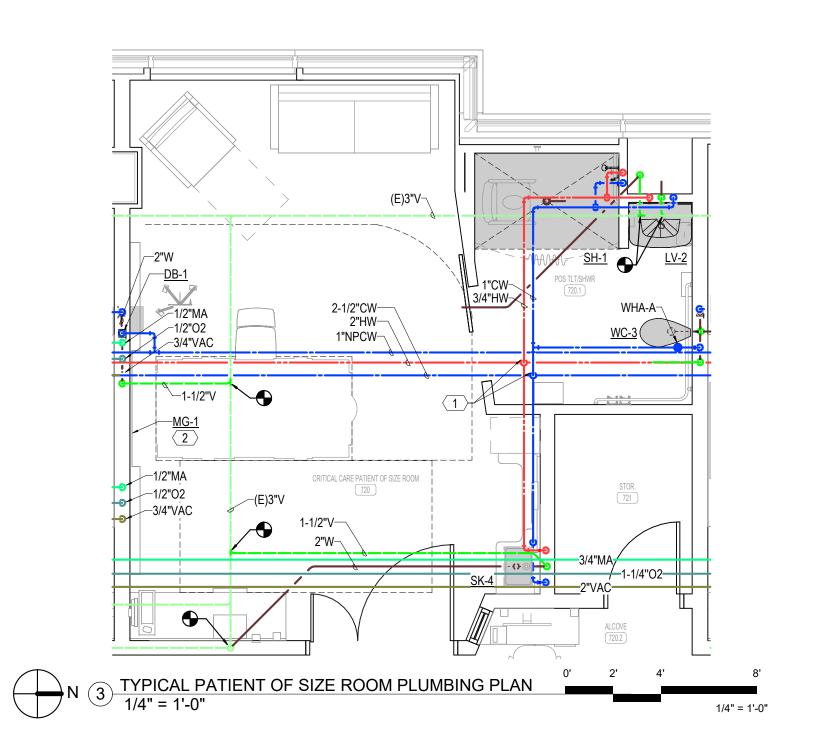


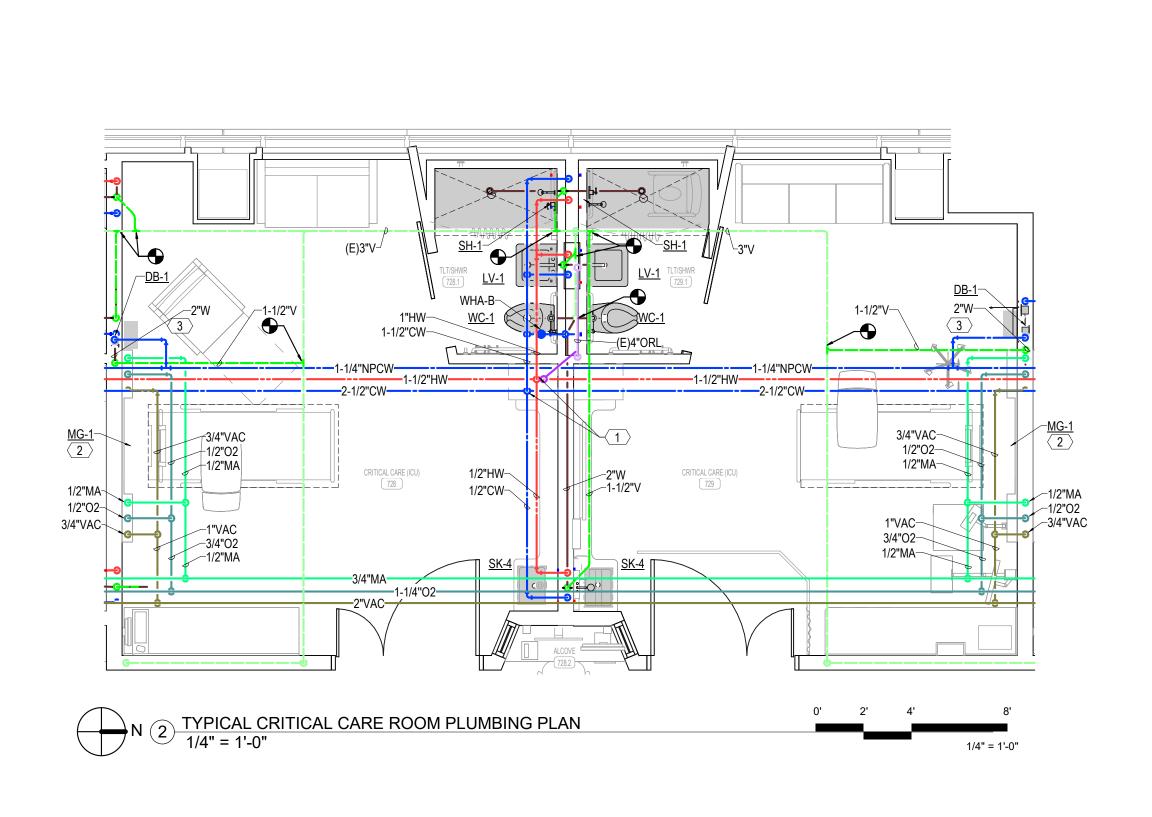

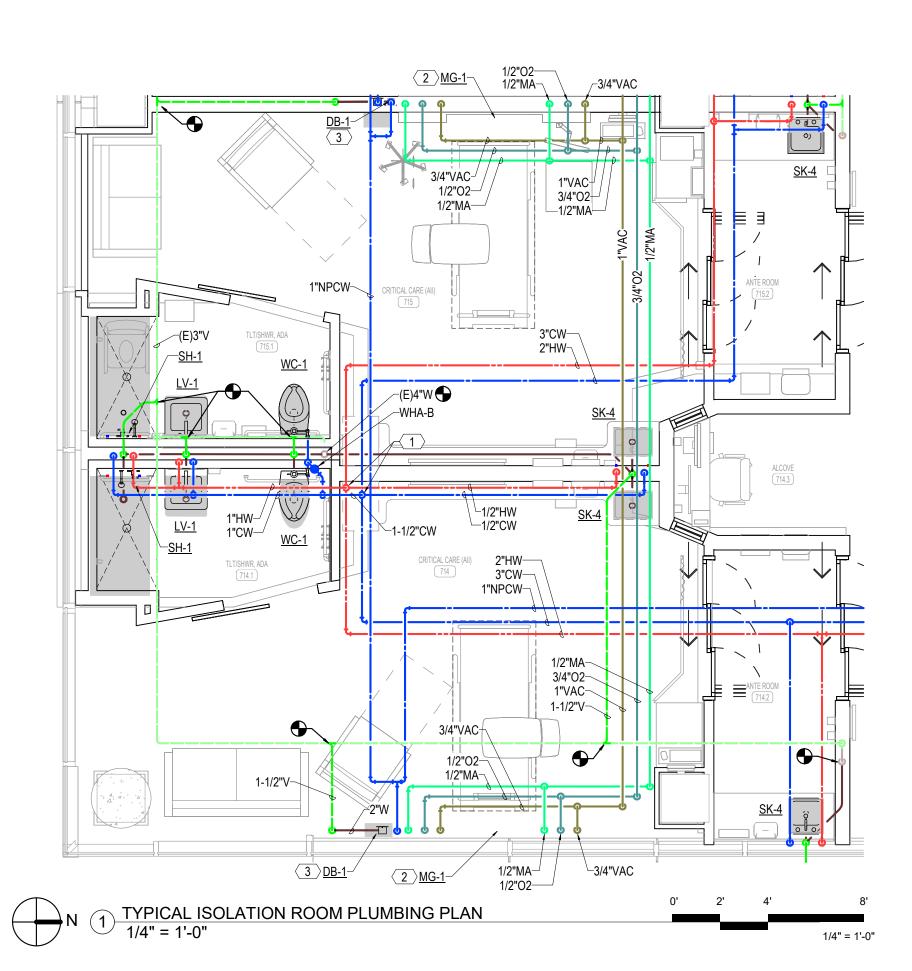



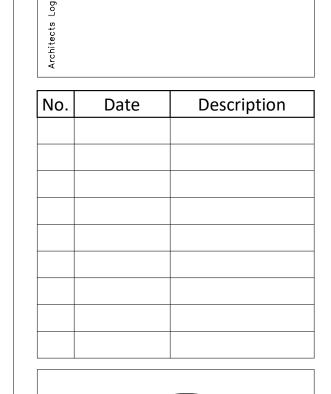






SPIT


**RO** 2710


P5.1

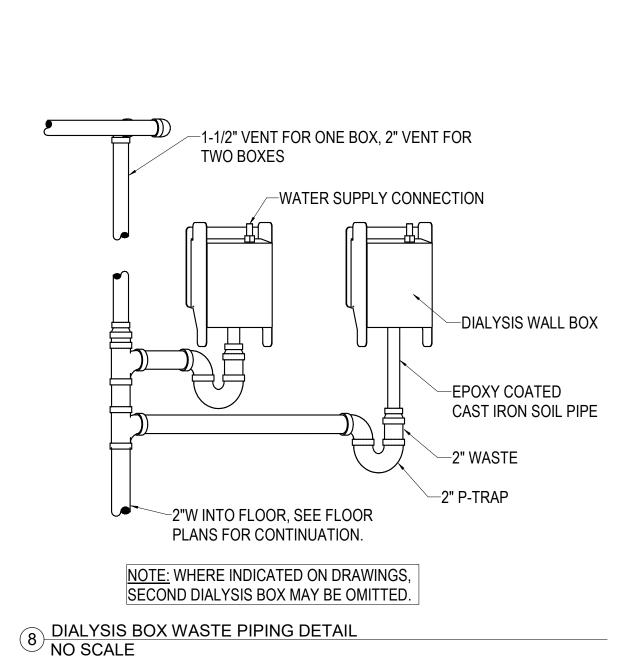

FLUSH VALVE WITH VACUUM

BREAKER

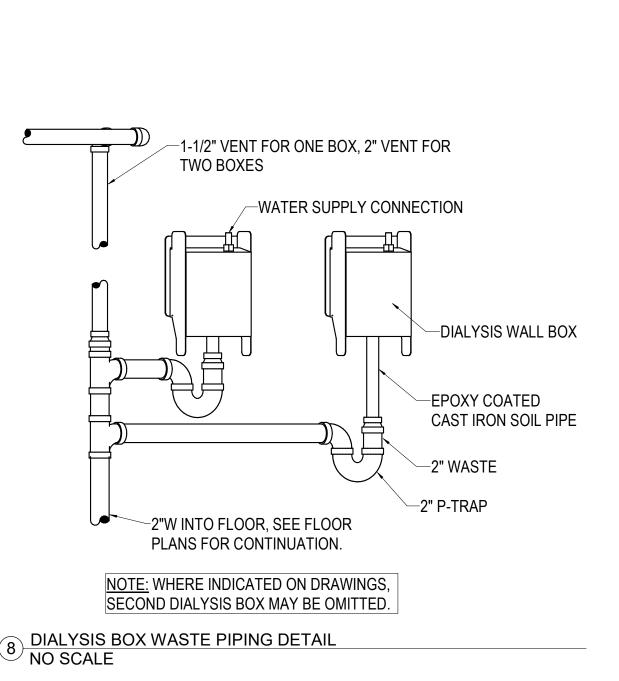

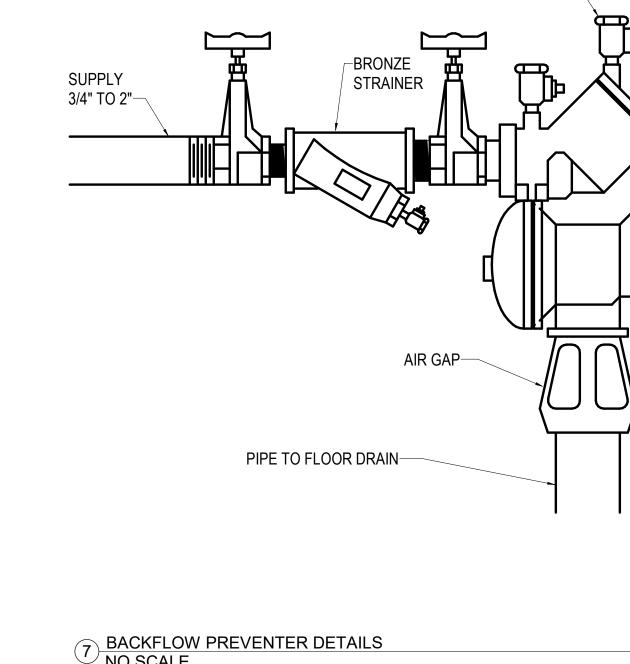

BALL VALVE TEST COCK (TYP)-

OR EQUAL **GENERAL NOTES:** I. INSTALLATION OF ALL BACKFLOW PREVENTERS SHALL BE IN STRICT ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS. ACCESS & CLEARANCE SHALL BE PROVIDED FOR REQUIRED TESTING, MAINTENANCE & REPAIR; INCLUDING A MINIMUM OF 1'-0" BETWEEN LOWEST PORTION OF ASSEMBLY, AND FLOOR OR PLATFORM. ASSEMBLIES INSTALLED MORE THAN 5'-0" ABOVE FLOOR SHALL BE PROVIDED WITH A PERMANENT PLATFORM CAPABLE OF SUPPORTING A TESTER OR MAINTENANCE PERSON.

/-GATE VALVES OR BALL VALVES

3/4" TO 2" OUTLET-

BACKFLOW PREVENTER, WATTS LF909 SERIES,

7 BACKFLOW PREVENTER DETAILS NO SCALE

—SLEEVE GROUTED OR PLASTERED INTO WALL-PIPE INSULATION WITH PACK W/ U.L. RATED VAPOR BARRIER FASTENED SEALING MATERIAL. TO PIPE SLEEVE. MANUFACTURED PIPE SLEEVE OR FIRE RATED WALL MAY BE USED W/ SEALING RATED TO MATCH WALL RATING.

#92, 93, OR 94.-ROOF STRUCTURE ALL THREAD ROD - REFER (BEAM OR Z PURLIN) TO SPECIFICATIONS FOR SIZE REQUIREMENTS ANVIL ADJUSTABLE SWIVEL RING FIG. 69.-

\_"C" CLAMP ANVIL FIG.

NOTE: REFER TO SPECIFICATIONS FOR HANGER SPACING REQUIREMENTS.

2 PIPE HANGER DETAIL - UNINSULATED COPPER TUBING 1/8" = 1'-0"

3 PIPE THRU FIRE RATED WALL DETAIL 1/8" = 1'-0"

SERVICE SINK FAUCET WITHOUT HOSE CONNECTION BALL VALVE -SERVICE SINK -10" HIGH BASE BY GC INSTALL ALL TRIM PER -WATER MAIN MANUFACTURER'S INSTRUCTIONS.

BEDPAN WASHER WITH

(OPTIONAL MOUNTING ON OPPOSITE SIDE)

VACUUM BREAKER

-NON-POTABLE COLD WATER TO DIALYSIS

BOXES. REF. PLANS

FOR SIZES.

—PIPE RPZ

**FLOOR** 

FLOOR

DISCHARGE TO

BACKFLOW

**BYPASS** 

PREVENTERS IN

ORIENTATION

9 DIALYSIS WATER BACKFLOW PREVENTER INSTALLATION DETAIL NO SCALE

-WATER HAMMER ARRESTOR

6 WATER HAMMER ARRESTOR DETAIL NO SCALE

FROM DOMESTIC

COLD WATER MAIN-

SHUT-OFF VALVE-

STRAINER WITH

FLOOR DRAIN.—

WITH GC.-

BLOWDOWN. PIPE TO

SECURE ALL PIPING

TO WALL OR FROM

FLOOR. COORDINATE

AIR GAP FITTING, TYP.

5 CLINICAL SERVICE SINK DETAIL NO SCALE

AND INSTALLATION. INSULATED PIPE AT HANGER DETAIL 1 NO SCALE

PIPE RING HANGER

RING SIZED FOR

(ANVIL FIG 69 OR EQUAL ADJUSTABLE SWIVEL

INSULATION THICKNESS)

REMOTE

REMOTE

VISUAL ALARM-

AUDIBLE ALARM-

REF. ELEC. PLANS FOR

ANY VALVES UPSTREAM OF EMERGENCY

EMERGENCY EQUIPMENT.

EYEWASH SHALL BE LABELED AS SERVING

-SPRING LOADED SWITCH TO ALARM AND STROBE

-FACEPLATE

-MOUNTING

**FLANGES** 

ALARM LOCATIONS

STAINLESS STEEL EYE WASH OPERATOR FLAG HANDLE-

**COLD WATER** 

QUARTER-

BRANCH PIPING.

TURN VALVE.—

ARRESTOR.-

**FINISHED** 

FLOOR—

WATER HAMMER

4 WATER SUPPLY BOX DETAIL NO SCALE

-HANGER ROD TO STRUCTURE-

-PIPE INSULATION WITH

VAPOR BARRIER. REFER

TO SPECIFICATIONS FOR

INSULATION THICKNESS.

BASED ON PIPE SIZE.

RANGE AND SERVICE.—

ANVIL FIG 167 GALVANIZED

STEEL INSULATION SADDLE SHIELD. SHIELD LENGTH

-COMPRESSION RESISTANT

INSULATING MATERIAL, WITH

FOR PLANNED TEMPERATURE

NOTES:

1. OMIT COMPRESSION RESISTANT INSULATING MATERIAL ON PIPES 1-1/2" AND SMALLER.

1. OMIT COMPRESSION RESISTANT INSULATING MATERIAL ON PIPES 1-1/2" AND SMALLER.

. REFER TO SPECIFICATIONS FOR GUIDANCE ON HANGER SELECTION, APPLICATION,

VAPOR BARRIER, SUITABLE

EYE WASH-

10 EMERGENCY EYE WASH DETAIL NO SCALE

**CLEVIS HANGER** 

(ANVIL FIG 260 OR EQUAL

HEAVY DUTY CLEVIS

HANGER SIZED FOR

INSULATION THICKNESS)

							PLUM	BING FIX	<b>(TUR</b>	E SC	HED	ULE						
								TRIM				FLC	OW	I	PIPE RUNG	OUT SIZES		
MARK	DESCRIPTION	MANUFACTURER	MODEL	DIMENSIONS	ADA COMPLIANT	MATERIAL AND FINISH	MANUFACTURER	MODEL	FINISH	CONTROL TYPE	POWER		GALLONS PER FLUSH (GPF)	COLD WATER	HOT WATER	WASTE	VENT	SPECIFICATION
DB-1	DRAINAGE WALL BOX	SIOUX CHIEF	696R3	4" x 5-1/2" x 3-1/2"		ABS PLASTIC										2"	1-1/2"	ABS FACEPLATE/FRAME - 18 GAUGE FACEPLATE AND 5/8" INTEGRAL TESTABLE NIPPLE ON K NOCKOUT
DF-1	ELECTRIC WATER COOLER - SINGLE WITH BOTTLE FILLER	ELKAY	EZS8WSLK	32-7/8" BUBBLER HEIGHT	YES	STAINLESS STEEL					PLUG-IN			1/2"		2"	1-1/2"	UNFILTERED - CAPACITY OF 8 GPH OF 50 DEGREE WATER AT ARI CONDITIONS - 1-1/2" CAST BRASS P-TRAP - CHROME PLATED SUPPLIES WITH LOOSE KEY QUARTER TURN STOP - FLOOR MOUNTED CARRIER
EE-1	EMERGENCY EYE WASH - EYE/FACE WASH COMBO	HAWS	7360BT-7460BT	11"ø BOWL	YES	STAINLESS STEEL BOWL						3.7		3/4"	3/4"	2"	1-1/2"	3.7 GPM EYE/FACE WASH - 1-1/2" CAST BRASS P-TRAP FOR BOWL WASTE CONNECTION - THERMOSTATIC MIXING VALVE [[ABOVE CEILING] [EXPOSED] [IN RECESSED CABINET]] WITH 10 GPM FLOW RATE, SET TO 85°F. PROVIDE WITH STAINLESS STEEL DUST COVER OVER EYEWASH HEADS AND BOWL. EMERGENCY FIXTURE SHALL MEET ANSI Z358.1.
LV-1	LAVATORY - WALL HUNG	AMERICAN STANDARD	MURRO	22-1/16" x 20-7/8", 15-1/2" x 13-1/2" BOWL	YES	WHITE VITREOUS CHINA	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.5	-1-	1/2"	1/2"	2"	1-1/2"	WALL MOUNT LAVATORY WITH SHROUD, OVAL BASIN, VITREOUS CHINA, 5-1/4" RIGID MOUNT GOOSENECK SPOUT, 8" CENTERS, PRESSURE COMPENSATING NON-AERATING SPRAY, 4" WRIST BLADE HANDLES, CHROME PLATED WATER SUPPLY LINES WITH 1/4 TURN LEAD FREE LOOSE KEY STOPS, ASSE 1070 TEMPERING VALVE - SET TO 90 DEGREES (ADJ.) PROVIDE WITH CERAMIC COMPRESSION CARTRIDGES.
LV-2	LAVATORY - FLOOR MOUNTED - BARIATRIC	WILLOUGHBY INDUSTRIES	BHS-3123	31-1/8" x 22-11/16", 19-3/8" x 11-1/2" BOWL	YES	AQUASURF MOLDED CAST POLYMER	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.5		1/2"	1/2"	2"	1-1/2"	FLOOR MOUNTED BARIATRIC LAVATORY, 4" CENTER FAUCET, 8" GOOSENECK FAUCET, 4" WRIST BLADES, 4" BACKSPLASH AND APRON PROVIDED BY MANUFACTURER. COORDINATE COLOR AND FINISH WITH ARCHITECT AND OWNER. ASSE 1070 TEMPERING VALVE - SET TO 90 DEGREES (ADJ.) PROVIDE WITH CERAMIC COMPRESSION CARTRIDGES. RATED FOR 1000 LBS OF DOWNWARD STATIC FORCES.
MB-1	MOP BASIN	STERN WILLIAMS	SB-900	24" x 24" x 12"		TERRAZZO	STERN WILLIAMS	T-15 VB	CHROME	MANUAL				3/4"	3/4"	3"	2"	SERVICE SINK WITH ADJUSTABLE WALL BRACE, INTEGRAL STOPS, VACUUM BREAKER, AND PAIL HOOK.
SH-1	SHOWER - SURFACE MOUNT			72" SHOWERHEAD HEIGHT	YES		CHICAGO	SH-TP7-00-023	CHROME	MANUAL		2.5		1/2"	1/2"			ASSE 1016 T/P BALANCING MIXING VALVE - TOP SUPPLY WITH SUPPLY COVER - HANDHELD SHOWER WITH 69" STAINLESS STEEL HOSE AND PAUSE CONTROL. READ ARCHITECTURAL PLANS FOR SHOWER ENCLOSER.
SK-1	SINK - SINGLE BOWL, DROP-IN -SPLASH GUARDS - MANUAL	ELKAY	EHS-18-SSX	18" x 14-1/2" x 11", 14" x 10" x 5" BOWL	NO	STAINLESS STEEL, 18 GA	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.0		1/2"	1/2"	2"	1-1/2"	STAINLESS STEEL DROP-IN SINK WITH 3 HOLES ON 8" CENTERS, SIDE SPLASH GAURDS - LAMINAR FLOW GOOSENECK FAUCET WITH 6" WRISTBLADE HANDLES, ASSE 1070 THERMOSTATIC MIXING VALVE SET TO 110°F - PROVIDE WITH DUO STRAINER WITH NEOPRENE STOPPER - WALL SUPPLIES WITH LOOSE KEY QUARTER TURN STOPS - 1-1/2" CHROME PLATED CAST BRASS P-TRAP
SK-2	CLINICAL SINK - WALL-MOUNT - MANUAL	ELKAY	EHS-18X	18" x 14-1/2" x 11", 10" x 14" x 5" BOWL	YES	STAINLESS STEEL, 18 GA	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.0		1/2"	1/2"	2"	1-1/2"	CLINICAL WALL-MOUNT SINK WITH 3 HOLES ON 8" CENTERS - LAMINAR FLOW GOOSENECK FAUCET WITH 6" WRISTBLADE HANDLES, ASSE 1070 THERMOSTATIC MIXING VALVE SET TO 110°F - PROVIDE WITH DUO STRAINER WITH NEOPRENE STOPPER - WALL SUPPLIES WITH LOOSE KEY QUARTER TURN STOPS - 1-1/2" CHROME PLATED CAST BRASS P-TRAP
SK-3	SINK - SINGLE BOWL, DROP-IN - MANUAL	ELKAY	LRAD191865	19" x 18" x 6-1/2", 16" x 11-1/2" x 6-3/8" BOWL	YES	STAINLESS STEEL, 18 GA	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.0	<del></del>	1/2"	1/2"	2"	1-1/2"	DROP-IN SINK WITH 3 HOLES ON 8" CENTERS - LAMINAR FLOW GOOSENECK FAUCET WITH 6" WRISTBLADE HANDLES, ASSE 1070 THERMOSTATIC MIXING VALVE SET TO 110°F - PROVIDE WITH DUO STRAINER WITH NEOPRENE STOPPER - WALL SUPPLIES WITH LOOSE KEY QUARTER TURN STOPS - 1-1/2" CHROME PLATED CAST BRASS P-TRAP
SK-4	SINK - INTEGRAL - MANUAL					<del></del>	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.0	1	1/2"	1/2"	2"	1-1/2"	DROP-IN SINK WITH 3 HOLES ON 8" CENTERS - LAMINAR FLOW GOOSENECK FAUCET WITH 6" WRISTBLADE HANDLES, ASSE 1070 THERMOSTATIC MIXING VALVE SET TO 110°F - PROVIDE WITH DUO STRAINER WITH NEOPRENE STOPPER - WALL SUPPLIES WITH LOOSE KEY QUARTER TURN STOPS - 1-1/2" CHROME PLATED CAST BRASS P-TRAP
SK-5	SINK - SINGLE BOWL, DROP-IN - MANUAL	ELKAY	LR1919	19-1/2" x 19" x 7-1/2", 16" x 13-1/2" x 7-3/8" BOWL	YES	STAINLESS STEEL, 18 GA	CHICAGO	786-E36XKABCP	CHROME	MANUAL		1.0		1/2"	1/2"	2"	1-1/2"	DROP-IN SINK WITH 3 HOLES ON 8" CENTERS - LAMINAR FLOW GOOSENECK FAUCET WITH 6" WRISTBLADE HANDLES, ASSE 1070 THERMOSTATIC MIXING VALVE SET TO 110°F - PROVIDE WITH DUO STRAINER WITH NEOPRENE STOPPER - WALL SUPPLIES WITH LOOSE KEY QUARTER TURN STOPS - 1-1/2" CHROME PLATED CAST BRASS P-TRAP
WB-1	WALL BOX - SUPPLY AND DRAIN	SIOUX CHIEF	696RG2313MF	11-1/2" x 7-1/4" x 3-1/2"		ABS PLASTIC								1/2"	1/2"	2"	1-1/2"	ABS FACEPLATE/FRAME - 18 GAUGE FACEPLATE - QUARTER-TURN VALVES WITH ARRESTOR, 3/4" MALE HOLES THREAD OUTLETS, AND 5/8" INTEGRAL TESTABLE NIPPLE ON KNOCKOUT. BOTH SUPPLIES SHALL BE 1/2" COLD WATER.
WC-1	WATER CLOSET - FLUSH VALVE - FLOOR MOUNTED - BEDPAN WASHER	KOHLER	K-96057 "HIGHCLIFF ULTRA"	17" MIN 19" MAX. SEAT HEIGHT	YES	WHITE VITREOUS CHINA	SLOAN	REGAL BPW 1150-1.28-XL	CHROME	MANUAL			1.28	1-1/4"		3"	2"	KOHLER K-96057-L "HIGHCLIFF ULTRA" FLOOR MOUNTED, VITREOUS CHINA, 16 5/8" HIGH ELONGATED BOWL 1.6 GPF SIPHON JET TOILET WITH 1-1/2" TOP SPUD. SLOAN BPW 1150-1.28-XL "REGAL" MANUAL FLUSHOMETER WITH VACUUM BREAKER AND BEDPAN WASHER. BEMIS 1055SSC COMMERCIAL HEAVY-DUTY PLASTIC ELONGATED OPEN FRONT SEAT, LESS COVER, WITH SELF-SUSTAINING STAINLESS-STEEL CHECK HINGE. FLUSH HANDLE SHALL BE ON THE WIDE SIDE OF THE TOILET. ADA COMPLIANCE REQUIRED.
WC-2	WATER CLOSET - FLUSH VALVE - FLOOR MOUNTED	KOHLER	K-96057 "HIGHCLIFF ULTRA"	17" MIN 19" MAX. SEAT HEIGHT	YES	WHITE VITREOUS CHINA	SLOAN	REGAL 111-1.28	CHROME	MANUAL			1.28	1-1/4"		3"	2"	KOHLER K-96057-L "HIGHCLIFF ULTRA" FLOOR MOUNTED, VITREOUS CHINA, 16 5/8" HIGH ELONGATED BOWL 1.6 GPF SIPHON JET TOILET WITH 1-1/2" TOP SPUD. SLOAN 111-1.28 "REGAL" MANUAL FLUSHOMETER WITH VACUUM BREAKER. BEMIS 1055SSC COMMERCIAL HEAVY-DUTY PLASTIC ELONGATED OPEN FRONT SEAT, LESS COVER, WITH SELF-SUSTAINING STAINLESS-STEEL CHECK HINGE. FLUSH HANDLE SHALL BE ON THE WIDE SIDE OF THE TOILET. ADA COMPLIANCE REQUIRED.
WC-3	WATER CLOSET - FLUSH VALVE - FLOOR MOUNTED - BARIATRIC - BEDPAN WASHER	SLOAN	2029-BPL	17" MIN 19" MAX. SEAT HEIGHT	YES	WHITE VITREOUS CHINA	SLOAN	REGAL BPW 1150-1.28-XL	CHROME	MANUAL			1.28	1-1/4"		3"	2"	SLOAN 2029-BPL FLOOR MOUNTED, VITREOUS CHINA, 1.6 GPF SIPHON JET TOILET WITH 1-1/2" TOP SPUD. SLOAN BPW 1150-1.28-XL "REGAL" MANUAL FLUSHOMETER WITH VACUUM BREAKER. BEMIS 1055SSC COMMERCIAL HEAVY-DUTY PLASTIC ELONGATED OPEN FRONT SEAT, LESS COVER, WITH SELF-SUSTAINING STAINLESS-STEEL CHECK HINGE. FLUSH HANDLE SHALL BE ON THE WIDE SIDE OF THE TOILET. ADA COMPLIANCE REQUIRED. WATER CLOSET, GRAB BARS, AND ACCESSORIES SHALL BE RATED FOR 2500 LBS.

# MEDICAL GAS CONNECTION SCHEDULE

1. WHERE ZONE VALVE BOXES OR AREA ALARM PANELS ARE LOCATED IN SMOKE WALL, PROVIDE APPROPRIATE PROTECTION AROUND THE BOX TO MAINTAIN THE RATING.
2. ZONE VALVE BOXES AND AREA ALARM PANELS SHALL BE LABELED WITH THE ROOM NUMBERS FOR WHICH THEY ARE ASSOCIATED WITH.


					PIPING	CONNECTION	ONS (IN)	AL	ARM SIGNA	AL	
MARK	MFR.	MODEL	LOC.	SERVING ROOM	MEDICAL AIR	OXYGEN	VACUUM	MEDICAL AIR	OXYGEN	VACUUM	REMARKS
AAP-7-1	OHIO MEDICAL	DIGITAL AREA ALARM	7813 NURSE STATION	714 - 717 CRITICAL CARE (A.I.I.) 718 - 724 CRITICAL CARE				Х	Χ	Х	ALL
AAP-7-2	OHIO MEDICAL	DIGITAL AREA ALARM	7712 NURSE STATION	725 - 734 CRITICAL CARE				Χ	Χ	Х	ALL
AAP-7-3	OHIO MEDICAL	DIGITAL AREA ALARM	7812 NURSE STATION	707 - 712 INTERMEDIATE CARE				Χ	Х	Х	ALL
AAP-7-4	OHIO MEDICAL	DIGITAL AREA ALARM	7711 NURSE STATION	701 - 706 INTERMEDIATE CARE				Χ	Χ	Х	ALL
ZVB-7-1	OHIO MEDICAL	TRIPLEX ZONE VALVE BOX	C-775 CORRIDOR	714 - 717 CRITICAL CARE (A.I.I.) 718 - 724 CRITICAL CARE	3/4"	1-1/4"	2"				ALL
ZVB-7-2	OHIO MEDICAL	TRIPLEX ZONE VALVE BOX	C-785 CORRIDOR	725 - 734 CRITICAL CARE	3/4"	1-1/4"	2"				ALL
ZVB-7-3	OHIO MEDICAL	TRIPLEX ZONE VALVE BOX	C-765 CORRIDOR	707 - 712 INTERMEDIATE CARE	3/4"	1-1/4"	2"				ALL
ZVB-7-4	OHIO MEDICAL	TRIPLEX ZONE VALVE BOX	C-750 CORRIDOR	701 - 706 INTERMEDIATE CARE	3/4"	1-1/4"	2"				ALL

## MEDICAL GAS OUTLET SCHEDULE

MINIMUM RUNOUT SIZE TO BRANCH MAIN TO BE 1/2" FOR OXYGEN AND MED AIR; 3/4" FOR VAC.
 A VACUUM SLIDE SHALL BE PROVIDED ADJACENT TO EACH VACUUM INLET.

MARK	MFR.	MODEL	DESCRIPTION	OXYGEN (O2)	VAC (VAC)	MEDICAL AIR (MA)	REMARKS
MG-1	OHIO MEDICAL	OHMEDA COMPATIBLE WALL OUTLET	QUICK CONNECT PIN INDEX STATION OUTLET	4	4	4	ALL

No.	Date	Description



HOSPIT/

P6.1