



- CONSTRUCTION EXIT NOTES**
1. REPLACE CONTAMINATED STONE AS REQUIRED TO PREVENT TRACKING OF SEDIMENT OR MUD ON PUBLIC STREETS.
 2. CLEAN STREETS DAILY WITH BROOM AND SHOVEL. THE USE OF WATER IS PROHIBITED.
 3. ALL VEHICLES MUST USE CONSTRUCTION EXIT.

CONSTRUCTION EXIT
N.T.S.

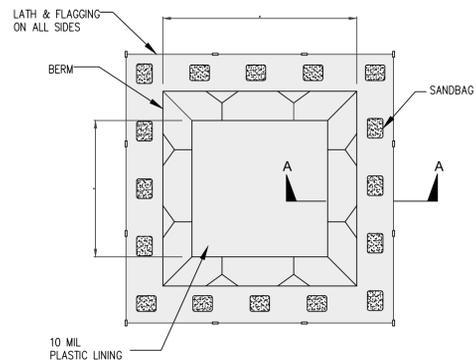


CONCRETE WASHOUT
TYPE "BELOW GRADE"



SECTION A-A


- NOTES**
1. NO WASHING OUT OF CONCRETE TRUCKS OR WASHING OF SWEEPINGS FROM EXPOSED AGGREGATE CONCRETE INTO STORM DRAINS, OPEN DITCHES, STREETS, OR STREAMS IS ALLOWED.
 2. EXCESS CONCRETE IS NOT ALLOWED TO BE DUMPED ON-SITE, EXCEPT IN DESIGNATED TEMPORARY CONCRETE WASHOUT PIT AREAS.
 3. ON-SITE TEMPORARY CONCRETE WASHOUT AREAS WILL BE LOCATED AT LEAST 50 FEET FROM STORM DRAINS, OPEN DITCHES, OR WATER BODIES AS DETERMINED IN THE FIELD.
 4. THE CONCRETE WASHOUT SIGN SHALL BE INSTALLED WITHIN 30 FT. OF THE TEMPORARY CONCRETE WASHOUT FACILITY.
 5. TEMPORARY CONCRETE WASHOUT FACILITIES WILL BE CONSTRUCTED AND MAINTAINED IN SUFFICIENT QUANTITY AND SIZE TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY WASHOUT OPERATIONS.
 6. WASHOUT FACILITIES WILL BE CLEANED OUT ONCE THE WASHOUT IS 75% FULL.
 7. PLASTIC LINING MATERIAL WILL BE MINIMUM OF 10 MIL POLYETHYLENE SHEETING AND WILL BE FREE OF HOLES, TEARS, OR OTHER DEFECTS.
 8. WHEN WASHOUT FACILITIES ARE NO LONGER REQUIRED FOR WORK, THE HARDENED CONCRETE WILL BE REMOVED AND DISPOSED OF. MATERIALS USED TO CONSTRUCT TEMPORARY CONCRETE WASHOUT FACILITIES WILL BE REMOVED FROM THE SITE AND DISPOSED OF.



SIGN DETAIL


CONCRETE WASTE MANAGEMENT DETAIL

N.T.S.

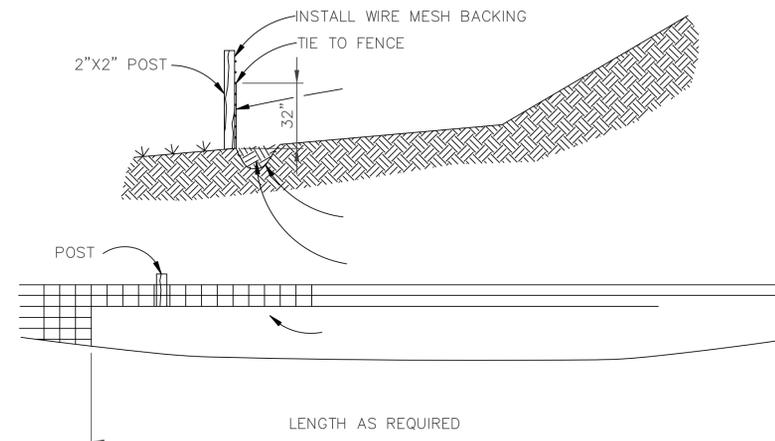

- NOTES:**
- THE EMBEDDED SILT FENCE SHALL BE PLACED ON A CONTOUR AND DESIGNED TO HOLD RUNOFF FROM THE 10 YEAR STORM FROM AN AREA OF 100 SQ. FT. FOR EACH FOOT OF FENCE. THE MAXIMUM DEPTH OF RETAINED WATER ON THE UPSTREAM SIDE OF THE FENCE SHALL BE TWO (2) FEET. THE MAXIMUM SLOPE LENGTH ABOVE THE FENCE SHALL BE NO MORE THAN ONE HUNDRED (100) FEET. THE MAXIMUM SLOPE ABOVE THE FENCE IS 3:1.
 - THE FABRIC SHALL BE BURIED IN A TRENCH THAT IS AT LEAST EIGHT INCH DEEP AND EIGHT INCHES WIDE. THE FABRIC SHALL BE PLACED ON THE UPSTREAM SIDE OF THE POSTS.
 - POST SHALL BE MADE OF METAL (1-POST) OR WOOD (2X2) AND PLACED NO MORE THAN SIX FEET APART.
 - ALL EMBEDDED SILT FENCE SHALL BE WIRE-BACKED EXCEPT WHEN USED AS INLET PROTECTION.
 - THE EMBEDDED SILT FENCE SHALL BE INSPECTED WEEKLY AND AFTER ONE-HALF (1/2) INCH OR GREATER RAINFALLS FOR PROPER INSTALLATION, DEFECTIVE FENCING, EROSION ON THE ENDS, AND EXCESSIVE SEDIMENT BUILDUP BEHIND THE FENCE (HALF THE FENCE HEIGHT). ANY SEDIMENT ACCUMULATED BEHIND THEM MUST BE REMOVED AND DISPOSED OF PROPERLY. ANY DEFECTIVE MEASURES SHALL BE REPAIRED OR REPLACED WITHIN 24 HOURS.

FILTER FABRIC BARRIER (SILT FENCE)

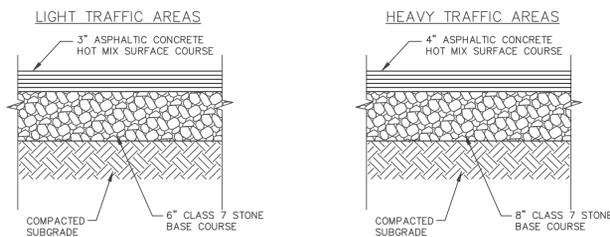

PAVEMENT SECTIONS

ENGINEER: GB
DRAWN BY: MW

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 9810
GREGORY H. BATES
02-19-2026

CERTIFICATE OF AUTHORITY
BATES & ASSOCIATES, INC.
#335
ARKANSAS ENGINEER
Copyright © 2023 Bates & Associates, Inc.

REVISIONS	DATE
SKETCH PLAN FOR REVIEW	11/06/25
1ST SUBMITTAL	11/26/25
2ND SUBMITTAL	01/14/26
3RD SUBMITTAL	01/28/26
ADDED ROOF DRAIN	02/05/26
PLOTTED CONSTRUCTION PLAN	02/05/26
UPDATES TO TITLE BLOCK	02/18/26
ADDED NOTE REGARDING IRRIGATION	02/19/26

MANA HEALTH BUILDING ADDITION
SDP / PIP
SITE DETAILS
ROGERS, ARKANSAS

BATES
Engineers - Surveyors
7230 S Pleasant Ridge Dr / Fayetteville, AR 72704
PH: (479) 442-9350 / batesnwa.com

PROJECT NO. 16-260
DRAWING NO. DT1