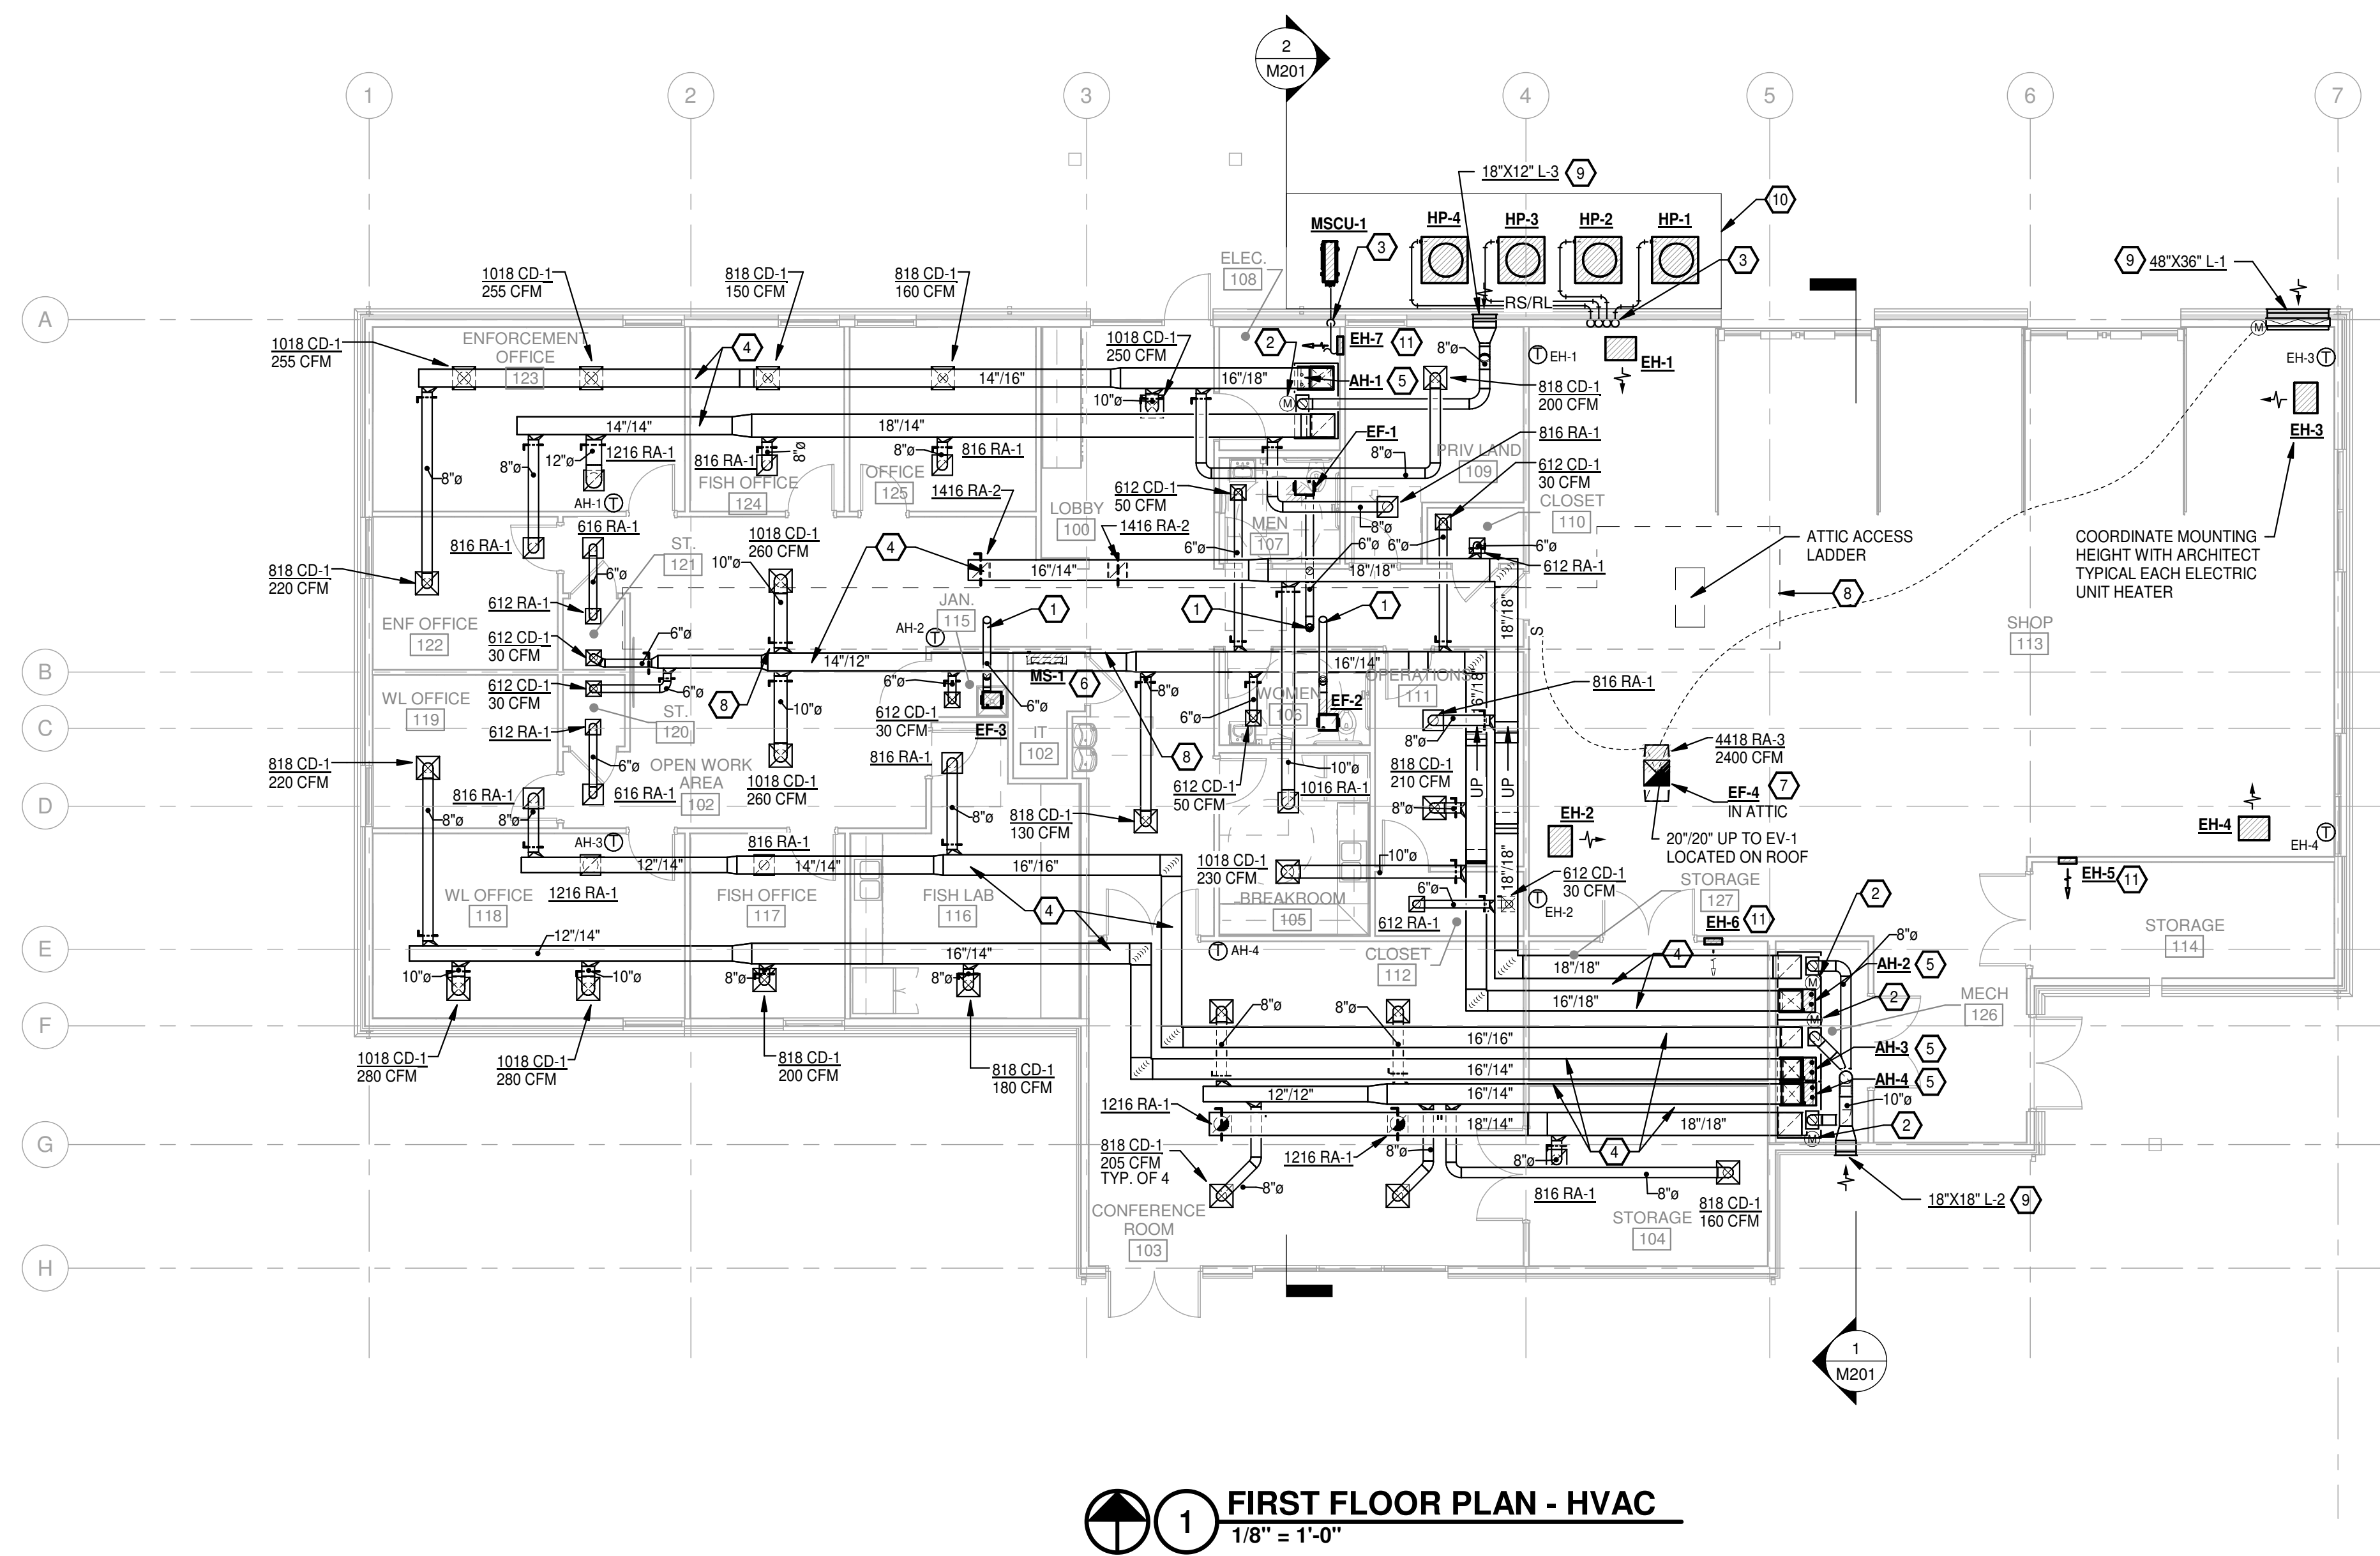


HVAC KEYED NOTES

- ROUTE EXHAUST DUCT UP THRU ATTIC TO ROOF AND PROVIDE ROOF JACK COMPATIBLE WITH STANDING SEAM METAL ROOF.
- MOTORIZED OUTSIDE AIR CONTROL DAMPER.
- ROUTE REFRIGERANT LINES FROM CONDENSER UP THROUGH EXTERIOR WALL AND PROVIDE SLEEVE THRU WALL AND SEAL WATER TIGHT. ROUTE LINES UP IN WALL IN A PVC SLEEVE. ROUTE LINES UP AND THROUGH ATTIC SPACE AND DOWN TO ITS CORRESPONDING AIR HANDLER UNIT.
- COORDINATE THE ROUTING OF ALL SUPPLY AND RETURN DUCTS UP THROUGH ATTIC SPACE TRUSS SYSTEM. REFER TO STRUCTURAL PLANS.
- ROUTE CONDENSATE DRAIN LINE FROM AIR HANDLER TO FLOOR SINK. REFER TO PLUMBING FOR LOCATION.
- MS-1 MOUNTED HIGH ON WALL. COORDINATE EXACT LOCATION AND HEIGHT WITH I.T. EQUIPMENT LOCATED IN ROOM. ROUTE CONDENSATE DRAIN LINE THROUGH JANITORS CLOSET WALL TO JANITORS SERVICE SINK. REFER TO PLUMBING FOR EXACT LOCATION.
- EXHAUST FAN EF-4 LOCATED IN ATTIC BETWEEN THE WEB OF THE ATTIC TRUSS. COORDINATE ROUTING OF DUCT WITH TRUSS SYSTEM. INSTALL THE EXHAUST FAN SO THAT TRUSSES DO NOT INTERFERE WITH ACCESS TO FAN. REFER TO STRUCTURAL PLANS.
- WALK PLATFORM LOCATED IN ATTIC SPACE. COORDINATE ROUTING OF ALL DUCT WORK IN ATTIC SPACE TO PROVIDE A CLEAR PATHWAY ABOVE WALK PLATFORM FROM ONE SIDE TO THE OTHER. REFER TO STRUCTURAL PLANS.
- REFER TO ARCHITECT FOR MOUNTING HEIGHT AND LOCATION.
- INSTALL UNITS ON 4" CONCRETE EQUIPMENT PAD.
- MOUNT ELECTRIC HEATER 12" ABOVE FINISH FLOOR.

1 FIRST FLOOR PLAN - HVAC
1/8" = 1'-0"