


PLUMBING RISERS

NO.	DATE	DESCRIPTION
	25-065	
	07.30.2026	

ISSUE

P301

NOTE: ALL FLOOR DRAINS SHALL HAVE TRAP PRIMERS. LOCATE TRAP PRIMER DEVICES IN MECHANICAL ROOMS AND JANITORS CLOSETS WHERE PRACTICAL. IN FINISHED AREAS PROVIDE TRAP PRIMER IN WALL WITH ACCESS PANELS. FIELD VERIFY EXACT LOCATIONS AND WATER PIPE ROUTING. NOT ALL WATER TO TRAP PRIMER IS SHOWN.

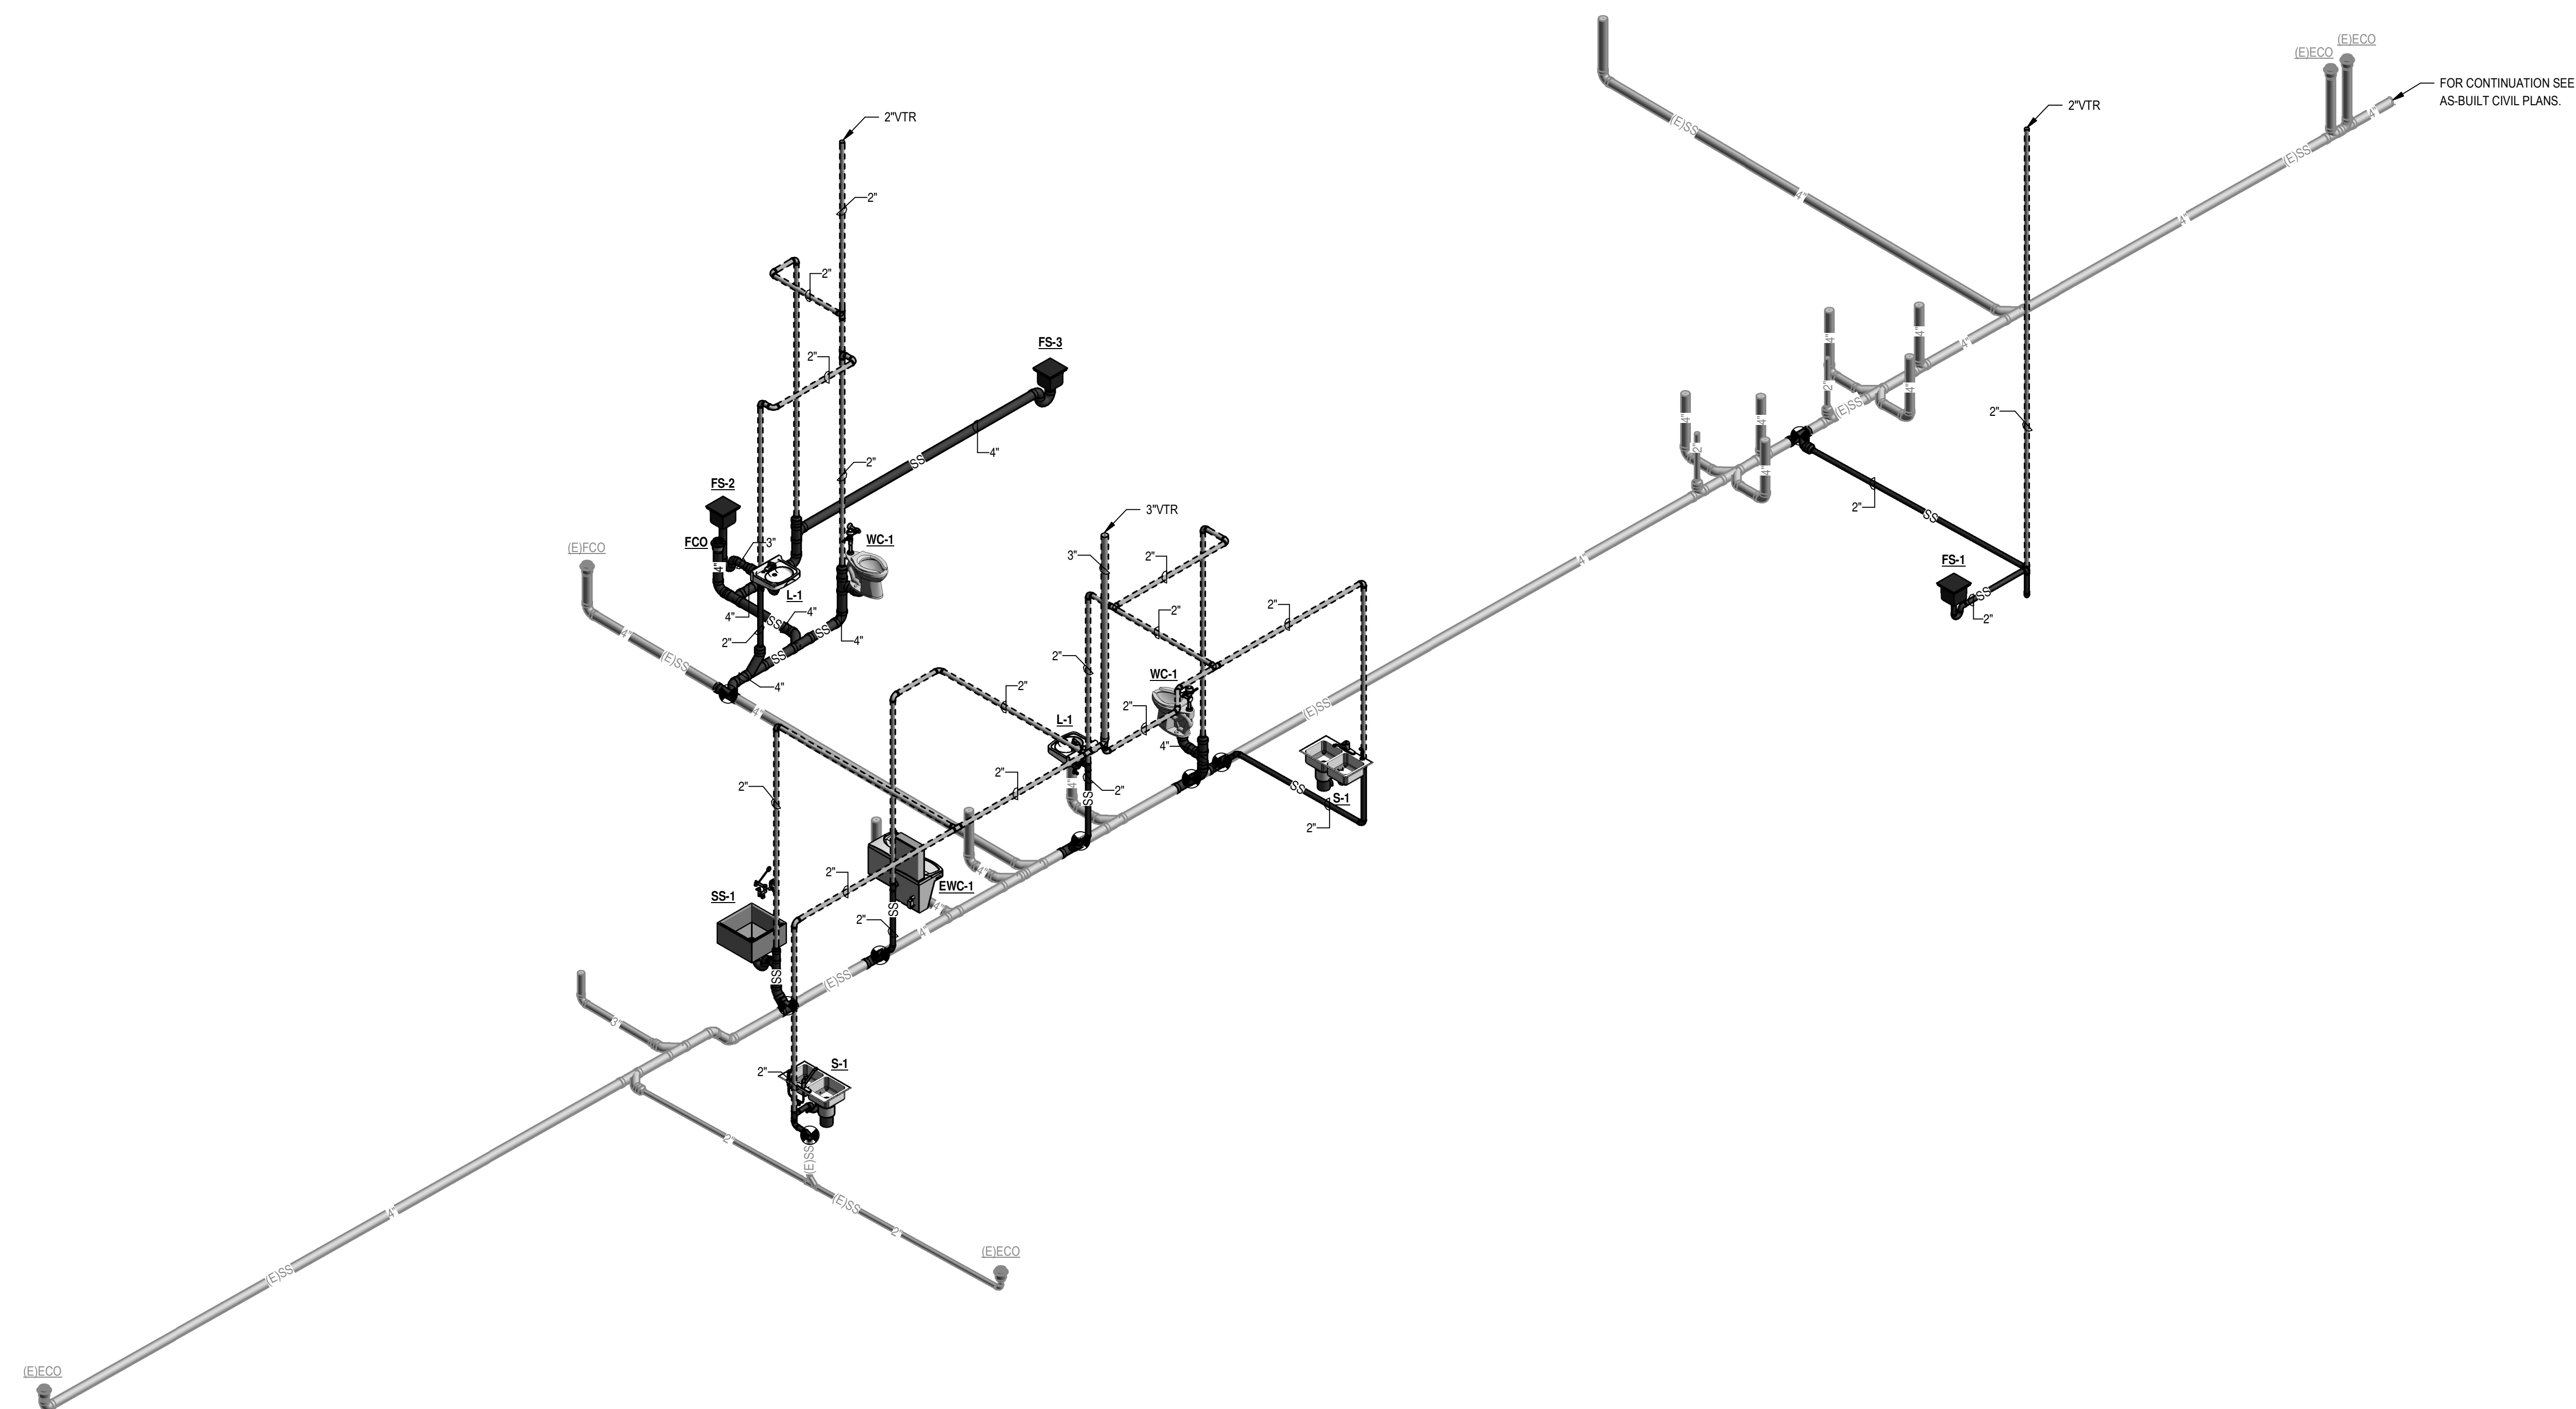

PLUMBING WASTE AND VENT RISER DIAGRAM

