



PHILANDER
SMITH
UNIVERSITY

M.L. HARRIS
AUDITORIUM
RENOVATION

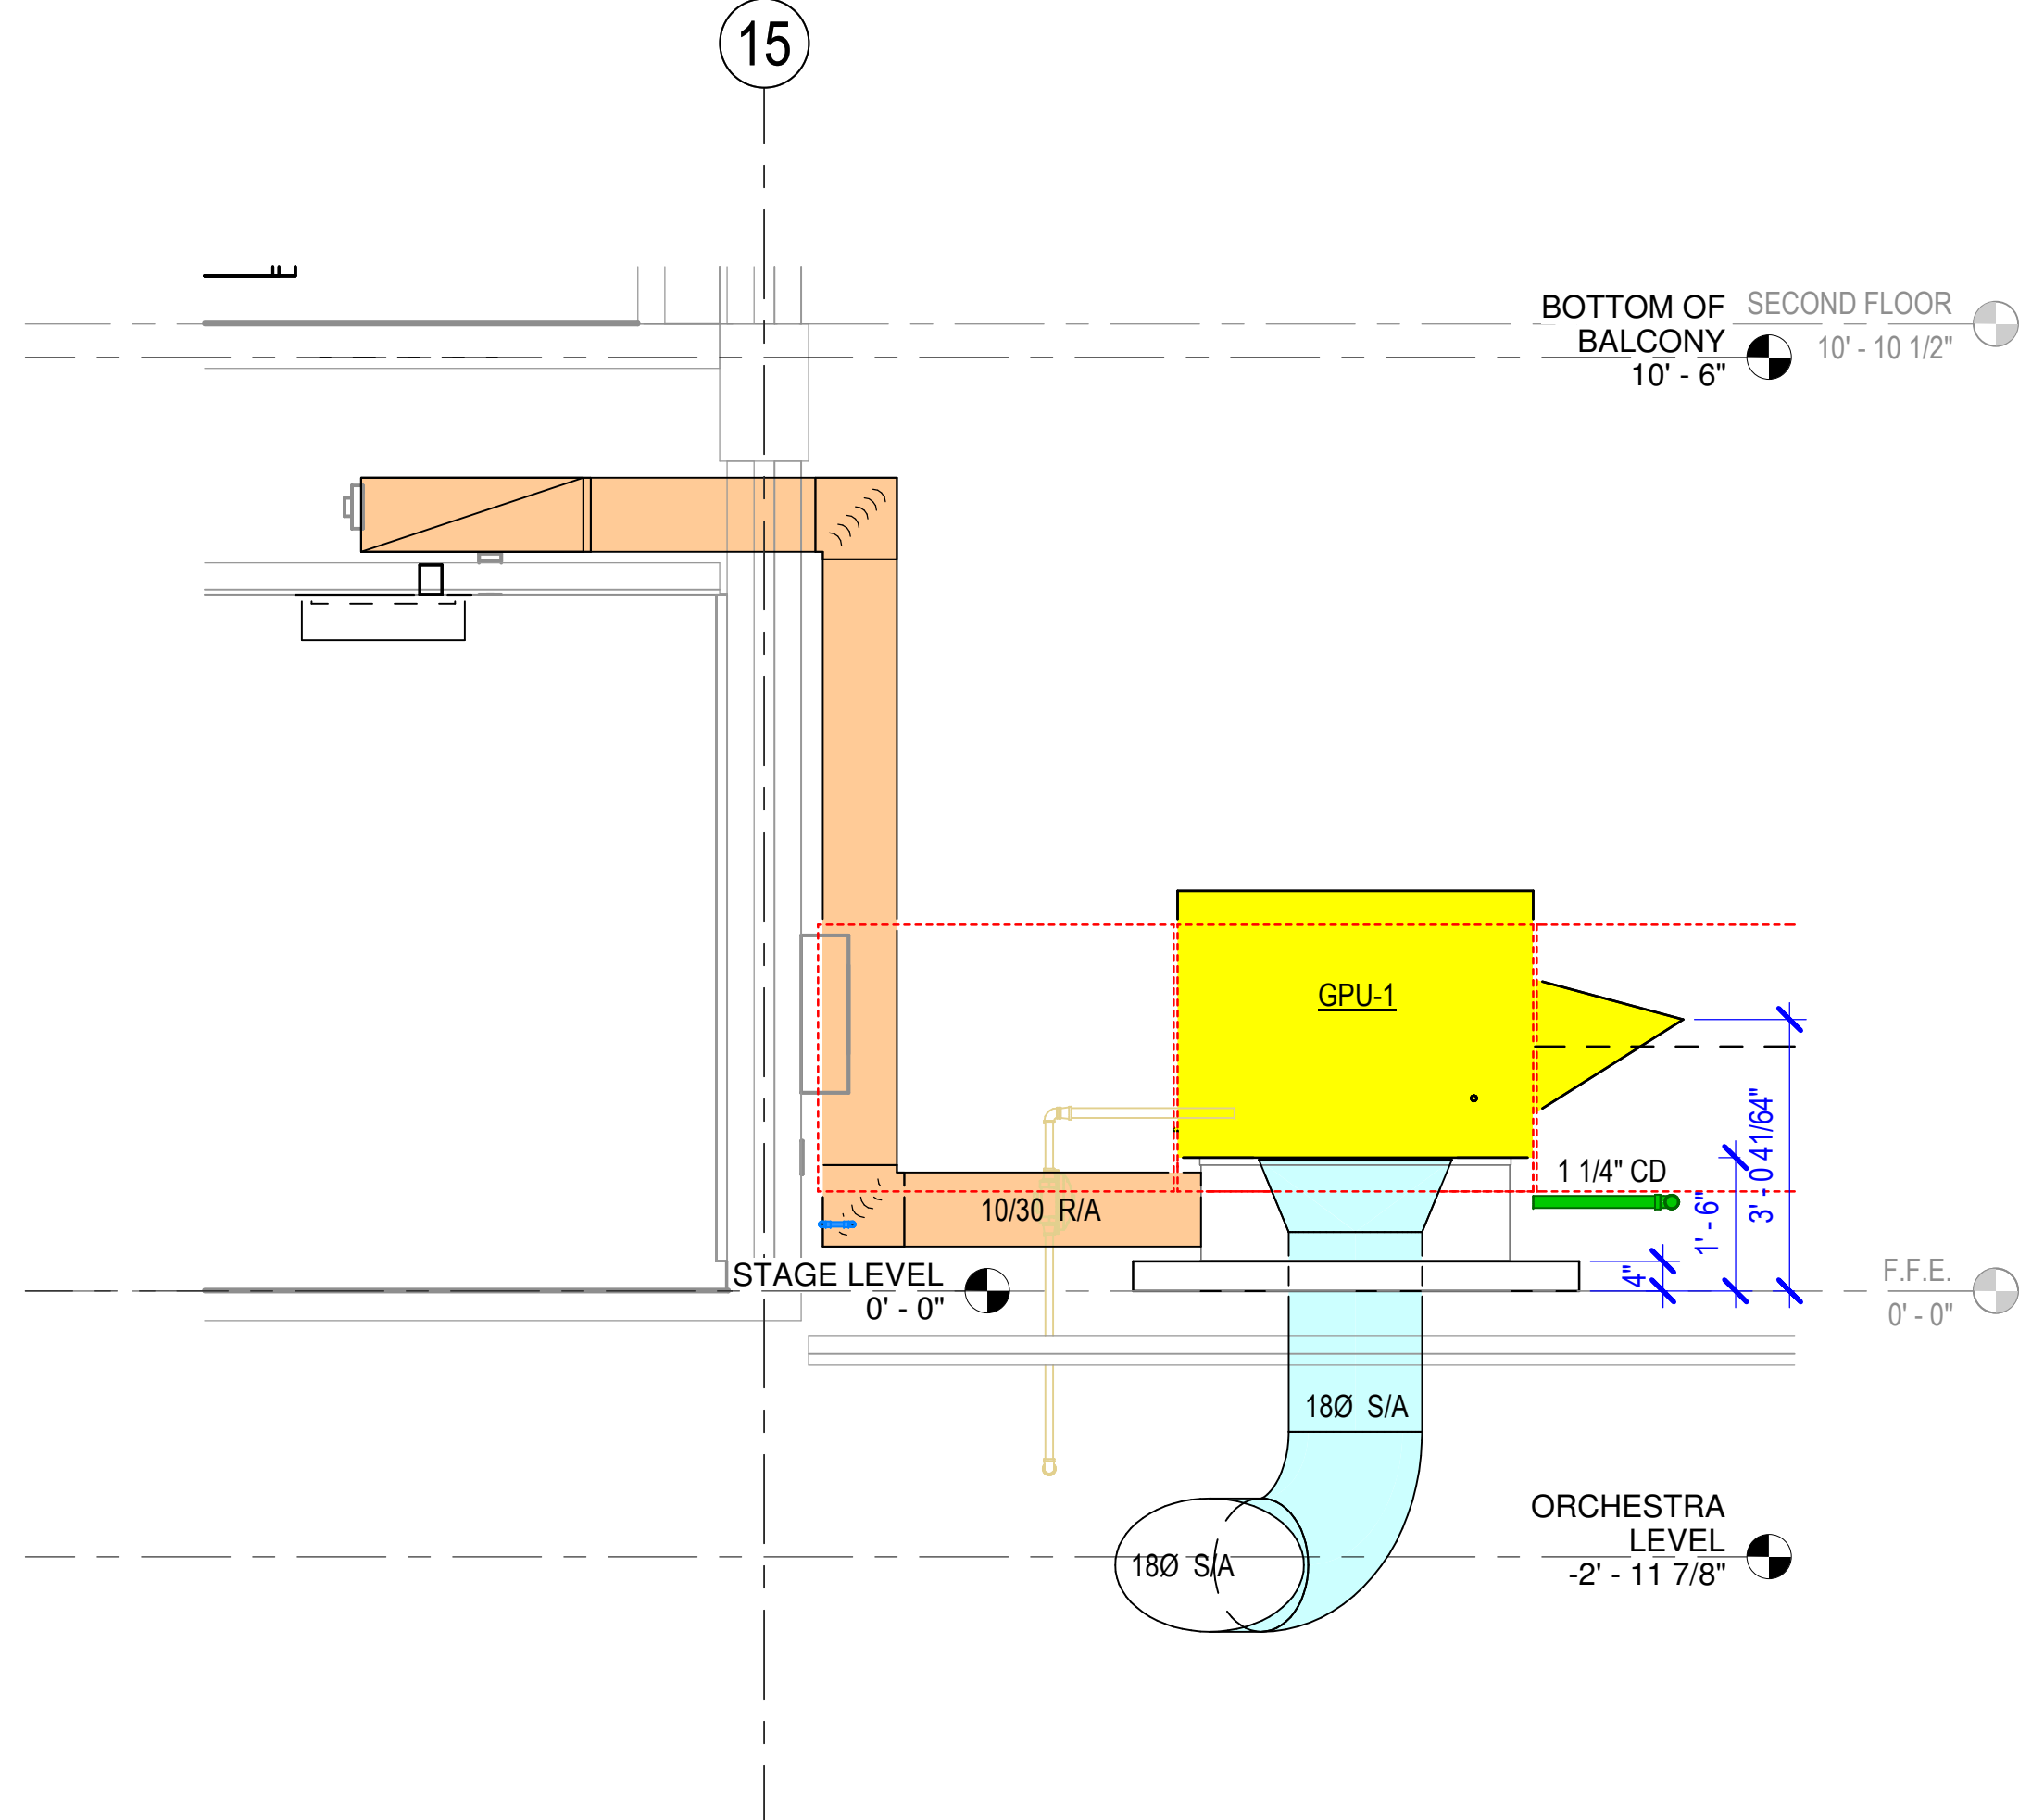


1 GPU-1 - SECTION
1/2" = 1'-0"

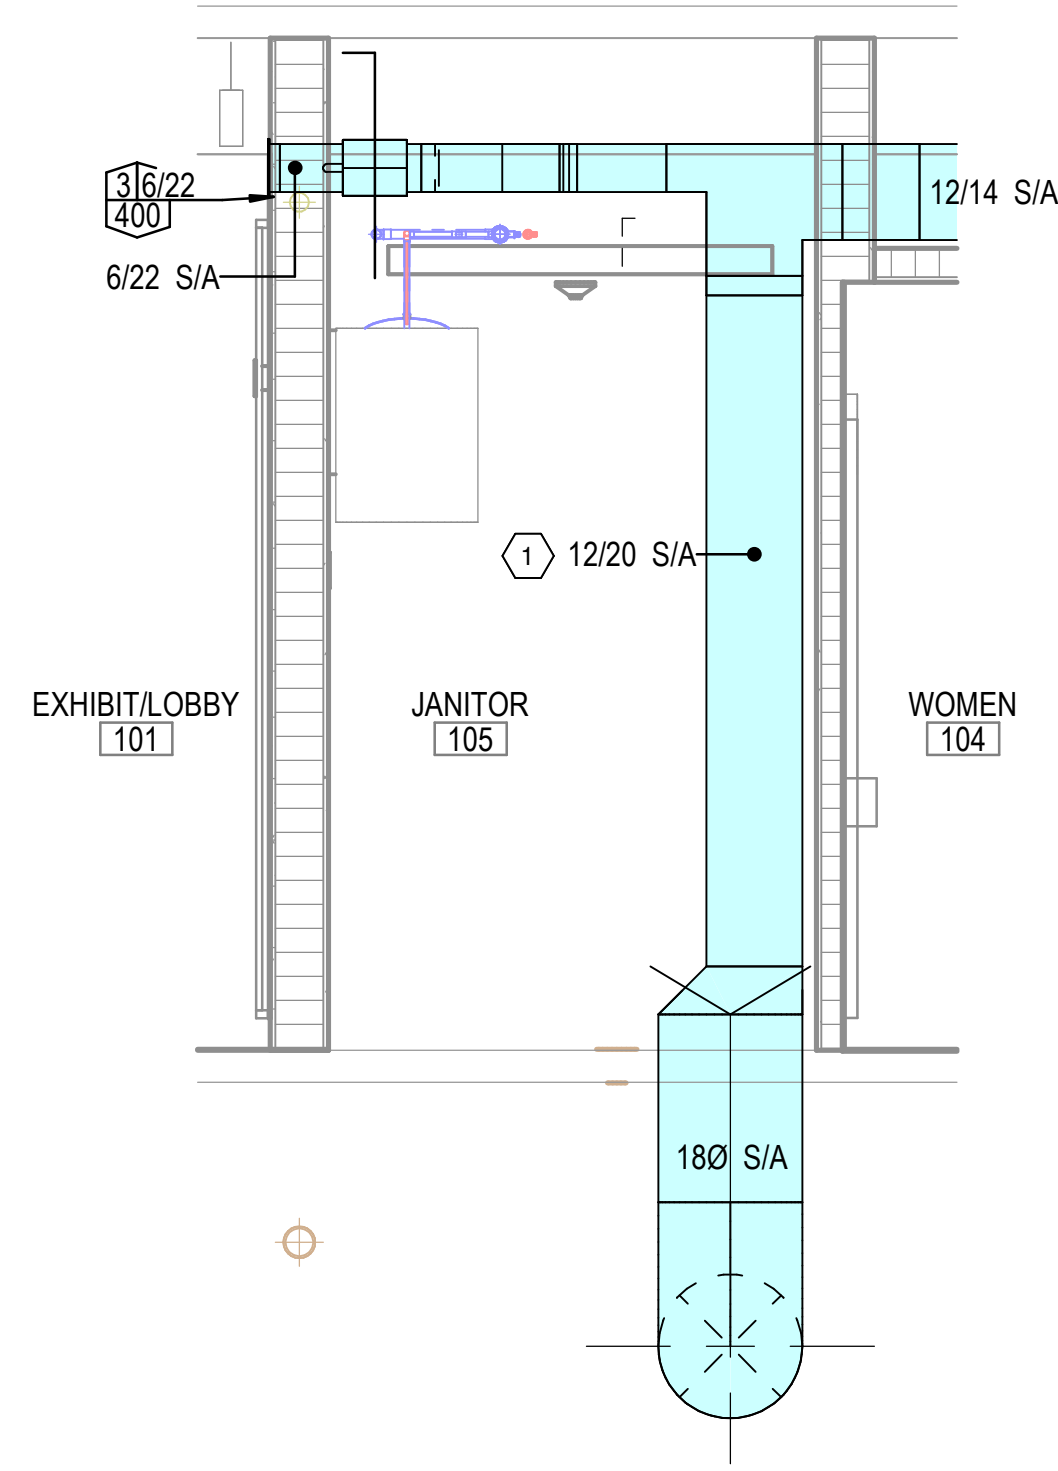

2 JANITOR'S CLOSET DUCT SECTION
1/2" = 1'-0"

KEYED NOTES

- RECTANGULAR DUCT BETWEEN FLOOR AND TEE TO BE DOUBLE-WALL, WITH MINIMUM 20-GA EXTERIOR SKIN. DIMENSIONS SHOWN ARE INTERIOR CLEAR DIMENSIONS AND DO NOT HAVE ALLOWANCES FOR INSULATION. INSULATE PER SPECS.
- INSTALL AIR DEVICES AT ROUGHLY 23'-0" A.F.F. COORDINATE FINAL ELEVATION WITH THEATER RIGGING, BATTENS, CURTAINS, LIGHTING, ETC. DUCTWORK AND AIR DEVICES ARE TO BE MOVED TO MEET ALL THEATER CLEARANCE REQUIREMENTS.
- COORDINATE ALL STAGE DUCT AND AIR DEVICE LOCATION WITH THEATER RIGGING, BATTENS, CURTAINS, LIGHTING, ETC. DUCTWORK AND AIR DEVICES ARE TO BE MOVED TO MEET ALL THEATER CLEARANCE REQUIREMENTS.
- NEW STAGE SMOKE VENT, REFER TO M-601.

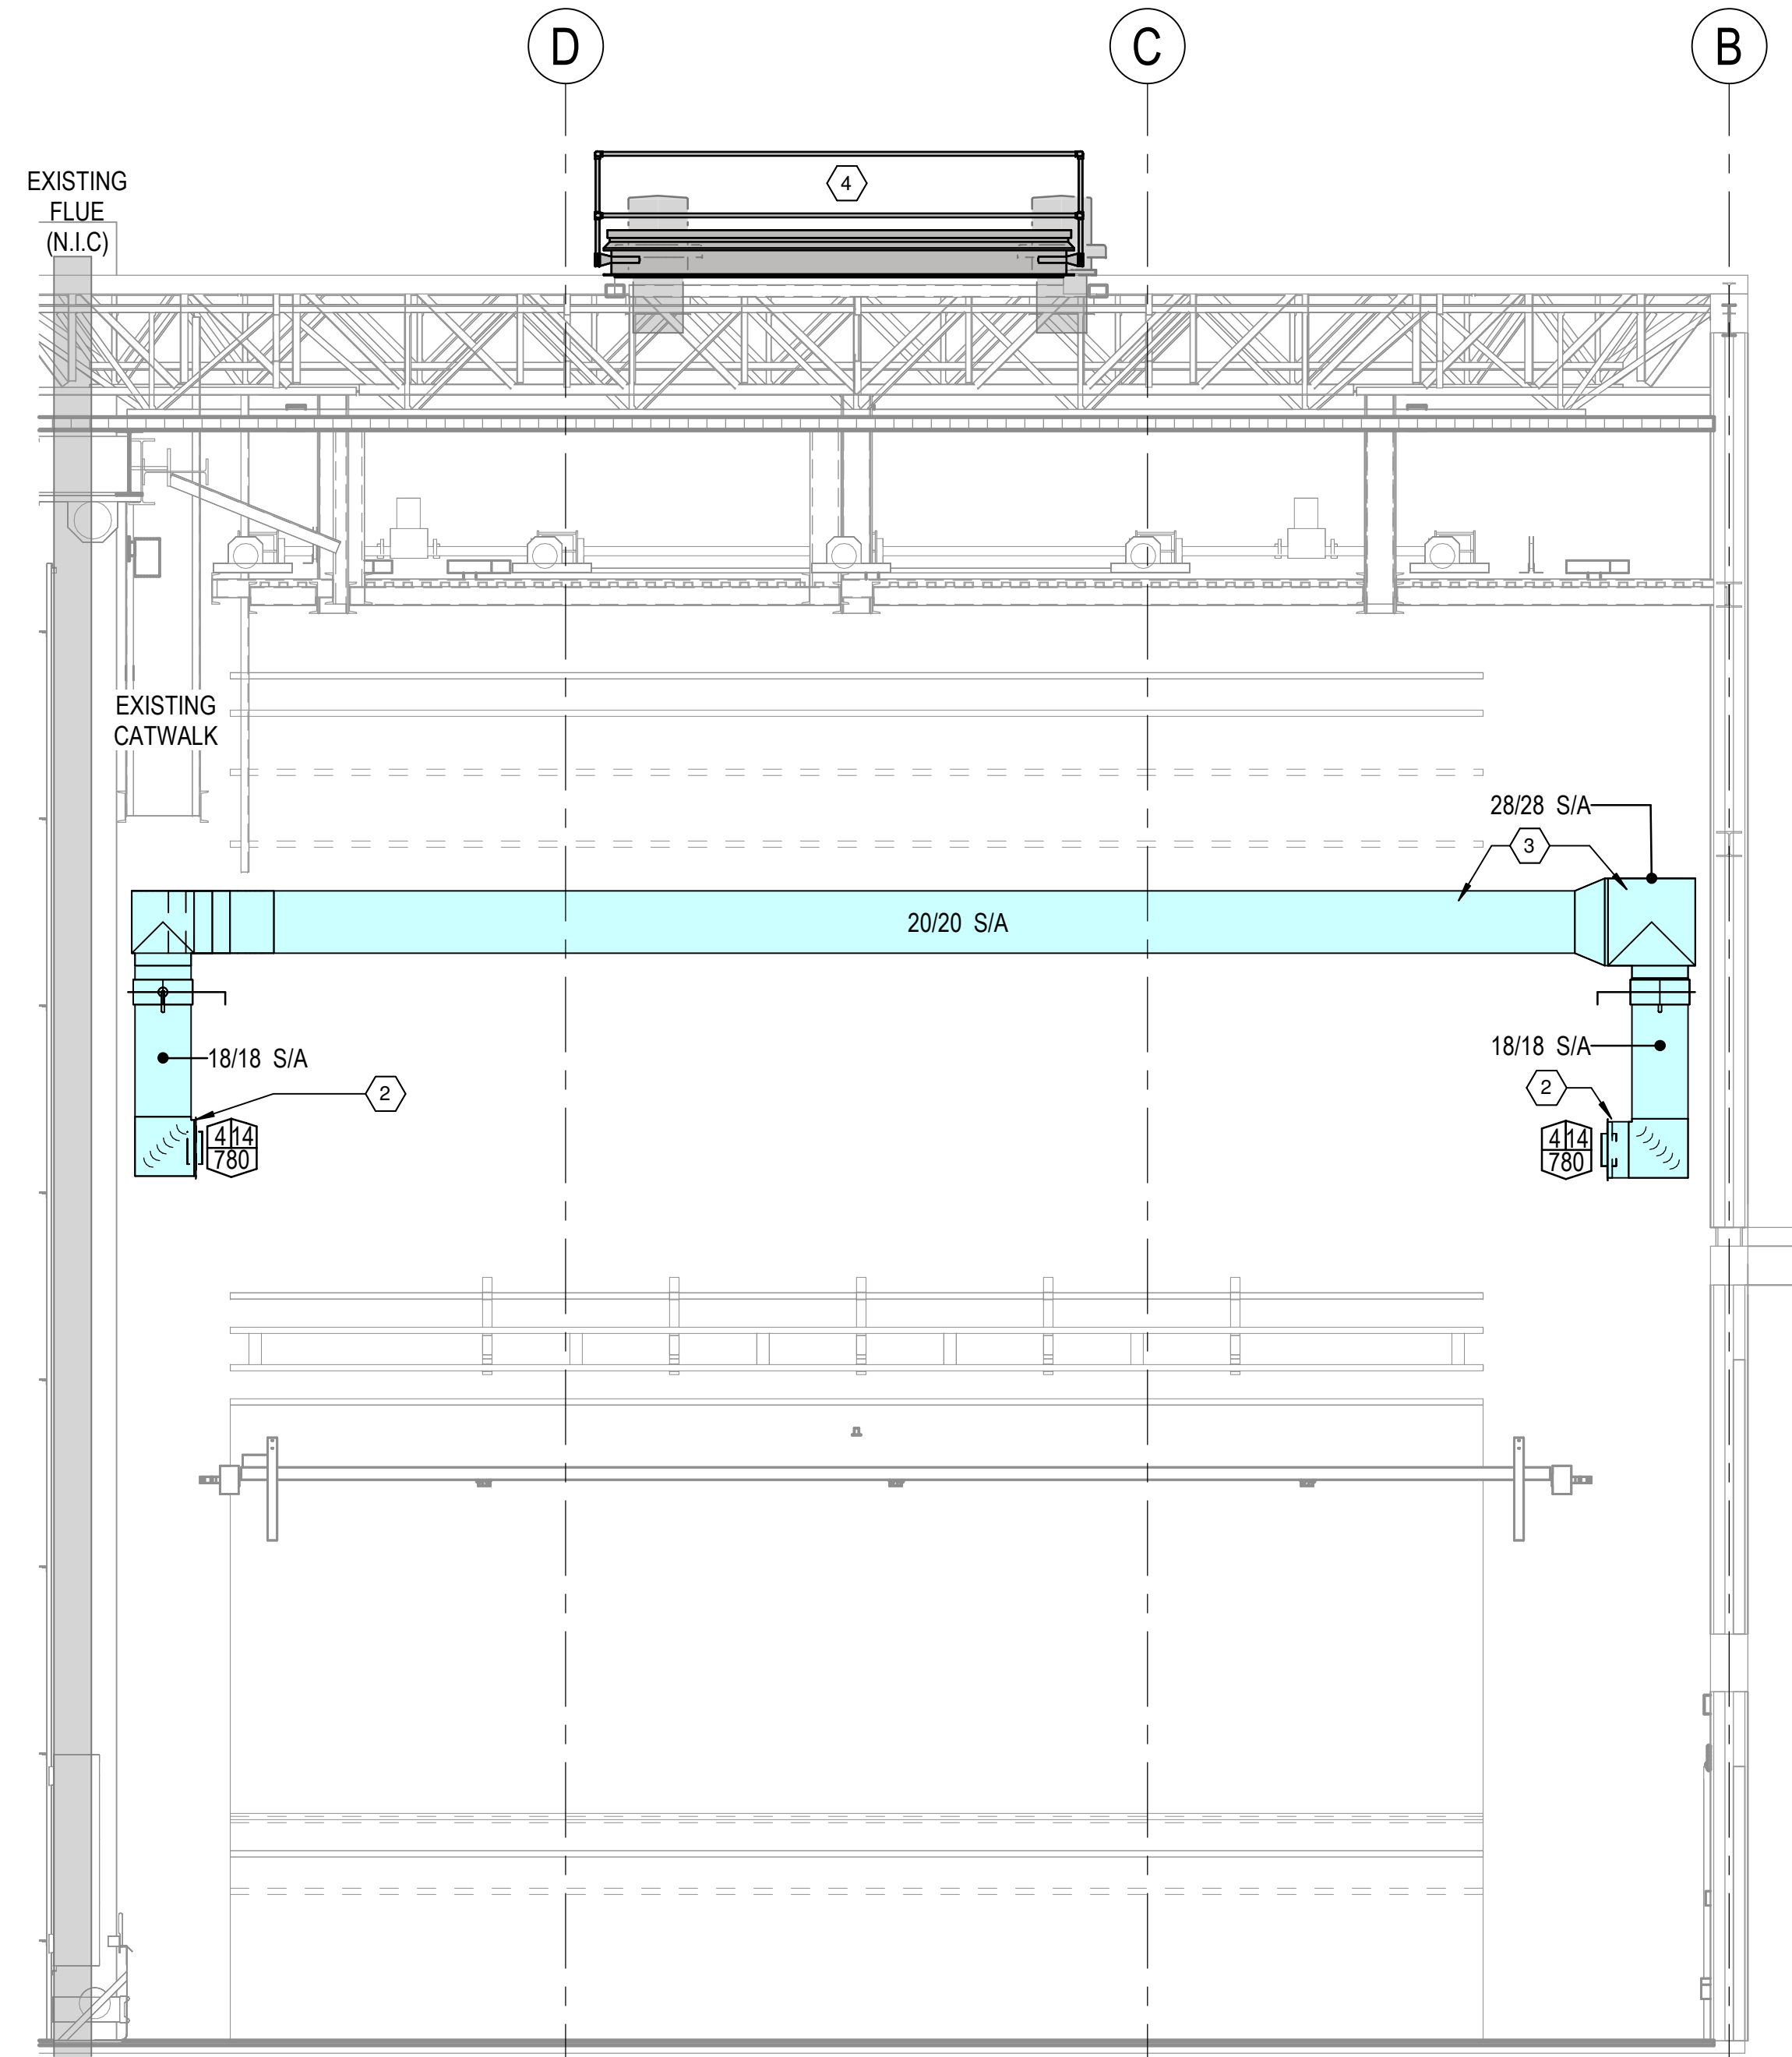

3 STAGE DUCTWORK SECTION
1/4" = 1'-0"

Volume
VOLUME 1

CONSTRUCTION
DOCUMENTS

No.	Date	Description

Stamp
CROMWELL ARCHITECTS/ENGINEERS
#5
09-10-2026

- Notes
- CROMWELL ARCHITECTS ENGINEERS, INC. ALL RIGHTS RESERVED
 - THIS SHEET DESIGNED FOR COLOR PRINTING. CRITICAL INFORMATION MAY BE LOST WITH BLACK AND WHITE PRINTING.

Project Number
2024-060
Issue Date
09-10-2026
Sheet Title

MECHANICAL SECTIONS

Sheet Number

M-301