

PHILANDER SMITH UNIVERSITY

M.L. HARRIS AUDITORIUM RENOVATION

Volume **VOLUME 1**

Design Phase
CONSTRUCTION DOCUMENTS

Revisions		
No.	Date	Description

Stamp

Notes
09-10-2026

1. CROMWELL ARCHITECTS ENGINEERS, INC. ALL RIGHTS RESERVED
2. THIS SHEET DESIGNED FOR COLOR PRINTING. CRITICAL INFORMATION MAY BE LOST WITH BLACK AND WHITE PRINTING.

Project Number **2024-060**
Issue Date **09-10-2026**

Sheet Title
FIRST FLOOR ELECTRICAL DEMOLITION PLAN

Sheet Number

ED101

GENERAL NOTES:


- A. INFORMATION REGARDING EXISTING CONDITIONS WAS TAKEN FROM RECORD DRAWINGS AND CASUAL SITE OBSERVATIONS. CONTRACTOR SHALL VERIFY AND DOCUMENT EXISTING CONDITIONS PRIOR TO DEMOLITION.
- B. REMOVE ALL ELECTRICAL DEVICES, FIXTURES, AND CIRCUITS IN WALLS, CEILINGS, MILLWORK, ETC. TO BE DEMOLISHED, WHETHER SHOWN ON THIS PLAN OR NOT. MAINTAIN CIRCUIT CONTINUITY FOR REMAINING DEVICES.
- C. COORDINATE WITH OTHER DISCIPLINES FOR COMPLETE DEMOLITION.
- D. CONDUIT (EXCEPT CONCRETE-EMBEDDED) AND CONDUCTORS OF DEMOLISHED CIRCUITS SHALL BE REMOVED TO THE POINT OF ORIGIN (PANELBOARD FOR CIRCUITS TO BE COMPLETELY REMOVED AND NEAREST J-BOX FOR CIRCUITS TO BE PARTIALLY REMOVED). INSTALL COVERS ON HOLES IN J-BOXES AND PANELBOARDS.
- E. MODIFY CIRCUITS AS REQUIRED FOR REMAINING DEVICES TO REMAIN OPERATIONAL.
- F. REROUTE CONCEALED CIRCUITS WHICH PASS THROUGH THIS FLOOR, WHICH ARE TO REMAIN TO SERVE DEVICES ABOVE OR BELOW THIS FLOOR.
- G. ANY DEVICES THAT MAY BE REMOVED AS PART OF THIS PROJECT ARE TO BE HANDED OVER TO THE OWNER.
- H. (NOT USED)
- I. ALL REQUIRED OUTAGES, CONDUIT ROUTING, ETC. WITHIN THE EXISTING BUILDING SHALL BE COORDINATED WITH OWNER 48 HOURS PRIOR TO ANY WORK BEING COMPLETED. SCHEDULE SHALL BE CONTINGENT UPON OWNER APPROVAL.

KEYED NOTES:

- 1 REMOVE PANELBOARD. CUT CONDUIT AT SLAB AND PREPARE FOR FINISHED FLOOR.
- 2 BRANCH CIRCUIT CONDUIT BELOW SLAB MAY BE ABANDONED DUE TO PREVIOUS REMOVAL OF EXTERIOR POLE LIGHTS. FIELD VERIFY TO DETERMINE IF BELOW-SLAB CONDUIT SERVES RECEPTACLES OR OTHER LOADS WHICH ARE TO REMAIN IN USE OR IF CONDUIT CAN BE ABANDONED.
- 3 EXISTING CIRCUITS FROM RECORD DRAWINGS SHOWN FOR INFORMATION ONLY.
- 4 REMOVE PORTION OF SLAB AS REQUIRED TO INTERCEPT BELOW GRADE CONDUITS AND REROUTE IF NECESSARY FOR REUSE.
- 5 TO CANOPY LIGHT FIXTURES.
- 6 MAINTAIN EXISTING AUTOMATIC CONTROLS OF EXTERIOR LIGHTING.
- 7 REMOVE EXISTING LIGHT SWITCH CONTROLLING STAIR LIGHTING.
- 8 REMOVE EXISTING CONDUCTORS. EMBEDDED CONDUIT TO REMAIN FOR REUSE.
- 9 FOR EXTENSION OF EXISTING CIRCUITS SERVING DEVICES OR EQUIPMENT TO REMAIN, WHICH MAY OR MAY NOT BE INDICATED, SEE EP101.
- 10 REMOVE EXISTING RECEPTACLE TO ALLOW RAMP CONSTRUCTION. SEE EP101.
- 11 REMOVE EXISTING RECEPTACLE. BOX AND CIRCUIT TO REMAIN.
- 12 REMOVE RECEPTACLE FROM BELOW STAGE.

KEYED NOTES:

- 13 ADD ALTERNATIVE #2B - RECEPTACLES TO REMAIN.

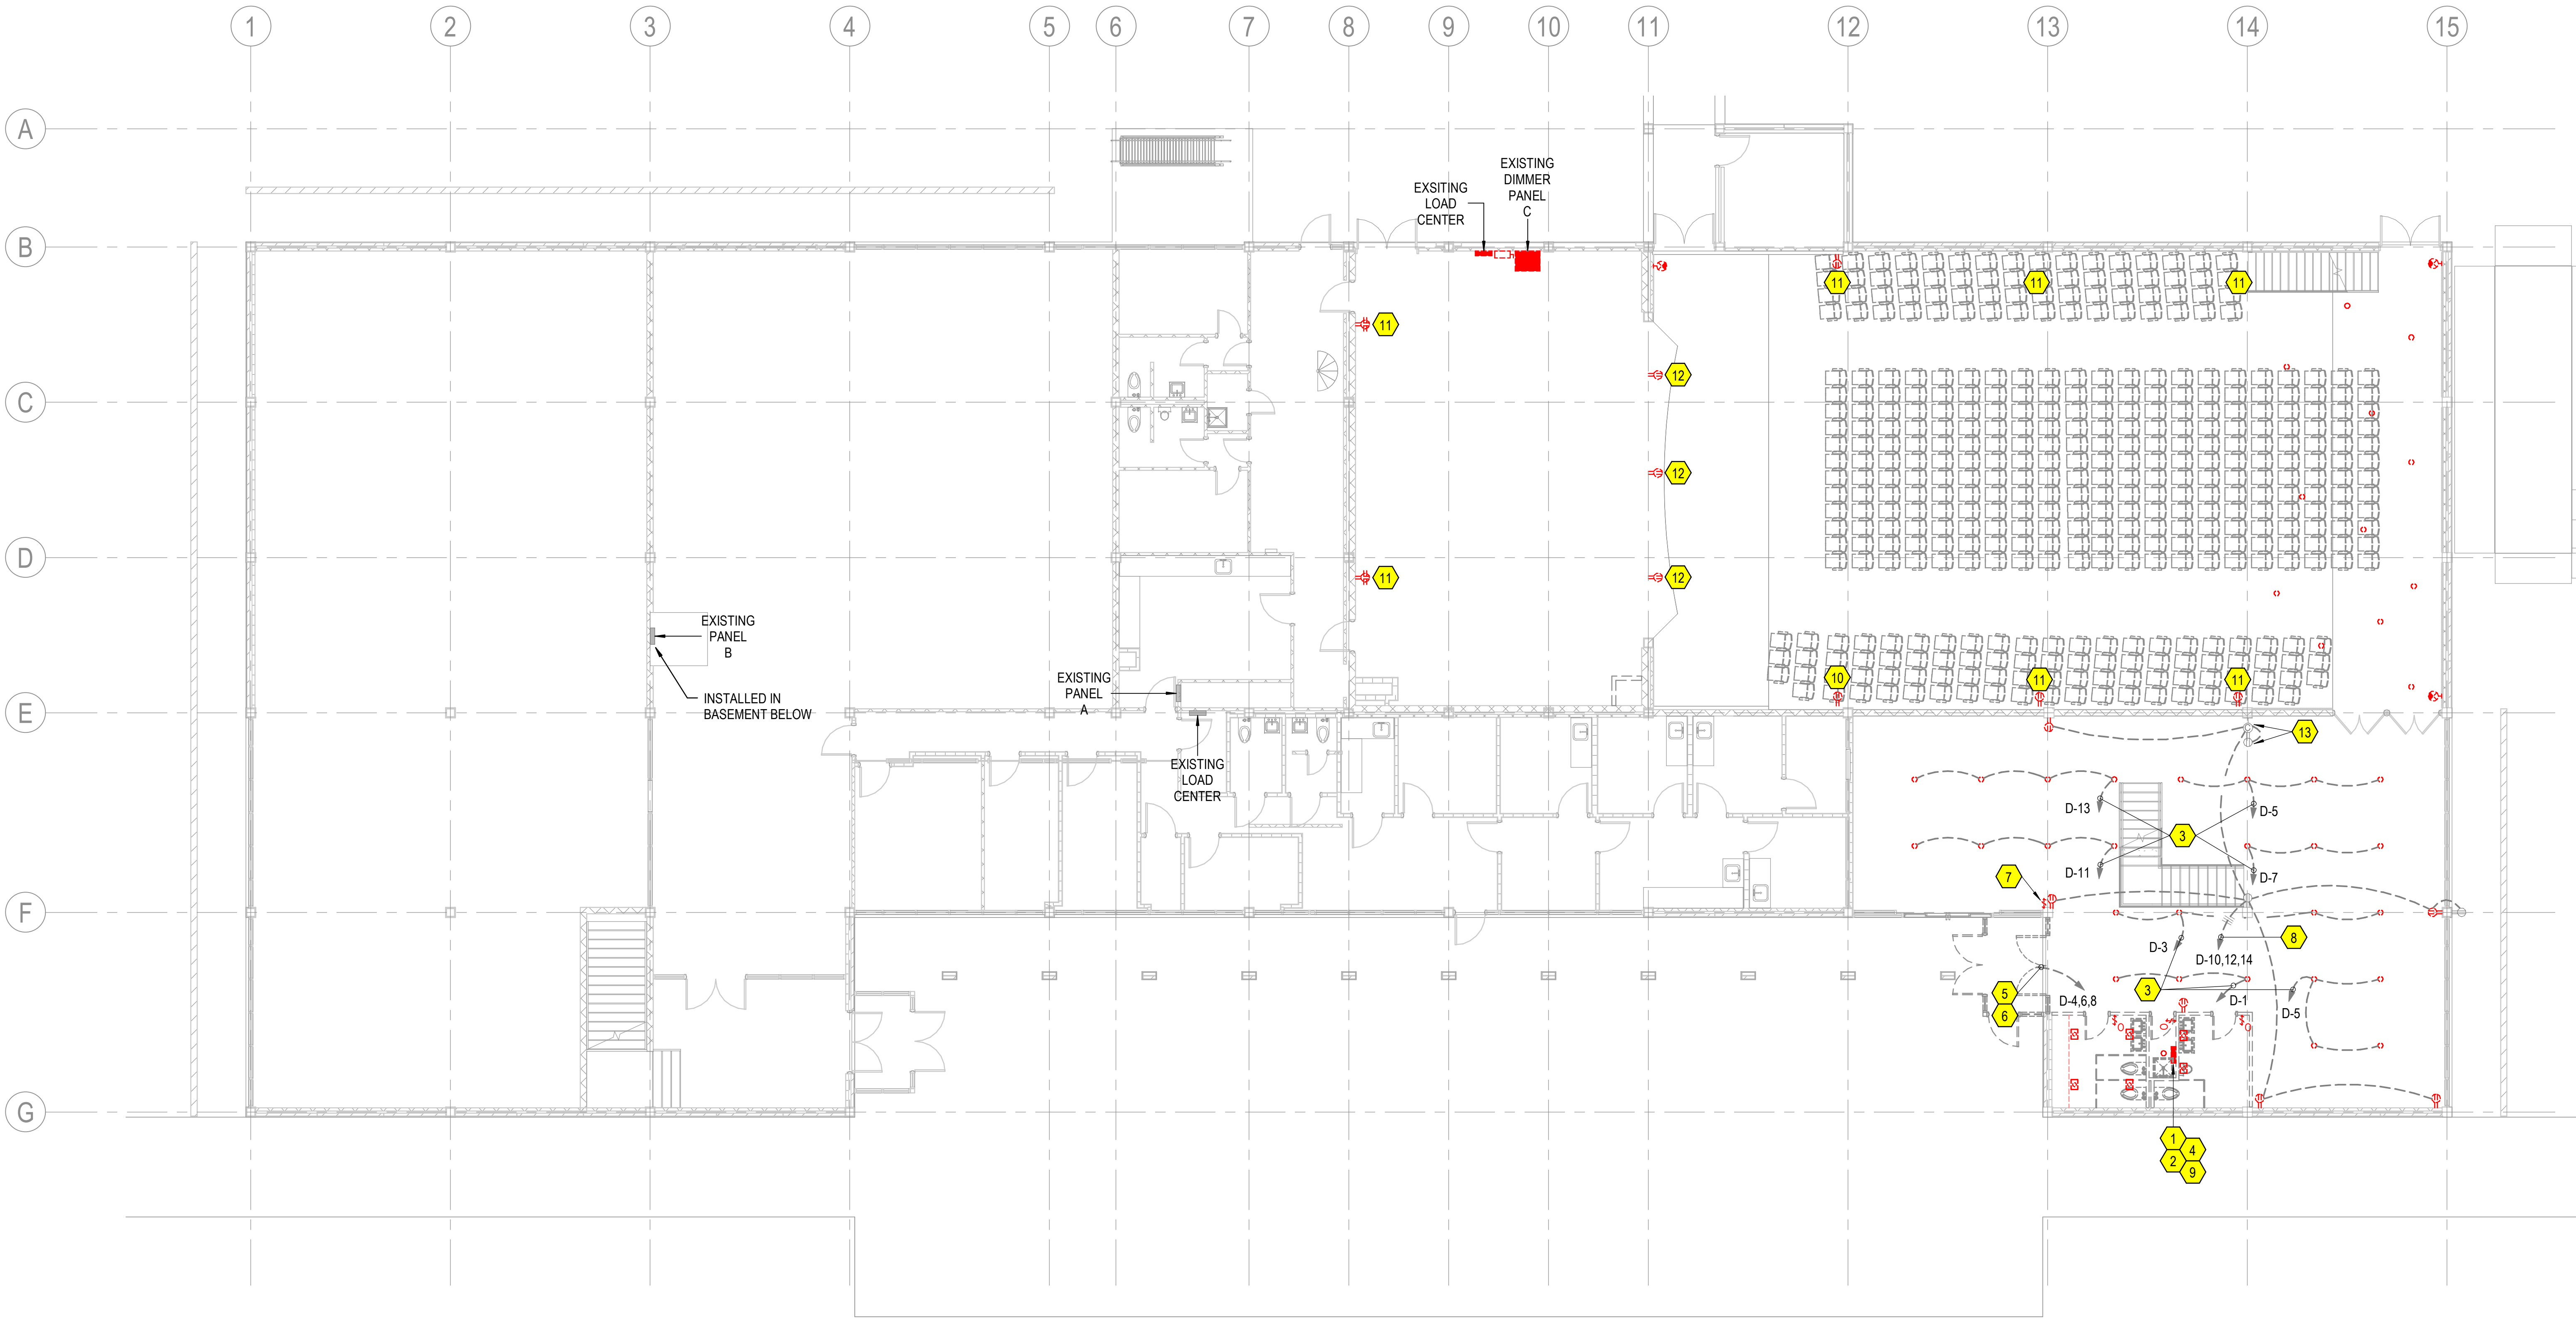

1 FIRST FLOOR ELECTRICAL DEMOLITION PLAN
1/8" = 1'-0"

NORTH
SCALE: 1/8" = 1'-0"