


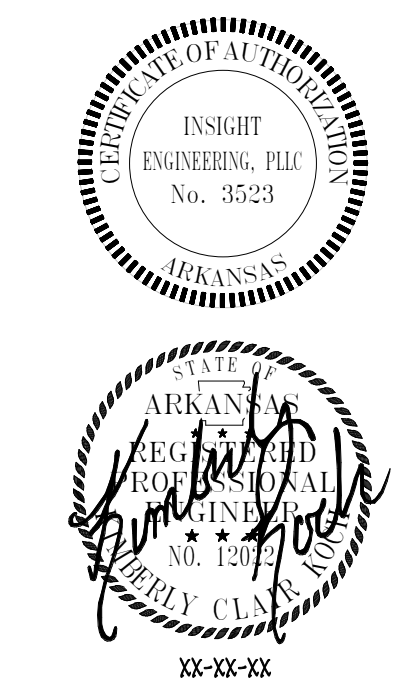

PSW Job Number:

699H

**SERVICE
CENTER
WAREHOUSE
ADDITION**

PERMIT AND BID ISSUE

Issue Date:

9/24/2026

REVISIONS		
NUMBER	DATE	DESCRIPTION

Contents:

WAREHOUSE ADDITION FIRE PROTECTION PLANS

THIS PAGE IS BEST
VIEWED IN COLOR

FP101

 1 WAREHOUSE ADDITION FIRE PROTECTION PLAN
1/8" = 1'-0"

KEYED NOTES

- TIE TOGETHER ALL DRAIN LINES IN HANGAR 12 AT EACH RISER ASSEMBLY BY THE NEW WAREHOUSE ADDITION. PROVIDE A FIRE HOSE BIBB AND FIRE HOSE AT EACH AFFECTED RISER.**
- RELOCATE THE EXISTING AIR COMPRESSOR AS REQUIRED TO ACCOMMODATE THE NEW CONSTRUCTION. COORDINATE THE FINAL LOCATION OF THE AIR COMPRESSOR WITH THE OWNER. ALL EXPOSED COMPRESSED AIR LINES SHALL BE PAINTED GREEN.**
- AT EACH AFFECTED RISER, PROVIDE A 150-FOOT-LONG, 1-1/2" FIRE HOSE AND WALL-MOUNTED HOSE REEL FOR FIRE DRAINING PURPOSES. PROVIDE A THREADED FIRE HOSE ADAPTER AT THE END OF EACH INTERCONNECTED DRAIN LINE. THE FIRE HOSE SHALL REMAIN CONNECTED TO THE SYSTEM TO ALLOW THE SYSTEM TO BE DRAINED WITHOUT DISCHARGING WATER ONTO THE FLOOR.**
- ALL WORK TO BE PERFORMED BY VSC FIRE-SECURITY, AS HIRED BY THE CONTRACTOR.**
- CONTACT: B.J. GOODEN; 501-843-6392**

GENERAL NOTES

1. ALL PIPE, DEVICES, AND INSTALLATION SHALL FULLY COMPLY WITH NFPA 13 AND ALL REQUIRED AUTHORITIES HAVING JURISDICTION
2. REFER TO THE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS. REFER TO ARCHITECTURAL DRAWINGS FOR BUILDING DETAILS
3. REFER TO ARCHITECTURAL DRAWINGS FOR GENERAL RELEVANT ITEMS SUCH AS CEILING, WALLS AND AREA OF WORK
4. PROVIDE MODIFICATIONS TO THE EXISTING FIRE SPRINKLER SYSTEM TO ACCOMMODATE RENOVATIONS TO THE EXISTING HAZARDOUS HAZARD AREA. CODE PERFORM MODIFICATIONS IN ACCORDANCE WITH ALL APPLICABLE NFPA STANDARDS, JOB SPECIFICATIONS, FM GLOBAL ELEMENTS, AND NFPA HAZARDOUS HAZARD CODE. PROVIDE NEW SPRINKLER HEADS, FITTINGS, PIPING, VALVING, SUPPLEMENTARY DEVICES, AND OTHER APPURTENANCES AS REQUIRED. FIRE PROTECTION CONTRACTOR RESPONSIBLE FOR DETERMINING THE AREA OF WORK TO DETERMINE THE SCOPE OF DEMOLITION WORK REQUIRED.
5. SPRINKLER COVERAGE NOT TO EXCEED 225 SQUARE FEET PER LIGHT EXPOSURE HAZARD CATEGORY 1 AREAS. SPRINKLER COVERAGE NOT TO EXCEED 1000 SQUARE FEET PER LIGHT OR ORDINARY HAZARD CATEGORY 2 AREAS.
6. THOROUGHLY SURVEY THE PROPERTY AND REVIEW ARCHITECTURAL, STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND HVAC DRAWINGS, EXISTING OR PLANNED, PRIOR TO BID.
7. FIRE PROTECTION SYSTEM SHALL BE COMPLETE WITH SPRINKLER PIPING AND HEADS, ELECTRONIC SUPERVISED FIRE ALARM APPURTENANCES, AS REQUIRED BY NFPA AND AUTHORITIES HAVING JURISDICTION. PIPE SIZES SHALL BE ESTABLISHED BY THE FIRE PROTECTION CONTRACTOR.
8. INTERFACE FIRE PROTECTION SYSTEM WITH THE BUILDING FIRE ALARM SYSTEM. REFER TO ELECTRICAL.
9. SEISMIC BRACING RESTRAINT IS REQUIRED FOR THIS PROJECT
10. ALL EXPOSED FIRE SPRINKLER LINES SHALL BE PAINTED RED