

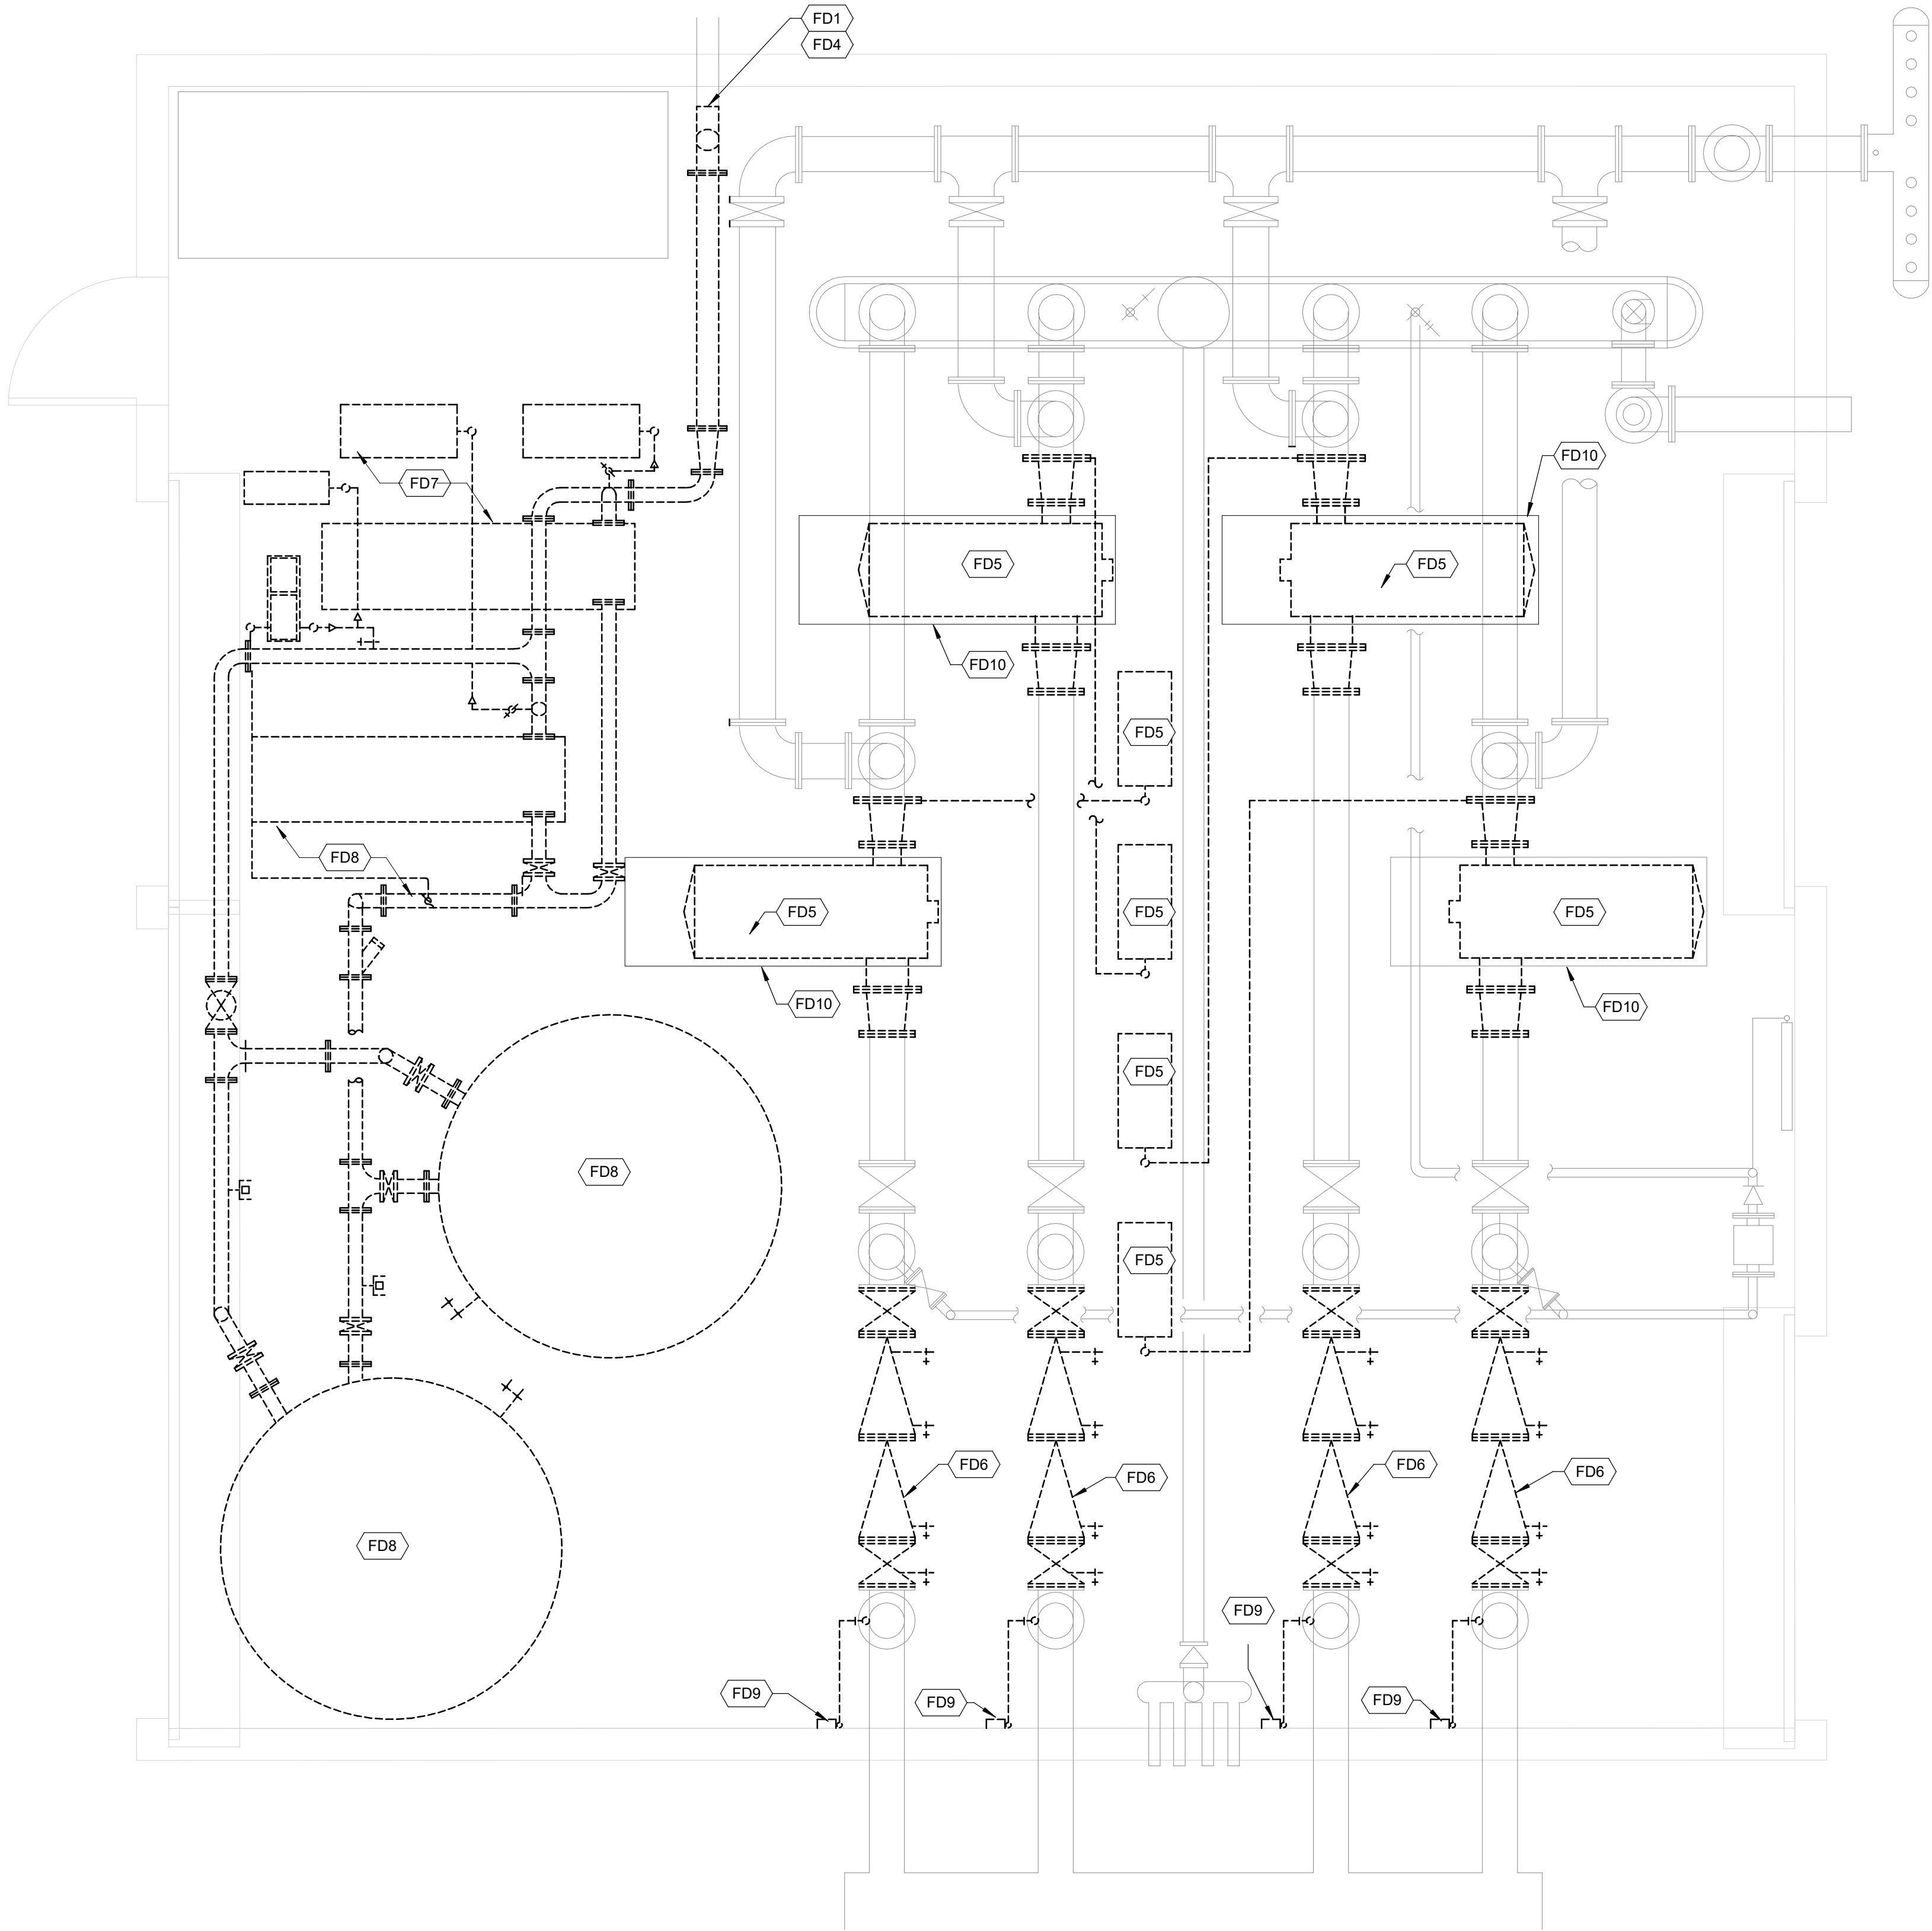
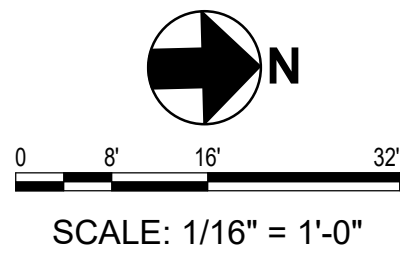


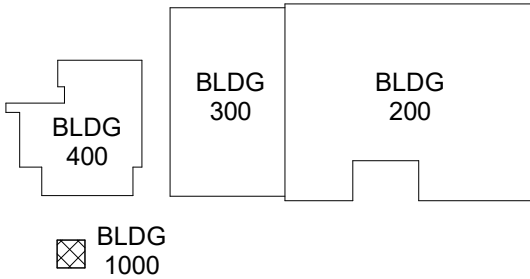

1 BUILDING 1000 FIRE SUPPRESSION DEMOLITION PLAN
SCALE: 3/8" = 1'-0"



KEYED NOTES

- FD1 FOAM CONCENTRATE PIPING AND DISPOSAL OF FOAM TO BE HANDLED UNDER A SEPARATE CONTRACT.
- FD4 CAP 6-INCH FOAM CONCENTRATE PIPE.
- FD5 REMOVE EXISTING FIRE PUMP AND CONTROLLER (150 HP, 2,500 GPM @ 65 PSI) FOR REPLACEMENT.
- FD6 REMOVE BACKFLOW PREVENTER AND SHUTOFF VALVES FOR REPLACEMENT.
- FD7 FOAM CONCENTRATE PIPING AND DISPOSAL OF FOAM TO BE HANDLED UNDER A SEPARATE CONTRACT.
- FD8 FOAM CONCENTRATE PIPING AND DISPOSAL OF FOAM TO BE HANDLED UNDER A SEPARATE CONTRACT..
- FD9 REMOVE LOW PUMP SUCTION PRESSURE CONTROLLER AND WIRING. REUSE TRIM PIPING CONNECTION TO SUCTION PIPING.
- FD10 EXISTING CONCRETE BASE FOR PUMP TO REMAIN FOR REUSE.



© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE
IDEAS AND DESIGNS CONVEYED
HEREIN, SHALL BE CONSIDERED
INSTRUMENTS OF PROFESSIONAL
SERVICE AND ARE PROPERTY OF
GARVER, LLC. ANY USE,
REPRODUCTION, OR DISTRIBUTION
OF THIS DOCUMENT, ALONG WITH
THE IDEAS AND DESIGN CONTAINED
HEREIN, IS PROHIBITED UNLESS
AUTHORIZED IN WRITING BY
GARVER, LLC OR EXPLICITLY
ALLOWED IN THE GOVERNING
PROFESSIONAL SERVICES
AGREEMENT FOR THIS WORK.



REV	DATE	DESCRIPTION	BY

BILL AND HILARY CLINTON
NATIONAL AIRPORT
LITTLE ROCK, AR 72206
LIT FIRE SUPPRESSION
IMPROVEMENTS

BLDG 1000 FIRE
SUPPRESSION DEMO
PLAN

JOB NO.: 21A10111
DATE: MAY 2025
DESIGNED BY: JCF
DRAWN BY: JCF

BAR IS ONE INCH ON
ORIGINAL DRAWING
0 8 16 32
IF NOT ONE INCH ON THIS SHEET,
ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
FX-105