


1 BUILDING 400 FIRE SUPPRESSION PLAN
SCALE: 1/16" = 1'-0"


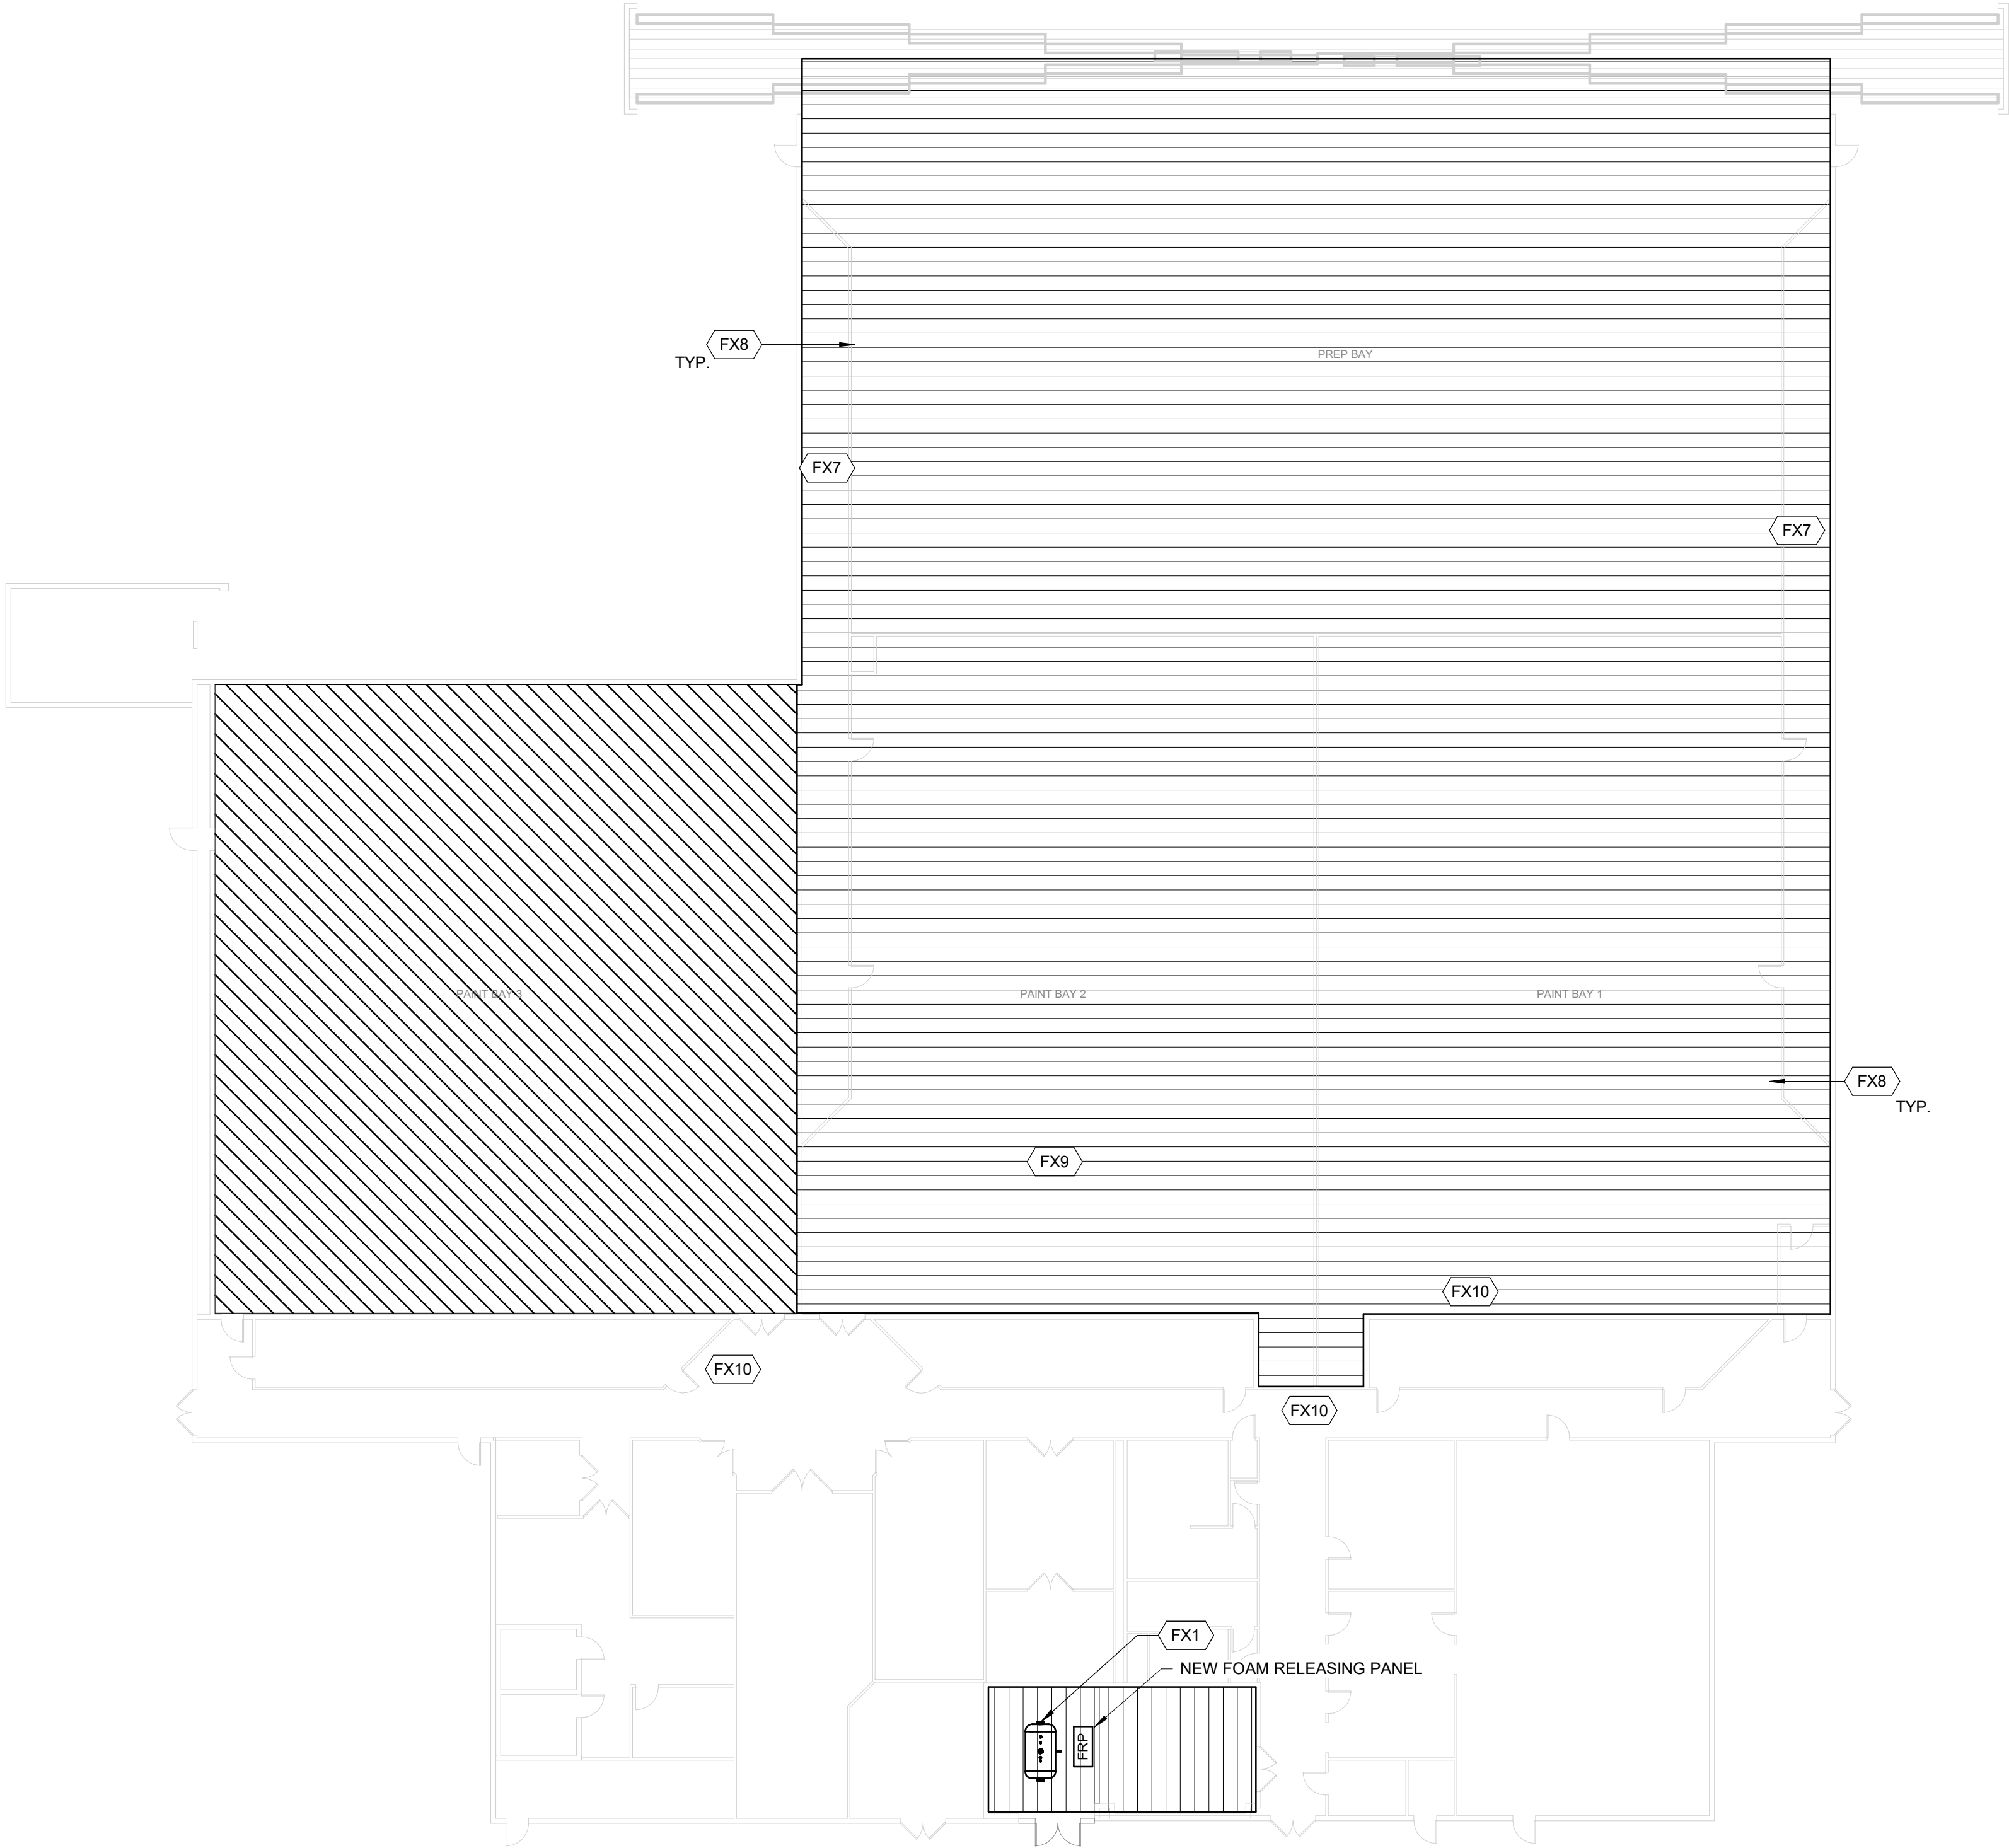


GENERAL NOTES

- EXISTING DOCUMENTATION INDICATES THE EXISTING FOAM/WATER DELUGE SYSTEM IS HYDRAULICALLY CALCULATED FOR A MINIMUM DENSITY OF 0.16 GPM/SF.
- PROVIDE THE OWNER WITH A RESERVE SUPPLY OF LOW EXPANSION FOAM CONCENTRATE EQUAL TO THE REQUIRED FOAM FIRE FLOW.

KEYED NOTES

- FX1 LOCATION FOR NEW HORIZONTAL BLADDER TANK
FX7 EXTEND SPRINKLER COVERAGE INTO UNPROTECTED
FX2 LOCATION OF MANUAL FOAM STATION
FX8 MODIFY SPRINKLER COVERAGE TO MEET CODE MINIMUM SPACING FROM WALL.
FX9 PROVIDE SPRINKLER COVERAGE ABOVE EXISTING DROP CEILING AT ROOF LINE.
FX10 LOCATION OF MANUAL FOAM STATION

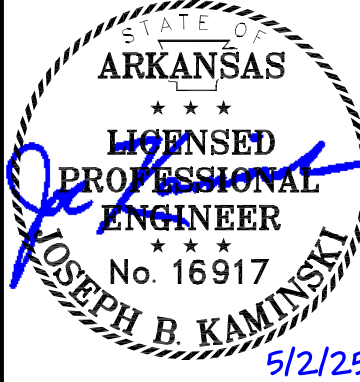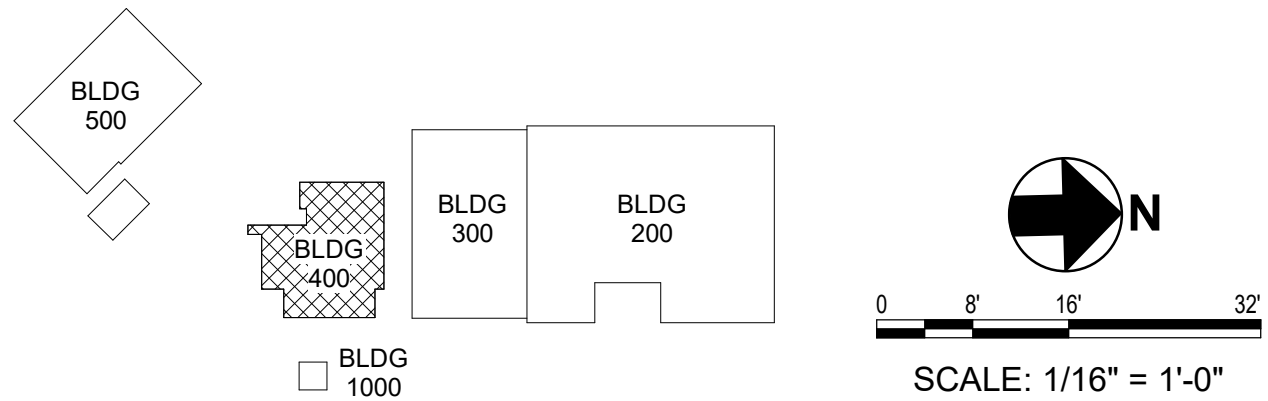

BY	
DESCRIPTION	
DATE	
REV	

BILL AND HILARY CLINTON
NATIONAL AIRPORT
LITTLE ROCK, AR 72206

LIT FIRE SUPPRESSION
IMPROVEMENTS

BLDG 400 FIRE
SUPPRESSION PLAN

JOB NO.: 21A10111
DATE: MAY 2025
DESIGNED BY: JCF
DRAWN BY: JCF

BAR IS ONE INCH ON
ORIGINAL DRAWING
0 8 16 32
IF NOT ONE INCH ON THIS SHEET,
ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
FX-203