

Digitally Signed 05/02/2025

[illegible]


NATIONAL AIRPORT
LITTLE ROCK, AR 72206

FIRE SUPPRESSION IMPROVEMENTS

ITE UTILITY
LAN

DB NO.: 21A10111
DATE: MAY 2025
DESIGNED BY: NAH
DRAWN BY: ICC


BAR IS ONE INCH ON
ORIGINAL DRAWING

0  1"

NOT ONE INCH ON THIS SHEET
JUST SCALES ACCORDINGLY

DRAWING NUMBER
GI-003



LEGEND	
— W —	DOMESTIC WATER PIPING
— FW —	FIRE WATER PIPING
— FD —	FOAM CONCENTRATE PIPING
	FIRE HYDRANT





Know what's **below**.
Call before you dig.

CAUTION: UNDERGROUND UTILITIES EXIST WITHIN AND ADJACENT TO THE LIMITS OF CONSTRUCTION. AN ATTEMPT HAS BEEN MADE TO LOCATE THESE UTILITIES ON THE PLANS. HOWEVER, ALL EXISTING UTILITIES MAY NOT BE SHOWN AND THE ACTUAL LOCATIONS OF THE UTILITIES MAY VARY FROM THE LOCATIONS SHOWN. PRIOR TO BEGINNING ANY TYPE OF EXCAVATION, THE CONTRACTOR SHALL CONTACT THE UTILITIES INVOLVED AND MAKE ARRANGEMENTS FOR THE LOCATION OF THE UTILITIES ON THE GROUND. THE CONTRACTOR SHALL MAINTAIN THE UTILITY LOCATION MARKINGS UNTIL THEY ARE NO LONGER NECESSARY.

ARKANSAS STATE LAW, THE UNDERGROUND FACILITIES DAMAGE PREVENTION ACT, REQUIRES TWO WORKING DAYS ADVANCE NOTIFICATION THROUGH THE ONE-CALL SYSTEM CENTER BEFORE EXCAVATING USING MECHANIZED EQUIPMENT OR EXPLOSIVES (EXCEPT IN THE CASE OF AN EMERGENCY). THE ONE-CALL SYSTEM PHONE NUMBER IS 1-800-482-8998. THE CONTRACTOR IS ADVISED THAT THERE IS A SEVERE PENALTY FOR NOT MAKING THIS CALL. NOT ALL UTILITY COMPANIES ARE MEMBERS OF THE ARKANSAS ONE-CALL SYSTEM; THEREFORE, THE CONTRACTOR IS ADVISED TO CONTACT ALL NON-MEMBER UTILITIES AS WELL AS THE ONE-CALL SYSTEM.

GENERAL NOTES

1. UNDERGROUND FIRE WATER PIPING AND DOMESTIC WATER PIPING IS EXISTING TO REMAIN.
2. UNDERGROUND AFFF FOAM CONCENTRATE PIPING SHALL BE CLEARED BY OTHERS, CONTRACTOR SHALL COORDINATE SCHEDULE WITH OWNER FOR REMOVAL OF AFFF CONCENTRATE AT COMPLETION OF EACH HANGAR SUPPRESSION SYSTEM AND RELATED MODIFICATIONS.

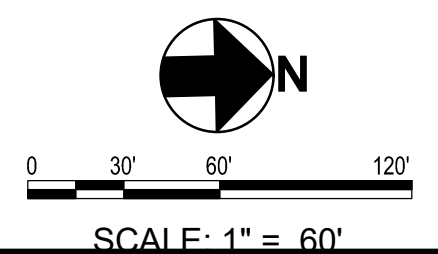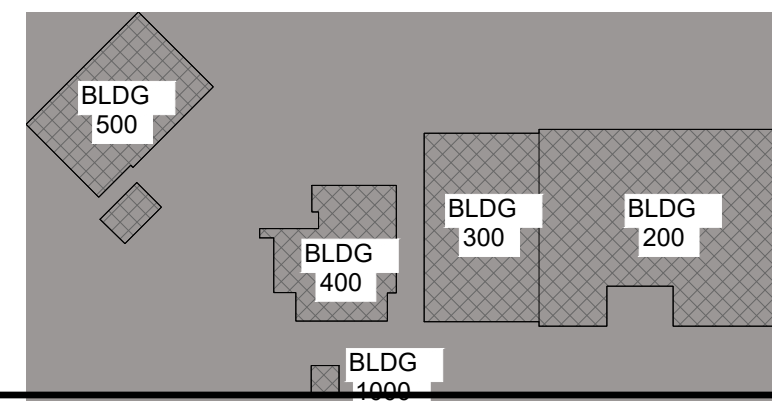

PRINTING NOTE: SHEET SHOULD BE PRINTED IN COLOR