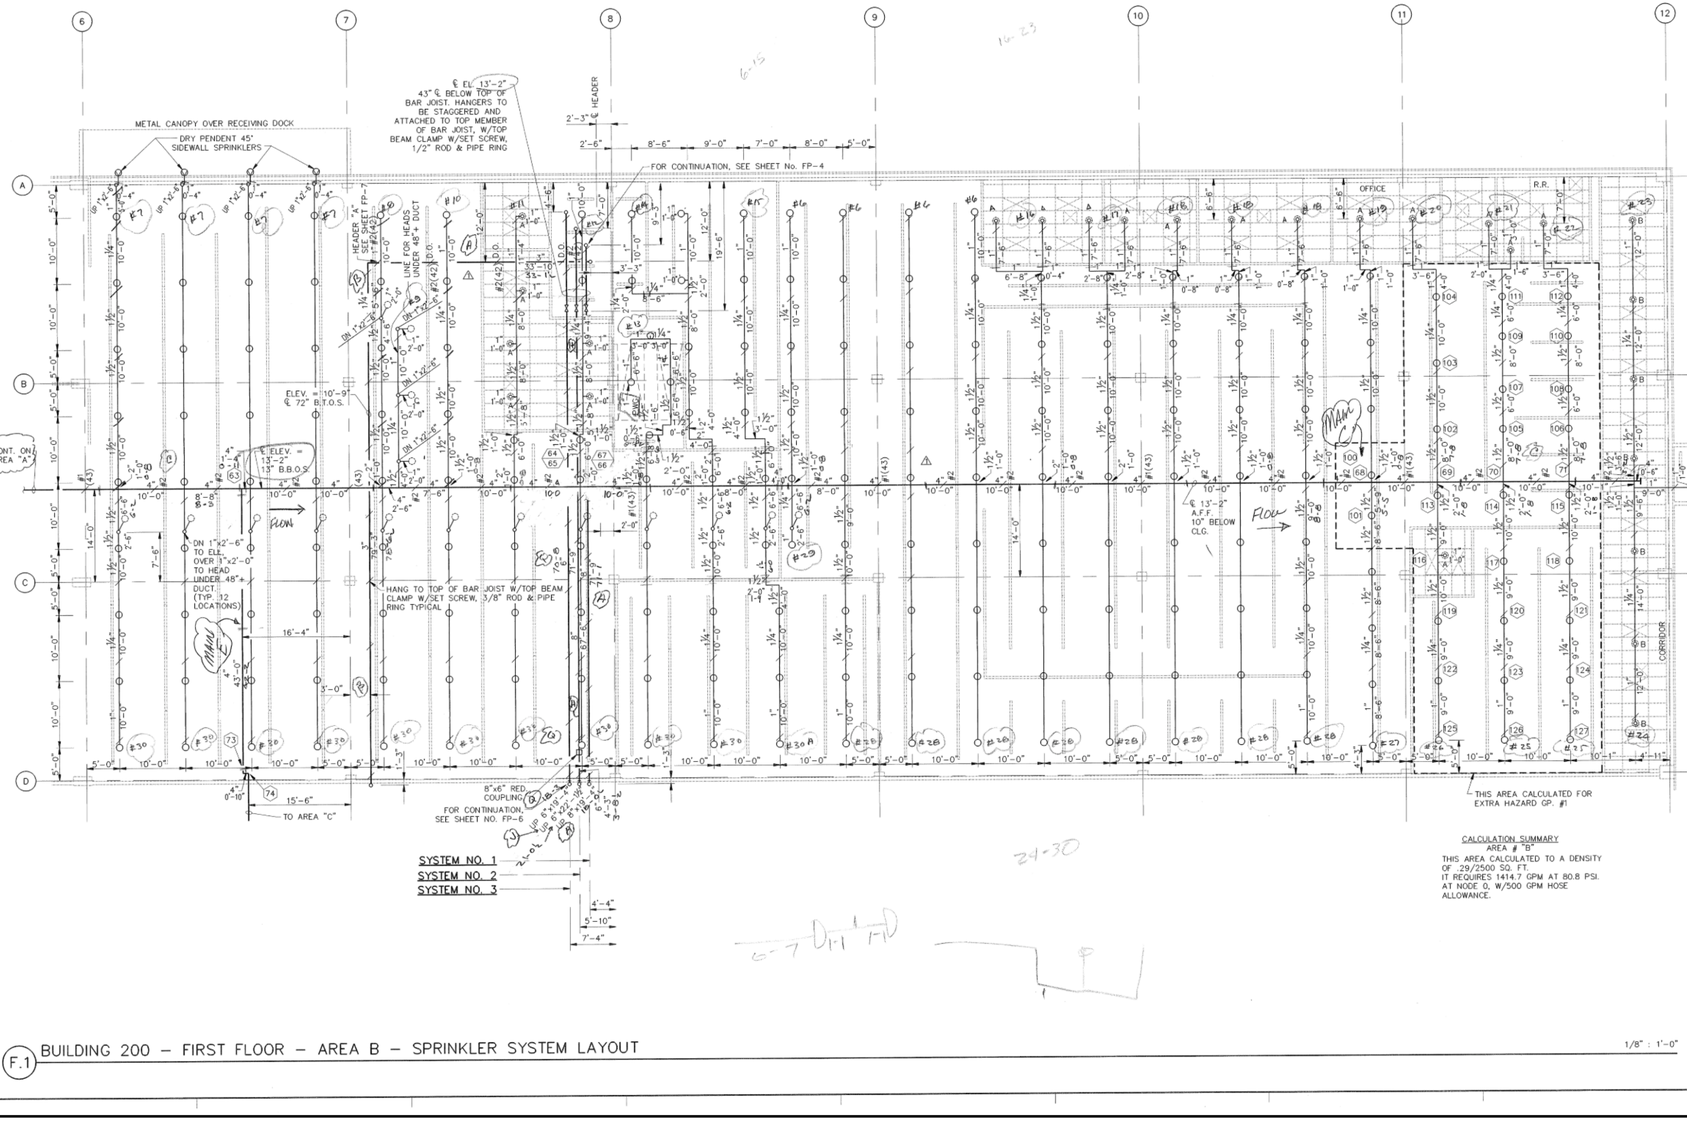

SYM.	SPRINKLER DESCRIPTION	QTY.
◎	1/2" ORIFICE CHROME PENDENT,165°, WITH 1/8" CHROME ESCUTCHEON.K=5.6	26
○	1/2" ORIFICE BUSS,165°K=5.6	221
◎	1/2" ORIFICE DRY PEND. HORZ. S.W. 45°	4

F.1 BUILDING 200 – FIRST FLOOR – AREA B – SPRINKLER SYSTEM LAYOUT

1/8" : 1'-0"

ISSUE FOR CONSTR. 12-18-90

⚠	REVISION	DWN.	APP.	DATE
	ADDED HANGER NOTATIONS	MBD	RLH	12/18/90

BUILDING 200
FIRST FLOOR – AREA B
SPRINKLER SYSTEM LAYOUT

Arkansas Modification Center
LITTLE ROCK, ARKANSAS

ARKMOD

CORPORATE REGISTRATION
GARVER P.A. #23
ARKANSAS KENTUCKY

STATE OF ARKANSAS REGISTERED PROFESSIONAL ENGINEER RICHARD L. HALL No.4193

Garver + Garver, P.A.
Little Rock, Arkansas

	BY	DATE
DESIGNED	MTA	30 NOV 90
DRAWN	JBM	10 DEC 90
CHECKED	RLH	11 DEC 90

SCALE: 1/8" = 1'-0"
SHEET NO. FP-8 of 17

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

FOR REFERENCE ONLY

REV	DATE	DESCRIPTION	BY

BILL AND HILARY CLINTON NATIONAL AIRPORT
LITTLE ROCK, AR 72206

LIT FIRE SUPPRESSION IMPROVEMENTS

BLDG 200
REFERENCE
DRAWING

JOB NO.: 21A10111
DATE: MAY 2025
DESIGNED BY: JCF
DRAWN BY: JCF

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
R-05

Revit File: Autodesk Docs://21A10111 - LIT Fire Suppression Improvements/21A10111 - LIT Fire Suppression Improvements - R23.rvt
Plot Date: 5/2/2025 2:42:08 PM
Autodesk Revit 2023