



CDI CONTRACTORS CDI Contractors, LLC
 3000 Cantrell Road
 Little Rock, Arkansas 72202
 501 / 666-4300

Transmittal
No 2024.11.11-7

PROJECT: UAMS- CAMID

DATE: Nov 11, 2024

To: UAMS
 4301 W MARKHAM ST. SLOT 545
 LITTLE ROCK AR 72205
 US

RE: 233423 - Dryer Fan

ATTN: TAMARA BARRON

JOB: 240147

WE ARE SENDING:		SUBMITTED FOR:		ACTION TAKEN:	
<input type="checkbox"/>	Shop Drawings	<input checked="" type="checkbox"/>	Approval	<input type="checkbox"/>	Approved as Submitted
<input type="checkbox"/>	Letter	<input type="checkbox"/>	Your Use	<input type="checkbox"/>	Approved as Noted
<input type="checkbox"/>	Prints	<input type="checkbox"/>	As Requested	<input type="checkbox"/>	Returned After Loan
<input type="checkbox"/>	Change Order	<input type="checkbox"/>	Review and Comment	<input type="checkbox"/>	Resubmit
<input type="checkbox"/>	Plans	<input type="checkbox"/>		<input type="checkbox"/>	Submit
<input type="checkbox"/>	Samples	SENT VIA:		<input type="checkbox"/>	Returned
<input type="checkbox"/>	Specifications	<input type="checkbox"/>	Attached	<input type="checkbox"/>	Separate Cover
<input type="checkbox"/>	Other:	<input type="checkbox"/>		<input type="checkbox"/>	Returned for Corrections
<input type="checkbox"/>	Other:	<input type="checkbox"/>		<input type="checkbox"/>	Due
<input checked="" type="checkbox"/>	Submittal:	<input type="checkbox"/>		<input type="checkbox"/>	Other:

Line	Item	Package	Code	Rev.	QTY	Date	Description	Status
1	Submittal		233423-04	1		Nov 11, 2024	PD:DF - 1	Submitted

REMARKS:

CC:

CLARK & ENERSEN, Mark Huettner

Signed: _____

MATTHEW HUGHES



CDI CONTRACTORS, LLC

APPROVED AS NOTED
 REJECTED
 APPROVED
 REVISE

BY hughem **DATE** 11/11/2024
SUBMITTAL# 233423-04 **SPEC** 233423

This submittal has been reviewed for compliance with the contract documents. Approval does not relieve the subcontractor/supplier of the responsibility for conformance to the quality standards as set forth in the contract document, nor does it relieve the responsibility for field verification of all conditions relating to this contract.

Quality People. Building Solutions.

Comfort Systems USA (Arkansas), Inc.
P.O. Box 16620
Little Rock, AR 72231
Phone 501-834-3320
Fax 501-834-5416

Date: 10/18/2024
Return Request: 11/1/2024
Project: UAMS (CAMID)
Supplier: Airetech
Manufacturer: Fantech
Submittal: Dryer Fan
Submittal Number: 23 00 00-02
Drawing # and Installation: Mechanical Drawings

ARCHITECT

Clark Kenersen
2020 Baltimore Avenue, Suite 300
Kansas City, MO 64108
816-474-8237

ENGINEER

Clark Kenersen
2020 Baltimore Avenue, Suite 300
Kansas City, MO 64108
816-474-8237

GENERAL CONTRACTOR

CDI Contractors
3000 Cantrell Rd.
Little Rock, AR 72202
501-666-4300

MECHANICAL SUBCONTRACTOR

Comfort Systems USA (Arkansas), Inc.
9924 Landers Rd.
N. Little Rock, AR 72117
501-834-3320

Notes:

***Plan Page M8.04**

- | | |
|----------------------------------------------|--------------------------------------------------------|
| <input type="checkbox"/> REVIEWED | <input checked="" type="checkbox"/> REVIEWED AND NOTED |
| <input type="checkbox"/> REVISE AND RESUBMIT | <input type="checkbox"/> REJECTED |

Corrections or comments made on the shop drawings during this review do not relieve contractor from compliance with requirements of the drawings and specifications. This check is only for review of general conformance with design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and correlating all quantities and dimensions; selecting fabrication process and techniques of construction; coordinating their work with that of all other trades; and performing their work in a safe and satisfactory manner.

CLARK & ENERSEN

By csharp Date 12/17/2024

SUSA PROJECT NO.

22-6069

an@comfortar.com

9924 Landers Rd.
No. Little Rock, AR 72117



SUBMITTAL DATA

EQUIPMENT: Fantech Dryer Fan

TAGS: DF-1

PROJECT: UAMS CAMID
325 Jack Stephens Dr.
LOCATION: Little Rock, Arkansas

ENGINEER: James R. Beecher

CONTRACTOR: The logo for Comfort Systems USA Arkansas features the words 'COMFORT SYSTEMS' in a bold, black, sans-serif font, followed by 'USA' in a larger, bold, red and blue font. Below this, the word 'ARKANSAS' is written in a smaller, black, sans-serif font.

DATE: 9/3/2024


SUBMITTED BY: Forrest Moseley
forrest@airetechcorp.com

DEDPV-705

Dryer Exhaust Fan

STANDARD FEATURES

- Dryer Exhaust Duct Power Ventilator (DEDPV)
- Pressure-sensing switch automatically turns on the fan
- LED indicator display panel & temperature limit switch
- Short duct junctions and qty (4) 4" fast clamps for easy installation and maintenance
- Performance certified by HVI
- Safety certified by UL to the DEDPV supplement to UL705
- Safety certified by UL to CSA C22.2 No. 113
- Five-year factory warranty

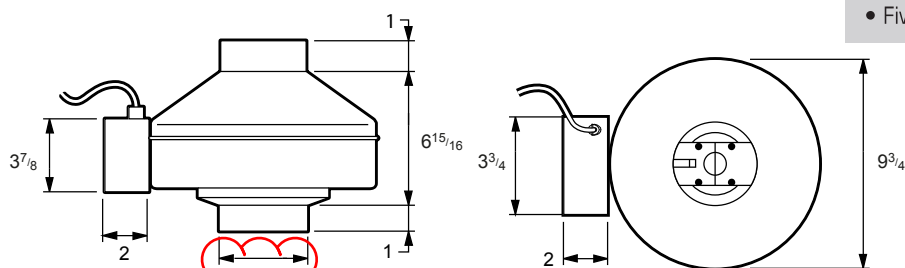

Model	Metal Gauge	Weight
DEDPV-705	22	10

CDI: A/E please confirm ok.

CLARK & ENERSEN:
ACCEPTABLE, COORDINATE DUCT CONNECTION TO TRANSITION TO INSIDE OF 3 7/8" FAN CONNECTION TO PREVENT LINT BUILDUP.

All dimensions in inches. Weights in pounds.

Fan Specifications							Motor Specifications					
Line	Qty	Model No.	Tag	CFM	SP	Fan RPM	Watts	Volts	Phase	Hertz	Encl	
1	1	DEDPV-705	DF-1	125	0.2	1,100		115	1	60		
2												
3												
4												

Accessory Items	1	2	3	4	Accessory Items	1	2	3	4

Project: UAMS CAMID Submitted: AIRETECH CORPORATION
 Customer: COMFORT SYSTEMS Approved: _____
 Location: LITTLE ROCK, ARKANSAS