

DOOR SCHEDULE											
DOOR NO.	DOOR WIDTH	DOOR HEIGHT	PANEL TYPE	PANEL MATERIAL	PANEL FINISH	FRAME TYPE	FRAME MATERIAL	FRAME FINISH	FIRE RATING	HARDWARE SET	COMMENTS
100A	3'-0"	7'-0"	NL	HM	PT	A	HM	PT	-	1	1, 2, 5, 6
100B	12'-0"	16'-0"	OH	STL	FF	-	STL	GALV	-	-	5, 9
100C	3'-0"	7'-0"	NL	HM	PT	A	HM	PT	-	1	1, 2, 5, 6
100D	3'-0"	7'-0"	NL	HM	PT	A	HM	PT	-	1	1, 2, 5, 6
103	3'-0"	7'-0"	NL	HM	PT	A	HM	PT	-	4	5
104A	3'-0"	7'-0"	NL	HM	PT	A	HM	PT	-	1	1, 2, 5, 6
104B	6'-0"	7'-0"	NL2	HM	PT	B	HM	PT	-	5	5, 7
105	3'-0"	7'-0"	F	HM	PT	A	HM	PT	-	3	-
106	3'-0"	7'-0"	F	HM	PT	A	HM	PT	-	3	-
107	3'-0"	7'-0"	NL	HM	PT	A	HM	PT	-	2	-


DOOR SCHEDULE COMMENTS

- PANIC BAR EXIT DEVICE
- ELECTRONIC STRIKE FOR CARD READER
- FIRE RATED DOOR, FRAME, HARDWARE
- GLAZING AT FIRE RATED DOOR LIMITED TO 100 SQ IN MAX
- INSULATED DOOR AND/OR FRAME
- INSULATED SAFETY GLASS
- GLAZING ON ACTIVE LEAF
- REMOVABLE MULLION AND TRANSOM PANEL (FIRE RATED)
- MOTORIZED


DOOR SCHEDULE ABBREVIATIONS

HM	HOLLOW METAL
PT	PAINT-COLOR TO BE DETERMINED
FF	FACTORY FINISH
HM	INSULATED HOLLOW METAL
STL	STEEL
GALV	GALVANIZED

NOTE: PROVIDE SAFETY GLAZING AS REQUIRED, TYPICAL

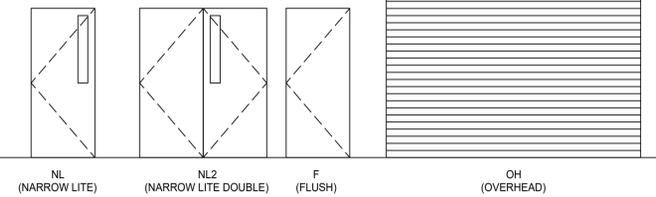

DOOR TYPES

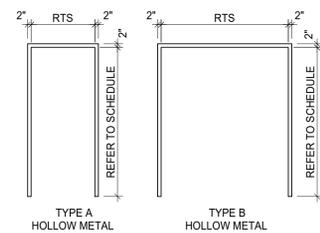

DOOR FRAME TYPES

SET 1: SINGLE EXTERIOR	
#	DESCRIPTION
3	HINGES
1	EXIT DEVICE W/ LEVER-STOREROOM
1	DOOR CLOSER
1	KICKPLATE
1	THRESHOLD
1	RAIN GUARD
1	WEATHERSTRIP
1	SWEEP

SET 2: SINGLE INTERIOR- PASSAGE	
#	DESCRIPTION
3	HINGES
1	LEVER SET- PASSAGE
1	DOOR CLOSER
1	KICKPLATE
1	GASKETING
1	DOOR STOP

SET 3: SINGLE INTERIOR- PRIVACY	
#	DESCRIPTION
3	HINGES (HEAVYWEIGHT)
1	PRIVACY LOCK
1	DOOR CLOSER
1	KICKPLATE
1	GASKETING
1	DOOR STOP

SET 4: SINGLE INTERIOR- STOREROOM	
#	DESCRIPTION
3	HINGES
1	LEVERSET- STOREROOM
1	ELECTRONIC STRIKE FOR CARD READER
1	DOOR CLOSER
1	KICKPLATE
1	GASKETING
1	DOOR STOP

SET 5: DOUBLE INTERIOR- PASSAGE	
#	DESCRIPTION
6	HINGES (3 EA LEAF)
1	LEVERSET- PASSAGE
2	DOOR CLOSER/HOLD
1	COORDINATOR
1	ASTRAGAL (ACTIVE LEAF)
1	TOP AND BOTTOM FLUSH BOLTS (INACTIVE LEAF)
1	DUSTPROOF STRIKES (INACTIVE LEAF)
2	KICKPLATE
1	GASKETING
2	DOOR STOP
2	SWEEP

DOOR SCHEDULE NOTES

- ALL DOOR LOCKSETS / PASSAGE SETS SHALL BE OF THE LEVER HANDLE TYPE. HARDWARE SHALL BE MOUNTED NO HIGHER THAN 48" ABOVE FINISHED FLOOR (MOUNTED BETWEEN 44" TO 48"). MAXIMUM PULL FORCES FOR INTERIOR DOORS TO BE 5.0 LBS FORCE. MAXIMUM PULL FORCES FOR EXTERIOR DOORS TO BE 15.0 LBS FORCE.
- VERIFY ALL ROUGH OPENING SIZES AND REQUIREMENTS WITH DOOR MANUFACTURER.
- HOLLOW METAL DOOR FRAMES IN CMU WALLS SHALL BE GROUTED SOLID. COAT INTERIOR OF FRAME WITH WATERPROOFING EMULSION PRIOR TO GROUTING.
- THE EXTERIOR SIDE OF ALL HOLLOW METAL DOOR FRAMES AND DOORS SHALL BE PAINTED SEMI-GLOSS.
- LOCKSETS SHALL BE PROVIDED WITH REMOVABLE CONSTRUCTION CORE CYLINDERS SUPPLIED BY HARDWARE MANUFACTURER. CONTRACTOR SHALL PROVIDE AND INSTALL PERMANENT CORE CYLINDERS FOR MASTER KEYING AT THE COMPLETION OF THE PROJECT. COORDINATE KEYING SCHEDULE WITH OWNER.
- ALL HARDWARE TO COMPLY WITH THE LATEST REQUIREMENTS OF ADA/ANSI.
- SAFETY TEMPERED GLAZING AS REQUIRED PER CODE, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:
 - GLAZING IN DOORS
 - GLAZING ADJACENT & WITHIN 24" ARC OF DOOR AND LESS THAN 60" A.F.F.
 - GLAZING IN FIXED PANELS AND MORE THAN 9 S.F., WITH THE LOWEST EDGE LESS THAN 18" A.F.F. AND WITH THE TOP EDGE MORE THAN 36" A.F.F. AND WITHIN 36" OF A WALKING SURFACE.
- EXTERIOR SWINGING DOORS WITH LESS THAN 50% GLAZING SHALL HAVE A MAXIMUM U-VALUE OF 0.70.
- EXTERIOR OH DOORS SHALL HAVE MAXIMUM U-VALUE OF 1.45.

ROOM FINISH SCHEDULE												
ROOM NO.	ROOM NAME	FLOOR	WALLS								CEILING	COMMENTS
			NORTH		EAST		SOUTH		WEST			
			MATERIAL	FINISH	MATERIAL	FINISH	MATERIAL	FINISH	MATERIAL	FINISH		
100	MAINTENANCE BAY/CRANE BAY	CONC/EPX	PEMB/LP	FF	PEMB/LP	FF	CMU/GYP	PT	PEMB/LP	FF	ES	1
103	OFFICE	CONC/SC	CMU/GYP	PT	CMU/GYP	PT	PEMB/LP	FF	PEMB/LP	FF	ACT	1
104	OFFICE AREA/BREAK AREA	CONC/SC	CMU/GYP	PT	CMU/GYP	PT	PEMB/LP	FF	CMU/GYP	PT	ACT	1
105	TOILET-1	CONC/SC	CMU	PT	CMU	PT	PEMB/LP	FF	CMU/GYP	PT	GWB/PT	
106	TOILET-2	CONC/SC	CMU/GYP	PT	CMU	PT	CMU	PT	CMU/GYP	PT	GWB/PT	
107	UTILITY ROOM	CONC/SC	CMU/GYP	PT	PEMB/LP	FF	PEMB/LP	FF	CMU	PT	ES	

ROOM FINISH SCHEDULE NOTES

- PEMB STRUCTURE AND ALL SECONDARY FRAMING TO BE FACTORY PRIMED
- PAINT ACCESS PANELS TO MATCH ADJACENT SURFACE
- FINISH MATERIALS AND COLOR SELECTION BY OWNER

ROOM FINISH SCHEDULE ABBREVIATIONS



ACT	ACOUSTIC CEILING TILE
CMU	CONCRETE MASONRY UNIT
GWB	GYPSUM WALL BOARD
PT	PAINT
LP	LINER PANEL (8'-0" HIGH)
ES	EXPOSED TO STRUCTURE
EPX	EPOXY COATING
FT	FLOOR TILE
FF	FACTORY FINISH
SC	SEALED CONCRETE

ROOM FINISH SCHEDULE COMMENTS


- SOUND ATTENUATION BATT INSULATION AT WALL BETWEEN OFFICE AREA AND MAINT. BAY, REFER TO WALL TYPES

TOILET ACCESSORIES SCHEDULE

- STAINLESS STEEL FIXT TILT MIRROR - BRADLEY MODEL 740-2 (OR EQUAL) WITH SHELF - BRADLEY MODEL 758-36, (OR EQUAL)
- TOILET PAPER HOLDER - BRADLEY MODEL 5402, (OR EQUAL)
- ADA COMPLIANT GRAB BARS - BRADLEY 812 - 7, (OR EQUAL)
- ADA COMPLIANT PROTECTIVE SUPPLY AND DRAIN GUARDS, TURBO (OR EQUAL)
- PAPER TOWEL DISPENSER - BRADLEY MODEL 2482-110000 (OR EQUAL)

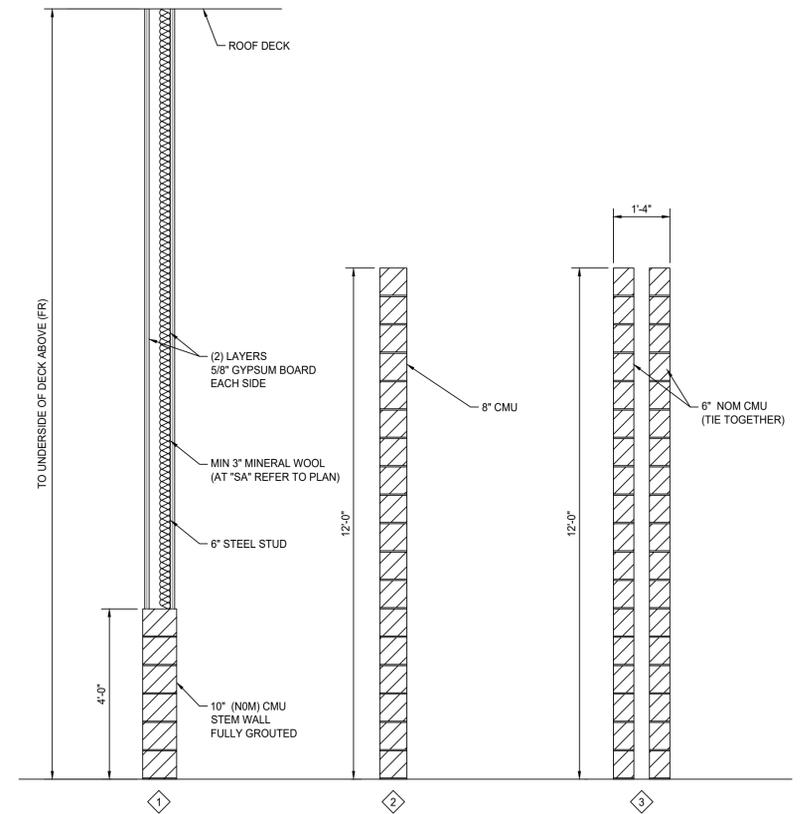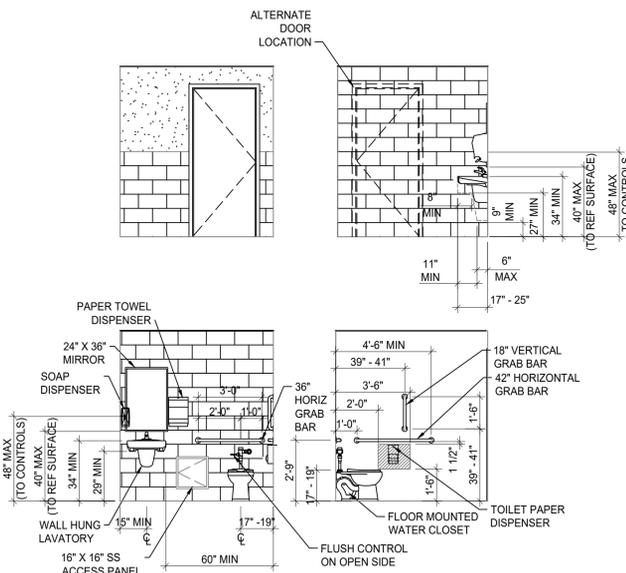

NOTES:
FR = 2-HOUR RATED (UL #U419)
SA = SOUND ATTENUATION

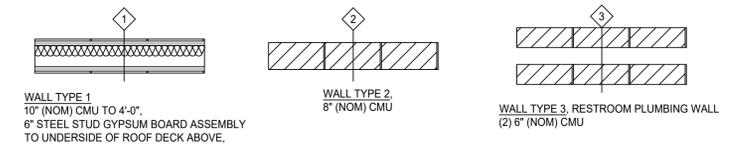

1 WALL TYPES
SCALE: 1/2" = 1'-0"

REVISIONS			PRELIMINARY, NOT FOR CONSTRUCTION, RECORDING PURPOSES, OR IMPLEMENTATION	 Power Engineers Inc. - Arkansas State Certificate of Registration # 645 PROJECT LOCATION: 6006 LOCK AND DAM ROAD OZARK, FRANKLIN CO., ARKANSAS SAM BORMAN, LIC # 10136	 FITZHUGH GENERATING STATION ARCHITECTURAL DOOR SCHEDULE AND TYPES, HARDWARE SETS, DOOR NOTES, INT. ELEVATIONS, WALL TYPES, FINISH SCHEDULE AND NOTES
NO.	DATE	DESCRIPTION			
C	07/23/25	ISSUED FOR REVIEW			
D	06/16/25	ISSUED FOR REVIEW			
B	05/28/25	ISSUED FOR REVIEW			
A	03/05/25	ISSUED FOR REVIEW			

DRAWN BY: D. SILVERTHORNE	APPD: S. BUFFINGTON	POWER ENGINEERS INC.	DWG. NO.: 34001-A6-0-1
CHECKED: J. LUDEWG	DATE: 03/05/25	REV. NO.: D	SH. NO.: 1
		SCALE: 3/16" = 1'-0"	CTN. ON SH.: 1