


1 POWER PLAN
1/4" = 1'-0"



## **KEYED NOTES:**


- NEW PANELBOARDS TO BE NAMED FOLLOWING EXISTING AEROJET NOMENCLATURE.
- CONNECT TO RECEPTACLE CIRCUIT THIS AREA WITH AVAILABLE CAPACITY. IF NO CIRCUIT AVAILABLE, PROVIDE NEW 1 POLE, 20 AMP CIRCUIT TO EXISTING PANEL WHICH SERVES THIS AREA.
- JUNCTION BOX POWERS FIRE ALARM CONTROL PANEL. COORDINATE EXACT LOCATION WITH THIS INSTALLER.
- 4 LIGHTING CONTROL PANEL. SEE DETAIL 2, SHEET EL101.
- JUNCTION BOX TO POWER EWH-1 LOCATED BELOW SINK. COORDINATE EXACT LOCATION WITH PLUMBING.
- DISCONNECT POWERS EWH-2 WATER HEATER. COORDINATE EXACT LOCATION WITH INSTALLER.

## **GENERAL NOTES:**

- LOCATIONS INDICATED IN DRAWINGS ARE APPROXIMATE. COORDINATE WITH INSTALLER ON EXACT LOCATIONS.
- CONTRACTOR SHALL WIRE EQUIPMENT PER MANUFACTURER INSTRUCTIONS. ALL WIRING AND CONNECTIONS SHALL BE PER MANUFACTURER'S RECOMMENDATIONS.
- COORDINATE ALL CONDUIT LOCATIONS WITH OTHER DISCIPLINES.
- POWER INDICATED ON PLANS IS BASED ON BASIS OF DESIGN. IF DIFFERENT EQUIPMENT IS USED CONTRACTOR SHALL PROVIDE POWER PER MANUFACTURER'S RECOMMENDATIONS AT NO EXTRA





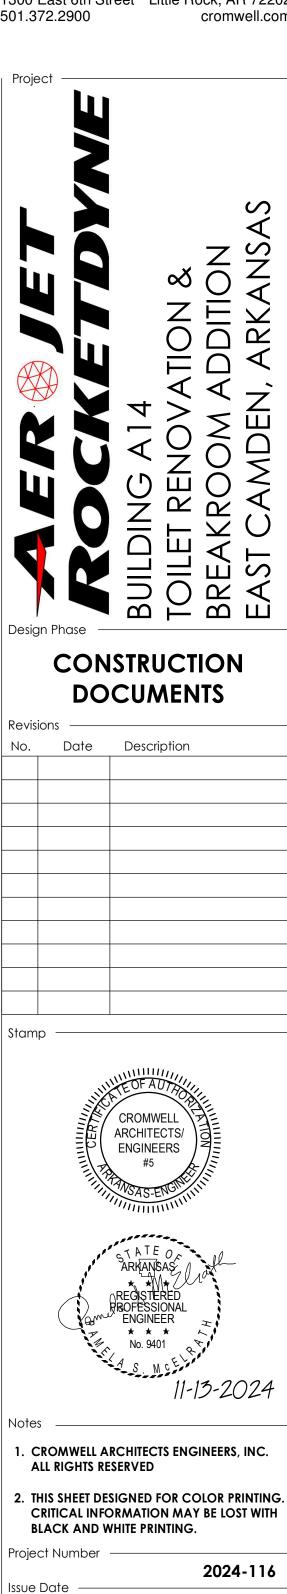

2024-116

11-13-2024

POWER PLAN

Sheet Title

Sheet Number -