

1. INSULATION TO BE CONTINUOUS THROUGH HANGERS. DO NOT BREAK INSULATION


. INSULATION JACKET TO BE CONTINUOUS THROUGH PIPE SUPPORT COMPONENTS.

3. USE CLEVIS HANGERS FOR SINGLE PIPE RUNS, USE TRAPEZE HANGERS TO GROUP


AT SUPPORTS, DO NOT INSULATE AROUND HANGERS.


AS MUCH PIPING AS POSSIBLE PER HANGER.


1 ADJUSTABLE CLEVIS HANGER
NOT TO SCALE

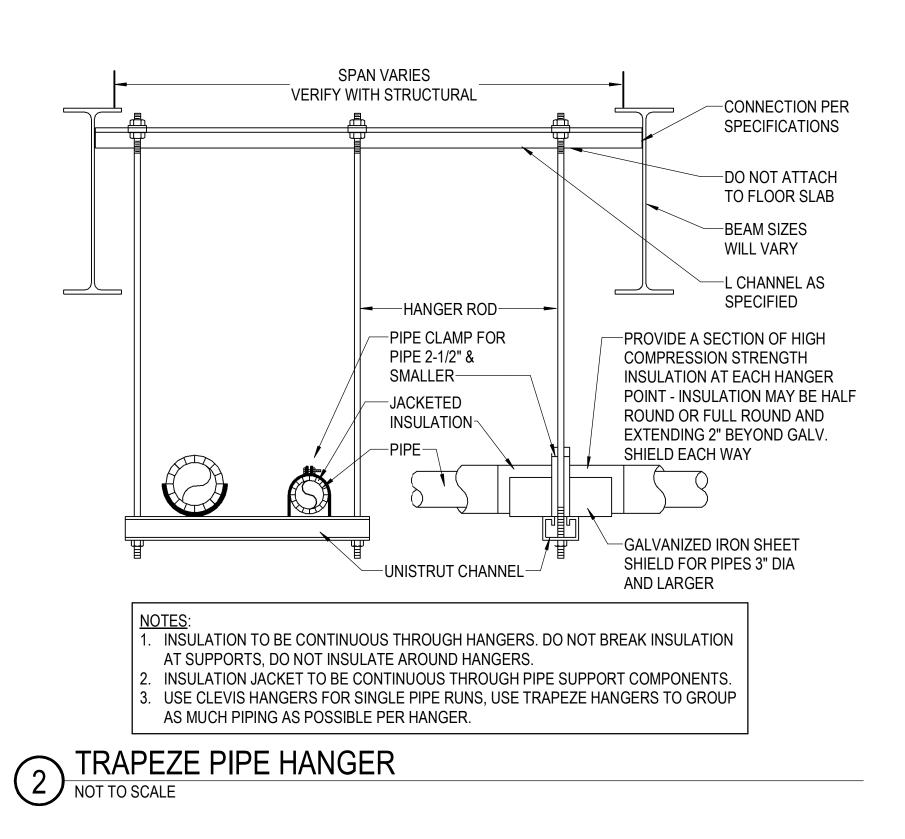

NOTE: SEE SPECIFICATIONS FOR MATERIALS

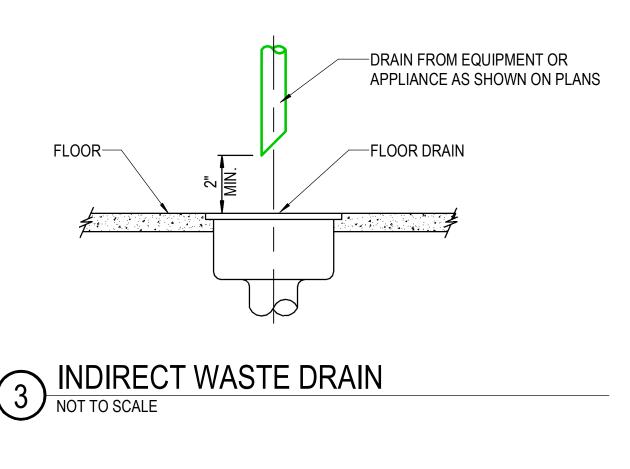


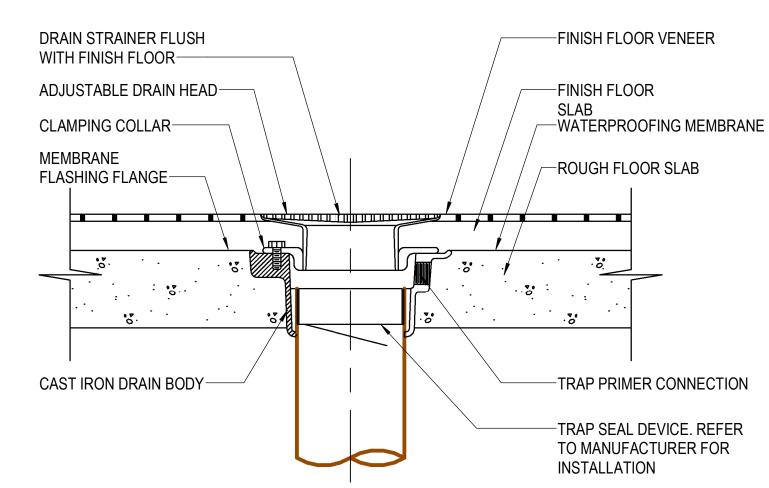

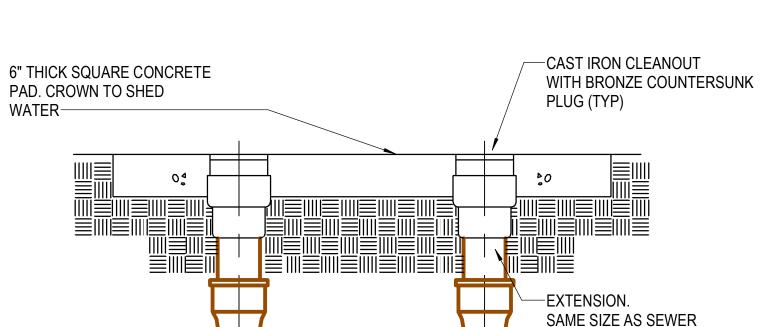


TRAP SEAL DEVICE INSTALLATION

NOT TO SCALE

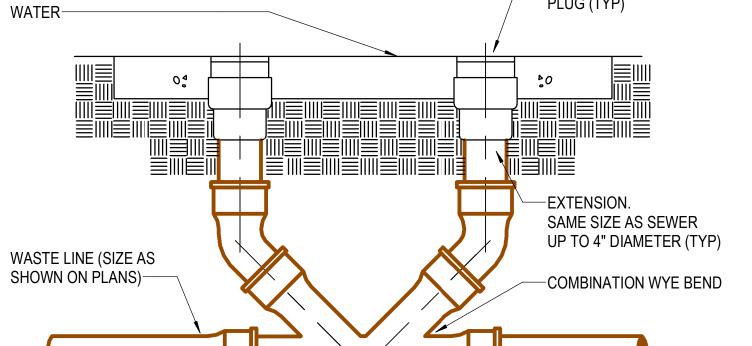



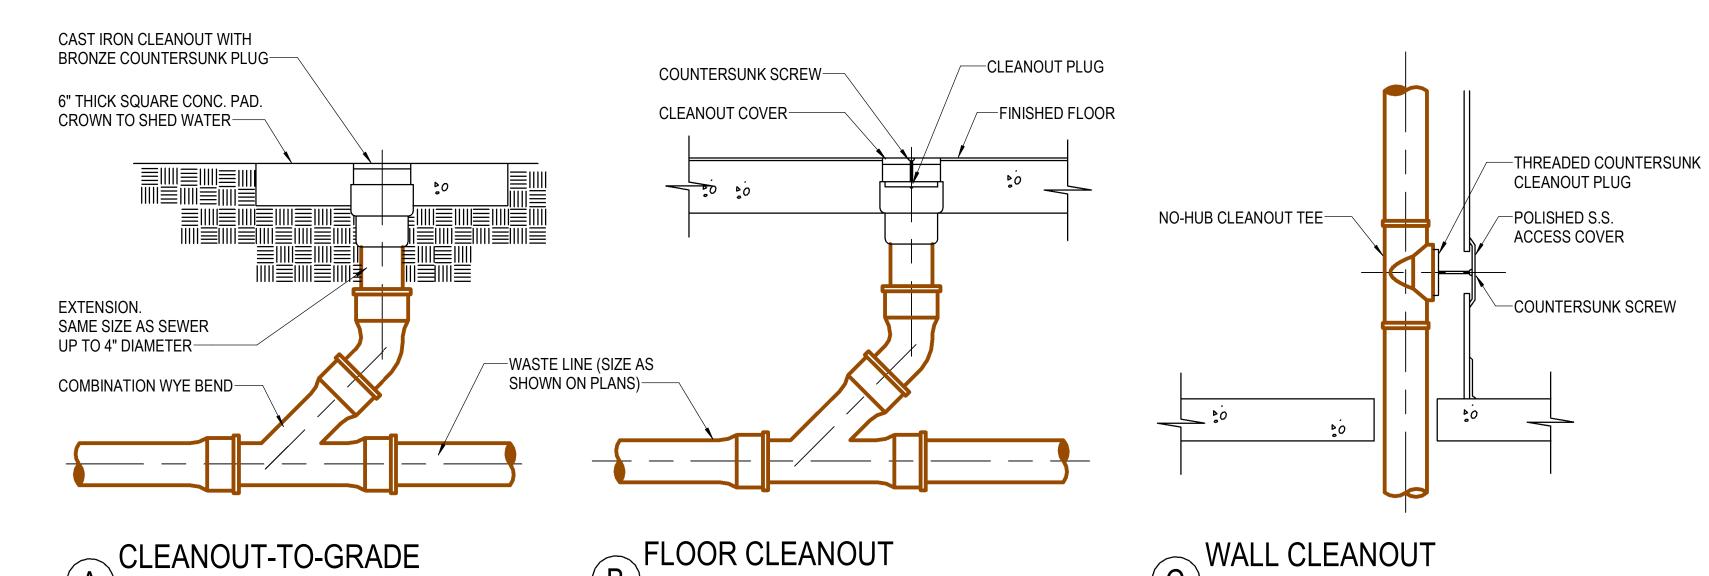


NOTE: SEE SPECIFICATIONS FOR MATERIALS

NOTE: SEE SPECIFICATIONS FOR MATERIALS

TYPICAL CLEANOUTS

NOTE: SEE SPECIFICATIONS FOR MATERIALS

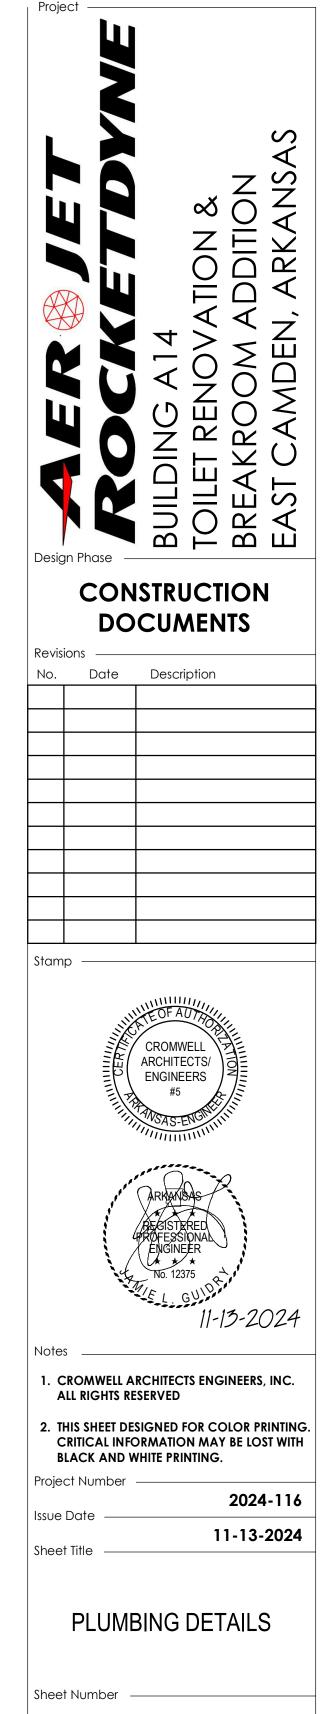

C R O M W E L L

1300 East 6th Street Little Rock, AR 72202 501.372.2900 cromwell.com