


NOTE:

1. PROVIDE MODIFICATIONS TO THE EXISTING FIRE SUPPRESSION SYSTEM FOR RENOVATIONS AND ADDITION AS INDICATED. REFER TO ARCHITECTURAL DRAWINGS FOR COMPLETE DETAILS OF ALL AREAS TO BE RENOVATED. ALL MODIFICATIONS TO THE EXISTING FIRE SUPPRESSION SYSTEM SHALL BE IN ACCORDANCE WITH 2019 NFPA 13, FM GLOBAL REQUIREMENTS, AND LOCAL AHJ REQUIREMENTS.
2. THIS IS A FULLY SPRINKLERED BUILDING WITH AN EXISTING WET SYSTEM AND DRY SYSTEM.
3. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING FIRE PROTECTION CONDITIONS PRIOR TO THE DEVELOPMENT OF SHOP DRAWINGS.
4. NEW ADDITION SHALL BE SUPPLIED FROM THE EXISTING WET SYSTEM.

KEYED NOTE:

- 1 MODIFY THE EXISTING AUTOMATIC FIRE SUPPRESSION SYSTEM AS NEEDED TO COMPLY WITH NFPA 13 FOR SPRINKLER HEAD LOCATIONS.

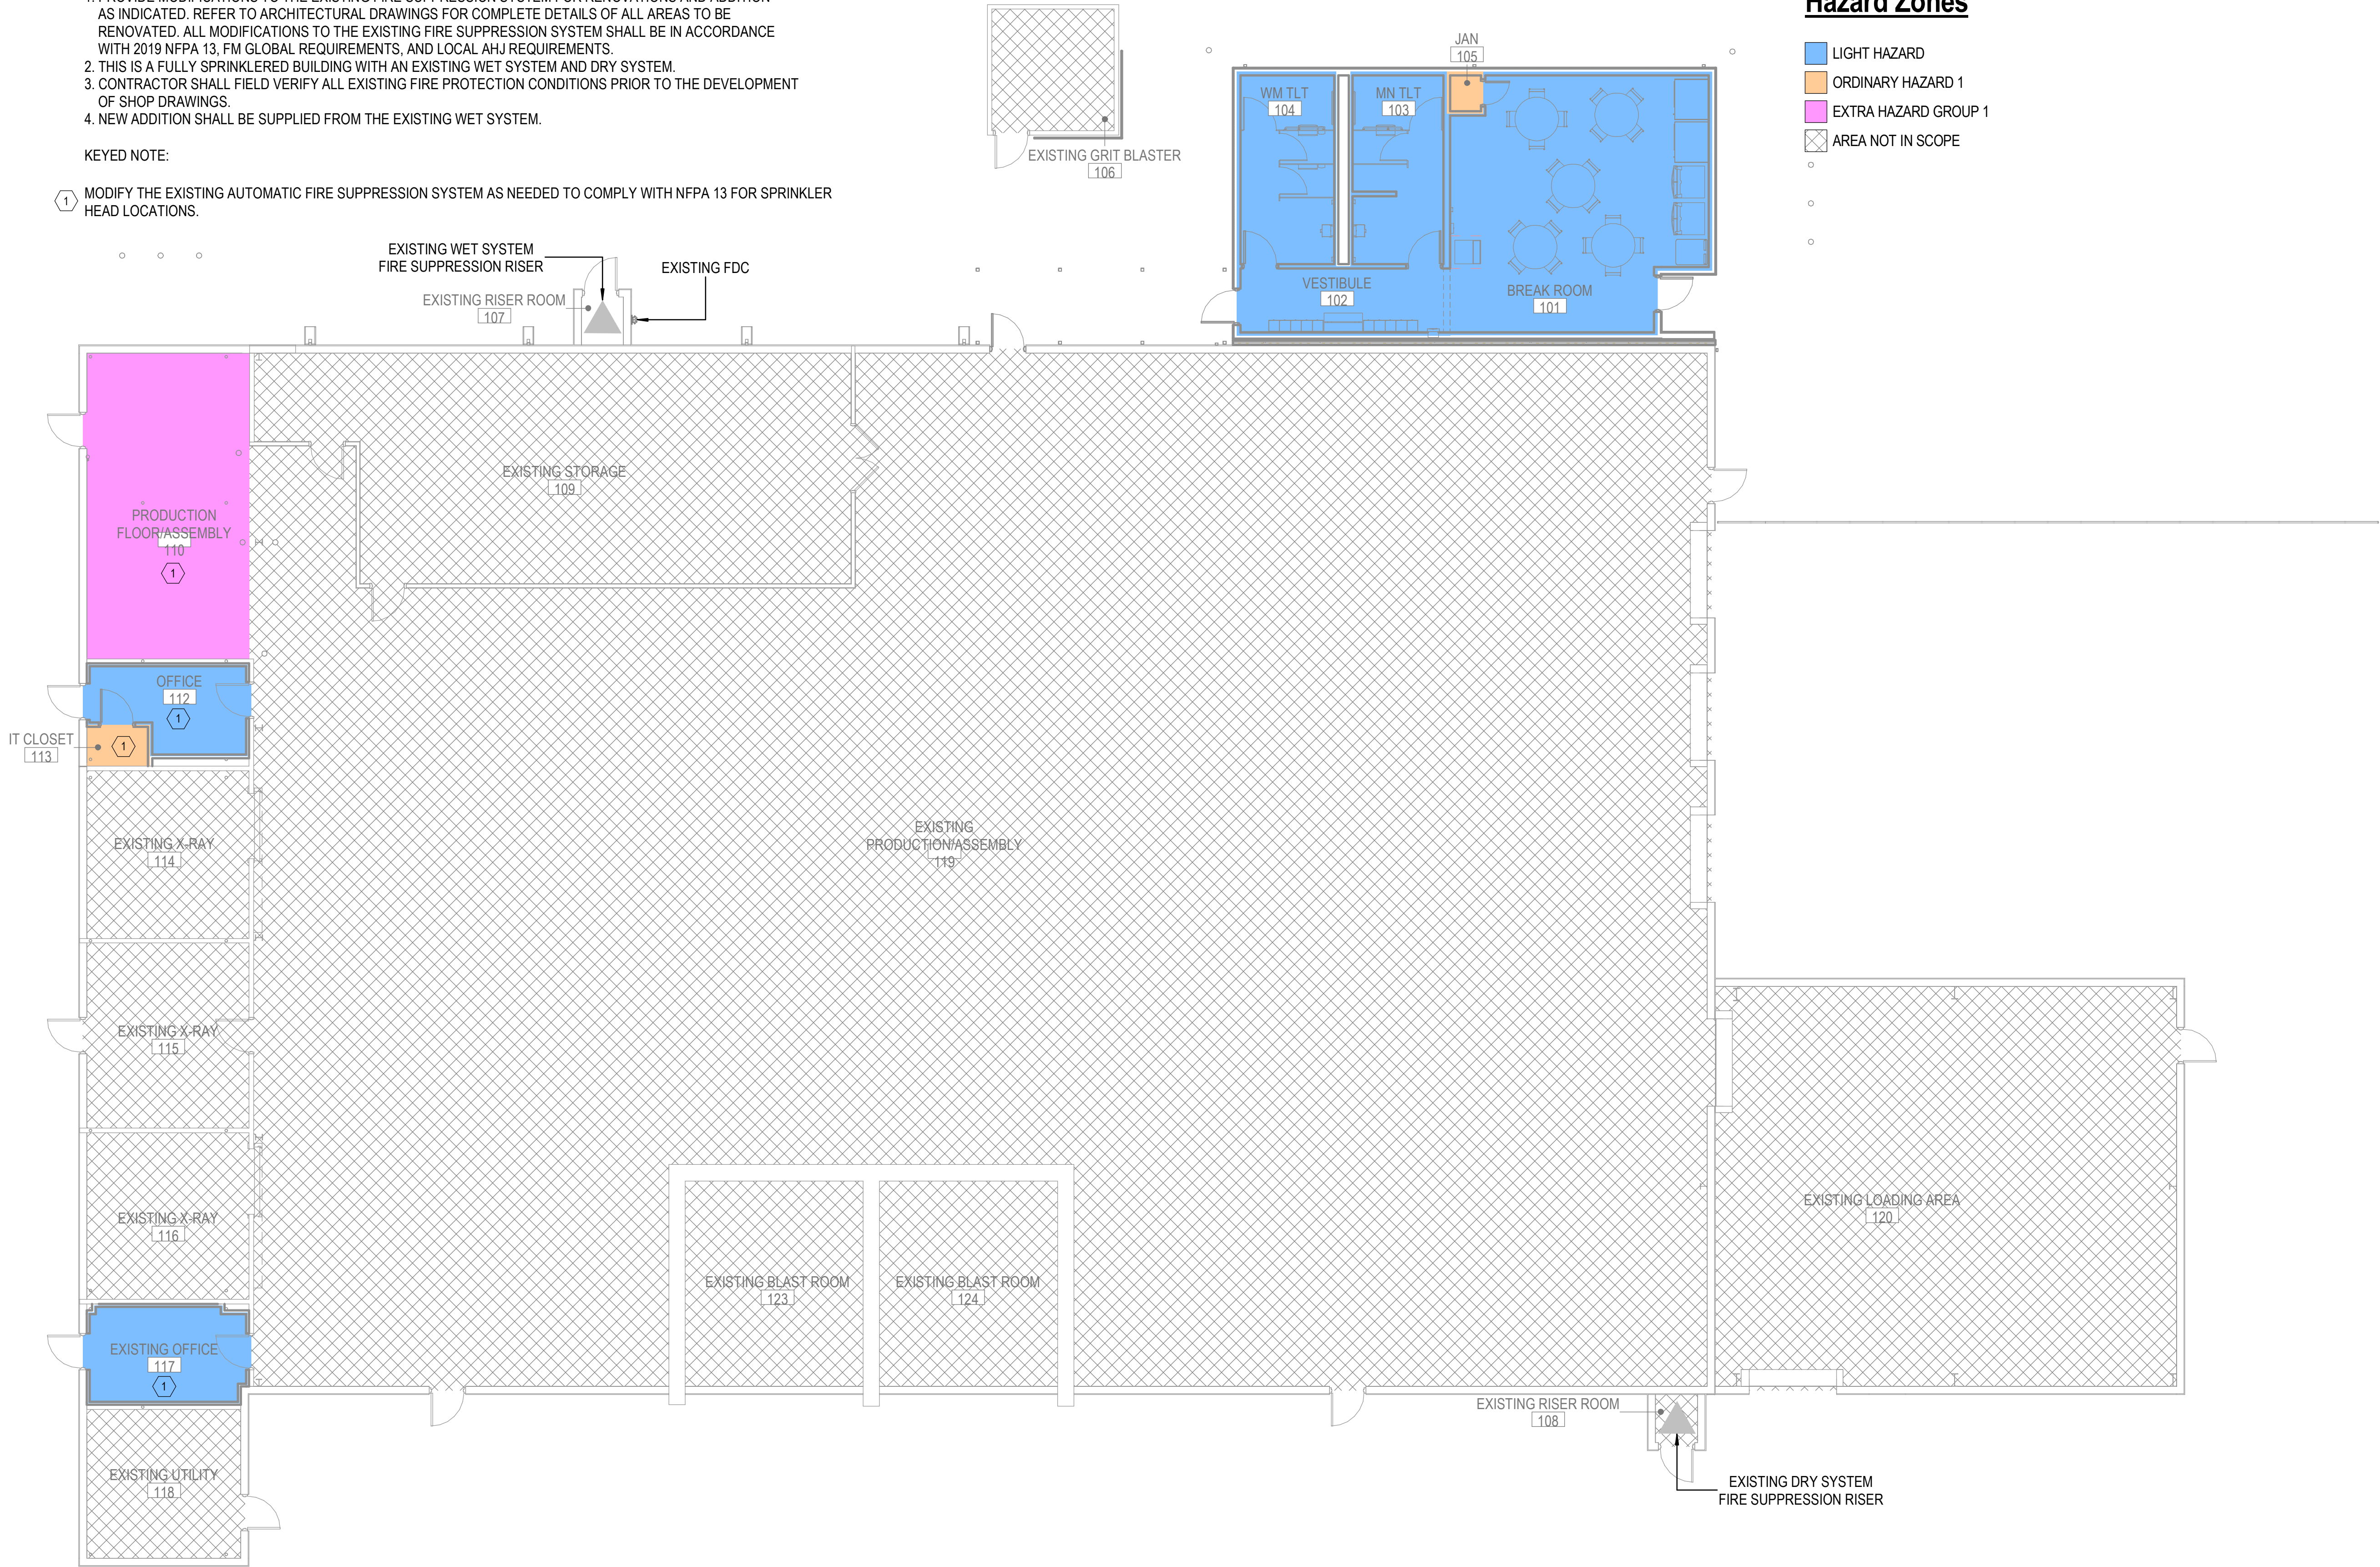

Hazard Zones

- LIGHT HAZARD
- ORDINARY HAZARD 1
- EXTRA HAZARD GROUP 1
- AREA NOT IN SCOPE

Project

AEROJET BUILDING E33
OFFICE EXPANSION
EAST CAMDEN,
ARKANSAS



Design Phase

CONSTRUCTION
DOCUMENTS

Revisions

| No. | Date | Description |
|-----|------|-------------|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

Stamp



12-19-2024

Notes

1. CROMWELL ARCHITECTS ENGINEERS, INC.
ALL RIGHTS RESERVED

2. THIS SHEET DESIGNED FOR COLOR PRINTING.
CRITICAL INFORMATION MAY BE LOST WITH
BLACK AND WHITE PRINTING.

Project Number

2024-134

Issue Date

12-19-2024

Sheet Title

FIRE PROTECTION
FLOOR PLAN

Sheet Number

FX101