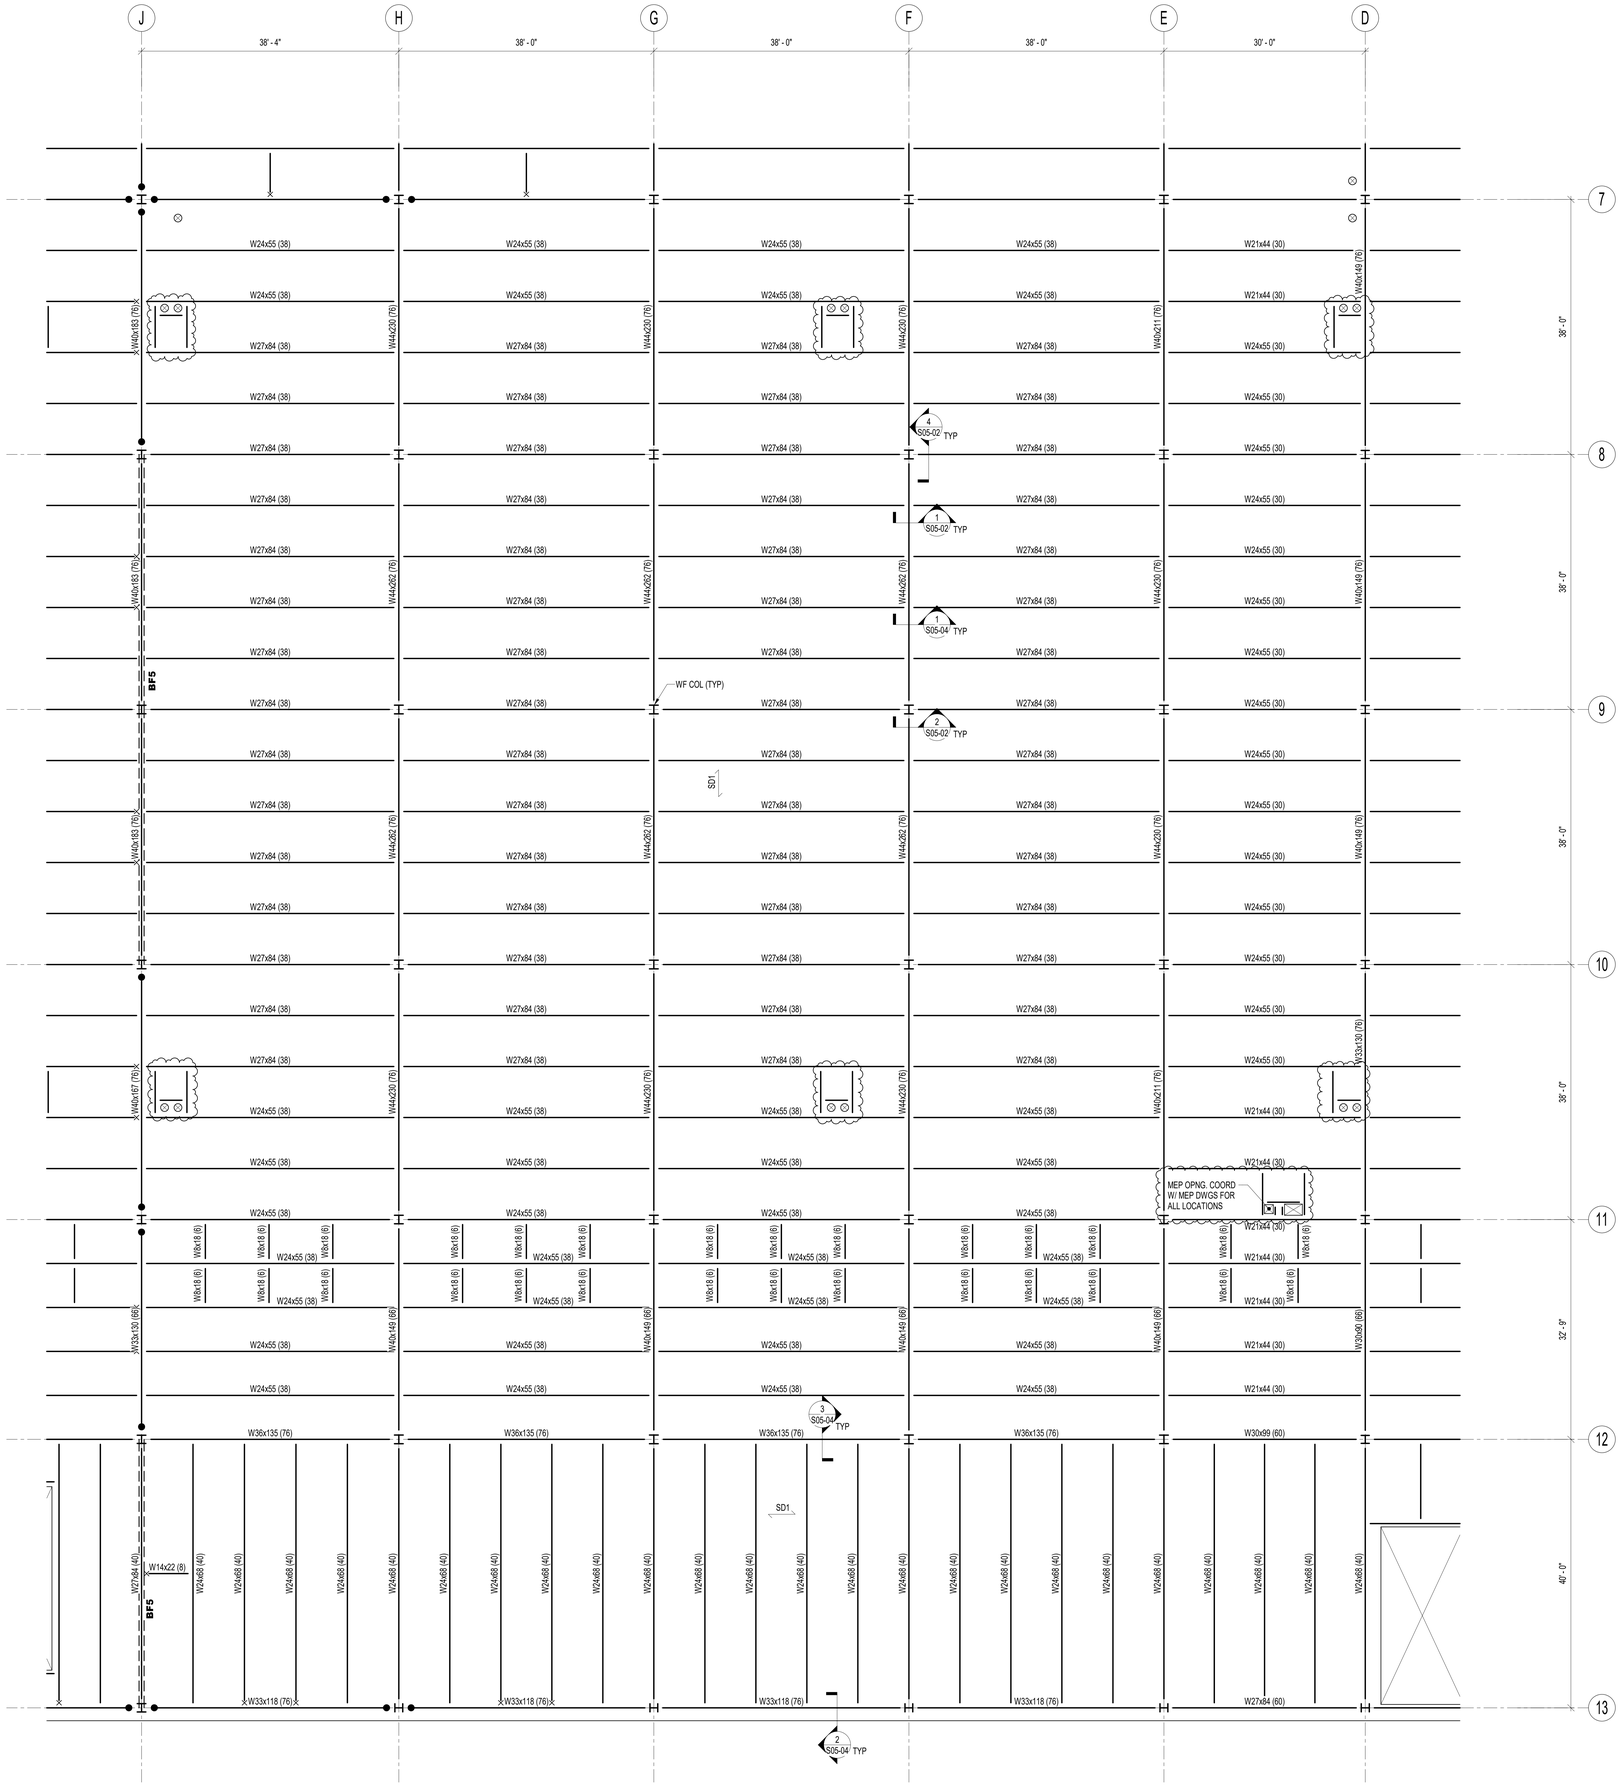

1 LEVEL 02 FRAMING PLAN - SECTOR D
SCALE: 1/8" = 1'-0"

SHEET NOTES:

1. T/SLAB EL = 24'-0", UNO
2. T/STEEL EL = B/DECK EL, UNO
3. SD1 - INDICATES 3", 18 GA COMPOSITE METAL DECK W/ 4 1/2" NORMAL WEIGHT CONCRETE TOPPING (7 1/2" TOTAL THICKNESS) WITH 4.0 LBS/CU YARD MACROSYNTHETIC FIBER REINFORCEMENT.
4. RD1 - INDICATES 1 1/2", 18 GA METAL ROOF DECK
5. CONCRETE SLAB-ON-METAL DECK SHALL BE POURED "FLAT" WITH MAXIMUM OVERPOUR OF 1".
6. WHERE NO HEADED SHEAR STUD QUANTITIES ARE INDICATED, PROVIDE 3/4" DIA HEADED SHEAR STUDS AT 12" OC ALONG LENGTH OF THE BEAM.
7. PROVIDE ELEVATOR GUIDE RAIL SUPPORT POSTS, DIVIDER BEAMS, AND HOIST BEAM IN ELEVATOR SHAFTS. COORDINATE WITH ELEVATOR CONTRACTOR.
8. CONTRACTOR TO COORDINATE ALL MEP/FP OPENING DIMENSIONS WITH MEP/FP DRAWINGS AND CONTRACTOR.
9. SEE S05-01 FOR STEEL COLUMN SCHEDULE AND DETAILS.
10. SEE S05-02 FOR STEEL CONNECTION DETAILS.
11. SEE S05-03 FOR STEEL BRACED FRAME DETAILS.
12. SEE S05-04 FOR SLAB AND SLAB EDGE DETAILS.

serverfarm
CORGAN
TGRWA STRUCTURAL ENGINEERS
kW Mission Critical Engineering Member of WSP
EP ENGINEERING PLUS
Kimley»Horn

ISSUES

1		
2		
3	12/17/2025	STEEL MILL ORDER
4	01/23/2026	DESIGN DEVELOPMENT
5		
6		
7		
8		
9		
10		
11		
12		
13		

REVISIONS

NOT FOR CONSTRUCTION

This document is incomplete and may not be used for regulatory approval, permit or construction.
Date of issue:
01/23/2026

SF - ARK01
DESIGN DEVELOPMENT
CLARKSVILLE, AR 72830

L	K	J	
G	E	C	A
H	F	D	B
P	N	M	

NORTH

LEVEL 02
FRAMING PLAN - SECTOR D

JOB 25131
SHEET
S02-02D

SCALE 1/8"=1'-0"
8 0 8 16
FEET

1/22/2026 4:21:06 PM S02-02D LEVEL 02 FRAMING PLAN - SECTOR D