


- GENERAL NOTES**
- COORDINATE EXACT ROUTING AND BURIAL DEPTH OF CONDUIT TO AVOID CONFLICTS WITH OTHER UTILITIES.
 - EXISTING UNDERGROUND UTILITIES SHALL BE LOCATED PRIOR TO ANY EXCAVATION WORK TAKING PLACE. PERFORM CAREFUL EXCAVATION IN AREAS IN CLOSE PROXIMITY TO EXISTING BURIED UTILITIES.
 - SITE LIGHTING SHALL BE CONTROLLED VIA LIGHTING CONTROL PANEL. LIGHTING CONTROL PANEL SHALL HAVE THE FOLLOWING CHARACTERISTICS:
 - UL LISTED MODULAR RELAY PANEL.
 - INTEGRAL TIME CLOCK AND MASTER CONTROLLER.
 - NETWORK CONNECTION BETWEEN PANEL AND CONTROL DEVICES.
 - LOW VOLTAGE PHOTOCELL INPUT FOR DUSK TO DAWN OPERATION AND PROGRAMMABLE SCHEDULES FOR EACH INDIVIDUAL RELAY.
 - REFER TO E04-50 FOR LUMINAIRE SCHEDULE.
 - EXTERNAL LIGHTING SHALL BE LOCATED AND DESIGNED TO PREVENT RAYS FROM BEING DIRECTED OFF THE PROPERTY UPON WHICH THE LIGHTING IS LOCATED.
 - COORDINATE EXACT SITE LIGHTING PLACEMENT AND ORIENTATION WITH ARCHITECT PRIOR TO ALL WORK.
 - WHERE A BOXED CIRCUIT DESIGNATION IS SHOWN IN A SPACE, THE INDICATED CIRCUIT DESIGNATION SHALL APPLY TO ALL FIXTURES IN THE SAME SPACE UNLESS OTHERWISE NOTED.
 - REFER TO E00-51 FOR SITE LIGHTING BOLLARD BASE DETAIL AND SITE LIGHTING POLE BASE DETAIL.

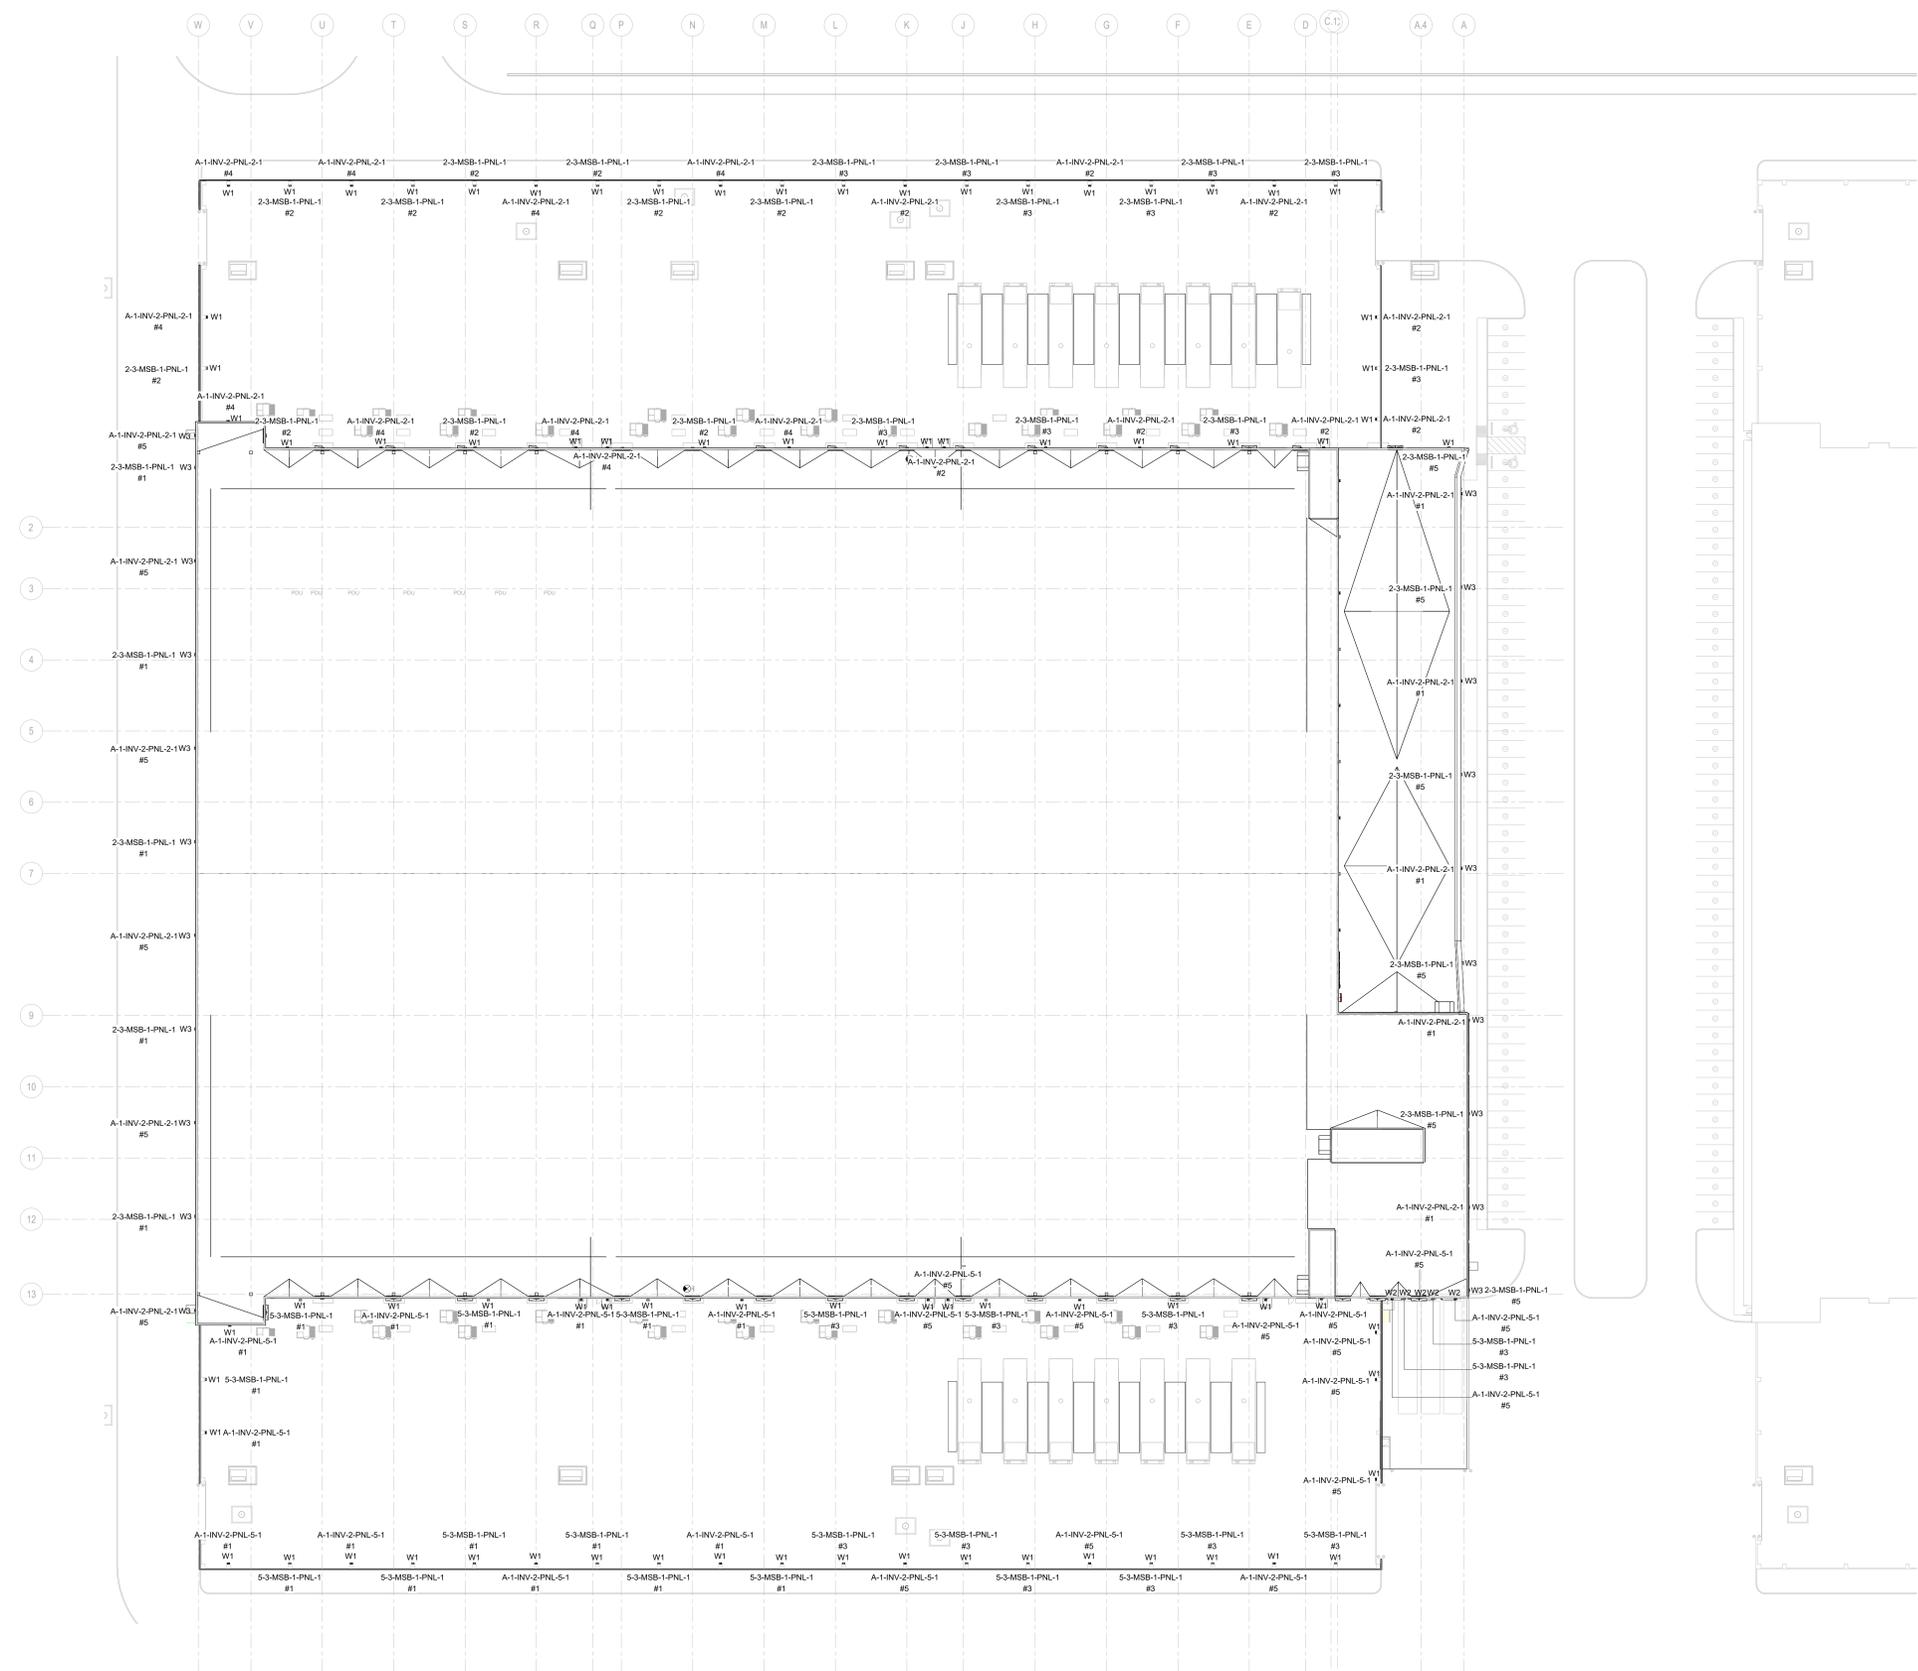

ISSUES

1	11/12/2025	CONCEPTUAL DESIGN
2	12/12/2025	SCHEMATIC DESIGN
3	12/17/2025	STEEL MILL ORDER
4	1/23/2026	DESIGN DEVELOPMENT

REVISIONS

kw Mission Critical Engineering
 Contact: David Adams Phone: 703.928.0715
 Engineer: Matthew Fagert
 License #: 123456 Exp. Date: 00/00/0000

NOT FOR CONSTRUCTION

Date: 00/00/0000

SERVERFARM
 Clarksville, AR

SITE LIGHTING PLAN

JOB SHEET US0049903.5614

1 SITE LIGHTING PLAN
 1/32" = 1'-0"