

- GENERAL NOTES**
- REFER TO E00-01 FOR LINE TYPE LEGEND.
  - REFER TO THE E00-03 SERIES DRAWINGS FOR EQUIPMENT LOCATIONS.
  - CIRCUIT BREAKERS ARE 3P, 100% RATED WITH LSI TRIP UNITS UNLESS NOTED OTHERWISE.
  - EQUIPMENT IN PRE-PURCHASE MATRIX IS FURNISHED BY THE OWNER AND INSTALLED BY THE CONTRACTOR. MATERIALS (CABLE, RACEWAY, ETC.) REQUIRED FOR INSTALLATION AND CONNECTION OF PRE-PURCHASED EQUIPMENT IS BY CONTRACTOR UNLESS OTHERWISE NOTED. ANY EQUIPMENT NOT IN THE MATRIX AND NOT SPECIFICALLY CALLED OUT AS BEING OWNER FURNISHED SHALL BE FURNISHED AND INSTALLED COMPLETE BY THE CONTRACTOR.
  - THE ROUTING OF THIS CABLE SHALL BE NEAT AND A PLAN SHALL BE PRESENTED TO THE OWNER AND ENGINEER DETAILING PROPOSED ROUTING FOR APPROVAL PRIOR TO BEGINNING THIS WORK.
  - ENGINEER SHALL PROVIDE ELECTRICAL CONTRACTOR A SPREADSHEET PRIOR TO COMMISSIONING WITH A LIST OF ALL THE CIRCUIT BREAKER TYPES AND PLUGS USED TO CONSTRUCT THE MODEL. FOR THE COORDINATION STUDY. ELECTRICAL CONTRACTOR SHALL TAKE SPREADSHEET INTO THE FIELD AND VERIFY EACH BREAKER IN SHEET MATCHES WHAT IS INSTALLED. PROVIDE LIST OF DISCREPANCIES, IF ANY, TO THE ENGINEER WITHIN 3 WORKING DAYS OF RECEIPT OF DOCUMENT.
  - ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR PROVIDING A COMPLETE SET OF AS-BUILT FEEDER CONFIGURATIONS AND LENGTHS TO THE ENGINEER FOR USE IN THE SHORT CIRCUIT AND ARC FLASH STUDIES. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
  - REFER TO OWNER FURNISHED EQUIPMENT SCHEDULE AND FEEDER SCHEDULES FOR ADDITIONAL INFORMATION.
  - SECONDARY TAP CONDUCTORS FOR OUTSIDE TRANSFORMERS ARE COMPLIANT WITH NEC 240.21(C) (2), INSTALLED IN ACCORDANCE WITH 230.6
  - ALL POWER AND GROUNDING CONNECTIONS SHALL USE NEMA 2-HOLE, LONG-BARREL COMPRESSION TYPE CONNECTIONS WITH NO OX COMPOUND, UNLESS OTHERWISE INDICATED. MARK LUG AND BUS WITH PERMANENT MARKS AFTER INSTALLATION AND VERIFICATION OF PROPER TORQUE TO INDICATE CORRECT BOLT TORQUE LOCATION. BOLTS, FLAT WASHERS, AND BELLEVILLE WASHERS SHALL BE GRADE 5 WITH A MINIMUM OF THREE (3) THREADS SHOWING AFTER TORQUES IS COMPLETE. SEE DETAILS FOR GROUNDING TERMINATIONS AND POWER TERMINATIONS.
  - ALL CONTROL WIRING TERMINATIONS SHALL USE RING TYPE OR WAGO COMPRESSION CONNECTORS. ALL WIRING SHALL BE LABELED.
  - PROVIDE GLAND TYPE CONNECTORS FOR ALL BATTERY CABLES PUNCHING DOWN ON THE TOP OF UPS MODULES AND BATTERY CABINETS.
  - RESTRAIN ALL FEEDERS 800A AND ABOVE TO PREVENT CABLE MOVEMENT DURING EXTERNAL FAULT CONDITIONS AT ALL SWITCHBOARDS, UPS, BATTERY CABINETS AND CABLE TRAYS WITH BATTERY CABLES. PROVIDE AS RECOMMENDED BY MANUFACTURER FOR THE AVAILABLE FAULT CURRENT. TYPICALLY, PROVIDE THE FOLLOWING:
    - WRAP LINE CABLES TOGETHER AT 6" AND 12" FROM TERMINALS WITH 5 WRAPS OF 3/8" NYLON ROPE OR EQUIVALENT (TENSILE STRENGTH OF 2000LBS)
    - SUPPORT THE REMAINDER OF THE CABLE WITH FIVE WRAPS EVERY 6" OR ONE WRAP EVERY 1'
  - COORDINATION STUDY TO BE COMPLETED ONCE FINAL EQUIPMENT SUBMITTALS HAVE BEEN RECEIVED AND DEVICES VERIFIED ON SITE. CONTRACTOR TO PROVIDE FINAL FEEDER LENGTHS TO ENGINEER FOR COORDINATION STUDY AND ARC FLASH ANALYSIS.

**ISSUES**

1	11/12/2025	CONCEPTUAL DESIGN
2	12/12/2025	SCHEMATIC DESIGN
3	12/17/2025	STEEL MILL ORDER
4	1/23/2026	DESIGN DEVELOPMENT

**REVISIONS**


kW Mission Critical Engineering  
 Contact: David Adams Phone: 703.928.0715  
 Engineer: Matthew Fagert  
 License #: 123456 Exp. Date: 00/00/0000

**NOT FOR CONSTRUCTION**


Date: 00/00/0000

**SERVERFARM**  
 Clarksville, AR

**RESERVE POWER BLOCK ONE-LINE DIAGRAM 3/9**

**JOB SHEET** US0049903.5614

**E01-39R**

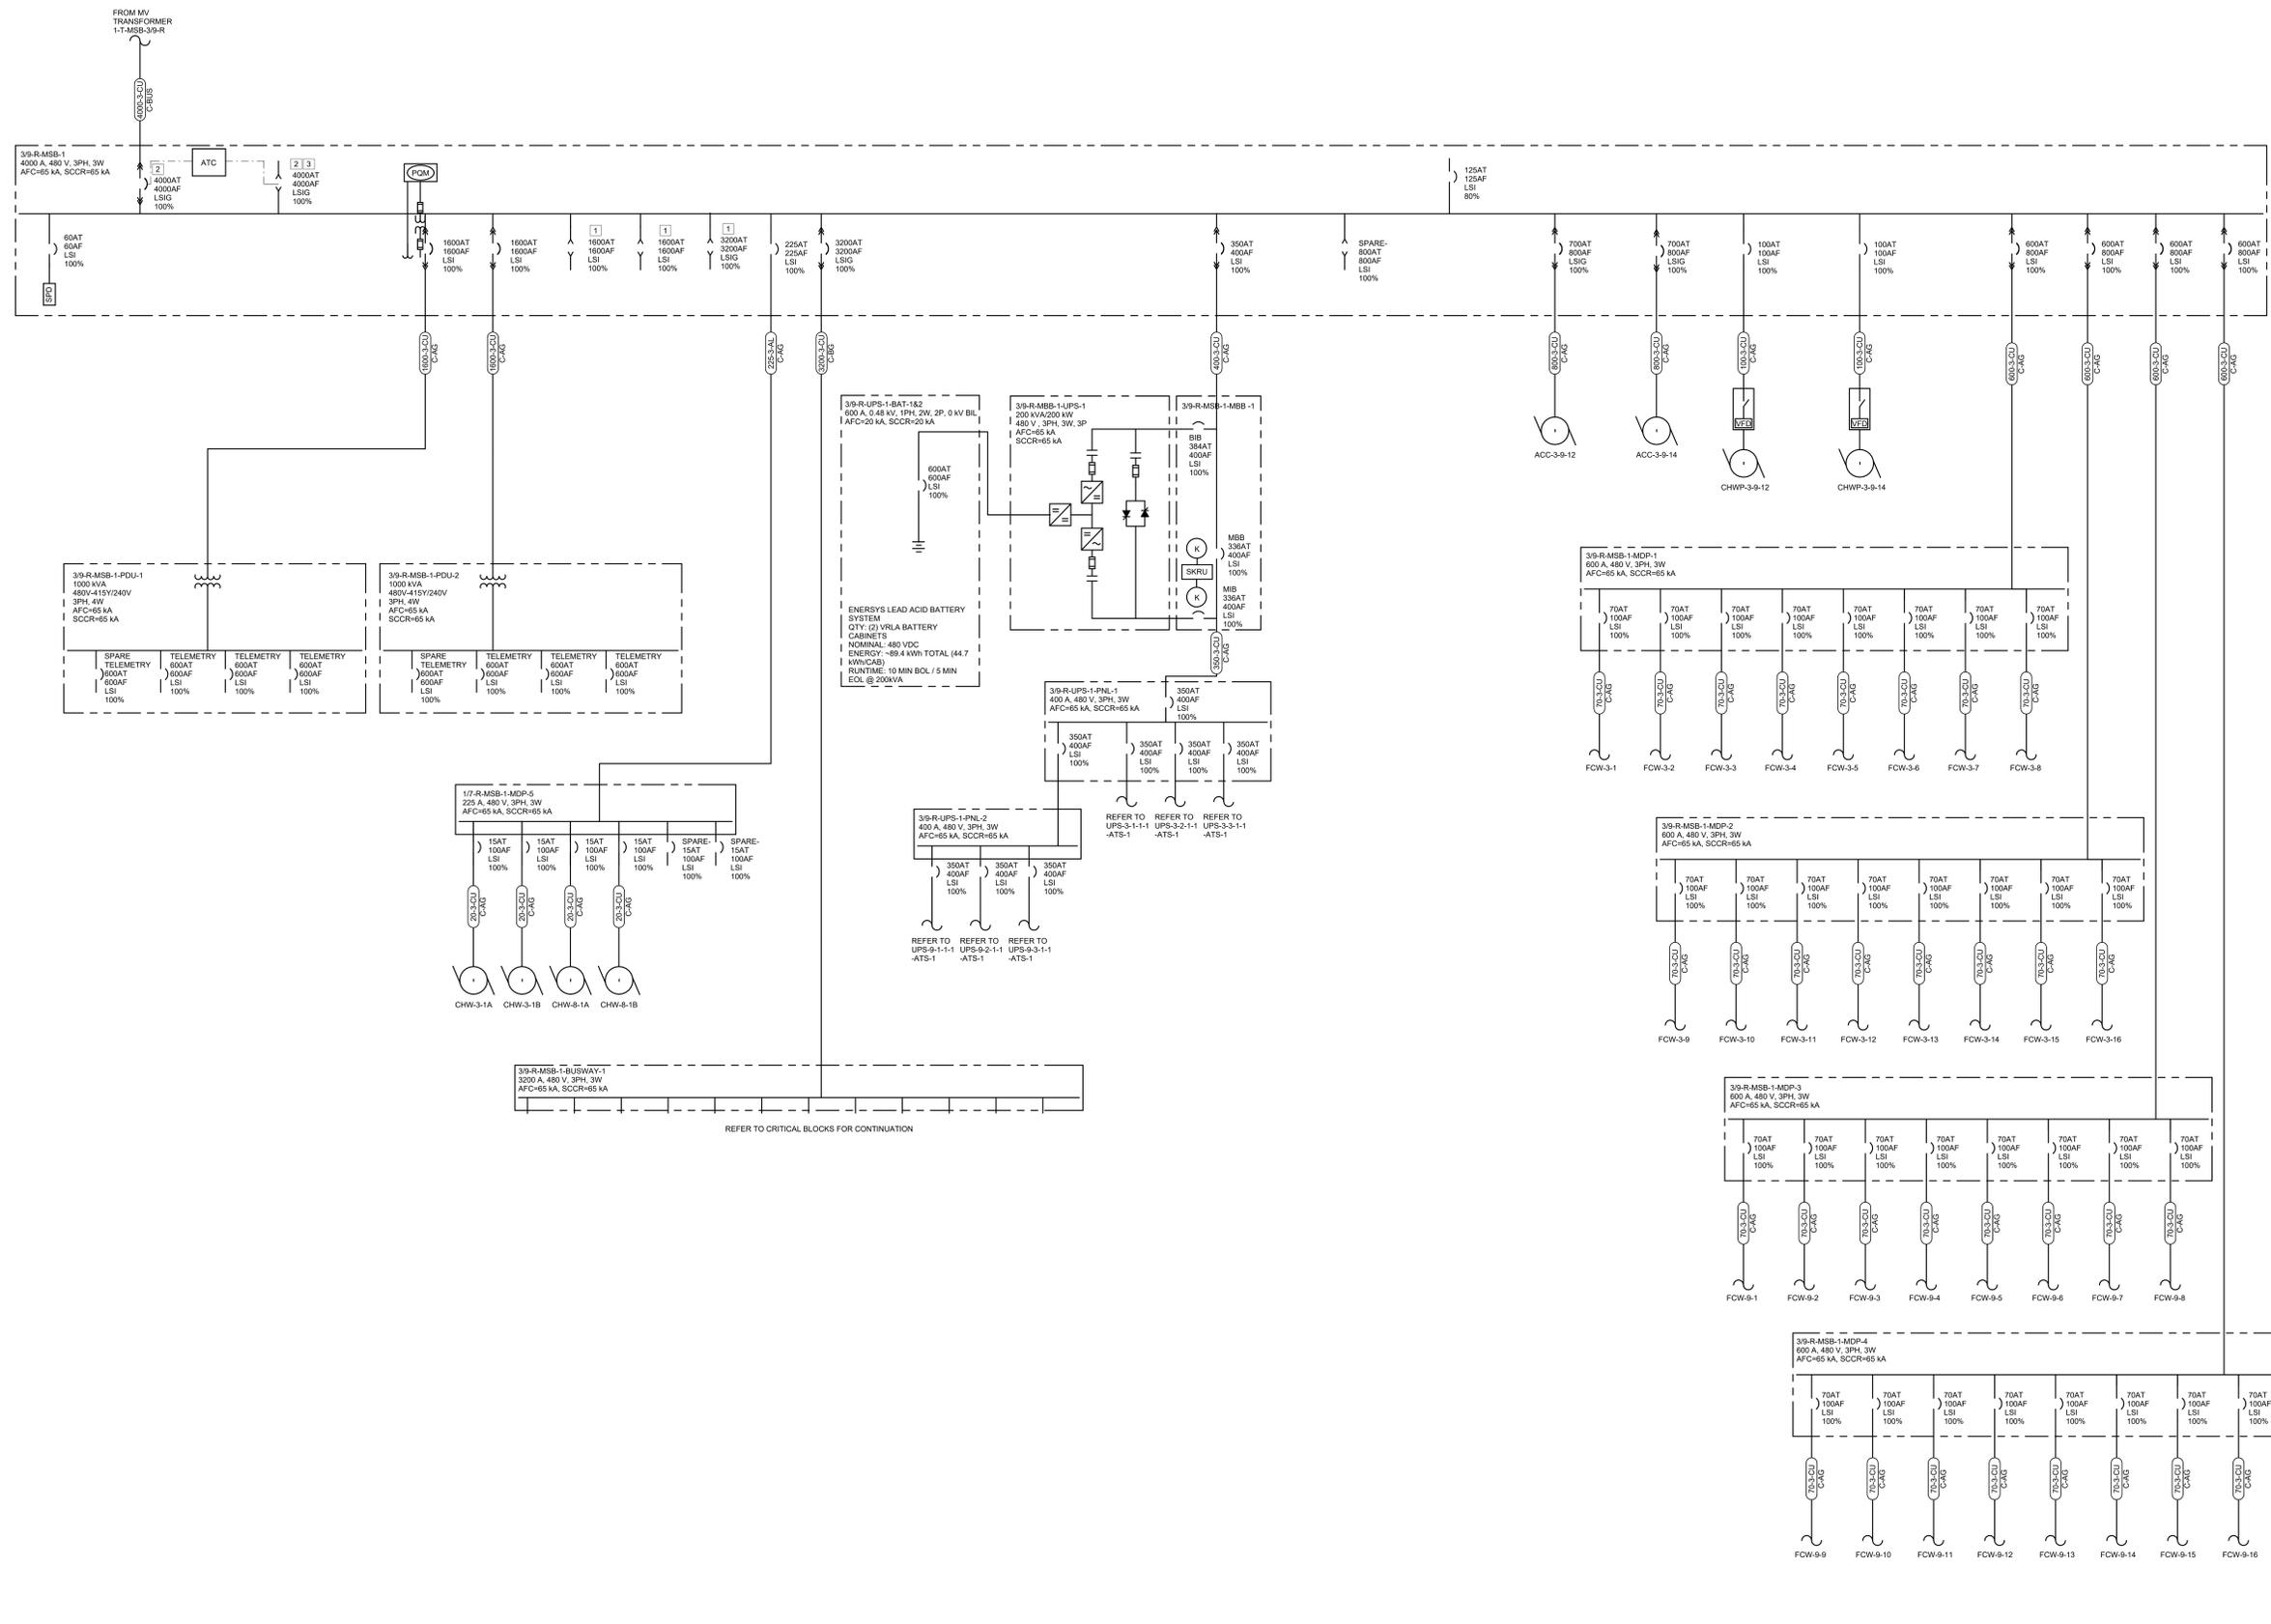

- KEYED NOTES**
- FUTURE PROVISION FOR MBB BREAKER
  - BREAKER TOP OR BOTTOM FED
  - PREPARED SPACE ON ALL BLOCKS. ONLY PROVIDE BREAKER ON BLOCKS FOR DATAHALLS 1.4.7 AND 10

- FEEDER NAMING SCHEME**
- INDICATES CONDUCTOR MATERIAL OR WIRE  
 INDICATES 3 OR 4 WIRE  
 INDICATES AMPACITY  
 INDICATES CONDUCTOR VOLTAGE CLASS/USAGE
- MATERIAL LEGEND:**  
 AL ALUMINUM  
 CU COPPER
- CONVEYANCE LEGEND:**  
 C-AG ABOVE GRADE CONDUIT  
 C-BG BELOW GRADE CONDUIT  
 C-BUS CABLEBUS  
 T-AC TRAY  
 T-CT CABLE TRAY WIRE IN TRAY
- CLASSUSAGE LEGEND:**  
 [BLANK] 600V, TYP. LV DISTRIBUTION  
 T 600V FOR LV XFMR  
 G 600V FOR LV GENERATOR  
 MV 35KV, MV DISTRIBUTION