

- GENERAL NOTES - PIPING**
- FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M00-00.
 - FOR PROJECT DESIGN CRITERIA SEE DRAWING M00-01.
 - PROVIDE LEAK DETECTION CABLE AROUND CRAH UNITS AND FAN WALLS.
 - VALVE INDICATORS SHALL BE INSTALLED IN SUCH A MANNER AS TO ALLOW UNOBSTRUCTED OBSERVATION FROM MAINTENANCE AREA.
 - ALL ESS INSTALLED WITHIN DATA HALL SPACES SHALL CONTAIN LESS THAN 20 kWh OF LITHIUM-ION ENERGY STORAGE PER SYSTEM TO COMPLY WITH 2023 NFPA 855.

KEYNOTE LEGEND

ISSUES

NO.	DATE	DESCRIPTION
4	1.23.2026	DESIGN DEVELOPMENT

REVISIONS

NO.	DATE	DESCRIPTION
-----	------	-------------

KW Mission Critical Engineering
 Contact: K. DREWNOWSKI Phone: 601.451.2099
 Engineer: K. COOPER License #: 23615 Exp. Date: 00/00/0000

NOT FOR CONSTRUCTION

Date: 12/12/2025


SERVERFARM
 Clarksville, AR

L	K	J
G	E	C
H	F	D
P	N	M

LEVEL 1 - MECHANICAL PIPING PLAN - SEGMENT A

JOB US0049903.5614
SHEET

M03-01A

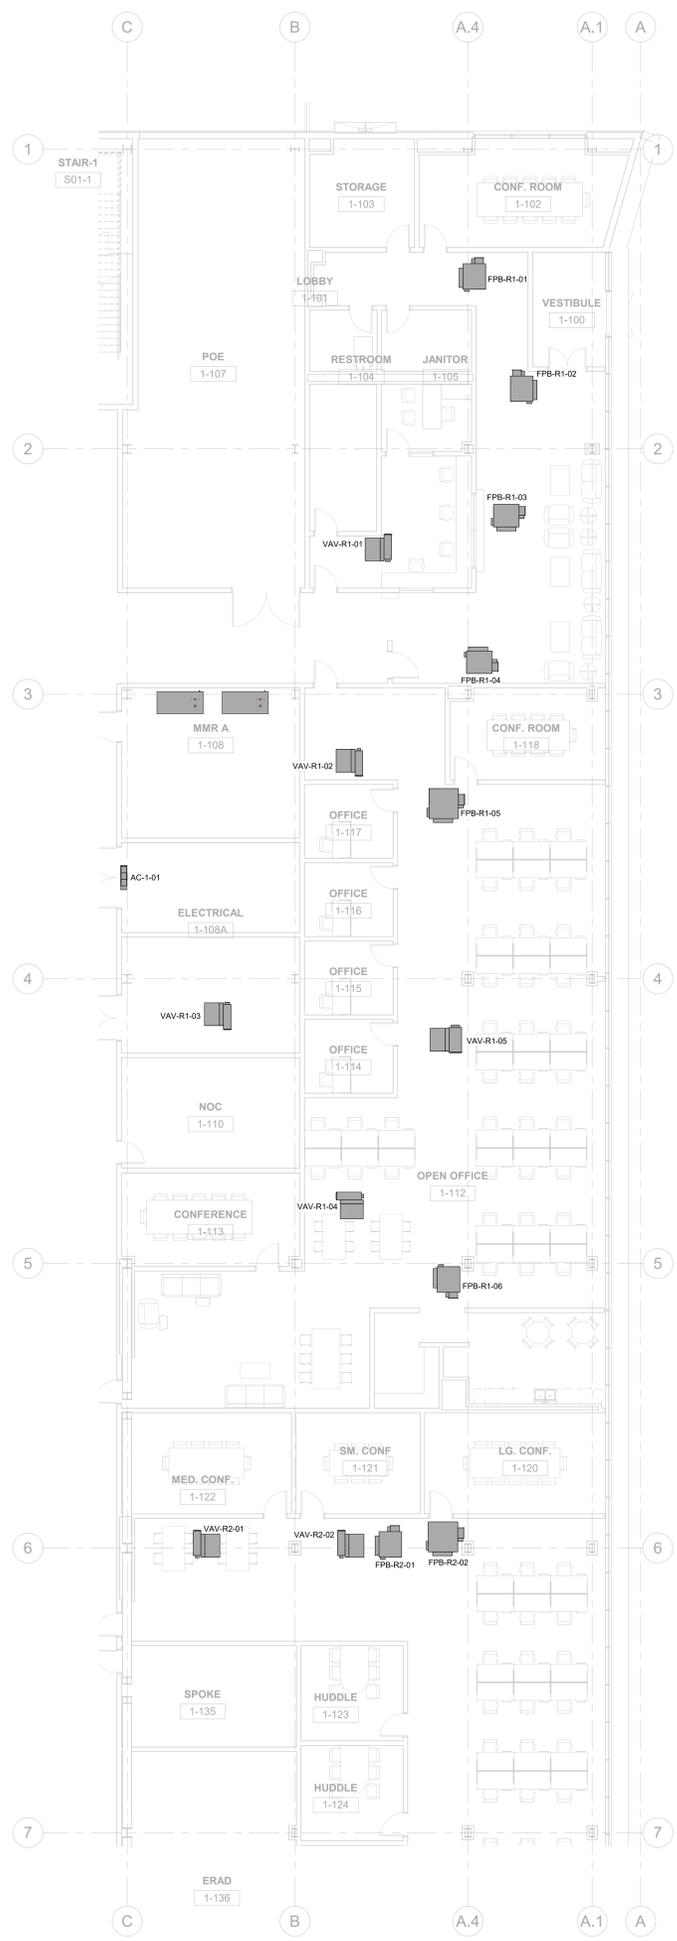

LEVEL 1 - MECHANICAL PIPING PLAN - SEGMENT A
 1/8" = 1'-0"